

REPUBLIC OF THE PHILIPPINES NATIONAL POWER CORPORATION

(Pambansang Korporasyon sa Elektrisidad)

TERMS OF REFERENCE

Name of Project

: SUPPLY AND DELIVERY OF RENEWABLE

ENERGY FOR THE HYBRIDIZATION OF DIESEL

POWER PLANTS UNDER SCHEDULE III

CLUSTER 4A-PALAWAN

PR No.

: HO-PMD25-003

Contents:

Section I

- Invitation to Bid

Section II

- Instructions to Bidders

Section III

- Bid Data Sheet

Section IV

- General Conditions of Contract

Section V

Special Conditions of Contract

Section VI

Schedule of Requirements

Section VII

- Technical Specifications

Part I – Technical Specifications

Part II - Technical Data Sheets

Section VIII

Bidding Forms

Section IX

- Appendices



National Power Corporation NEGOTIATED PROCUREMENT NP 2025-0004

 The NATIONAL POWER CORPORATION (NPC), through its approved Corporate Budget of CY 2025 intends to apply the sum of (<u>Please see schedule below</u>) being the Approved Budget for the Contract (ABC) to payments under the contract. Bids received in excess of the ABC shall be automatically rejected at Bid opening.

PR Nos./PB Ref No. & Description	Pre-Nego Conference	Bid Submission / Opening	ABC
HO-PMD25-001 /			
FB250812-HB00219			
Supply and Delivery of Renewable Energy for			9 900,000,000.00
the Hybridization of Diesel Power Plants under			E.M. B.
Schedule I (Cluster 1A - Batanes) HO-PMD25-002 /			
FB250812-HB00222	- An		- 1 T
	n in an		**************************************
Supply and Delivery of Renewable Energy for		1 140	P 820,000,000.00
the Hybridization of Diesel Power Plants under			1918
Schedule II (Cluster 5A - Bicol) HO-PMD25-003 /	24 June 2025	07 August 2025	
FB250812-HB00223	9:30 AM	9:30 AM	
1 52000 12:11500220			
Supply and Delivery of Renewable Energy for			₱ 960,000,000.00
the Hybridization of Diesel Power Plants under			PAL TOTAL CONTRACTOR
Schedule III (Cluster 4A - Palawan)			Lorenza de la
HO-PMD25-004 / FB250812-HB00224			India da, on balida as-il-as
1 02000 12-1 1000224	14 14 4		
Supply and Delivery of Renewable Energy for			₱ 740,000,000.00
the Hybridization of Diesel Power Plants under			
Schedule IV (Cluster 10 - Tawi-Tawi)	1 1 1 1 1 1 1 1 1 1		# H H H

Contracts similar to the Project shall comply with at least 50% of the ABC either through any of the following:

- 1. Completed PSA/ PPA with contract amount of at least 50% of the ABC
- 2. Completed Construction of Any Power Plant (with ongoing PSA/ PPA) with contract amount of at least 50% of the ABC
- Combination of two (2) similar contracts with an aggregate contract amount of at least 50% of the ABC as follows:
 - 3.1. One (1) completed PSA/ PPA or Completed Construction of Any Power Plant Contract (with ongoing PSA/ PPA) with an amount of at least 25% of the ABC; and
 - 3.2. One (1) ongoing contract (PSA/ PPA of RE Facility only) with completed portion amounting to at least 25% of the ABC, provided that the RE facility is operationalized, and a certificate of satisfactory performance has been issued by the concerned Procuring Entity.

AFG-LOG-002,F03 Rev.No.0 Page 1 of 2 2. The NPC now invites Bids for Items listed above. Delivery of the items is required within (see table below) in the Technical Specifications in the Terms of Reference. Bidders should have completed from the date of submission and receipt of bids, a contract similar to the Project., must be at least equivalent to an amount as stated in the Terms of Reference.

PR Nos./PB Ref Nos.	Contract Duration	Relevant Period of SLCC reckoned from the date of submission & receipt of bids
HO-PMD25-001 HO-PMD25-002 HO-PMD25-003 HO-PMD25-004	Twenty-Two (22) Years	

 Bidding will be conducted through Negotiated Procurement procedures using a non-discretionary "pass/fail" criterion as specified in the Implementing Rules and Regulations (IRR) of Republic Act (RA) 9184, otherwise known as the "Government Procurement Reform Act".

Bidding is open to all interested bidders, whether local or foreign, subject to the conditions for eligibility provided in the 2016 revised IRR of RA No. 9184 and DOE Department Circular No. 2022-11-0034 subject to compliance of securing registration with the SEC and/or any agency authorized by the laws of the Philippines within ten (10) days upon receipt of the Notice of Award.

- Interested bidders may obtain further information from BAC Secretariat at the address given below during office hours.
- A complete set of TOR will be provided to the interested Bidders from the address below. It may also be downloaded from the website of National Power Corporation http://www.napocor.gov.ph.
- 6. NPC will hold a Pre-Negotiation Conference on the date, time and venue stated above. Interested bidder/s is/are allowed to join and participate in the Pre-Negotiation Conference at the Kañao Room or virtually. However, those attending virtually shall assume the risk of any internet connectivity issues. Further, interested bidders are hereby informed of the following:
 - Only a maximum of two (2) representatives from each bidder / company shall be allowed to participate.
 - Wearing of Face Masks is recommended but not required in view of Proclamation No. 297 S.2023
 lifting the State of Public Health Emergency Throughout the Philippines
 - c. The requirements herein stated including the medium of submission shall be subject to GPPB Resolution No. 09-2020 dated 07 May 2 020
 - d. The Guidelines on the Implementation of Early Procurement Activities (EPA) shall be subject to GPPB Circular No. 06-2019 dated 17 July 2019
- 7. Bids must be delivered to the address below on the date stated above. Late bids shall not be accepted.
- NPC reserves the right to accept or reject any bid, to annul the bidding process, and to reject all bids at
 any time prior to the contract award, without thereby incurring any liability to the affected bidder or
 bidders.
- 9. For further information, please refer to:

Bids and Contracts Services Division,

Logistics Department

Gabriel Y. Itchon Building

Senator Miriam P. Defensor-Santiago Ave. (formerly BIR Road)

Cor. Quezon Ave., Diliman, Quezon City, 1100

Tel Nos.: 8921-3541 local 5564/5713

Email: bcsd@napocor.gov.ph

Vice President, MinGen and Chairman, Bids and Awards Committee

AFG-LOG-002.F03 Rev.No.0 Page 2 of 2

SECTION II - INSTRUCTIONS TO BIDDERS

TABLE OF CONTENTS

CLAUSE	ENO. TITLE	PAGE NO.
1.	Scope of Bid	1
2.	Funding Information	1
3.	Corrupt, Fraudulent, Collusive, and Coercive Practices	1
4.	Eligible Bidders	1
5 .	Origin of Goods	2
6.	Pre-Bid Conference	2
7 .	Clarification and Amendment of Terms of Reference	2
8.	Documents comprising the Bid: Eligibility and Technical Components	2
9.	Documents comprising the Bid: Financial Component	
10.	Bid Prices	3
11.	Bid and Payment Currencies	3
12.	Bid Security	4
13.	Sealing and Marking of Bids	4
14.	Deadline for Submission of Bids	4
15.	Opening and Preliminary Examination of Bids	4
16.	Domestic Preference	5
17.	Detailed Evaluation and Comparison of Bids	5
18.	Post-Qualification	5
19.	Signing of the Contract	5

SECTION II - INSTRUCTIONS TO BIDDERS

SECTION II - INSTRUCTIONS TO BIDDERS

1. Scope of Bid

The National Power Corporation wishes to receive Bids for the SUPPLY AND DELIVERY OF RENEWABLE ENERGY FOR THE HYBRIDIZATION OF DIESEL POWER PLANTS UNDER SCHEDULE III (CLUSTER 4A-PALAWAN). with PR No. HO-PMD25-003.

The Procurement Project (referred to herein as "Project") is composed of supply of energy from RE facilities in one cluster, the details of which are described in **Section VII** (Technical Specifications).

2. **Funding Information**

- 2.1 The GOP through the source of funding as indicated below for 2027 to 2047 in the total amount of Php960,000,000.00 for the 20-year period O&M of the RE Facility.
- 2.2 The source of funding is the Corporate Operating Budget of NPC.

3. Corrupt, Fraudulent, Collusive, Coercive, and Obstructive Practices

The Procuring Entity, as well as the Bidders and Suppliers, shall observe the highest standard of ethics during the procurement and execution of the contract. They or through an agent shall not engage in corrupt, fraudulent, collusive, coercive, and obstructive practices defined under Annex "I" of the 2016 revised IRR of RA No. 9184 or other integrity violations in competing for the Project.

Eligible Bidders 4.

- 4.1. Only Bids of Bidders found to be legally, technically, and financially capable will be evaluated.
- 4.2. Foreign ownership limited to those allowed under the rules may participate in this Project.
- 4.3. Pursuant to Section 23.4.1.3 of the 2016 revised IRR of RA No.9184, the Bidder shall have an SLCC that is at least one (1) contract similar to the Project the value of which, adjusted to current prices using the PSA's, CPI must be at least equivalent to:
 - a. For the procurement of Non- expendable Supplies and Services: The Bidder must have completed a single contract that is similar to this Project, equivalent to at least fifty percent (50%) of the ABC.
- 4.4. The Bidders shall comply with the eligibility criteria under Section 23.4.1 of the 2016 IRR of RA No. 9184.

5. **Origin of Goods**

There is no restriction on the origin of goods other than those prohibited by a decision of the UN Security Council taken under Chapter VII of the Charter of the UN, subject to Domestic Preference requirements under ITB Clause 18.

6. **Pre-Bid Conference**

The Procuring Entity will hold a pre-bid conference for this Project on the specified date and time and either at its physical address {[insert if applicable] and/or through videoconferencing/webcam as indicated in Notice of Eligibility & Shortlisting.

Clarification and Amendment of Terms of Reference 7.

Prospective may request clarification on and/or interpretation of any part of the Terms of Reference. Such requests must be in writing and received by the Procuring Entity, either at its given address or through electronic mail indicated in the IB, at least ten (10) calendar days before the deadline set for the submission and receipt of Bids.

8. **Documents Comprising the Bid: Eligibility and Technical Components**

- 8.1 The first envelope shall contain the eligibility and technical documents of the Bid as specified in Section VIII (Checklist of Technical and Financial Documents).
- 8.2 The Bidder's SLCC as indicated in ITB Clause 5.3 should have been completed within twenty (20) years prior to the deadline for the submission and receipt of bids.
- If the eligibility requirements or statements, the bids, and all other documents for submission to the BAC are in foreign language other than English, it must be accompanied by a translation in English, which shall be authenticated by the appropriate Philippine foreign service establishment, post, or the equivalent office having jurisdiction over the foreign bidder's affairs in the Philippines. Similar to the required authentication above, for Contracting Parties to the Apostille Convention, only the translated documents shall be authenticated through an apostille pursuant to GPPB Resolution No. 13-2019 dated 23 May 2019. The English translation shall govern, for purposes of interpretation of the bid.

9. **Documents comprising the Bid: Financial Component**

9.1 The second bid envelope shall contain the financial documents for the Bid as specified in Section VIII (Checklist of Technical and Financial Documents).

- If the Bidder claims preference as a Domestic Bidder or Domestic Entity, 9.2 a certification issued by DTI shall be provided by the Bidder in accordance with Section 43.1.3 of the 2016 revised IRR of RA No. 9184.
- 9.3 Any bid exceeding the ABC or SAGR cap for the cluster as indicated in the table in item 1 of the Negotiated Procurement Invitation shall not be accepted.
- For Foreign-funded Procurement, a ceiling may be applied to bid prices provided the conditions are met under Section 31.2 of the 2016 revised IRR of RA No. 9184.

10. Bid Prices

- 10.1. Prices indicated on the Price Schedule shall be entered separately in the following manner:
 - a. For Goods offered from within the Procuring Entity's country:
 - The price of the Goods quoted EXW (ex-works, ex-factory, exwarehouse, ex-showroom, or off-the-shelf, as applicable);
 - The cost of all customs duties and sales and other taxes already paid or payable;
 - The cost of transportation, insurance, and other costs incidental to iii. delivery of the Goods to their final destination: and
 - The price of other (incidental) services, if any, listed in the **BDS**. iν.
 - b. For Goods offered from abroad:
 - i. Unless otherwise stated in the BDS, the price of the Goods shall be quoted delivered duty paid (DDP) with the place of destination in the Philippines as specified in the BDS. In quoting the price, the Bidder shall be free to use transportation through carriers registered in any eligible country. Similarly, the Bidder may obtain insurance services from any eligible source country.
 - ii. The price of other (incidental) services, if any, as listed in the **BDS**.

11. Bid and Payment Currencies

11.1 For Goods that the Bidder will supply from outside the Philippines, the bid prices may be quoted in the local currency or tradeable currency accepted by the BSP at the discretion of the Bidder. However, for purposes of bid evaluation, Bids denominated in foreign currencies, shall be converted to Philippine currency based on the exchange rate as published in the BSP reference rate bulletin on the day of the bid opening.

- 11.2 Payment of the contract price shall be made in:
 - a. Philippine Pesos.

12. Bid Security

- 12.1 The Bidder shall submit a Bid Securing Declaration or any form of Bid Security in the amount indicated in the BDS, which shall be not less than the percentage of the ABC in accordance with the schedule in the BDS.
- 12.2 The Bid and bid security shall be valid for **One Hundred Twenty (120)** calendar days from the date of opening of bids. Any Bid not accompanied by an acceptable bid security shall be rejected by the Procuring Entity as non-responsive.

13. Sealing and Marking of Bids

Each Bidder shall submit Two (2) copies of the first and second components of its Bid, marked **Original** and photocopy. Only the original copy will be read and considered for the bid.

Any misplaced document outside of the **Original** copy will not be considered. The photocopy is ONLY FOR REFERENCE.

The Procuring Entity may request additional hard copies and/or electronic copies of the Bid. However, failure of the Bidders to comply with the said request shall not be a ground for disqualification.

14. Deadline for Submission of Bids

14.1. The Bidders shall submit on the specified date and time and either at its physical address as indicated in Negotiated Procurement Invitation.

15. Opening and Preliminary Examination of Bids

- 15.1 The BAC shall open the Bids in public at the time, on the date, and at the place specified in Negotiated Procurement Invitation. The Bidders' representatives who are present shall sign a register evidencing their attendance.
 - In case the Bids cannot be opened as scheduled due to justifiable reasons, the rescheduling requirements under Section 29 of the 2016 revised IRR of RA No. 9184 shall prevail.
- 15.2 The preliminary examination of bids shall be governed by Section 30 of the 2016 revised IRR of RA No. 9184.

16. Domestic Preference

16.1. The Procuring Entity will grant a margin of preference for the purpose of comparison of Bids in accordance with Section 43.1.2 of the 2016 revised IRR of RA No. 9184.

17. Detailed Evaluation and Comparison of Bids

- 17.1 The Procuring Entity's BAC shall immediately conduct a detailed evaluation of all Bids rated "passed," using non-discretionary pass/fail criteria. The BAC shall consider the conditions in the evaluation of Bids under Section 32.2 of the 2016 revised IRR of RA No. 9184.
- 17.2 If the Project allows partial bids, bidders may submit a proposal on any of the clusters/lots or plants/items, and evaluation will be undertaken on a per cluster/lot or item basis, as the case maybe. In this case, the Bid Security as required by ITB Clause 14 shall be submitted for each cluster/lot or item separately.
- 17.3 The descriptions of the clusters/lots or items shall be indicated in **Section** VII (Technical Specifications), although the ABCs of these clusters/lots or plants/items are indicated in the BDS for purposes of the NFCC computation pursuant to Section 23.4.2.6 of the 2016 revised IRR of RA No. 9184. The NFCC must be sufficient for the total of the ABCs for all the clusters/lots or items participated in by the prospective Bidder
- 17.4 The Project having several plants/items shall be awarded as One Contract.
- 17.5 Except for bidders submitting a committed Line of Credit from a Universal or Commercial Bank in lieu of its NFCC computation, all Bids must include the NFCC computation pursuant to Section 23.4.1.4 of the 2016 revised IRR of RA No. 9184, which must be sufficient for the total of the ABCs for all the clusters/lots or plants/items participated in by the prospective Bidder. For bidders submitting the committed Line of Credit, it must be at least equal to ten percent (10%) of the ABCs for all the clusters/lots or plants/items participated in by the prospective Bidder.

18. Post-Qualification

Within a non-extendible period of five (5) calendar days from receipt by the Bidder of the notice from the BAC that it submitted the Lowest Calculated Bid, the Bidder shall submit its latest income and business tax returns filed and paid through the BIR Electronic Filing and Payment System (eFPS) and other appropriate licenses and permits required by law and stated in the BDS.

19. Signing of the Contract

19.1. The documents required in Section 37.2 of the 2016 revised IRR of RA No. 9184 shall form part of the Contract. Additional Contract documents are indicated in the **BDS**.

SECTION III - BID DATA SHEET

ITB Clause			
5.1	Only Bids of Bidders found to be legally, technically, and financially capable will be evaluated.		
5.2	Foreign ownership limited to those allowed under the rules may participate in this Project.		
5.3	Contracts similar to the Project shall comply with at least 50% of the ABC either through any of the following:		
	1. Completed PSA/ PPA with contract amount of at least 50% of the ABC		
	Completed Construction of Any Power Plant (with ongoing PSA/ PPA) with contract amount of at least 50% of the ABC		
	3. Combination of two (2) similar contracts with an aggregate contract amount of at least 50% of the ABC as follows:		
	3.1. One (1) completed PSA/ PPA or Completed Construction of Any Power Plant Contract (with ongoing PSA/ PPA) with an amount of at least 25% of the ABC;		
	3.2. One (1) ongoing contract (PSA/ PPA of RE Facility only) with completed portion amounting to at least 25% of the ABC, provided that the RE facility is operationalized, and a certificate of satisfactory performance has been issued by the concerned Procuring Entity.		
	It shall be a ground for disqualification if verification and validation cannot be conducted for reasons attributable to the Bidder.		
13.1	The bid security shall be in the form of a Bid Securing Declaration, or any of the following forms and amounts:		
	1. The amount of not less than [Indicate the amount equivalent to two percent (2%) of the ABC], if bid security is in cash, cashier's/manager's check, bank draft/guarantee or irrevocable letter of credit; or		
	2. The amount of not less than [Indicate the amount equivalent to five percent (5%) of the ABC] if bid security is in Surety Bond.		

18.1	The bid evaluation will be undertaken as follows	•
10.1	i i ne biq evaluation will be undertaken as lollov	งร

- 1. The technical and financial offers shall be evaluated as to completeness of information and conformance with specified requirements. Non-compliance is a ground for disqualification of bid.
- 2. The Tariff Rate offer that exceeds the set SAGR and/ or the computed Contract Amount that exceeds the ABC shall be disqualified.
- 3. Subject to Section 32 of RA 9184 IRR, the basis of ranking of the complying bids will be computed using the formula below in reference to Section VII, Part II: Technical Data Sheet, and Section VIII, Bidding Forms, Schedule of Prices:

 $AGCD = (NPC RATE CAP) (MAG_{REPP}) - (CAGC_{CORRECTED})$

 $CAGC_{CORRECTED} = TR \times MAG_{REPP}$

Where:

AGCD – Annual Generation Cost Difference

NPC RATE CAP – Subsidized Approved Generation Rate in the area/ cluster

CAGC_{CORRECTED} – Computed Annual Generation Cost as corrected

TR - Tariff Rate Offered

MAG_{REPP} – Minimum Annual Generation committed by the REPP

 $MAG_{REPP} = MAG_{PLANT1} + MAG_{PLANT2} + ... + MAG_{PLANTn}$ $MAG_{PLANT} - Minimum Annual Generation per Plant$

Note: **MAG_{PLANT}** lower than the minimum annual generation requirement of NPC OR higher than the product of REPP's committed Capacity and Availability multiplied by 365 days will be grounds for disqualification.

The **Highest Rated Bid (HRB)** will be the bid offer that will maximize the benefit to NPC which is the highest computed value of AGCD.

In the event that the TR will be equal to the NPC Rate Cap, the HRB will be based on the highest MAGREPP.

- 18.2 Partial bid is not allowed. The diesel power plants are grouped into clusters which shall not be divided into sub-clusters for the purpose of bidding, evaluation, and contract award.
- The NFCC will be computed based on the 2-year construction cost or the total capital investment for the renewable energy facility, instead of the ABC of the Project. The NFCC must be sufficient for the total construction cost for the cluster participated in by the prospective Bidder

18.4	The project will be awarded per cluster specifying the components per plant.
18.5	Except for bidders submitting a committed Line of Credit from a Universal or Commercial Bank in lieu of its NFCC computation, all Bids must include the NFCC computation pursuant to GPPB Resolution No. 01-2024, which must be sufficient for the Two (2) Year construction cost of the RE facility for all the cluster/s participated in by the prospective Bidder. For bidders submitting the committed Line of Credit, it must be at least equal to ten percent (10%) of the RE facility construction cost for the cluster/s participated in by the prospective Bidder.
20.2	Within a non-extendible period of five (5) calendar days from receipt by the Bidder of the notice from the BAC that it submitted the HRB, the Bidder shall submit its latest income and business tax returns filed and paid through the BIR Electronic Filing and Payment System (eFPS) and other appropriate licenses and permits required by law such as RE Service Contract, Certificate of Compliance (COC), and other Government Permits.
21.1	The RE Power Purchase Agreement (REPPA) is the equivalent of the contract agreement as prescribed by the IRR of RA 9184 under Section 37.2.

SECTION IV - GENERAL CONDITIONS

TABLE OF CONTENTS

CLAUSE NO. IIILE	PAGE NO
4 00005 05 000170407	N/ 000 4
1. SCOPE OF CONTRACT	
2. ADVANCE PAYMENT AND TERMS OF PAYMENT	IV-GCC-1
3. PERFORMANCE SECURITY	IV-GCC-1
4. INSPECTION AND TESTS	IV-GCC-1
5. WARANTY	IV-GCC-2
6. LIABILITY OF THE SUPPLIER	IV-GCC-2

SECTION IV - GENERAL CONDITIONS

1. Scope of Contract

This Contract shall include all such items, although not specifically mentioned, that can be reasonably inferred as being required for its completion as if such items were expressly mentioned herein. All the provisions of RA No. 9184 and its 2016 revised IRR, including the Generic Procurement Manual, and associated issuances, constitute the primary source for the terms and conditions of the Contract, and thus, applicable in contract implementation. Herein clauses shall serve as the secondary source for the terms and conditions of the Contract.

This is without prejudice to Sections 74.1 and 74.2 of the 2016 revised IRR of RA No. 9184 allowing the GPPB to amend the IRR, which shall be applied to all procurement activities, the advertisement, posting, or invitation of which were issued after the effectivity of the said amendment.

Additional requirements for the completion of this Contract shall be provided in the Special Conditions of Contract (SCC).

2. Advance Payment and Terms of Payment

- 2.1 Advance payment of the contract amount is provided under Annex "D" of the revised 2016 IRR of RA No. 9184.
- 2.2 The Procuring Entity is allowed to determine the terms of payment on the partial or staggered delivery of the Goods procured, provided such partial payment shall correspond to the value of the goods delivered and accepted in accordance with prevailing accounting and auditing rules and regulations. The terms of payment are indicated.

3. Performance Security

Within ten (10) calendar days from receipt of the Notice of Award by the Bidder from the Procuring Entity but in no case later than the signing of the Contract by both parties, the successful Bidder shall furnish the performance security in any forms prescribed in Section 39 of the 2016 revised IRR of RA No. 9184.

4. Inspection and Tests

The Procuring Entity or its representative shall have the right to inspect and/or to test the Goods to confirm their conformity to the Project specifications at no extra cost to the Procuring Entity in accordance with the Generic Procurement Manual. In addition to tests in the **SCC**, **Section VII (Technical Specifications)** shall specify what inspections and/or tests the Procuring Entity requires, and where they are to be conducted. The Procuring Entity shall notify the Supplier in writing, in a timely manner, of the identity of any representatives retained for these purposes.

All reasonable facilities and assistance for the inspection and testing of Goods, including access to drawings and production data, shall be provided by the Supplier to the authorized inspectors at no charge to the Procuring Entity.

5. Warranty

- 5.1 In order to assure that manufacturing defects shall be corrected by the Supplier, a warranty shall be required from the Supplier as provided under Section 62.1 of the 2016 revised IRR of RA No. 9184.
- 5.2 The Procuring Entity shall promptly notify the Supplier in writing of any claims arising under this warranty. Upon receipt of such notice, the Supplier shall, repair or replace the defective Goods or parts thereof without cost to the Procuring Entity, pursuant to the Generic Procurement Manual.

6. Liability of the Supplier

The Supplier's liability under this Contract shall be as provided by the laws of the Republic of the Philippines.

If the Supplier is a joint venture, all partners to the joint venture shall be jointly and severally liable to the Procuring Entity.

SECTION V - SPECIAL CONDITIONS OF THE CONTRACT

GCC Clause		
1	Delivery and Documents –	
	Delivery of Services shall be made by the Renewable Energy Power Provider (REPP) in accordance with the terms specified in Section VI – Schedule of Requirements and SeCTION VII - Technical Specifications. The details of documents to be furnished by the REPP are as follows:	
	(i) Copy of system design plans, drawings and schematic diagrams for NPC's reference;	
	(ii) Summary of the REPP's installed RE facility equipment, parts and appurtenances;	
	(iii) Copy of REPP's factory test/ inspection report particularly for the metering facility;	
	(iv) Copy of the certification from ERC of the energy meter and calibration record;	
	(v) Copy of Testing, Commissioning, and Final Inspection Report; and	
	(vi) Documents specified in the Technical Specifications, if any.	
	For purposes of this Clause the Procuring Entity's Representative during the Construction stage are as follows: 1) Technical Staff from the Office of the President and Chief Executive Officer (OPCEO), 2) The Functional Group Head of the Power Engineering Services. The Functional Group Head of SPUG will be the representative of NPC during the Operation stage.	
	Incidental Services –	
	The REPP is required to provide other services as necessary in addition to those specified in Section VII – Schedule of Requirements.	
	Spare Parts –	
	Availability of spare parts of the RE Facility shall be the responsibility of the REPP.	
	The REPP shall carry sufficient inventories to assure ex-stock supply of consumable spare parts or components for the Services for the contract period specified in the Technical Specifications.	
	Spare parts or components shall be supplied as promptly as possible.	
	Contract Period –	
	The Contract Period for the Supply and Delivery of Renewable Energy for the Hybridization of Diesel Power Plants under Schedule III (Cluster 4A - Palawan) is Twenty-Two (22) Years covering the two (2) years pre-construction and	

	construction and twenty (20) years plant operation or upon exhaustion of contract amount whichever is earlier, reckoned from the first day of its commercial operation.			
2.1	Not Applicable			
2.2	Delivery of energy under the contract will be paid monthly based on billing submitted by the supplier and the records of energy generation. The monthly energy shortfall with corresponding penalty will be reconciled annually.			
3	1. To secure the REPP 's obligation and commitment to design, develop, construct, and operate the RE facility under the REPPA, the REPP must post a Development and Construction Performance Security which shall be based on Total Cost of RE Facility, and Operation Performance Security based on Item 3 below.			
	The following must be indicated in the performance security to be posted by the Supplier:			
	 i. Company Name ii. Correct amount of the Bond iii. Contract/Purchase Order Reference Number iv. Purpose of the Bond: "To guarantee the faithful performance of the Principal's obligation to undertake (Contract/Purchase Order Description) in accordance with the terms and conditions of (Contract No. & Schedule/Purchase Order No.) entered into by the parties." 			
	To guarantee the faithful performance by the winning bidder of its obligations under the contract in accordance with the Terms of Reference, it shall post a performance security prior to the signing of the contract. The Operation Performance Security shall be in an amount not less than			
	the required percentage of the total contract price in accordance with the following schedule.			
	Form of Operation Performance Security Amount of Operation Performance Security (Not less than the required percentage of the Total Contract Price)			
	a) Cash or cashier's/manager's check issued by a Universal or Commercial Bank.			
	b) Bank draft/guarantee or irrevocable letter of credit issued by a Universal or Commercial Bank: Provided, however, that it shall be confirmed or authenticated by a Universal or Commercial Bank, if issued by a foreign bank.			

	c) Surety bond callable upon demand issued by a surety or insurance company duly certified by the Insurance Commission as authorized to issue such security. Thirty percent (30%)			
	4. In case of surety bond, any extension of the contract duration or delivery period granted to the SUPPLIER shall be considered as given, and any modification of the contract shall be considered as authorized, as if with the expressed consent of the surety, provided that such extension or modifications falls within the effective period of the said surety bond. However, in the event that the extension of the contract duration or delivery schedule would be beyond the effective period of the surety bond first posted, it shall be the sole obligation of the SUPPLIER to post an acceptable Performance Security within ten (10) calendar days after the contract duration/delivery period extension has been granted by NPC.			
	5. Other required conditions in addition to the standard policy terms issued by the Bonding Company:			
	 The bond is a penal bond, callable on demand and the entire amount thereof shall be forfeited in favor of the Obligee upon default of the Principal without the need to prove or to show grounds or reasons for demand for the sum specified therein; 			
	ii. The amount claimed by the Obligee under this bond shall be paid in full and shall never be subject to any adjustment by the Surety;			
	iii. In case of claim, the Surety shall pay such claim within sixty (60) days from receipt by the Surety of the Obligee's notice of claim/demand letter notwithstanding any objection thereto by the Principal.			
	6. The Development and Construction Performance Security shall be valid until the committed Commercial Operation Start Date (COSD) indicated in the REPPA while the Operation Performance Security shall be for a 20-year contract period and renewed annually until the end of the contract period.			
4	NPC to participate on the following:			
	1. Conduct of Test and Commissioning of the necessary Communication and Interface Systems for Synchronization and Protection of the RE facility to be interconnected with NPC's diesel power plant to verify compliance with the different construction codes and standard.			
	2. Inspection and test for the metering facility.			
5	Not Applicable			
6	In the event of inexcusable delay (causes within the control of the Proponent), in the committed Commercial Operation Start Date (COSD) of the RE facility,			

Liquidated Damage shall be imposed in accordance with RA 9184 as shown in the following formula:

LD = 1/10 {0.01 [(Offered Annual Generation in kWh/365) (Bid Price Offer in Php/kWh) (No. of days delayed)]}

During the cooperation period, in the event that **the REPP will not be** able to meet the offered **Minimum Annual Generation** as determined under Section 4.7, a Penalty Charge shall be imposed to the **REPP** to cover any shortfall, except those caused by Forced Majeure. The Penalty Charges shall be computed monthly and reconciled at the end of the year as shown in the formula below:

$$P = M_{(Jan)} + M_{(Feb)} + M_{(Mar)} + \dots + M_{(Dec)}$$

Where: **P** = Yearly Penalty to be imposed to REPP due to shortfall on Generated Electricity

M = Computed Monthly Penalty = [(Mc - Ma) x FR x D]-[(Mc - Ma) x WBTR)

Mc = Committed Energy (kwh) for the Month

M_A = Actual Generated Energy (kwh) for the Month

FR = Fuel Rate at 0.30 Liters/kwh

D = Peso per Liter Cost of Diesel for the Month

WBTR = Winning Bidder's Tariff Rate

The Annual Reconciliation covering January to December Monthly Billing of the previous year, shall take place on the 1st Week of January of the succeeding year. The Penalty Charge for shortfall, if there are any, shall be deducted from the claim of the REPP on the same month or may still be deducted in the succeeding months until the total Penalty Charge is paid.

Penalty computation on the 20th year shall be computed monthly and corresponding penalty charge for the month, if there are any, shall be deducted on the billing of the succeeding month.

Note: Penalties shall be imposed to recover the cost incurred by NPC in lieu of the shortfall.

Shortfall due to insufficiency or absence of RE sources like solar, water, wind, etc., is not force majeure and shall be subject to the imposition of Penalty Charges.

SECTION V - SPECIAL CONDITIONS OF THE CONTRACT

PR NO. HO-PMD25-003

Force Majeure is an extraordinary event which cannot be foreseen or which though foreseen, cannot be avoided. The event must render it impossible for a Party to fulfill its obligation in a normal manner despite the exercise of due care. Force Majeure shall only be limited to a storm, typhoon, lightning, flood, drought, earthquake, tsunami, fire, war, rebellion, insurrection, riot, naval or other blockade, labor disturbance, civil unrest, and other analogous circumstances natural or man-made. For the avoidance of doubt, force majeure does not include absence or limited RE resources like sunlight, wind, water, etc. that limits energy production.

Note: Please refer to **APPENDIX E** regarding the complete Renewable Power Purchased Agreement (REPPA).

SECTION VI – SCHEDULE OF REQUIREMENTS

The delivery schedule expressed as weeks/months stipulates hereafter a delivery date which is the date of delivery to the project site.

Item Number	Description	Quantity	Total	Delivered, Weeks/Months
1.	Financing, Pre-Construction, and Construction of RE Facility	per plant site	8	Maximum of two (2) years from Notice to Proceed
2.	Operation and Maintenance of RE Facility	per plant site	8	Twenty (20) years from Commercial Operation Start Date
3.	Training of the Procuring Entity's personnel, at the Supplier's plant and/or on-site, in start-up, operation, maintenance, and/or repair of the RE Facility.	per plant site	8	Prior to Commercial Operation of the RE Facility

NATIONAL POWER CORPORATION VII-SOR-1

SECTION VII - PART I: TECHNICAL SPECIFICATIONS

CLAUSE	E NO.	TITLE	PAGE NO.
TS 1 0	PROJECT DESCRIPTION		1
	PROJECT LOCATION		
TS 3.0	CONNECTION POINT		1
TS 4.0	PROJECT DEVELOPMENT	DURATION	1
TS 5.0	CONTRACT PERIOD		1
TS 6.0	SCOPE OF WORKS		2
TS 7.0	PROCURING ENTITY'S (NF	PC) PARTICIPATION	5
TS 8 0	PAYMENT		5

SECTION VII - PART I: TECHNICAL SPECIFICATIONS

TS 1.0 PROJECT DESCRIPTION

This specification covers the general technical and associated requirements for the Supply and Delivery of Renewable Energy for the Hybridization of Diesel Power Plants under Schedule III (Cluster 4A -Palawan).

The Generating Facility shall utilize any of the following Renewable **Energy Resources:**

- a. Biofuel
- b Biomass
- c. Geothermal
- d. Solar + BESS
- e. Water (Hydro or Tidal + BESS)
- Wind + BESS
- g. Hybrid

The Generating Capacity of the Renewable Energy facility shall be determined by the REPP based on the Load Curve/Demand profiles of the Batanes Area.

PROJECT LOCATION **TS 2.0**

The Supply and Delivery of Renewable Energy for the Hybridization of Diesel Power Plants under Schedule III (Cluster 4A - Palawan) can be referred to Appendix B: Cluster Location Map.

TS 3.0 CONNECTION POINT

Connection point shall be at the NPC assigned delivery/ tapping/ metering point where the Billing Meter will be installed. Interconnection assets shall be included in the scope of work to be provided by the REPP.

TS4.0 PROJECT DEVELOPMENT DURATION

Delivery Period/ Commercial Operation shall be twenty-four (24) months or earlier reckoned from the receipt of the Notice to Proceed by the winning bidder.

TS 5.0 CONTRACT PERIOD

The Contract Period for the Supply and Delivery of Renewable Energy for the Hybridization of Diesel Power Plants under Schedule III (Cluster 4A - Palawan) is Twenty-Two (22) Years covering the two (2) years preconstruction and construction and twenty (20) years plant operation or

upon exhaustion of contract amount whichever is earlier, reckoned from the first day of its commercial operation.

TS 6.0 SCOPE OF WORKS

TS 6.1 GENERAL

The scope of works shall cover the Supply and Delivery of Renewable Energy for the Hybridization of Diesel Power Plants under Schedule III (Cluster 4A - Palawan).

The Supplier's scope of works under this Contract shall generally consist of provisions stipulated hereunder.

PRE-CONSTRUCTION ACTIVITIES **TS 6.2**

- Project financing, site investigation, selection and survey, acquisition of Site/Right of Way, and securing of possessory rights for the land (lease maybe an option);
- b. Securing all necessary permits and licenses including but not limited to Environmental Compliance Certificate (ECC)/Certificate of Non-Coverage (CNC), Permit to Operate (PTO) Wastewater Discharge Permit (WDP), Hazardous Waste Generator Registration Certificate (HWGR Cert./HW ID), Chemical Control Order for PCB Registration (CCO-PCB Reg.), from Department of Environmental and Natural Resources – Environmental Management Bureau (DENR – EMB). Water Permit from National Water Resources Board (NWRB), Renewable Energy Service Contract (RESC) from Department of Energy (DOE), Certificate of Endorsement (COE) from DOE, Certificate of Compliance (COC) from Energy Regulatory Board (ERC), and other permits/ not specifically mentioned herein but necessary for the construction and operation of the facility;
- c. Design of the whole system including the Renewable Energy Facility, Battery Energy Storage System (BESS), 13.8 kV Tie Line and all necessary communication and Energy Management or Interface Systems for Synchronization and Protection of existing NPC assets to meet the demand during the operation of the RE facility in the island grids including the charging of the BESS, as necessary, in coordination with the Distribution Utilities/ Electric Cooperatives and NPC SPUG. Option of installing solar facilities at the rooftops of buildings shall also be explored/considered in the study/design.

TS 6.3 CONSTRUCTION OF RE GENERATING FACILITY

a. Supply, delivery, construction, installation, test and commissioning of the Renewable Energy Facility including all the interconnecting

assets and necessary appurtenances for the safe and proper operation and maintenance of the said facility;

- b. Supply, delivery, installation, test and commissioning of BESS (solar, wind, tidal) to smoothen the energy supply to meet the varying energy demand and allow the diesel generator sets to ramp up and synchronize during the switch of operation from the renewable energy facility to the diesel generator sets and vice versa.
- c. Compliance with different construction codes and standards to ensure system safety and protection of NPC's diesel power plant where the RE facility will be interconnected;
- d. Supply, delivery, installation, test and commissioning of metering facilities. The Kilowatt-hour Meter must be certified and approved by ERC and be guided by the provided specifications particularly for 13.8kV three phase kilowatt-hour meter including instrument transformer and accessories for the metering facility:

ITEM	DESCRIPTION	SPECIFICATION
1	Number of Wires	4
2	Voltage, V	120-480
3	Accuracy class	0.2s
4	Frequency, Hz	60
5	Register Type	LCD
6	Soft Switches	Available
7	LCD Display	Programmable
8	Communication Port for Kilowatt-hour meter	To be Provided
9	Meter Test Block	
	a. No. of Poles	10 (4 Voltage & 6 Current Terminals)
	b. Rated Voltage, V	600
	c. Equipment Standard	ANSI C12.9
	d. Test Block Cover	Required
11	Metering Current Transformer	
	a. Application (Indoor/Outdoor)	Outdoor
	b. Insulation type	Full cast epoxy resin
	c. Primary rated current, A	20
	d. Secondary rated current for all windings,	5
	e. No. of cores	One (1) core Secondary CT
	f. CT ratio	20:5
	g. Burden	45

ITEM	DESCRIPTION	SPECIFICATION
	h. BIL, kV	110
12	Metering Voltage Transformer	
	a. Application (Indoor/Outdoor)	Outdoor
	b. Highest continuous operating voltage, kV	15
	c. Nominal voltage, kV	8.4
	d. Rated secondary voltage, V	120
	e. Insulation type	Full cast epoxy resin
	f. PT ratio	70:1
	g. Burden	75
	h. BIL, kV	110
13	Meter Housing/ Enclosure	
	a. Material	Stainless Steel
	b. Dimension (LxWxH)	16" x 12" x 22" (Front Height) & 24"(Rear Height)
	c. Display/Viewing Window	Required

The 13.8kV Three Phase Kilowatt-Hour Meter shall have but not limited to the following features:

- 1. Pilferage proof
- 2. Tamper Proof
- 3. Wrong Wiring Alarm
- 4. Can withstand the temperature of -20°C to +70°C and Humidity of up to 95% non-condensing
- 5. With back light display
- 6. With built-in battery for LCD display and back-up battery
- 7. TOU Programmable Ready
- 8. Measure display (Delivered and Received Energy, RMS voltage & current per phase, Reactive & Apparent Power, Power factor, Frequency and etc.)

The 13.8kV three phase kilowatt-hour meter and its required metering instruments shall be pole mounted with stainless steel bracket, bolts, etc.

TS 6.4 OPERATION AND MAINTENANCE OF THE RE GENERATING FACILITY

This will involve the capability of the RE facility with BESS for standalone operation during its availability period and synchronization with NPC's diesel power plant during transition from RE source to Diesel Power and vice versa, and maintenance activities. Parallel operation for

SECTION VII - PART I: TECHNICAL SPECIFICATIONS

both REPP's RE Facility and NPC's diesel power plant shall be implemented whenever necessary.

TS 7.0 PROCURING ENTITY'S (NPC) PARTICIPATION

During the Contract Period, NPC shall monitor the operations of the Renewable Energy Facility. NPC shall have the authority to restrict the dispatch of power or disconnect the REPP Facility in the event that the REPP exceeds the demand or oversupply of energy from its existing generating assets.

During the development period, NPC shall:

- Monitor the project:
- Allow REPP's access to NPC SPUG Plant/s;
- o Provide assistance through best efforts in TS 6.2 (a) and (b) like provision of required data/ information, assistance during site selection/ investigation, and in securing permits/ licenses; and
- o Witness the conduct of Testing and Commissioning, Final Inspection of the RE facility, and attest to its successful commissioning.

TS 8.0 PAYMENT

Payment shall be based on the monthly billing for the delivered renewable energy (kWh) at the Delivery Point and based on the Bid Price Offer (Php per kWh) in Section VIII – Bidding Forms, Schedule of Prices of the Terms of Reference

SECTION VII – PART II: TECHNICAL DATA SHEET

Contra	Contract Area / Cluster No.: PALAWAN / 4A			
ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA	
	Plant: CUYO DPP			
1.0	RE Type	By Supplier		
2.0	Capacity* (kW in AC)	By Supplier		
3.0	BESS (kWh), as applicable	At least 25% of Item 2.0		
4.0	Availability, (PCF or Annual Daily Average in Hours)	16% or 3.8 Hours (minimum)		
5.0	Minimum Annual Generation (MAG _{PLANT1})	1,474,571 kWh (minimum)		
6.0	Commercial Operation Start Date (COSD)	2 years or earlier		
Plant: RIZAL DPP				
1.0	RE Type	By Supplier		
2.0	Capacity* (kW in AC)	By Supplier		
3.0	BESS (kWh), as applicable	At least 25% of Item 2.0		
40	Availability, (PCF or Annual Daily Average in Hours)	16% or 3.8 Hours (minimum)		
5.0	Minimum Annual Generation (MAG _{PLANT2})	982,338 kWh (minimum)		
6.0	Commercial Operation Start Date (COSD)	2 years or earlier		
	Plant:	SAN VICENTE DPP		
1.0	RE Type	By Supplier		
2.0	Capacity* (kW in AC)	By Supplier		
3.0	BESS (kWh), as applicable	At least 25% of Item 2.0		
4.0	Availability, (PCF or Annual Daily Average in Hours)	16% or 3.8 Hours (minimum)		
5.0	Minimum Annual Generation (MAG _{PLANT3})	1,080,366 kWh (minimum)		
6.0	Commercial Operation Start Date (COSD)	2 years or earlier		
	Plant:	BITON DPP		
1.0	RE Type	By Supplier		
2.0	Capacity* (kW in AC)	By Supplier		

Name of Firm Name & Signature of Representative Designation SECTION VII - PART II: TECHNICAL DATA SHEET PR NO. HO-PMD25-003

Contrac	ct Area / Cluster No.:	PALAWAN / 4A		
ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA	
3.0	BESS (kWh), as applicable	At least 25% of Item 2.0		
4.0	Availability, (PCF or Annual Daily Average in Hours)	16% or 3.8 Hours (minimum)		
5.0	Minimum Annual Generation (MAG _{PLANT4})	15,092 kWh (minimum)		
6.0	Commercial Operation Start Date (COSD)	2 years or earlier		
	Plant: CASIAN DPP			
1.0	RE Type	By Supplier		
2.0	Capacity* (kW in AC)	By Supplier		
3.0	BESS (kWh), as applicable	At least 25% of Item 2.0		
4.0	Availability, (PCF or Annual Daily Average in Hours)	16% or 3.8 Hours (minimum)		
5.0	Minimum Annual Generation (MAG _{PLANT5})	51,962 kWh (minimum)		
6.0	Commercial Operation Start Date (COSD)	2 years or earlier		
	Plant: PALY DPP			
1.0	RE Type	By Supplier		
2.0	Capacity* (kW in AC)	By Supplier		
3.0	BESS (kWh), as applicable	At least 25% of Item 2.0		
4.0	Availability, (PCF or Annual Daily Average in Hours)	16% or 3.8 Hours (minimum)		
5.0	Minimum Annual Generation (MAG _{PLANT6})	105,644 kWh (minimum)		
6.0	Commercial Operation Start Date (COSD)	2 years or earlier		
	Plant: NANGALAO DPP			
1.0	RE Type	By Supplier		
2.0	Capacity* (kW in AC)	By Supplier		
3.0	BESS (kWh), as applicable	At least 25% of Item 2.0		
4.0	Availability, (PCF or Annual Daily Average in Hours)	16% or 3.8 Hours (minimum)		
5.0	Minimum Annual Generation (MAG _{PLANT7})	57,039 kWh (minimum)		

Name of Firm	Name & Signature of Representative	Designation

Contract Area / Cluster No.:		PALAWAN / 4A	
ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
6.0	Commercial Operation Start Date (COSD)	2 years or earlier	
Plant: TARA DPP			
1.0	RE Type	By Supplier	
2.0	Capacity* (kW in AC)	By Supplier	
3.0	BESS (kWh), as applicable	At least 25% of Item 2.0	
4.0	Availability, (PCF or Annual Daily Average in Hours)	16% or 3.8 Hours (minimum)	
5.0	Minimum Annual Generation (MAG _{PLANT8})	7,546 kWh (minimum)	
6.0	Commercial Operation Start Date (COSD)	2 years or earlier	
Total Minimum Annual Generation for the Cluster (MAGREPP)		3,775,558 kWh (min)	

Notes: 1. * Shall be determined based on the given load curve data in Annex C.

- 2. Any offer not meeting the NPC minimum requirements shall be grounds for disqualification.
- 3. The BESS with at least 25% of the committed capacity will be used to support the shifting operation from RE to diesel and vice versa. However, REPP may opt to install higher capacity if it intends to offer a longer availability period.
- 4. Offered MAG_{PLANT} lower than the minimum annual generation requirement of NPC **OR** higher than the product of REPP's committed Capacity and Availability multiplied by 365 days will be grounds for disqualification.
- 2. MAGREPP = MAGPLANT1 + MAGPLANT2 + MAGPLANT3 + ... + MAGPLANT8

Name of Firm Name & Signature of Representative Designation	 ation

Financial

and

NPCSF-GOODS-01

Envelope

SECTION VIII - BIDDING FORMS

TABLE OF CONTENTS

of

Technical

Checklist

Requirements for Bidders NPCSF-GOODS-02 List of all Ongoing Government & Private Contracts Including Contracts Awarded but not yet Started NPCSF-GOODS-03 Computation of Net Financial Contracting Capacity (NFCC) NPCSF-GOODS-04 Joint Venture Agreement NPCSF-GOODS-05a Form of Bid Security: Bank Guarantee NPCSF-GOODS-05b Form of Bid Security: Surety Bond NPCSF-GOODS-05c Bid Securing Declaration Form NPCSF-GOODS-06 Omnibus Sworn Statement (Revised)

NPCSF-GOODS-07 - Bid Letter

Sample Form - Bank Guarantee Form for Advance Payment

Sample Form - Certification from DTI as Domestic Bidder

SECTION VIII - BIDDING FORMS

Checklist of Technical & Financial Envelope Requirements for Bidders

A. THE 1ST ENVELOPE (TECHNICAL COMPONENT) SHALL CONTAIN THE FOLLOWING:

1. ELIGIBILITY DOCUMENTS

a. (Class A)

PhilGEPs Certificate of Registration and Membership under Platinum Category (all pages) in accordance with Section 8.5.2 of the Revised IRR of RA. 9184;

Notes:

- 1) Submission of proof of application will be allowed subject to submission and verification of PhilGEPs Certificate of Registration and Membership during post-qualification; or
- 2) Failure by the prospective bidder to update its Certificate with the current and updated Class "A" eligibility documents shall result in the automatic suspension of the validity of its Certificate until such time that all of the expired Class "A" eligibility documents has been updated.
- Statement of all its ongoing government and private contracts if any, whether similar or not similar in nature and complexity to the contract to be bid (NPCSF-GOODS-02)
- The Statement of the bidder's Single Largest Completed Contract (SLCC) similar to the contract to be bid, and whose value, adjusted to current prices using the Philippine Statistics Authority (PSA), Consumer Price Index (CPI), must be at least 50% of the ABC (NPCSF-GOODS-03) complete with documentary requirements as described below:

SLCC (ANY OF THE FOLLOWING)	DOCUMENTARY REQUIREMENTS
Completed PSA/ PPA with contract amount of at least 50% of the ABC	 Certified true copy of notarized PSA/ PPA; and Certificate of Satisfactory Performance signed by the Contracting Party
2. Completed Construction of Any Power Plant (with ongoing PSA/ PPA) with contract amount of at least 50% of the ABC	Certified true copy of notarized Power Plant Construction Contract with Certificate of Compliance (COC)/Certificate of Acceptance/Satisfactory Completion; and Certified true copy of ongoing PSA/PPA, with Certificate of Satisfactory Performance signed by the Contracting Party
3. Combination of two (2) similar contracts with an aggregate contract amount of at least 50% of the ABC.	
3.1 One (1) completed PSA/ PPA or Construction of Any Power Plant Contract (with ongoing PSA) with amount of at least 25% of the ABC;	For PSA/ PPA: 1. Certified true copy of notarized PSA/ PPA; and 2. Certificate of Satisfactory Performance signed by the Contracting Party
and	For Power Plant: 1. Certified true copy of notarized Power Plant Construction Contract with Certificate of Compliance (COC)/

3.2 One (1) ongoing contract (PSA/ PPA of RE Facility only) with completed portion amounting to at least 25% of the ABC, provided that the RE facility is operationalized, and a certificate of satisfactory performance has been issued by the concerned PE

Certificate of Acceptance/ Satisfactory Completion: and

PR NO. HO-PMD25-003

- Certified true copy of Ongoing PSA/ PPA, with Certificate of Satisfactory Performance signed by the Contracting Party
- Certified true copy of Ongoing PSA/ PPA, with Certificate of Satisfactory Performance signed by the Contracting Party for the RE Facility; and
- 2. Certified true copy of Billing/ Official Receipt/s

(The Single Largest Completed Contract (SLCC) as declared by the bidder shall be verified and validated to ascertain such completed contract. Hence, bidders must ensure access to sites of such projects/equipment to NPC representatives for verification and validation purposes during post-qualification process.

Duly signed computation of its Net Financial Contracting Capacity (NFCC) at least equal to 2-year construction cost or the total capital investment for the renewable energy facility (NPCSF-GOODS-03) or Committed Line of Credit (CLC) at least equal to ten percent (10%) of the total capital investment, issued by a Universal or Commercial Bank; If the Bidder opted to submit a Committed Line of Credit (CLC), the bidder must submit a granted credit line valid/effective at the date of bidding.

b. (CLASS B)

- For Joint Venture (if applicable), any of the following:
 - Valid Joint Venture Agreement (NPCSF-GOODS-04)

OR

- Notarized statements from all the potential joint venture partners stating that they will
 enter into and abide by the provisions of the JVA, if awarded the contract. The JVA
 shall be submitted ten (10) days from receipt of the Notice of Award (NOA) per Section
 37.1.4 of the IRR of RA9184.
- Certification from the relevant government office of their country stating that Filipinos are allowed to participate in their government procurement activities for the same item/product (For foreign bidders claiming eligibility by reason of their country's extension of reciprocal rights to Filipinos)

2. Technical Documents

- Bid Security, any one of the following:
 - Bid Securing Declaration (NPCSF-GOODS-05c)

OR

 Cash or Cashier's/Manager's check issued by a Universal or Commercial Bank – 2% of ABC;

OR

 Bank draft/guarantee or irrevocable letter of credit issued by a Universal or Commercial Bank: (NPCSF-GOODS-05a)- 2% of ABC;

OR

- Surety Bond callable upon demand issued by a reputable surety or insurance company (NPCSF-GOODS-05b)- 5% of ABC, with
 - Certification from the Insurance Commission as authorized company to issue surety
- Duly signed, completely filled-out and notarized Omnibus Sworn statement (Revised) (NPCSF-GOODS-07), complete with the following attachments:
 - For Sole Proprietorship:
 - Special Power of Attorney
 - For Partnership/Corporation/Cooperative/Joint Venture:
 - Document showing proof of authorization (e.g., duly notarized Secretary's Certificate, Board/Partnership Resolution, or Special Power of Attorney, whichever is applicable)
- Complete eligibility documents of the proposed subcontractor, if any
- Documents to be submitted with the Bid as specified in *Section VII: Technical Specifications, Part II-* Technical Data Sheet, that would indicate the Cluster of interest, the diesel power plants and corresponding capacity, RE Type, COSD, availability and metering compliance.

B. THE 2ND ENVELOPE (FINANCIAL COMPONENT) SHALL CONTAIN THE FOLLOWING:

- Duly signed Bid Letter indicating the total bid amount in accordance with the prescribed form (NPCSF-GOODS-07)
- Duly signed and completely filled-out Schedule of Prices (Section VIII Bidding Forms) indicating the Cluster of interest, SAGR for the cluster, bid price/ tariff rate offer that is capped on the cluster's SAGR, Committed Total Annual Generation, Computed Annual Generation Cost, and Computed Cost of Energy for Twenty (20) Years, and Total RE Project Cost
- For Domestic Bidder claiming for domestic preference:
 - Letter address to the BAC claiming for preference
 - Certification from DTI as Domestic Bidder in accordance with the prescribed forms provided

CONDITIONS:

- 1. Each Bidder shall submit Two (2) copies of the first and second components of its Bid, marked Original and photocopy. Only the original copy will be read and considered for the bid. Any misplaced document outside of the Original copy will not be considered. The photocopy is <u>ONLY FOR REFERENCE</u>. NPC may request additional hard copies and/or electronic copies of the Bid. However, failure of the Bidders to comply with the said request shall not be a ground for disqualification.
- 2. In the case of foreign bidders, the eligibility requirements under Class "A" Documents (except for Tax Clearance) may be substituted by the appropriate equivalent documents, if any, issued by the country of the foreign bidder concerned. The eligibility requirements or statements, the bids, and all other documents to be submitted to the BAC must be in English. If the eligibility requirements or statements, the bids, and all other documents submitted to the BAC are in foreign language other than English, it must be accompanied by a translation of the documents in English. The documents shall be translated by the relevant foreign government agency, the foreign government agency authorized to translate documents, or a registered translator in the foreign bidder's country; and shall be authenticated by the appropriate Philippine foreign

service establishment/post or the equivalent office having jurisdiction over the foreign bidder's affairs in the Philippines.

These documents shall be accompanied by a Sworn Statement in a form prescribed by the GPPB stating that the documents submitted are complete and authentic copies of the original, and all statements and information provided therein are true and correct. Upon receipt of the said documents, the Philippines shall process the same in accordance with the guidelines on the Government of the Philippines – Official Merchants Registry (GoP-OMR).

3. A Bidder not submitting bid for reason that his cost estimate is higher than the set SAGR and/or ABC, is required to submit his letter of non-participation/regret supported by corresponding detailed estimates. Failure to submit the two (2) documents shall be understood as acts that tend to defeat the purpose of public bidding without valid reason as stated under Section 69.1.(i) of the revised IRR of R.A. 9184.

The prescribed documents in the checklist are mandatory to be submitted in the Bid, but shall be subject to the following:

- a. GPPB Resolution No. 09-2020 on the efficient procurement measures during a State of Calamity or other similar issuances that shall allow the use of alternate documents in lieu of the mandated requirements; or
- b. Any subsequent GPPB issuances adjusting the documentary requirements after the effectivity of the adoption of the PBDs.

The BAC shall be checking the submitted documents of each Bidder against this checklist to ascertain if they are all present, using a non-discretionary "pass/fail" criterion pursuant to Section 30 of the 2016 revised IRR of RA No. 9184.

Standard Form Number: NPCSF-GOODS-02

List of All Ongoing Government and Private Contracts Including Contract Awarded But Not Yet Started

			Bidder's Rol	е	a. Date Awarded	
Name of Contract/ Project Cost	a. Owner's Name b. Address c. Telephone Nos.	Nature of Work	Description	%	b. Date Started c. Date of Completion or Contract Duration/ Date of Delivery	Value of Outstanding Works / Undelivered Portion
<u>Government</u>						
<u>Private</u>						
	1	L	L		Total Cost	

The bidder shall declare in this form all his on-going government and private contracts including contracts where the bidder (either as individual or as a Joint Venture) is a partner in a Joint Venture agreement other than his current joint venture where he is a partner. Non declaration will be a ground for disqualification of bid.

Note: This statement shall be supported with the following documents for all the contract(s) stated above which shall be submitted during Post-qualification:

- 1. Contract/ PSA/ PPA
- 2. Certification coming from the project owner/client that the performance is satisfactory as of the bidding date.

Submitted by	: <u></u>	
		(Printed Name & Signature)
Designation	:	
Date	:	

SECTION VIII - BIDDING FORMS

Standard Form Number: NPCSF-GOODS-03

	The	Statement	of the	bidder's	s Sinale	Larges	t Com	pleted	Contract ((SLCC)	simila	r to t	he con	tract	to k	oe k	oid
--	-----	-----------	--------	----------	----------	--------	-------	--------	------------	--------	--------	--------	--------	-------	------	------	-----

Business Address :):		protou contrac	. (02 00)			
	a. Owner's Name			Contractor's F	Role	a.Amount at Award	a. Date Awarded
Name of Contract	b. Address c. Telephone Nos.	٨	lature of Work	Description	%	b.Amount at Completion c.Duration	b. Contract Effectivity c. Date Completed
Notes:							
(An	SLCC by of the following)				REC	QUIRMENTS	
	contract amount of at least 50% of the AB	C	Certified true copy of n	otarized PSA/ PPA, and C	ertificate of	Satisfactory Performance signed by	the Contracting Party
Completed Construction of contract amount of at least.	Any Power Plant (with ongoing PSA/ PPA 50% of the ABC	() with	Certified true copy of notarized Power Plant Construction Contract with Certificate of Compliance (COC) / Certificate of Acceptance/ Satisfactory Completion; and Certified true copy of ongoing PSA/ PPA, with Certificate of Satisfactory Performance signed by the Contracting Party				
Combination of two (2) simi of at least 50% of the ABC and a similar control of two similars.	lar contracts with an aggregate contract a as follows:	mount					
a.One (1) completed PSA/ PPA or Construction of Any Power Plant Contract (with ongoing PSA) with amount of at least 25% of the ABC;			For PSA/ PPA: • Certified true copy of notarized PSA/ PPA; and Certificate of Satisfactory Performance signed by the Contracting Party For Power Plant:				
and			Certified true copy of notarized Power Plant Construction Contract with Certificate of Compliance (COC) / Certificate of Acceptance/ Satisfactory Completion; and Certified true copy of Ongoing PSA/ PPA, with Certificate of Satisfactory Performance signed by the Contracting Party				
portion amounting to	ct (PSA/PPA of RE Facility only) with com at least 25% of the ABC, provided that t zed, and a certificate of satisfactory perfor the concerned PE	npleted of	Certified true copy of Ongoing PSA/ PPA, with Certificate of Satisfactory Performance signed by the Contracting Party for the RE Facility; and Certified true copy of Billing/ Official Receipt/s				
Submitted by :							
	(Printed Name & Signature	e)					
Designation :							
Date :							

SECTION VIII - BIDDING FORMS

Standard Form Number: NPCSF-GOODS-04

NET FINANCIAL CONTRACTING CAPACITY (NFCC)

A.	Summary of the Supplier's/Distributor's/Manufacturer's assets and liabilities on the basis
	of the income tax return and audited financial statement for the immediately preceding
	calendar year are:

		Year 20
1.	Total Assets	
2.	Current Assets	
3.	Total Liabilities	
4.	Current Liabilities	
5.	Net Worth (1-3)	
6.	Net Working Capital (2-4)	

B.	The Net Financial Contracting Capacity (NFCC) based on the above data is computed as
	follows:

NFCC = [(Current assets minus current liabilities) x 15] minus the value of all outstanding or uncompleted portions of the projects under ongoing contracts, including awarded contracts yet to be started coinciding with the contract for this Project.					
NFCC = P					
Construction cost or total capital investment for the RE Facility project = P					
Notes:					

- 1. NFCC shall be compared with the two (2) year construction cost or total capital investment for the RE Facility project (Pre-Construction and Construction Cost).
- 2. The details of the total construction cost shall be validated during post qualification

Herewith attached is certified true copy of the audited financial statement, stamped "RECEIVED" by the BIR or BIR authorized collecting agent for the immediately preceding calendar year.

Submitted by:
Name of Supplier / Distributor / Manufacturer
Signature of Authorized Representative
Date :

SECTION VIII - BIDDING FORMS

Standard Form Number: NPCSF-GOODS-05

JOINT VENTURE AGREEMENT

KNO	W ALI	- MEN B	Y THESE PRESENT	5:	
That			, of legal ag	je, <i>(civil status</i>	entered into by and between: b), authorized representative of
				- and –	
			, of legal age, a resident of	(civil status)	, authorized representative of
	ırces a	nd efforts	rties agree to join too to enable the Joint V Contract of the Natio	enture to parti	apital, manpower, equipment, and other cipate in the Bidding and Undertaking of proration.
		NAME	OF PROJECT		CONTRACT AMOUNT
	That	the capit	al contribution of eacl	h member firm	:
		NAM	IE OF FIRM		CAPITAL CONTRIBUTION
1.				P	
2.				₽	
be th do, e Biddi and i	Thate office of the courter of the c	t both partial Representations of the thick with th	ties agree that sentative/s of the Joir orm any and all acts it ting of the said contra- ent with full power of	nt Venture, and necessary and ct, as fully and substitution ar	and/or shall dare granted full power and authority to d/or to represent the Joint Venture in the effectively and the Joint Venture may do not revocation.
unui	ermina	ited by bo	th parties.		
•	Nan		ature of Authorized esentative	•	Name & Signature of Authorized Representative
;		Official	Designation		Official Designation
		Nam	ne of Firm		Name of Firm
1				Witnesses 2.	

[Jurat]

[Format shall be based on the latest Rules on Notarial Practice]

SECTION VIII - BIDDING FORMS

Standard Form Number: NPCSF-GOODS-06a

(Signature, Name and Address)

FORM OF BID SECURITY (BANK GUARANTEE)

	AS, (Name of Bidder)		(hereinafter called			
submitte	ed his bid dated <i>(Date)</i>	for the <i>[name of the line of the li</i>	of project] (hereinaft	er called "the Bid").		
of Count (hereina Entity") which pa	<u>ry)</u> Ifter called "the Bank" in the sum of <u>[amoun</u>	sents that We (Name of Bank) having our registered off are bound unto National Pow tin words & figures as preso to be made to the said Entity to see	<u>cribed in the Terms</u>	<u>of Reference]</u> for		
SEALE	O with the Common Se	eal of the said Bank this	_ day of	_ 20		
THE CC	ONDITIONS of this obli	gation are that:				
,	if the Bidder withdraw reference; or	s his Bid during the period o	f bid validity specifi	ed in the Terms of		
		ot accept the correction of a estructions to Bidder; or	arithmetical errors o	of his bid price in		
,) if the Bidder, having determined as the LCB, fails or refuses to submit the required tax clearance, latest income and business tax returns and PhilGEPs registration certificate within the prescribed period; or					
		en notified of the acceptance e period of bid validity:	of his bid and award	d of contract to him		
;	a) fails or refuses to e	execute the Contract; or				
	b) fails or refuses to s	submit the required valid JVA	, if applicable; or			
1	 fails or refuses to furnish the Performance Security in accordance with the Instructions to Bidders; 					
without note tha	the Entity having to s	tity up to the above amount u ubstantiate its demand, provi by it is due to the occurrence	ded that in his dem	nand the Entity will		
by the E	Entity, notice of which	orce up to 120 days after the o extension(s) to the Bank is he h the Bank not later than the a	ereby waived. Any			
DATE .		SIGNATURE OF THE BANK	<			
WITNES	SS	SEAL		-		

SECTION VIII - BIDDING FORMS

Standard Form Number: NPCSF-GOODS-06b

FORM OF BID SECURITY (SURETY BOND)

BOND	NO.:	_ DATE BOND EXECUTED:
Surety transa Nation in word of which	of (<u>Name</u> ct business in the Philippines (herei al Power Corporation (hereinafter o ds & figures as prescribed in the Te	(hereinafter called "the Principal") and (Name of of Country of Surety), authorized to inafter called "the Surety") are held and firmly bound unto called "the Employer") as Obligee, in the sum of (amount erms of Reference), callable on demand, for the payment e, we, the said Principal and Surety bind ourselves, our rally, firmly by these presents.
SEALE	ED with our seals and dated this	day of 20
		a written Bid to the Employer dated the day of (hereinafter called "the Bid").
NOW,	THEREFORE, the conditions of thi	is obligation are:
1)	if the Bidder withdraws his Bid du Reference; or	uring the period of bid validity specified in the Terms of
2)	if the Bidder does not accept the	he correction of arithmetical errors of his bid price in

- accordance with the Instructions to Bidder; or
- if the Bidder, having determined as the LCB, fails or refuses to submit the required tax 3) clearance, latest income and business tax returns and PhilGEPs registration certificate within the prescribed period; or
- if the Bidder having been notified of the acceptance of his bid and award of contract to him by the Entity during the period of bid validity:
 - d) fails or refuses to execute the Contract; or
 - e) fails or refuses to submit the required valid JVA, if applicable; or
 - fails or refuses to furnish the Performance Security in accordance with the Instructions to Bidders;

then this obligation shall remain in full force and effect, otherwise it shall be null and void.

PROVIDED HOWEVER, that the Surety shall not be:

- a) liable for a greater sum than the specified penalty of this bond, nor
- b) liable for a greater sum that the difference between the amount of the said Principal's Bid and the amount of the Bid that is accepted by the Employer.

Standard Form Number: NPCSF-GOODS-06b

Page 2 of 2

This Surety executing this instrument hereby agrees that its obligation shall be valid for 120 calendar days after the deadline for submission of Bids as such deadline is stated in the Instructions to Bidders or as it may be extended by the Employer, notice of which extension(s) to the Surety is hereby waived.

PRINCIPAL	SURETY
SIGNATURE(S)	SIGNATURES(S)
NAME(S) AND TITLE(S)	
	NAME(S)
SEAL	SEAL

SECTION VIII - BIDDING FORMS

Standard Form No: NPCSF-GOODS-06c REPUBLIC OF THE PHILIPPINES) CITY OF

BID-SECURING DECLARATION SUPPLY AND DELIVERY OF RENEWABLE ENERGY FOR THE HYBRIDIZATION OF DIESEL POWER PLANTS UNDER SCHEDULE III (CLUSTER 4A - PALAWAN)

To: **National Power Corporation** BIR Road cor. Quezon Ave. Diliman, Quezon City

I/We¹, the undersigned, declare that:

- 1. I/We understand that, according to your conditions, bids must be supported by a Bid Security, which may be in the form of a Bid-Securing Declaration.
- 2. I/We understand that this Bid-Securing Declaration shall be enforced/applied in accordance with Section 5 of the Guidelines on the use of Bid-Securing Declaration (Appendix 10 of RA 9184 IRR).
- 3. I/We accept that: (a) I/we will be automatically disqualified from bidding for any contract with any procuring entity for a period of two (2) years upon receipt of your Blacklisting Order; and, (b) I/we will pay the applicable fine provided under Section 6 of the Guidelines on the Use of Bid Securing Declaration, within fifteen (15) days from receipt of written demand by the procuring entity for the commission of acts resulting to the forfeiture of bid security under Sections 23.1(b), 34.2, 40.1 and 69.1, except 69.1 (f), of the IRR of RA 9184; without prejudice to other legal action the government may undertake.
- 4. I/We understand that this Bid-Securing Declaration shall cease to be valid on the following circumstances:
 - Upon expiration of the bid validity period, or any extension thereof pursuant to your a) request:
 - I am/we are declared ineligible or post-disqualified upon receipt of your notice to such effect, and (i) I/we failed to timely file a request for reconsideration or (ii) I/we filed a waiver to avail of said right;
 - I am/we are declared as the bidder with the Highest Rated Responsive Bid, and I/we have furnished the performance security and signed the Contract.

IN WITNESS V	WHEREOF , Philippines.	I/we have	hereunto	set my	hand	this	day of	20	_ at
			[Na		Auth	orized S	idder's Repres Signatory] gal capacity] nt	sentative/	_

¹Select one and delete the other. Adopt same instruction for similar terms throughout the document.

PR^{NO}. HO-PMD25-003

SECTION VIII - BIDDING FORMS

IN WITNESS WHEREOF, I/We have hereunto set my/our hand/s this ____ day of month] [year] at [place of execution].

[Insert NAME OF BIDDER'S AUTHORIZED REPRESENTATIVE] [Insert signatory's legal capacity]
Affiant SUBSCRIBED AND SWORN to before me this day of [month] [year] at [place of execution], Philippines. Affiant/s is/are personally known to me and was/were identified by me through competent evidence of identity as defined in the 2004 Rules on Notarial Practice (A.M. No. 02-8-13-SC). Affiant/s exhibited to me his/her [insert type of government identification card used], with his/her photograph and signature appearing thereon, with no
Witness my hand and seal this day of [month] [year].
NAME OF NOTARY PUBLIC

Serial No. of Commi	ssion
Notary Public for	until
Roll of Attorneys No)
PTR No, [date iss	ued], [place issued]
IBP No, [date issu	ued], [place issued]
Doc. No	
Page No	
Book No	
Series of	

Standard Form No: NPCSF-GOODS-07

Omnibus Sworn Statement (Revised)

REPUBLIC OF THE PHILIPPINES)
CITY/MUNICIPALITY OF	S.S

AFFIDAVIT

- I, [Name of Affiant], of legal age, [Civil Status], [Nationality], and residing at [Address of Affiant], after having been duly sworn in accordance with law, do hereby depose and state that:
- 1. [Select one, delete the other:]

[If a sole proprietorship:] I am the sole proprietor or authorized representative of [Name of Bidder] with office address at [address of Bidder];

[If a partnership, corporation, cooperative, or joint venture:] I am the duly authorized and designated representative of [Name of Bidder] with office address at [address of Bidder]:

2. [Select one, delete the other:]

[If a sole proprietorship:] As the owner and sole proprietor, or authorized representative of [Name of Bidder], I have full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for [Name of the Project] of the [Name of the Procuring Entity], as shown in the attached duly notarized Special Power of Attorney;

Ilf a partnership, corporation, cooperative, or joint venture:] I am granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for [Name of the Project] of the [Name of the Procuring Entity], as shown in the attached [state title of attached document showing proof of authorization (e.g., duly notarized Secretary's Certificate, Board/Partnership Resolution, or Special Power of Attorney, whichever is applicable;)];

- 3. [Name of Bidder] is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units (LGUs), foreign government/foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board, by itself or by relation, membership, association, affiliation, or controlling interest with another blacklisted person or entity as defined and provided for in the Uniform Guidelines on Blacklisting;
- 4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
- 5. [Name of Bidder] is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;
- 6. [Select one, delete the rest:]

Ilf a sole proprietorship:] The owner or sole proprietor is not related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;

[If a partnership or cooperative:] None of the officers and members of [Name of Bidder] is related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management

CHEDULE III (CLUSTER 4A - PALAWAN)
PR NO. HO-PMD25-003

Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;

[If a corporation or joint venture:] None of the officers, directors, and controlling stockholders of [Name of Bidder] is related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;

- 7. [Name of Bidder] complies with existing labor laws and standards; and
- 8. [Name of Bidder] is aware of and has undertaken the responsibilities as a Bidder in compliance with the Philippine Bidding Documents, which includes:
 - a. Carefully examining all of the Terms of Reference;
 - b. Acknowledging all conditions, local or otherwise, affecting the implementation of the Contract:
 - c. Making an estimate of the facilities available and needed for the contract to be bid, if any; and
 - d. Inquiring or securing Supplemental/Bid Bulletin(s) issued for the [Name of the Project].
- 9. [Name of Bidder] did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.
- 10. In case advance payment was made or given, failure to perform or deliver any of the obligations and undertakings in the contract shall be sufficient grounds to constitute criminal liability for Swindling (Estafa) or the commission of fraud with unfaithfulness or abuse of confidence through misappropriating or converting any payment received by a person or entity under an obligation involving the duty to deliver certain goods or services, to the prejudice of the public and the government of the Philippines pursuant to Article 315 of Act No. 3815 s. 1930, as amended, or the Revised Penal Code.

IN WITNESS WHEREOF, I hav	e hereunto set my hand this	day of	, 20	at	,
Philippines.	-				

[Insert NAME OF BIDDER OR ITS AUTHORIZED REPRESENTATIVE]
[Insert signatory's legal capacity]
Affiant

[Jurat]

[Format shall be based on the latest Rules on Notarial Practice]

Standard Form No: NPCSF-GOODS-08

BID LETTER

		Date:
To:	THE PRESIDENT National Power Corporation BIR Road cor. Quezon Ave. Diliman, Quezon City	
Gentle	emen:	
number perform DIESE with the	ers], the receipt of which is hereby duly m SUPPLY AND DELIVERY OF RENEWAE IL POWER PLANTS UNDER SCHEDULE	nce including Bid Bulletin Numbers [inserty acknowledged, we, the undersigned, offer to BLE ENERGY FOR THE HYBRIDIZATION OF III (CLUSTER 4A – PALAWAN) in conformity ofand computed cost of energy of Php
service		pply and deliver the goods and perform other and in accordance with the scope of the contract chnical Specifications.
	f our Bid is accepted, we undertake to provice thin the times specified in the Terms of Refe	le a performance security in the form, amounts, rence.
	I remain binding upon us and may be acce	dity Period specified in Terms of Reference and epted at any time before the expiration of that
	Until a formal Contract is prepared and e tance thereof and your Notice of Award, shall	executed, this Bid, together with your written
may re		cept the Lowest Calculated Bid or any Bid you
\ Refere	•	ligibility requirements pursuant to the Terms of
sole prand au latter's corpora	roprietor or authorized representative of [Name uthority to participate, submit the bid, and to behalf for the [Name of Project] of tions, cooperatives, or joint ventures, insert: is grant to participate, submit the bid, and to	ed, [for sole proprietorships, insert: as the owner and e of Bidder] has the full power sign and execute the ensuing contract, on the the National Power Corporation[for partnerships, ted full power and authority by the [Name of Bidder] to sign and execute the ensuing contract on the the National Power Corporation.
		nd every page of this Bid Letter, including the edule), shall be a ground for the rejection of our
	[name and signature of authorized signatory]	[in the capacity of]
Duly a	uthorized to sign Bid for and on behalf of	

[name of bidder]

SECTION VIII - BIDDING FORMS SCHEDULE OF PRICES

SCHEDULE III: Cluster 4A - PALAWAN, ABC=Php960M, CY2025 SAGR = Php7.3900/kWh

DECODIDEION	OFFER (Up to 4 decimal		l places)	
DESCRIPTION	UNIT	(IN WORDS)	(IN FIGURES)	
i. TARIFF RATE	(Php/kWh)			
B. TOTAL ANNUAL GENERATION (MAG _{REPP}) (From Technical Data Sheet)	kWh			
C. COMPUTED ANNUAL GENERATION COST (CAGC) = A x B	Php			
D. COST OF ENERGY FOR TWENTY (20) YEARS = C X 20	Php			
E. TOTAL RE PROJECT COST	Php			
Name of Firm N	ame & Signat	ure of Authorized Representative Designation		
INAME OF FIRM	ame & Signat	ule of Authorized Nepresentative Designation		

- Note: 1. The bid price offer in words shall prevail in case of discrepancy.
 - 2. Tariff Rate is capped at CY2025 SAGR as specified above and any offer exceeding the cap will be ground for disqualification.
 - 3. The CAGC is the basis in determining the Highest Rated Bid (HRB).
 - 4. The cost of energy for twenty (20) years exceeding the ABC will be grounds for disqualification.
 - 5. The Total RE Project Cost shall be used as reference for NFCC.

Bank Guarantee Form for Advance Payment

To: THE PRESIDENT

National Power Corporation Gabriel Y. Itchon Building Sen. Miriam P. Defensor-Santiago Blvd. (formerly BIR Road) corner Quezon Avenue Diliman, Quezon City, Philippines 1100

[name of Contract]

Gentlemen and/or Ladies:

In accordance with the Advance Payment Provision, of the General Conditions of Contract, [name and address of Supplier] (hereinafter called the "Supplier") shall deposit with the PROCURING ENTITY a bank guarantee to guarantee its proper and faithful performance under the said Clause of the Contract in an amount of famount of quarantee in figures and words1.

We, the [name of the universal/commercial bank], as instructed by the Supplier, agree unconditionally and irrevocably to guarantee as primary obligator and not as surety merely, the payment to the PROCURING ENTITY on its first demand without whatsoever right of objection on our part and without its first claim to the Supplier, in the amount not exceeding famount of guarantee in figures and words].

We further agree that no change or addition to or other modification of the terms of the Contract to be performed thereunder or of any of the Contract documents which may be made between the PROCURING ENTITY and the Supplier, shall in any way release us from any liability under this guarantee, and we hereby waive notice of any such change, addition, or modification.

This guarantee shall remain valid and in full effect from the date the advance payment is received by the Supplier under the Contract and until the Goods are accepted by the PROCURING ENTITY.

	Yo	urs	tru	ıΙν	١.
--	----	-----	-----	-----	----

[name of bank or financial institution	
[address]	
[date]	

Signature and seal of the Guarantors

CERTIFICATION AS A DOMESTIC BIDDER

This is to certify that based on the records of this	office, (Name of Bidder) is
duly registered with the DTI on	
This further certifies that the articles forming part	of the product of <u>(Name of Bidder)</u> .
which are/is (Specify)	are substantially composed of
articles, materials, or supplies grown, produced or ma	anufactured in the Philippines. (Please
encircle the applicable description/s).	
This certification is issued upon the request of (Na	me of Person/Entity) in connection with his
intention to participate in the bidding for the (Name of Project	<u>ot)</u> of
the National Power Corporation (NPC).	
Given this day of20 at	, Philippines
	Name
	Position
	Department of Trade & Industry

SECTION IX - APPENDICES


SECTION	DESCRIPTION	PAGE
Appendix A	Cluster Details	IX-A-2
Appendix B	Cluster Location Map	IX-A-3
Appendix C	Load & Demand Curve	IX-A-4
Appendix D	Distribution System Single Line Diagram	IX-A-101
Appendix E	Renewable Energy Project Cost Reference	IX-A-110

APPENDIX A CLUSTER DETAILS

SPUG POWER PLANTS		TAL CITIES	GRID PEAK LOAD (MW) of 25	Projected 2024 Peak	ECs/DUs/NPC	SAGR	TCGR Forecast	ABC
	RATED	DEP	March 2023	Demand (MW)		CY 2024	CY 2024 (with RORB)	
CLUSTER 4A (PALAWAN)	7.605	6.420		3.734		7.3900		50,000,000.00
1 CUYO DPP	3.200	2.350	1.4620	1.606	PALECO	7.3900	35.3486	
2 RIZAL DPP	1.465	1.370	0.7180	0.852	PALECO	7.3900	32.2043	
3 SAN VICENTE DPP, PAL	2.300	2.100	0.8570	0.940	PALECO	7.3900	33.4822	
4 BITON DPP	0.080	0.080	0.0140	0.021	Provincial Government of Palawan	7.3900	89.3473	
5 CASIAN DPP	0.140	0.140	0.0420	0.059	Provincial Government of Palawan	7.3900	47.9227	
6 PALY DPP	0.080	0.080	0.0470	0.061	Provincial Government of Palawan	7.3900	33.8063	
7 NANGALAO DPP	0.140	0.140	0.0600	0.087	BISELCO	7.3900	37.4124	
8 PANLAITAN DPP	0.100	0.080	0.0790	0.096	BISELCO	7.3900	28.4442	
9 TARA DPP	0.100	0.080	0.0070	0.013	BISELCO	7.3900	28.0928	·

APPENDIX B

CLUSTER LOCATION MAP

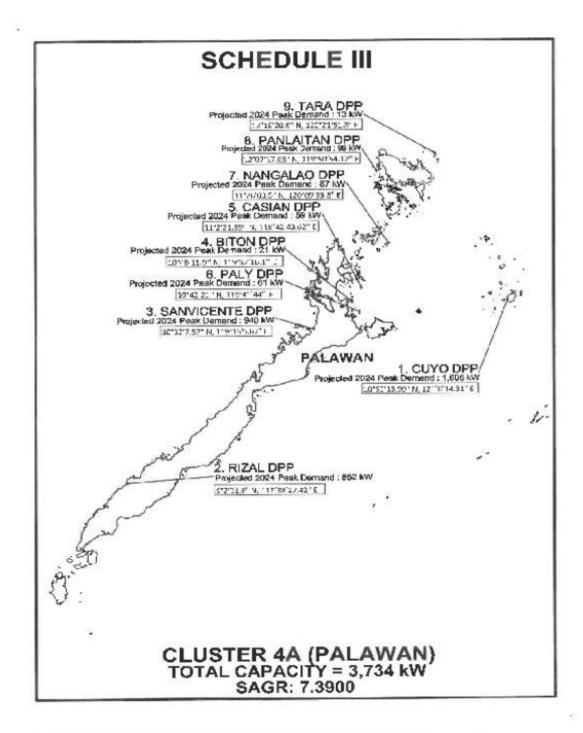

ENDICES PR NO. HO-PMD25-003

APPENDIX C LOAD AND DEMAND CURVE


National Power Corporation SMALL POWER UTILITIES GROUP



LOAD AND DEMAND CURVE

Cuyo Diesel Power Plant

December 25, 2023 to January 25, 2024

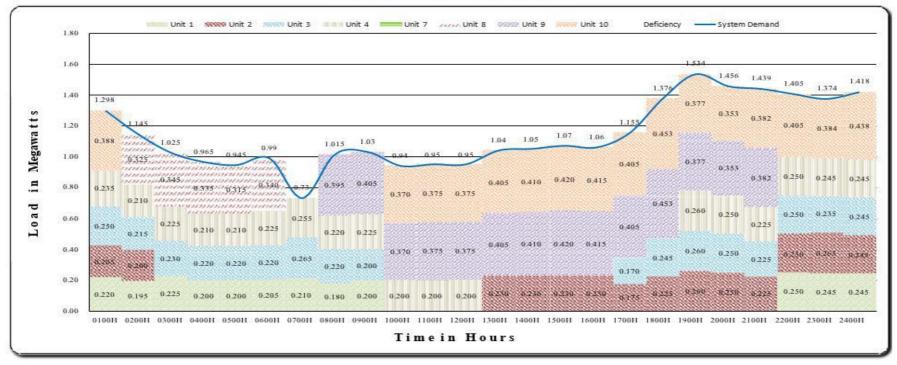

0100F	020	00H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	132	58		E 9	C 0	8 3	0 5	8 8	(C) (C)	9 25	TO	TAL CA	PABILI	TY		8 -	0	33	S) 20	133	- 33	- 8	A to	
3.100	3.	100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100
200000000000000000000000000000000000000											SY	STEM	DEMAN	ID										
1.298	1.	145	1.025	0.965	0.945	0.990	0.730	1.015	1.030	0.940	0.950	0.950	1.040	1.050	1.070	1.060	1.155	1.376	1.534	1.456	1.439	1.405	1.374	1.418
	- CX	7/2				0		70	50 50		RESE	RVED /	DEFIC	ENCY	n :			VI	50 50		10	- 55		
1.802	1.9	955	2.075	2.135	2.155	2.110	2.370	2.085	2.070	2.160	2.150	2.150	2.060	2.050	2.030	2.040	1.945	1.724	1.566	1.644	1.661	1.695	1.726	1.682

SECTION IX - APPENDICES

PR NO. HO-PMD25-003


National Power Corporation SMALL POWER UTILITIES GROUP



LOAD AND DEMAND CURVE

Cuyo Diesel Power Plant

January 25 to February 25, 2024

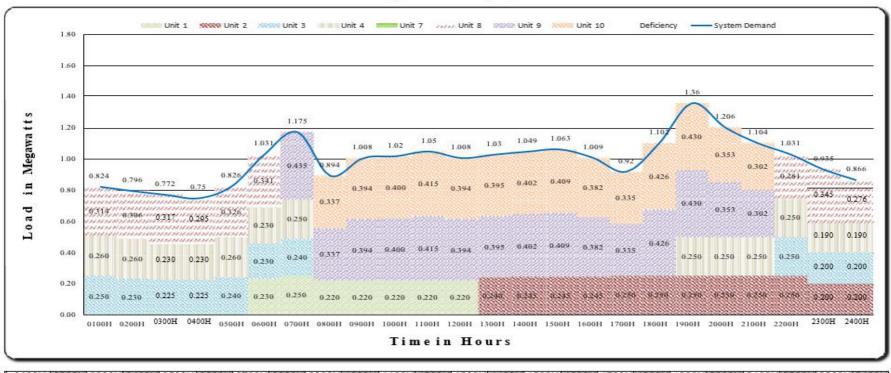

0100H | 0200H | 0300H | 0400H | 0500H | 0600H | 0700H | 0800H | 0900H | 1000H | 1100H | 1200H | 1300H | 1400H | 1500H | 1600H | 1700H | 1800H | 1900H | 2000H | 2100H | 2200H | 2300H | 2400H | 1000H | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100

SECTION IX – APPENDICES

PR NO. HO-PMD25-003


National Power Corporation SMALL POWER UTILITIES GROUP

Revised November 2001

LOAD AND DEMAND CURVE

Cuyo Diesel Power Plant

February 25 to March 25, 2024

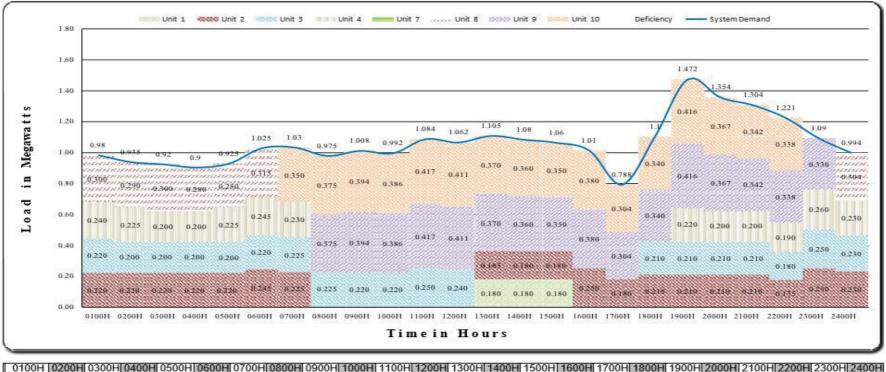

0100H | 0200H | 0300H | 0400H | 0500H | 0600H | 0700H | 0800H | 0900H | 1000H | 1100H | 1200H | 1300H | 1400H | 1500H | 1600H | 1700H | 1800H | 1900H | 2000H | 2100H | 2200H | 2300H | 2400H | 1000H | 2000H | 2100H | 2300H | 2400H | 1000H | 2100H | 2300H | 2400H | 1000H | 1000H

SECTION IX - APPENDICES

PR NO. HO-PMD25-003


National Power Corporation SMALL POWER UTILITIES GROUP

Revised November 2001

LOAD AND DEMAND CURVE

Cuyo Diesel Power Plant

March 25 to April 25, 2024

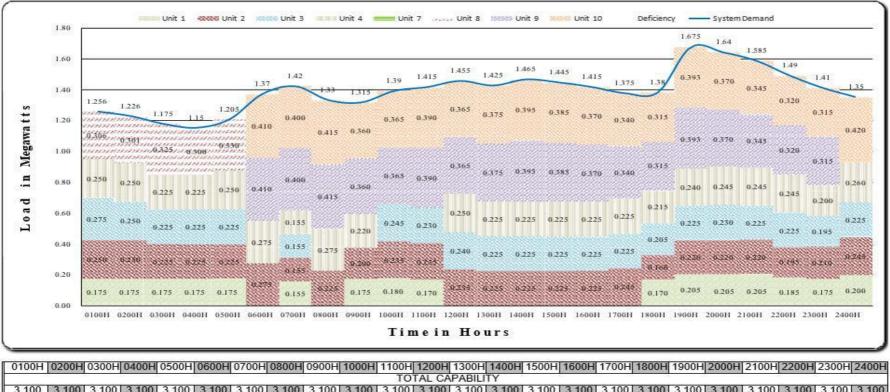

0100H | 0200H | 0300H | 0400H | 0500H | 0600H | 0700H | 0800H | 0900H | 1000H | 1100H | 1200H | 1300H | 1400H | 1500H | 1600H | 1700H | 1800H | 1900H | 2000H | 2100H | 2200H | 2300H | 2400H | TOTAL CAPABILITY

3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.10

SECTION IX – APPENDICES

PR NO. HO-PMD25-003


National Power Corporation SMALL POWER UTILITIES GROUP

Revised November 2001

LOAD AND DEMAND CURVE

Cuyo Diesel Power Plant

April 25 to May 25, 2024

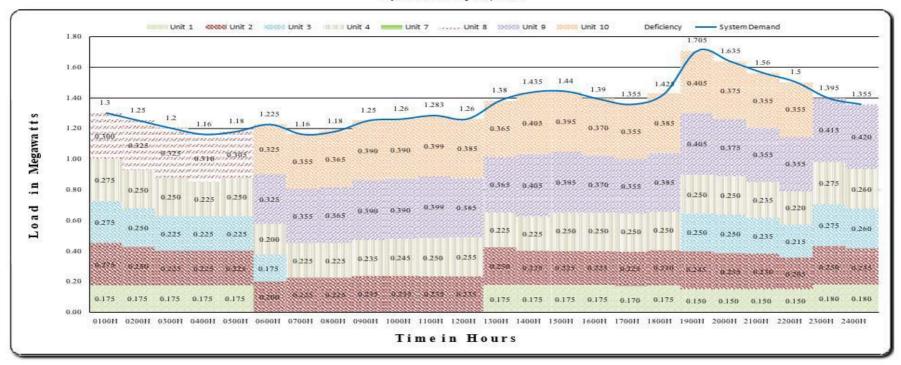

0100H | 0200H | 0300H | 0400H | 0500H | 0600H | 0700H | 0800H | 0900H | 1000H | 1100H | 1200H | 1300H | 1400H | 1500H | 1600H | 1700H | 1800H | 1900H | 2000H | 2100H | 2200H | 2300H | 2400H | 1000H | 2000H | 2100H | 2200H | 2300H | 2400H | 1000H | 1000H


National Power Corporation SMALL POWER UTILITIES GROUP

Revised November 2001

LOAD AND DEMAND CURVE

Cuyo Diesel Power Plant

May 25 to June 25, 2024

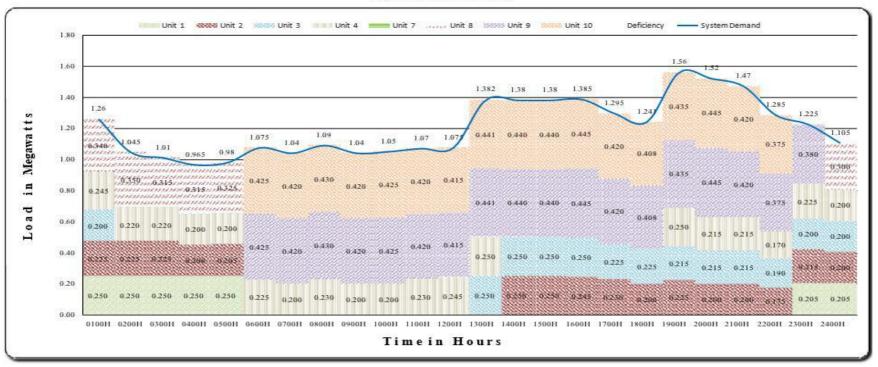

0100H | 0200H | 0300H | 0400H | 0500H | 0600H | 0700H | 0800H | 0900H | 1000H | 1100H | 1200H | 1300H | 1400H | 1500H | 1600H | 1700H | 1800H | 1900H | 2000H | 2100H | 2200H | 2300H | 2400H | 1000H | 2100H | 2200H | 2300H | 2400H | 1000H | 1000H

SECTION IX – APPENDICES

PR NO. HO-PMD25-003


National Power Corporation SMALL POWER UTILITIES GROUP

Revised November 2001

LOAD AND DEMAND CURVE

Cuyo Diesel Power Plant

June 25 to July 25, 2024

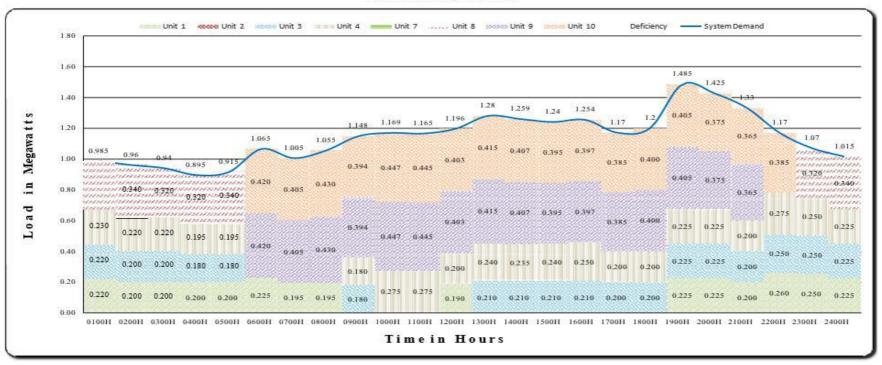

0100H | 0200H | 0300H | 0400H | 0500H | 0600H | 0700H | 0800H | 0900H | 1000H | 1100H | 1200H | 1300H | 1400H | 1500H | 1600H | 1700H | 1800H | 1900H | 2000H | 2100H | 2200H | 2300H | 2400H | 1000H | 1000H


National Power Corporation SMALL POWER UTILITIES GROUP

Revised November 2001

LOAD AND DEMAND CURVE

Cuyo Diesel Power Plant

July 25 to August 25, 2024

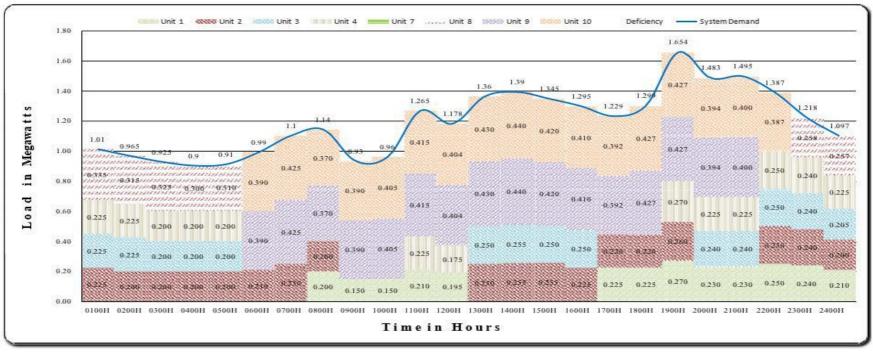

0100H	1 020)0H	0300F	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	-56	207		100	93 3	8 -	8:	93 39	- 3		TO	TAL CA	PABILI	TY		8 .	8:	100	- 55		b 51	S 50		00 0
3.100	3.1	100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100
											SY	STEM	DEMAN	ID	CARLON WATER	0.642.05133333703								
1.010	0.9	65	0.925	0.900	0.910	0.990	1.100	1.140	0.930	0.960	1.265	1.178	1.360	1.390	1.345	1.295	1.229	1.299	1.654	1.483	1.495	1.387	1.218	1.097
2											RESE	RVED /	DEFIC	ENCY										
2.090	2.1	35	2.175	2.200	2.190	2.110	2.000	1.960	2.170	2.140	1.835	1.922	1.740	1.710	1.755	1.805	1.871	1.801	1.446	1.617	1.605	1.713	1.882	2.003


National Power Corporation SMALL POWER UTILITIES GROUP

Revised November 2001

LOAD AND DEMAND CURVE

Cuyo Diesel Power Plant

August 25 to September 25, 2024

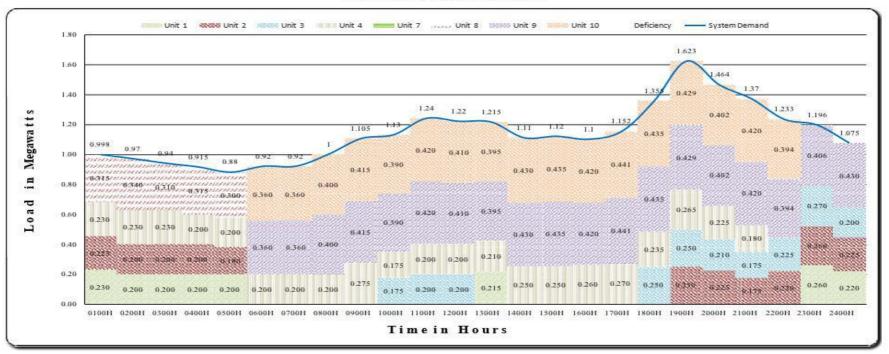

0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	6 3		8 - 3		82	87 38	.00			TO	TAL CA	PABILI	TY	8:	20	87 18	- 33		3	Y	6 3		85
3.100	3.100	3.100	3.100	3.100	3.100	3,100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100
	gc - 19		8 8	8:	55	(5) (5)	222			SY	STEM	DEMAN	ID.	85	33	SC 36							25
0.998	0.970	0.940	0.915	0.880	0.920	0.920	1.000	1.105	1.130	1.240	1.220	1.215	1.110	1.120	1.100	1.152	1.355	1.623	1.464	1.370	1.233	1.196	1.075
V1945AA 1945A			orana anaman	1.0000000000000000000000000000000000000						RESER	RVED /	DEFICI	ENCY	ra contrato de contrato	0.0000000000000000000000000000000000000	-0.000							With the second
2.102	2.130	2.160	2.185	2.220	2.180	2.180	2.100	1.995	1.970	1.860	1.880	1.885	1.990	1.980	2.000	1.948	1.745	1.477	1.636	1.730	1.867	1.904	2.025


NATIONAL POWER CORPORATION IX-A-13

SECTION IX - APPENDICES

PR NO. HO-PMD25-003

IX-A-14


National Power Corporation SMALL POWER UTILITIES GROUP



LOAD AND DEMAND CURVE

Cuyo Diesel Power Plant

September 25 to October 25, 2024

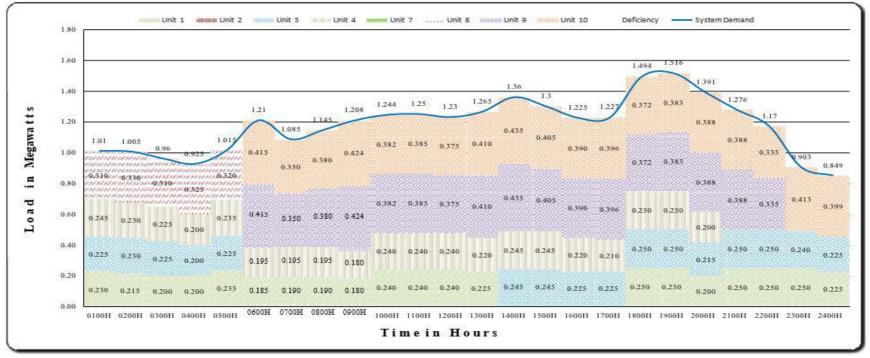

0100F	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	103	10	90	0.	93 32					TO	TAL CA	PABILI	TY	(S)	300 200				E 5	99 8	23	53	20
3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100	3.100
						- A 200 A 100 A 200 A				SY	STEM	DEMAN	ID										
1.010	1.005	0.960	0.925	1.015	1.210	1.085	1.145	1.208	1.244	1.250	1.230	1.265	1.360	1.300	1.225	1.227	1.494	1.516	1.391	1.276	1.170	0.903	0.849
	**	8	X/S	50		145				RESE	RVED /	DEFIC	ENCY	50.		115	70					AS	50
2.090	2.095	2.140	2.175	2.085	1.890	2.015	1.955	1.892	1.856	1.850	1.870	1.835	1.740	1.800	1.875	1.873	1.606	1.584	1.709	1.824	1.930	2.197	2.251

SECTION IX – APPENDICES

PR NO. HO-PMD25-003


National Power Corporation SMALL POWER UTILITIES GROUP

Revised November 2001

LOAD AND DEMAND CURVE

Cuyo Diesel Power Plant

October 25 to November 25, 2024

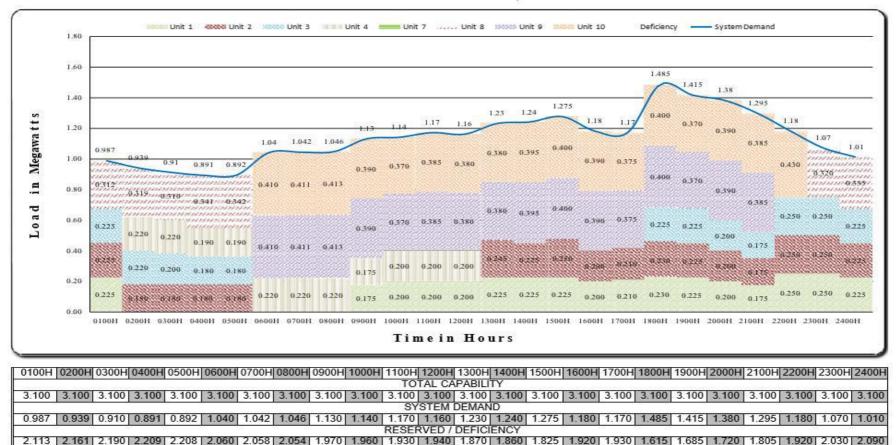

NATIONAL POWER CORPORATION IX-A-15

SECTION IX - APPENDICES

PR NO. HO-PMD25-003


National Power Corporation SMALL POWER UTILITIES GROUP

Revised November 2001

LOAD AND DEMAND CURVE

Cuyo Diesel Power Plant

November 25 to December 25, 2024

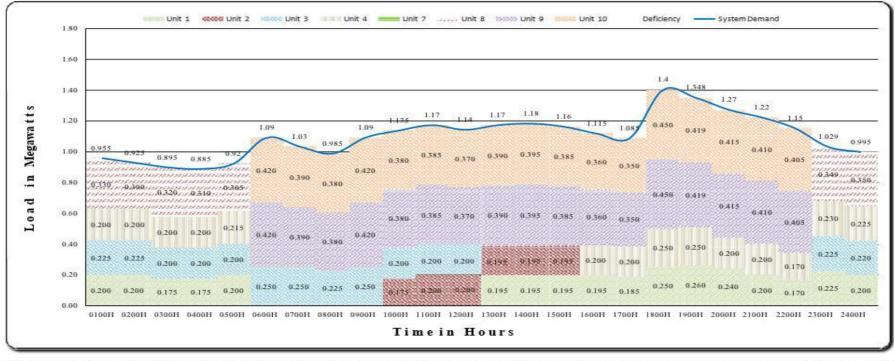

0100H | 0200H | 0300H | 0400H | 0500H | 0600H | 0700H | 0800H | 0900H | 1000H | 1100H | 1200H | 1300H | 1400H | 1500H | 1600H | 1700H | 1800H | 1900H | 2000H | 2100H | 2200H | 2300H | 2400H | TOTAL CAPABILITY

3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.100 | 3.10


National Power Corporation


SMALL POWER UTILITIES GROUP

RIZAL DIESEL POWER PLANT

December 25, 2023 - January 25, 2024



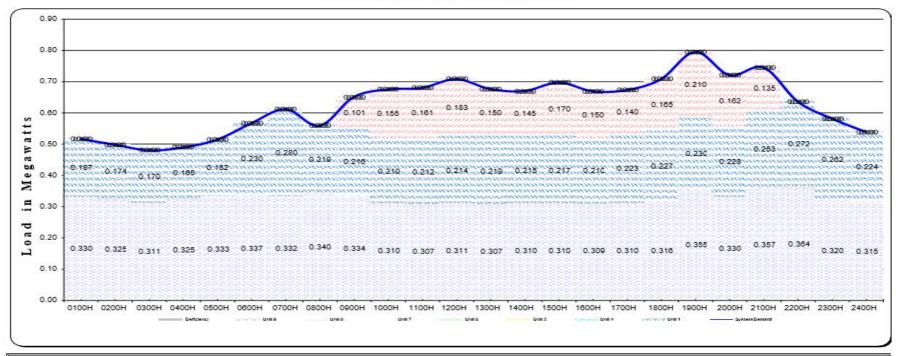



SECTION IX - APPENDICES

PR NO. HO-PMD25-003


National Power Corporation

SMALL POWER UTILITIES GROUP

RIZAL DIESEL POWER PLANT

January 25, 2023 - February 25, 2024



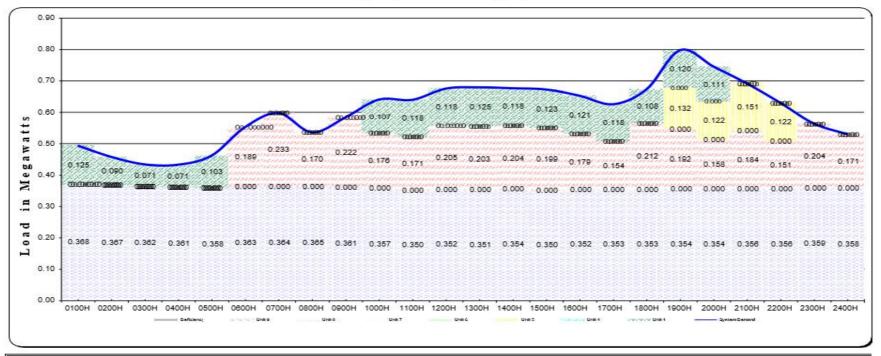

0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
2	25	(4)		9 9	St	2:	50 13			TOTA	AL CA	PABI	LITY		70 S	¢.	52 33		9		25	(4)	š 3
1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370
	891	51 198				991	700 30			SYS	TEM	DEM	AND		3	9	91 198				991	Sec	ķ
0.493	0.457	0.433	0.432	0.461	0.552	0.597	0.535	0.583	0.640	0.639	0.675	0.679	0.676	0.672	0.652	0.625	0.673	0.798	0.745	0.691	0.629	0.563	0.529
						Con Con	C		RE	SERV	ED /	DEFI	CIENO	Y)			S						
0.877	0.913	0.937	0.938	0.909	0.818	0.773	0.835	0.787	0.730	0.731	0.695	0.691	0.694	0.698	0.718	0.745	0.697	0.572	0.625	0.679	0.741	0.807	0.841


National Power Corporation

SMALL POWER UTILITIES GROUP

RIZAL DIESEL POWER PLANT

February 25, 2023 - March 25, 2024



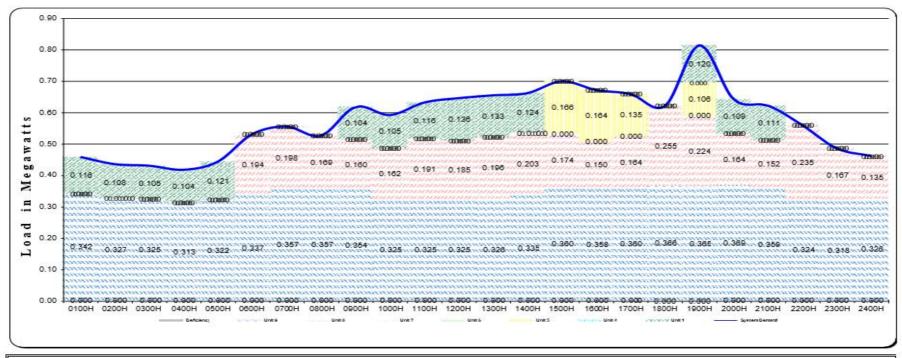

G-1 00				20 00									2.						0.0				
0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	H0060	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
										TOTA	AL CA	PABI	LITY						00 00				
1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370
	SYSTEM DEMAND															6							
0.458	0.435	0.430	0.417	0.443	0.531	0.555	0.526	0.618	0.592	0.632	0.646	0.655	0.862	0.700	0.672	0.659	0.621	0.815	0.642	0.622	0.559	0.485	0.461
3									RE	SERV	/ED/	DEFI	CIENC	Y)									
0.912	0.935	0.940	0.953	0.927	0.839	0.815	0.844	0.752	0.778	0.738	0.724	0.715	0.708	0.870	0.698	0.711	0.749	0.555	0.728	0.748	0.811	0.885	0.909

SECTION IX – APPENDICES

PR NO. HO-PMD25-003


National Power Corporation

SMALL POWER UTILITIES GROUP

RIZAL DIESEL POWER PLANT

March 25, 2023 - April 25, 2024



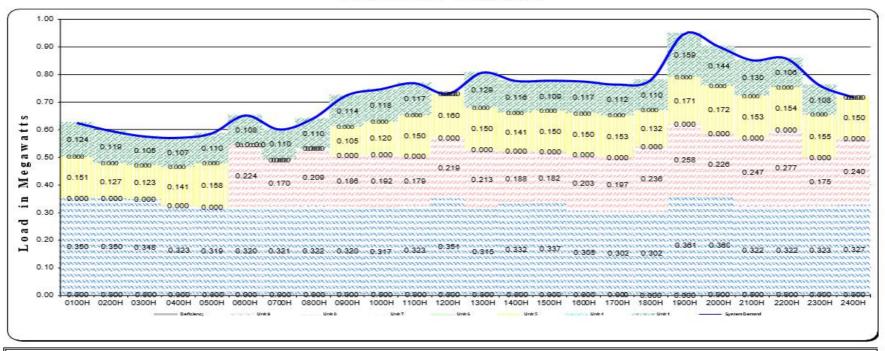

							-	0-1															
0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
					- 25					TOTA	AL CA	PABI	LITY		- 20				.0				20
1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370
	SYSTEM DEMAND																						
0.625	0.596	0.576	0.571	0.587	0.652	0.601	0.641	0.725	0.747	0.769	0.730	0.807	0.777	0.778	0.775	0.764	0.780	0.949	0.902	0.852	0.859	0.761	0.717
85 86	5 35			(a) (a)					RE	SERV	/ED/	DEFI	CIENC	Y)					25 256	- 50	5 36		85
0.745	0.774	0.794	0.799	0.783	0.718	0.769	0.729	0.645	0.623	0.601	0.640	0.563	0.593	0.592	0.595	0.606	0.590	0.421	0.468	0.518	0.511	0.609	0.653

SECTION IX - APPENDICES


PR NO. HO-PMD25-003


National Power Corporation

SMALL POWER UTILITIES GROUP

RIZAL DIESEL POWER PLANT

April 25, 2023 - May 25, 2024



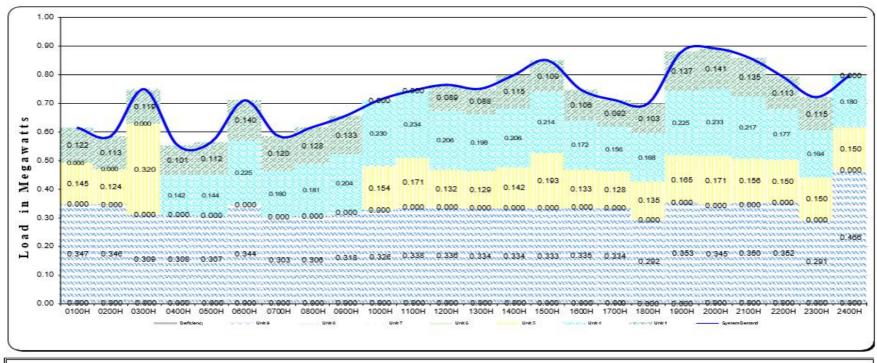

(4)	9	6 3	80 86	100	2 30		50 5				9	85 5	8 86		100		x 5		93 30		9		an 3
0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	0 0	: :	St. (40)				2: :	(0)	- 400	TOTA	AL CA	PABI	LITY	-00		. 52	: 6		(c) (c)		0 0		600 36
1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370
	SYSTEM DEMAND															- 8							
0.614	0.583	0.748	0.551	0.563	0.709	0.583	0.615	0.655	0.710	0.743	0.763	0.749	0.797	0.849	0.746	0.710	0.698	0.880	0.890	0.858	0.792	0.720	0.798
									RE	SERV	ED /	DEFI	CIENC	Y)					•				(8)
0.758	0.787	0.622	0.819	0.807	0.661	0.787	0.755	0.715	0.660	0.627	0.607	0.621	0.573	0.521	0.624	0.860	0.872	0.490	0.480	0.512	0.578	0.650	0.574

PR NO. HO-PMD25-003


National Power Corporation

SMALL POWER UTILITIES GROUP

RIZAL DIESEL POWER PLANT

May 25, 2023 - June 25, 2024



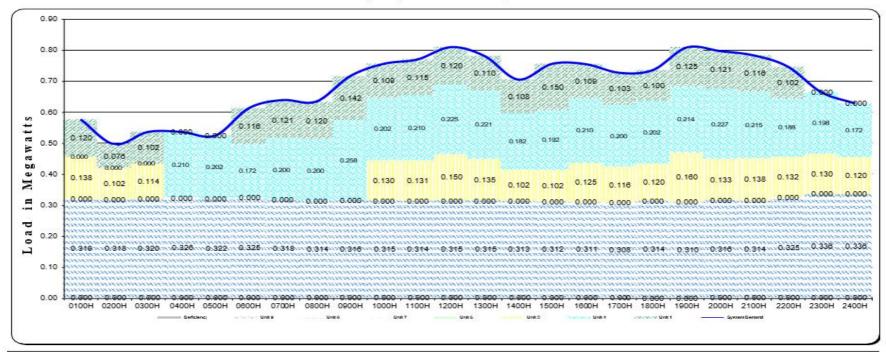

																							(8)
0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
										TOTA	AL CA	PABI	LITY										(8)
1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370
										SYS	TEM	DEM	AND										
0.577	0.496	0.536	0.536	0.524	0.613	0.639	0.634	0.716	0.756	0.770	0.810	0.781	0.705	0.758	0.755	0.727	0.738	0.809	0.797	0.783	0.747	0.864	0.628
	8		8. 38	-22		9 9	in the second	č. (2)	RE	SERV	/ED/	DEFI	CIENO	: Y)		9 9	je :	č-					S. S.
0.793	0.874	0.834	0.834	0.846	0.757	0.731	0.736	0.654	0.614	0.600	0.560	0.589	0.665	0.614	0.615	0.643	0.634	0.561	0.573	0.587	0.623	0.708	0.742

PR NO. HO-PMD25-003


National Power Corporation

SMALL POWER UTILITIES GROUP

RIZAL DIESEL POWER PLANT

June 25, 2023 - July 25, 2024



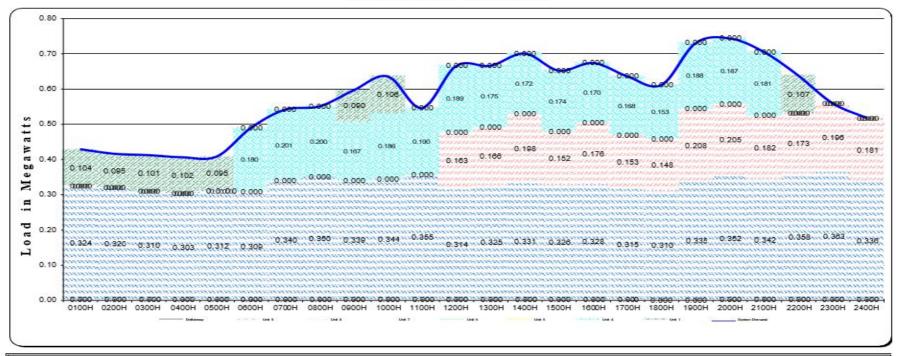

0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
			CO 1/2	-			0	91 = 10		TOTA	AL CA	PABI	LITY					500 300				381	
1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370
			55 65					50 60		SYS	TEM	DEM	AND	- 19					- 10				
0.428	0.415	0.411	0.405	0.407	0.489	0.541	0.550	0.598	0.636	0.545	0.666	0.666	0.701	0.652	0.674	0.636	0.611	0.731	0.744	0.705	0.638	0.559	0.517
	9 8							Ar 20	RE	SERV	/ED/	DEFI	CIENO	: Y)				S. 1.4			· ·	00	
0.942	0.955	0.959	0.965	0.963	0.881	0.829	0.820	0.774	0.734	0.825	0.704	0.704	0.669	0.718	0.696	0.734	0.759	0.639	0.626	0.665	0.732	0.811	0.853

PR NO. HO-PMD25-003


National Power Corporation

SMALL POWER UTILITIES GROUP

RIZAL DIESEL POWER PLANT

July 25, 2023 - August 25, 2024



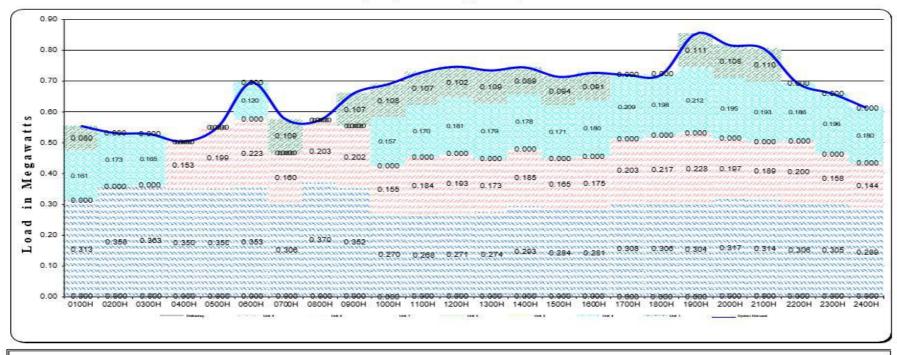


0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
Ĭ										TOTA	LCA	PABI	LITY										0
1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370
	20 00	8 8	0 105	400			8 8		- 23	SYS	TEM	DEM	AND				0 0		(C) (C)		8 8	8	20 00
0.554	0.531	0.528	0.503	0.549	0.696	0.575	0.573	0.661	0.690	0.729	0.747	0.735	0.745	0.714	0.727	0.720	0.721	0.855	0.817	0.806	0.692	0.659	0.613
	# #		VI NEE	510			Se 3.	100	RE	SERV	'ED / (DEFI	CIENC	: Y)				12	E6 7/2				0.7
0.816	0.839	0.842	0.867	0.821	0.674	0.795	0.797	0.709	0.680	0.641	0.623	0.635	0.625	0.656	0.643	0.650	0.649	0.515	0.553	0.564	0.678	0.711	0.757


National Power Corporation

SMALL POWER UTILITIES GROUP

RIZAL DIESEL POWER PLANT

August 25, 2023 - September 25, 2024



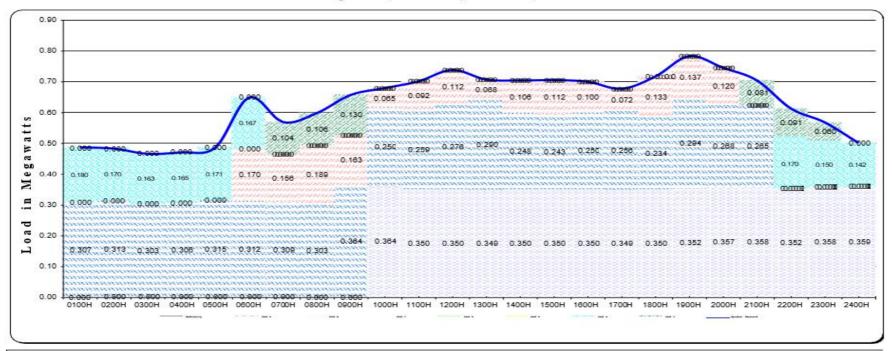

0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	24	(4) 39	5 20	2	ÇC :	90-	92 33			TOTA	AL CA	PABI	LITY	0 0	70 S	e.	22 22				245	(4)	ř.
1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370
	99	S-1 - 18				80	30 30			SYS	TEM	DEM	AND		3		St 188				59		ŝ.
0.487	0.483	0.466	0.471	0.486	0.649	0.569	0.598	0.657	0.679	0.701	0.738	0.707	0.704	0.705	0.700	0.677	0.717	0.783	0.745	0.704	0.613	0.568	0.501
			× 0		2	Kana -			RE	SERV	/ED/	DEFI	CIENO	Y)	0 9	in and a second					(C)		
0.883	0.887	0.904	0.899	0.884	0.721	0.801	0.772	0.713	0.691	0.669	0.632	0.663	0.888	0.665	0.670	0.693	0.653	0.587	0.625	0.666	0.757	0.802	0.869

PR NO. HO-PMD25-003


National Power Corporation

SMALL POWER UTILITIES GROUP

RIZAL DIESEL POWER PLANT

September 25, 2023 - October 25, 2024



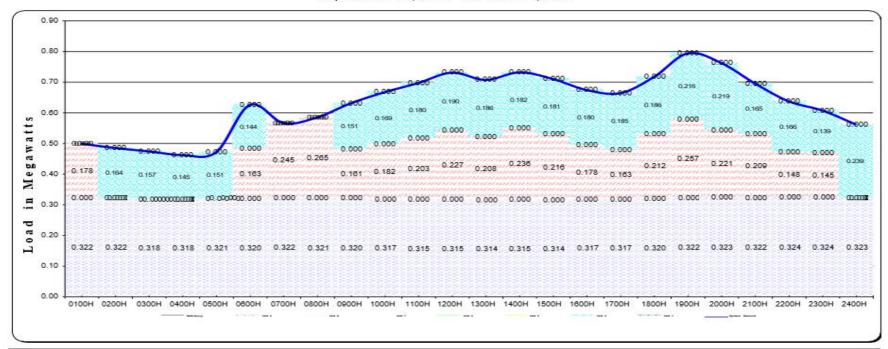

c			s - 5			95 E				CC						20 50					70		6-
0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
0					N.				G	TOTA	AL CA	APABI	LITY						9				
1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370
>			s &		5	507 17			6	SYS	STEM	DEM	AND		5)	14		, ,	3 8				
0.500	0.486	0.475	0.463	0.472	0.627	0.567	0.586	0.632	0.668	0.698	0.732	0.708	0.733	0.711	0.675	0.665	0.718	0.795	0.763	0.696	0.638	0.608	0.562
8									RE	SERV	/ED/	(DEFI	CIENO	(Y)									
0.870	0.884	0.895	0.907	0.898	0.743	0.803	0.784	0.738	0.702	0.672	0.638	0.662	0.637	0.659	0.695	0.705	0.652	0.575	0.607	0.674	0.732	0.762	0.808


National Power Corporation

SMALL POWER UTILITIES GROUP

RIZAL DIESEL POWER PLANT

October 25, 2023 - November 25, 2024



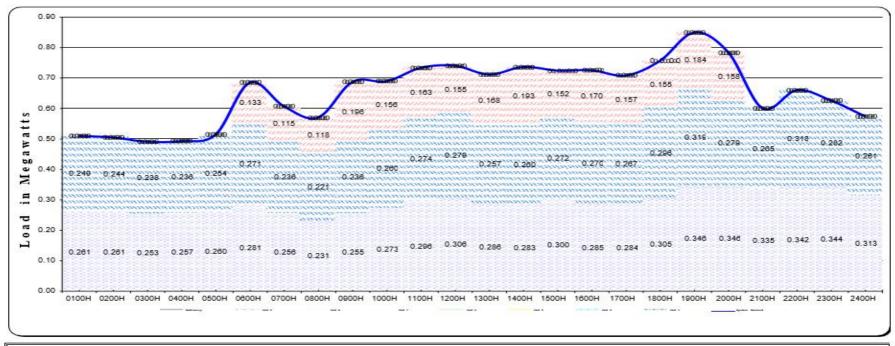



G-2 G2				ad 540				Ç.A.						per 191			0 0						6%
0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	. 2						× 2			TOT	AL CA	APABI	LITY						60 66				N.
1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370
V				S. 13			2 -	94		SYS	STEM	DEM	AND	201 100			3 8		0. 46.				
0.510	0.505	0.491	0.493	0.514	0.685	0.607	0.570	0.687	0.689	0.733	0.740	0.711	0.738	0.724	0.725	0.708	0.756	0.849	0.783	0.600	0.660	0.626	0.574
3									RE	SER	VED /	(DEFI	CIENO	(Y)									
0.860	0.865	0.879	0.877	0.856	0.685	0.763	0.800	0.683	0.681	0.637	0.630	0.659	0.634	0.646	0.645	0.662	0.614	0.521	0.587	0.770	0.710	0.744	0.798

National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE RIZAL DIESEL POWER PLANT

November 25, 2023 - December 25, 2024



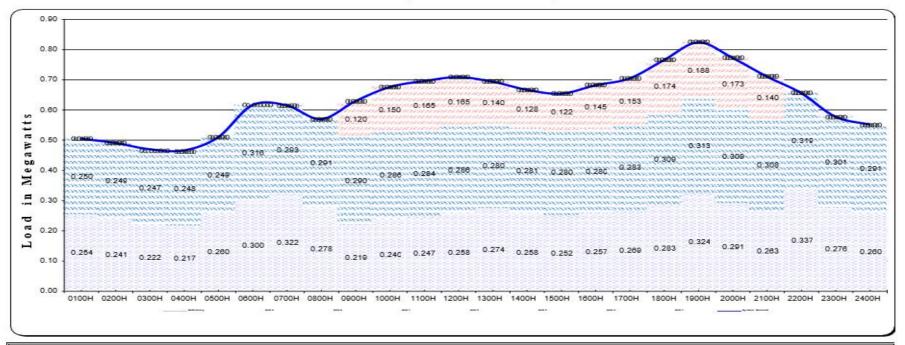

0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
										TOTA	LCA	PABI	LITY										
1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370	1.370
										SYS	TEM	DEM	AND										
0.504	0.490	0.469	0.465	0.509	0.616	0.615	0.569	0.629	0.676	0.696	0.709	0.694	0.667	0.654	0.682	0.705	0.766	0.825	0.773	0.711	0.656	0.577	0.551
	-0.0		- 20		PC	č-			RE	SERV	ED / (DEFI	CIENO	: Y)					- 3				
0.866	0.880	0.901	0.905	0.861	0.754	0.755	0.801	0.741	0.694	0.874	0.661	0.676	0.703	0.716	0.688	0.665	0.604	0.545	0.597	0.659	0.714	0.793	0.819


PR NO. HO-PMD25-003

National Power Corporation SMALL POWER UTILITIES GROUP

ĀĀRevised

LOAD AND DEMAND CURVE SAN VICENTE DIESEL POWER PLANT

DEC 25, 2023 - JAN 25, 2024

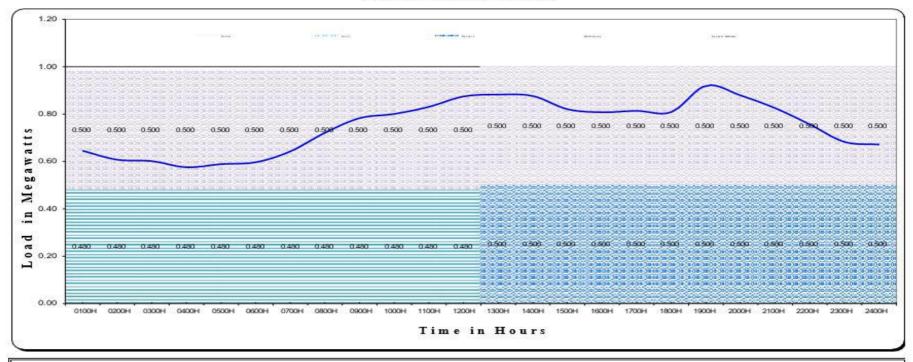


1 2																							
0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
										TOT	AL C	APAB	ILITY										
0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000
										SY	STEM	DEM	AND				-						
0.643	0.605	0.599	0.573	0.586	0.594	0.640	0.719	0.781	0.799	0.829	0.873	0.881	0.875	0.819	0.806	0.812	0.807	0.919	0.877	0.823	0.754	0.680	0.669
									R	ESER	VED/	(DEFI	CIENO	CY)									
0.337	0.375	0.381	0.407	0.394	0.386	0.340	0.261	0.199	0.181	0.151	0.107	0.119	0.125	0.181	0.194	0.188	0.193	0.081	0.123	0.177	0.246	0.320	0.331

National Power Corporation SMALL POWER UTILITIES GROUP



LOAD AND DEMAND CURVE SAN VICENTE DIESEL POWER PLANT

JAN 25, 2024 - FEB 25, 2024

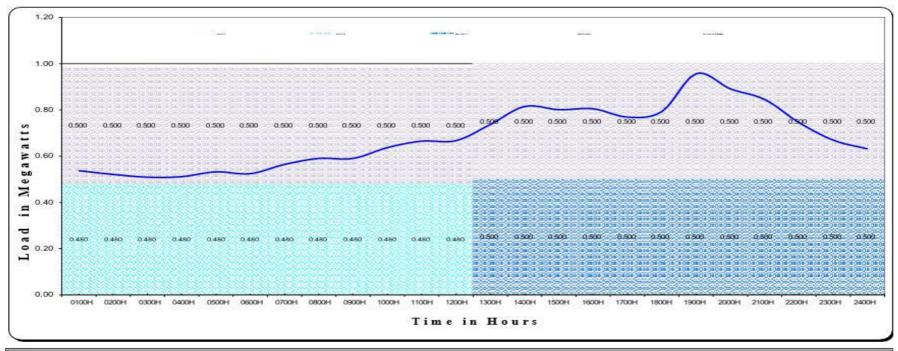


0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
10		500 55	2	SN S	2	SN 5		SS 3		TOT	AL C	APAB	ILITY	EN 5	2	50 53		(N) (1)	E	SN 53		55 5	E 3
0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000
		80 8	0.5		2	900 3		87 3		SY	STEM	DEM	AND	800 8		80 3		a :		950 5		900 - 50	
0.536	0.520	0.508	0.510	0.531	0.523	0.563	0.589	0.589	0.636	0.664	0.666	0.736	0.814	0.800	0.804	0.768	0.792	0.956	0.890	0.844	0.744	0.668	0.630
		87(Q-	87(3			R	ESER	VED /	(DEFI	CIEN	C Y)		3				87()	E	87 37	
0.444	0.460	0.472	0.470	0.449	0.457	0.417	0.391	0.391	0.344	0.316	0.314	0.284	0.186	0.200	0.196	0.232	0.208	0.044	0.110	0.158	0.258	0.332	0.370


PR NO. HO-PMD25-003

National Power Corporation SMALL POWER UTILITIES GROUP

SAN VICENTE DIESEL POWER PLANT

FEB 25, 2024 - MAR 25, 2024



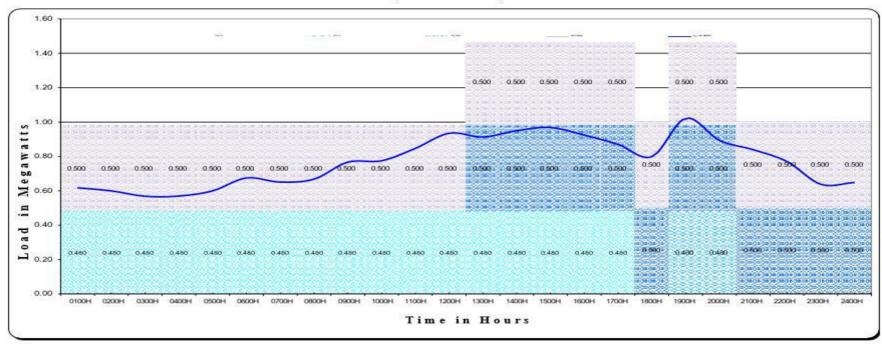

I																							
0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	6	80	ii.	30	96	20/	99	30 3	e.	TOT	AL C	APAB	ILITY	200	ii.	20	is .		96	30	ic .	30, 31	6
0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	1.480	1.480	1.480	1.480	1.480	1.000	1.480	1.480	1.000	1.000	1.000	1.000
		20.	6	87.	Si-	82.	96	30 3		SY	STEM	DEM	AND	(A)		20		97	96	(V) (1)		27. 27	
0.614	0.596	0.565	0.566	0.596	0.671	0.647	0.664	0.763	0.771	0.843	0.931	0.909	0.946	0.964	0.920	0.866	0.795	1.018	0.889	0.835	0.766	0.634	0.645
									R	ESER	VED /	(DEFI	CIEN	C Y)									
0.366	0.384	0.415	0.414	0.384	0.309	0.333	0.316	0.217	0.209	0.137	0.049	0.571	0.534	0.518	0.580	0.614	0.205	0.482	0.591	0.165	0.234	0.366	0.355

PR NO. HO-PMD25-003

National Power Corporation SMALL POWER UTILITIES GROUP



0.489


0.515

0.080

0.112

LOAD AND DEMAND CURVE SAN VICENTE DIESEL POWER PLANT

MAR 25, 2024 - APR 25, 2024

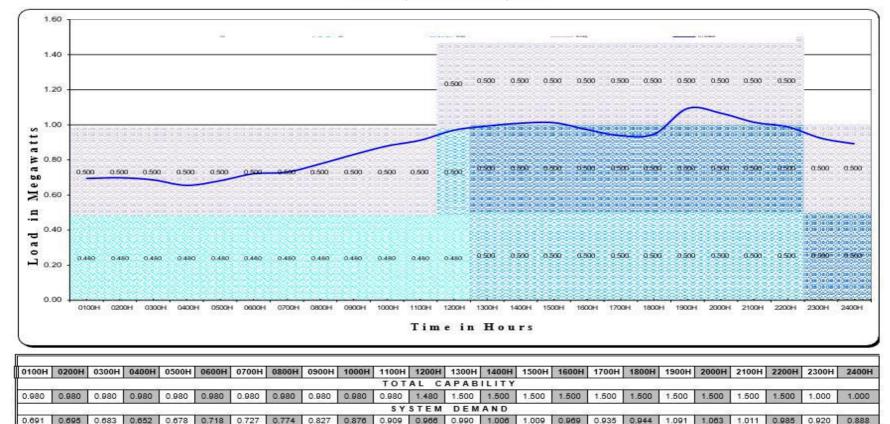

RESERVED / (DEFICIENCY)

0.153 0.104 0.071 0.514 0.510 0.494 0.491 0.531 0.565 0.556 0.409 0.437

0.297 0.328

0.302 0.262

0.253

0.206


0.285

National Power Corporation SMALL POWER UTILITIES GROUP



LOAD AND DEMAND CURVE SAN VICENTE DIESEL POWER PLANT

APR 25, 2024 - MAY 25, 2024

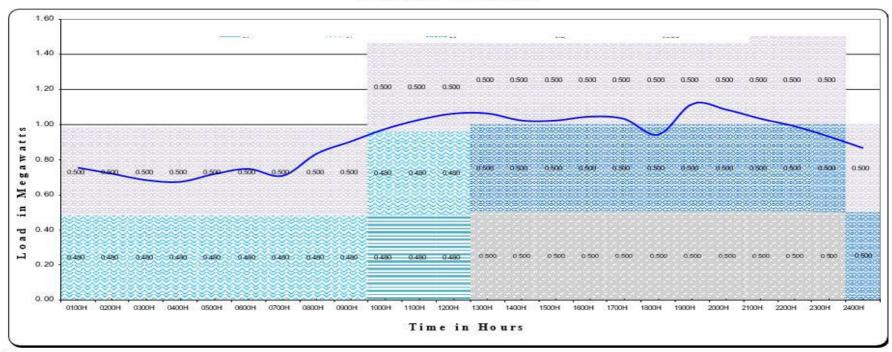

040011	000011	000011	0.10011	050011	000011		000011		400011	440011	400011	400011	440011	450011	******	470011	400011	400011	000011	040011	000011		0.10011
0100H	0200H	0300H	0400H	0500H	0600H	0/00H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	ę-	500 50	9			951 188			0.7 0.85	TOT	TAL C	APABI	LITY		n o	261	ten no		7	281	ES: 15		
0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	1.480	1.460	1.460	1.500	1.500	1.500	1.500	1.500	1.500	1.500	1.500	1.500	1.500	1.500	1.000
	32	(N) (N)	2 8	0 0	36	(S) (S)	9	0 3	85 KE	SY	STEM	DEMA	ND		8 8	0	500 100			73	500 - 50	A 0	
0.753	0.719	0.683	0.673	0.717	0.746	0.707	0.832	0.901	0.971	1.023	1.058	1.059	1.019	1.019	1.041	1.028	0.939	1.114	1.080	1.029	0.986	0.928	0.863
	۷.	00 50	x 30			90 180		0)	0.0	RESER	RVED /	(DEFIC	IENC	Y)	8 6	72	EC 95				FC 74		,
0.227	0.261	0.297	0.307	0.263	0.234	0.273	0.148	0.079	0.489	0.437	0.402	0.441	0.481	0.481	0.459	0.472	0.561	0.386	0.420	0.471	0.514	0.572	0.137


National Power Corporation SMALL POWER UTILITIES GROUP

ÄÄRevised November

PR NO. HO-PMD25-003

LOAD AND DEMAND CURVE SAN VICENTE DIESEL POWER PLANT

MAY 25, 2024 - JUN 25, 2024

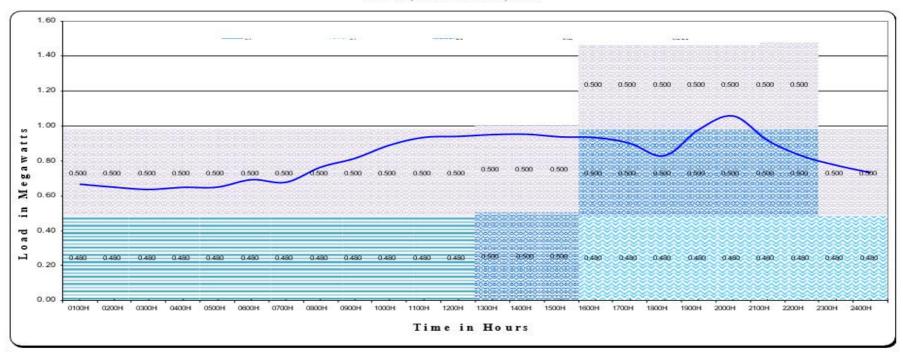

Š ca		s - 5	0 3	Care Los		a a	er.	and wat	e		66.	sist est	r 5		6.0 60			c.	X43		× .	C.	Ger 3
0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	7.5				2	3	2.0			TO:	TAL C	APAB	LITY						X-0				1000
0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	1,000	1.000	1.000	1.480	1.480	1.480	1.480	1.480	1.480	1.480	0.980	0.980
3 3			200	8. P	5 (5		20	(6)		S	STEM	DEMA	AND		22 22		3		\$25 X2	*		100	20
0.662	0.645	0.632	0.644	0.645	0.688	0.673	0.759	0.810	0.885	0.930	0.936	0.946	0.948	0.933	0.929	0.896	0.824	0.975	1.053	0.913	0.824	0.770	0.728
3 30	- 86		5c :	10 10			50	982 (3)		RESER	RVED /	(DEFIC	CIENC	Y)	F 10	10 0	5 8	×.	gr 25	374			
0.318	0.335	0.348	0.336	0.335	0.292	0.307	0.221	0.170	0.095	0.050	0.044	0.054	0.052	0.067	0.551	0.584	0.656	0.505	0.427	0.567	0.656	0.210	0.252


PR NO. HO-PMD25-003

National Power Corporation SMALL POWER UTILITIES GROUP

(ĀĀRevised November

LOAD AND DEMAND CURVE SAN VICENTE DIESEL POWER PLANT

JUN 25, 2024 - JULY 25, 2024

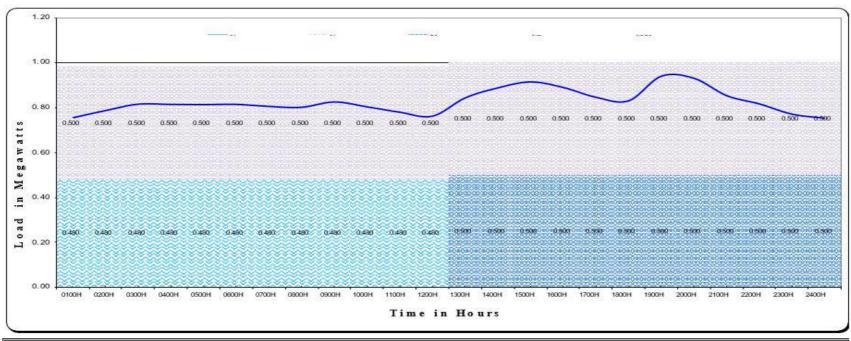


0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
										TOT	TAL C	APABI	LITY										
0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000	1.000
		e.	C- 50			tv - 120	99			SY	STEM	DEMA	ND	50 (6	X 70		00	50 (0			00 40	95	
0.752	0.784	0.813	0.812	0.811	0.812	0.803	0.799	0.823	0.801	0.777	0.759	0.841	0.886	0.913	0.888	0.844	0.828	0.939	0.929	0.851	0.814	0.768	0.750
										RESER	RVED /	(DEFIC	IENC	Y)									
0.228	0.198	0.167	0.168	0.169	0.168	0.177	0.181	0.157	0.179	0.203	0.221	0.159	0.114	0.087	0.112	0.156	0.172	0.061	0.071	0.149	0.188	0.232	0.250

PR NO. HO-PMD25-003

National Power Corporation SMALL POWER UTILITIES GROUP

ĀĀRevised November

LOAD AND DEMAND CURVE SAN VICENTE DIESEL POWER PLANT

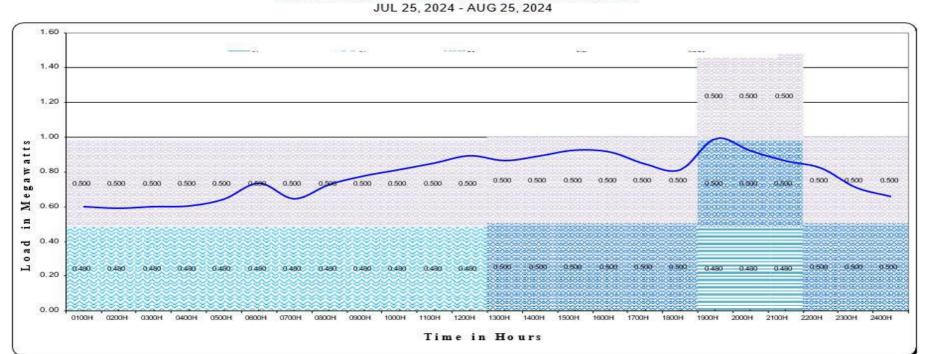

0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
		25		0 -		500 100			0.7	TO	TAL C	APABI	LITY				100	2	2		450 P	8 9	P.
0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	1.000	1.000	1.000	1.000	1.000	1.000	1.480	1.480	1.480	1.000	1.000	1.000
	36	80 3	2 8		36	500 0	5 9	83	85 85	SY	STEM	DEMA	AND		e :	20	50 0	2 5		10	53 8	a e	88
0.598	0.589	0.598	0.602	0.641	0.733	0.643	0.725	0.775	0.811	0.849	0.891	0.863	0.890	0.923	0.912	0.843	0.810	0.990	0.919	0.861	0.820	0.708	0.656
					ć				0.1	RESEF	RVED /	(DEFIC	IENC	Y)		20	FC 98			-31	50 8	0 4	
0.382	0.391	0.382	0.378	0.339	0.247	0.337	0.255	0.205	0.169	0.131	0.089	0.137	0.110	0.077	0.088	0.157	0.190	0.490	0.561	0.619	0.180	0.292	0.344


PR NO. HO-PMD25-003

National Power Corporation SMALL POWER UTILITIES GROUP

ÅÄRevised November

LOAD AND DEMAND CURVE SAN VICENTE DIESEL POWER PLANT

AUG 25, 2024 - SEP 25, 2024

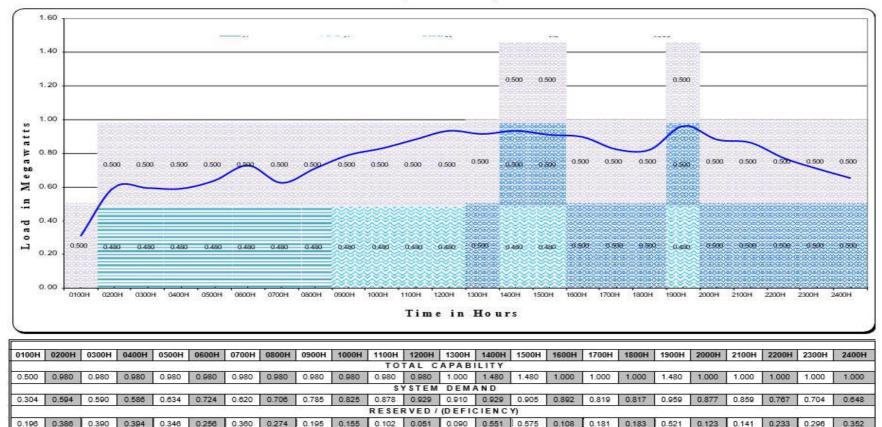


PR NO. HO-PMD25-003

National Power Corporation SMALL POWER UTILITIES GROUP

(ĀĀRevised November

SAN VICENTE DIESEL POWER PLANT SEP 25, 2024 - OCT 25, 2024

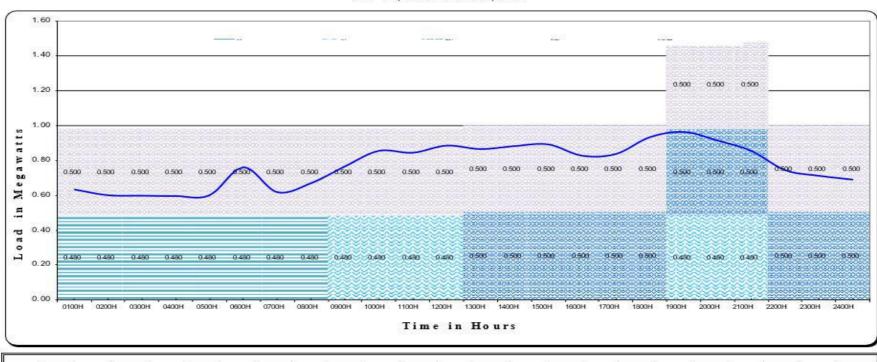

	93 S	C 53	0 0	SA.	ga 50	8 3	Ø	0.1 0.5		E 3	o :	0.00		c.	36	SEC 10		c :	33	38S 14	× 0	62 2	90.0
0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	= = =			85	\$100 m	×		0 - 55	77	TO	TAL C	APABI	LITY		20	200	*		20	***	*	**	
0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	1.000	1.000	1.000	1.000	1.000	1.000	1.480	1.480	1.480	1.000	1.000	1.000
	EX 33		6 3	19	EX 8	3	8	St. 72	- 3	SY	STEM	DEMA	ND	9	100	87	5 8	9	95	20	3 3	55	60
0.631	0.598	0.595	0.593	0.597	0.758	0.615	0.667	0.763	0.852	0.841	0.882	0.862	0.879	0.889	0.824	0.834	0.930	0.960	0.911	0.851	0.741	0.709	0.687
	980 (86			5	300 10		03	825 300	1)	RESER	RVED /	(DEFIC	CIENC	Y)	85		9 50).	85				921
0.349	0.382	0.385	0.387	0.383	0.222	0.365	0.313	0.217	0.128	0.139	0.098	0.138	0.121	0.111	0.176	0.166	0.070	0.520	0.569	0.629	0.259	0.291	0.313


PR NO. HO-PMD25-003

National Power Corporation SMALL POWER UTILITIES GROUP

ÄÄRevised November

LOAD AND DEMAND CURVE SAN VICENTE DIESEL POWER PLANT

OCT 25, 2024 - NOV 25, 2024

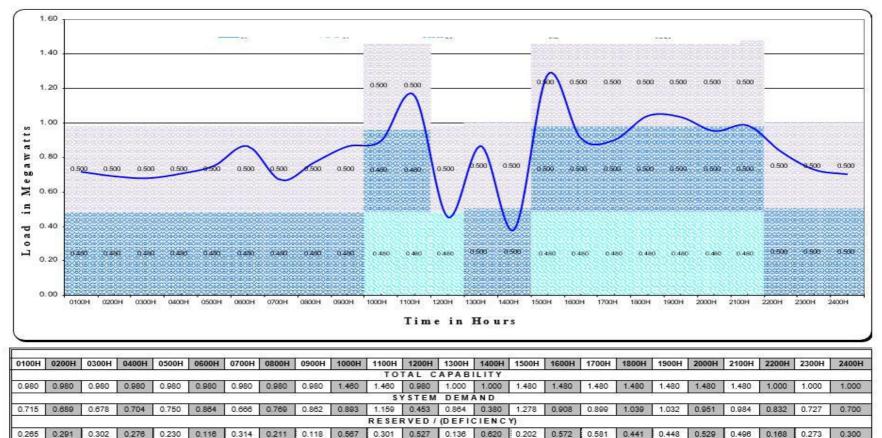


PR NO. HO-PMD25-003

National Power Corporation SMALL POWER UTILITIES GROUP

ĀĀRevised

LOAD AND DEMAND CURVE SAN VICENTE DIESEL POWER PLANT

NOV 25, 2024 - DEC 25, 2024

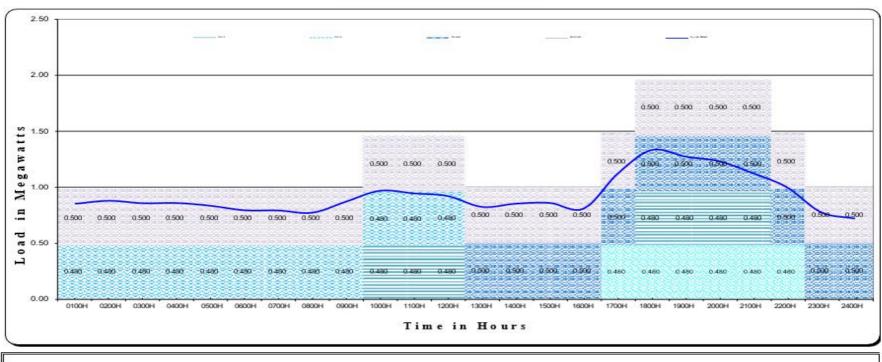

0100	1 0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
200	05-	547 50		8 10			290 125		51 100	TOT	AL C	APAB	LITY	8 10			u la		51 - 10			A.C 888	
0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	0.980	1.460	1.460	1.460	1.000	1.000	1.000	1.000	1.480	1.960	1.960	1.960	1.960	1.480	1.000	1.000
500	05-	5.7 30		8 20			25 12		50 (10	SY	STEM	DEM	AND	Na =10			4 14		51 19				
0.849	0.876	0.854	0.856	0.831	0.791	0.789	0.769	0.869	0.966	0.942	0.918	0.821	0.850	0.857	0.805	1.118	1.331	1.272	1.230	1.122	0.996	0.773	0.717
200	46-	50 30	9 8	8 10					R	ESER	VED /	(DEFI	CIENO	(Y)			A 4		5 19			A 20	
0.131	0.104	0.126	0.124	0.149	0.189	0.191	0.211	0.111	0.494	0.518	0.542	0.179	0.150	0.143	0.195	0.362	0.629	0.688	0.730	0.838	0.484	0.227	0.283


PR NO. HO-PMD25-003

National Power Corporation SMALL POWER UTILITIES GROUP

Revised November 2001

BITON DIESEL POWER PLANT

December 25, 2023 - January 25, 2024

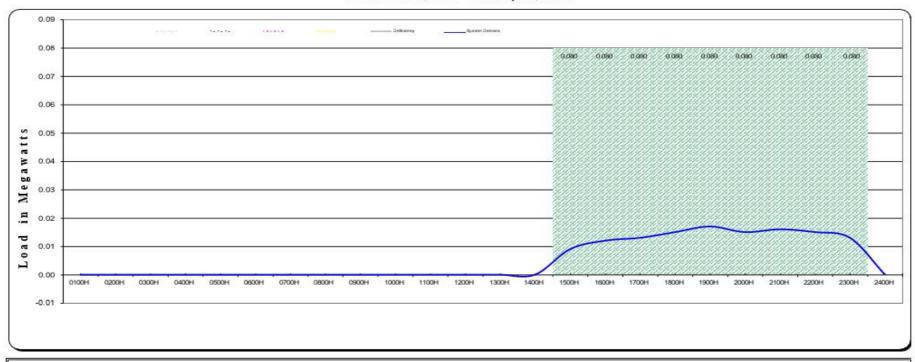

0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	H0060	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
1	- 45		8	*	P 19		7	12	8	TOT	AL CA	PABIL	ITY	~ ~	- 10			3= 3	E	= = = = = = = = = = = = = = = = = = = =	(0.1	Š .
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080
- 55			71. 8					300	V2	SY	STEM	DEMA	N D		90		71		5 50			201	W
0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.009	0.012	0.013	0.015	0.017	0.015	0.016	0.015	0.013	0.000
									- 1	RESER	VED/	DEFIC	IENCY)									
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.071	0.068	0.067	0.065	0.063	0.065	0.064	0.065	0.067	0.080

PR NO. HO-PMD25-003


National Power Corporation

SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE BITON DIESEL POWER PLANT

January 25 - February 25, 2024



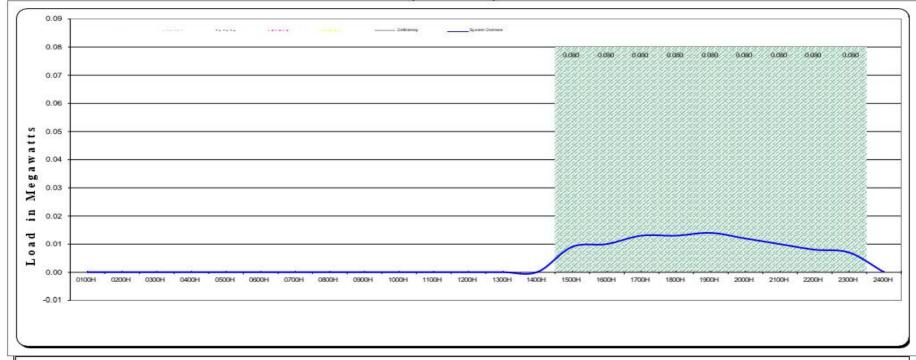

0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	51 12		(5)		800. 1	50 0	n	100		TOT	AL CA	PABIL	ITY	(c)	V2 12	11	7		001 1	500	3: :	8 30	
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080
	W. 18	3 - 3	. 29		gr		e 33			SY	STEM	DEMA	N D	(#) s	91 9	S				12	3c &	5 5	e 38
0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.009	0.010	0.013	0.013	0.014	0.012	0.010	0.008	0.007	0.000
	85 35	5						(5)		RESER	VED /	DEFIC	IENCY)	65				33		to a	5	20 34
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.071	0.070	0.067	0.067	0.066	0.068	0.070	0.072	0.073	0.080


PR NO. HO-PMD25-003

National Power Corporation SMALL POWER UTILITIES GROUP

Revised November 2001

LOAD AND DEMAND CURVE BITON DIESEL POWER PLANT

February 25 - March 25, 2024

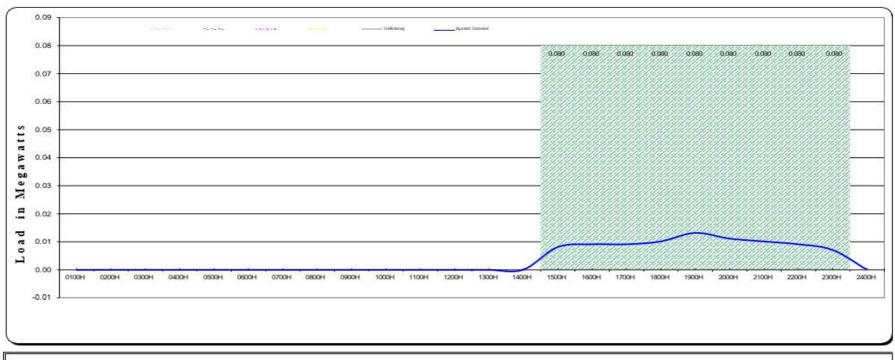

0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	D 88	. 38		N/ 8	K). //	2 8	8 1/2		5.7	TOT	AL CA	APABIL	ITY	W 4	85 - 53	i (88	1.62		95 4	2 3	si (5)		25.7
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080
	0 0				51 E		N 60			SY	STEM	DEMA	N D	15 5	5 9				0 - 8		8 1	X	2.5
0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.008	0.009	0.009	0.010	0.013	0.011	0.010	0.009	0.007	0.000
	6 3				٥ - ١		8 63			RESER	VED/	DEFIC	IENCY	1		6 20			7		8 1		240
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.072	0.071	0.071	0.070	0.067	0.069	0.070	0.071	0.073	0.080

PR NO. HO-PMD25-003


National Power Corporation

SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE BITON DIESEL POWER PLANT

March 25 - April 25, 2024



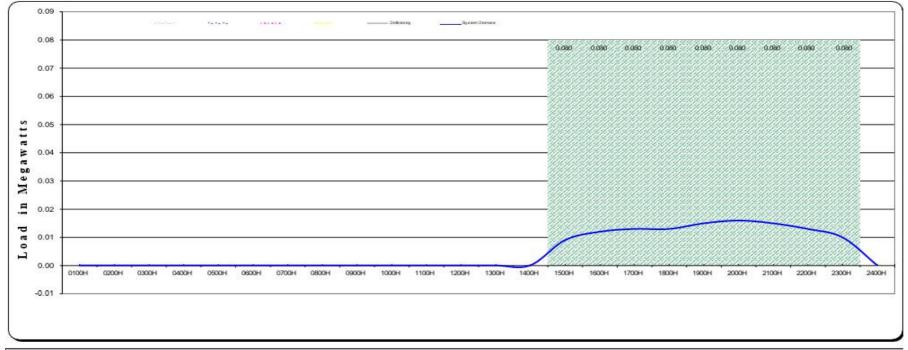

0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
										TOT	AL CA	APABII	ITY										
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080
Ü										SY	STEM	DEMA	N D	110000									
0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.009	0.012	0.013	0.013	0.015	0.016	0.015	0.013	0.010	0.000
	0. 4		7.0		19.	0.0	9			RESER	VED/	DEFIC	IENCY)	19. 3					32	3	N 50	
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.071	0.068	0.067	0.067	0.065	0.064	0.065	0.067	0.070	0.080


PR NO. HO-PMD25-003


National Power Corporation

SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE BITON DIESEL POWER PLANT

April 25 - May 25, 2024



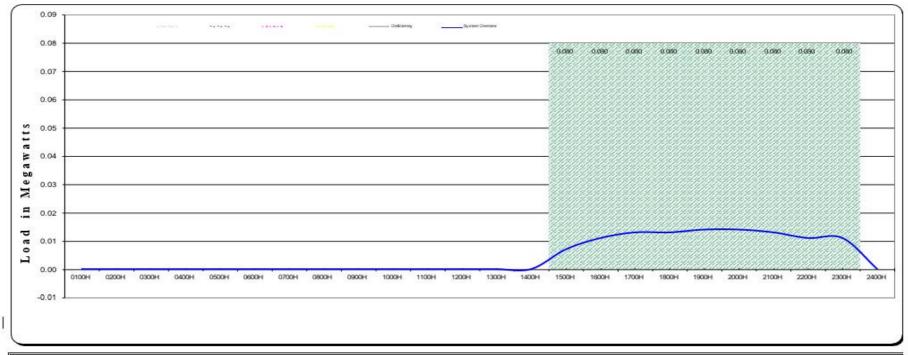


9	8 8	(4)		W :	5c 5c	5 S	ž.	(e) s	35	22 - 33	5 33	2	93 8		50	(4)		(e) (85 08	5a - 5a	8 88		555
0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	N (2)			30	K V	0 8	×		(6)	TOT	AL C	APABII	ITY	C 0	C 3			2	C - C	0 3			X30
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080
					,		×	20)		SY	STEM	DEMA	N D		0 10			2			6		7.0
0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.007	0.011	0.013	0.013	0.014	0.014	0.013	0.011	0.011	0.000
					0 0		× .	50 3		RESER	VED/	(DEFIC	IENCY)	0 10				W 0		S 40		X-S
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.073	0.069	0.067	0.067	0.066	0.066	0.067	0.069	0.069	0.080

National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE BITON DIESEL POWER PLANT

May 25 - June 25, 2024



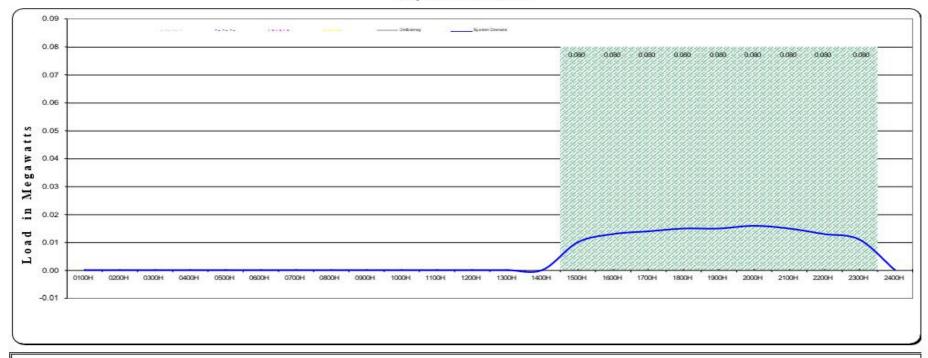

	(i) (i)				W 5		d 75		33 3		5 (3			32 3	5) 3d	12	133		8	2	E		33
0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
0	007 39			8	AG	G 3	A 55		2	TOT	AL CA	PABIL	ITY	60		0 60	198	-	60 0	(r	N	K	500
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080
	20 20				ec -					SY	STEM	DEMA	N D	Cre to	× ×					· ·			100
0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.010	0.013	0.014	0.015	0.015	0.016	0.015	0.013	0.011	0.000
0	20 20	0 00			w .		x 43			RESER	VED/	DEFIC	IENCY)	e	0 10							100
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.070	0.067	0.066	0.065	0.065	0.064	0.065	0.067	0.069	0.080

PR NO. HO-PMD25-003


National Power Corporation

SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE BITON DIESEL POWER PLANT

June 25 - July 25, 2024



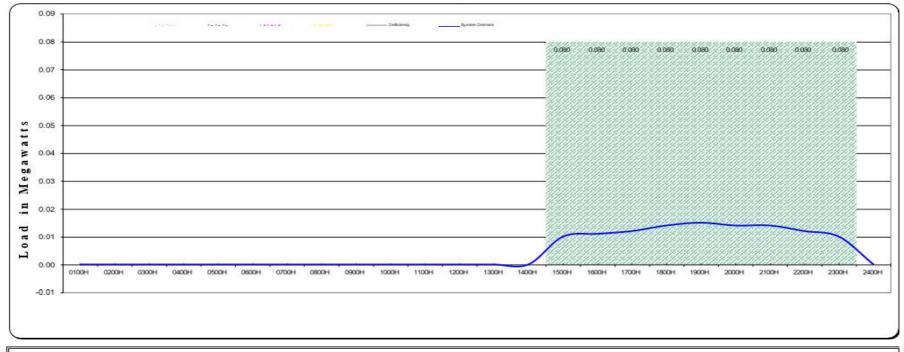

0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	H0060	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	500 00	8 8			(4)		35 35			TOT	AL CA	PABIL	ITY		e: 1	5 8	3			5%	55 5	0 0	8 8
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080
			- 32		-	e		- 50		SY	STEM	DEMA	N D		-3		- 3	5 (5)		331	85 3	01 12	
0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.010	0.011	0.012	0.014	0.015	0.014	0.014	0.012	0.010	0.000
.2			- 33		20	G	to the			RESER	VED /	DEFIC	IENCY)			5 3)	301	85 3	9 9	
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.070	0.069	0.068	0.066	0.085	0.066	0.066	0.068	0.070	0.080


PR NO. HO-PMD25-003


National Power Corporation

SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE BITON DIESEL POWER PLANT

July 25 - August 25, 2024



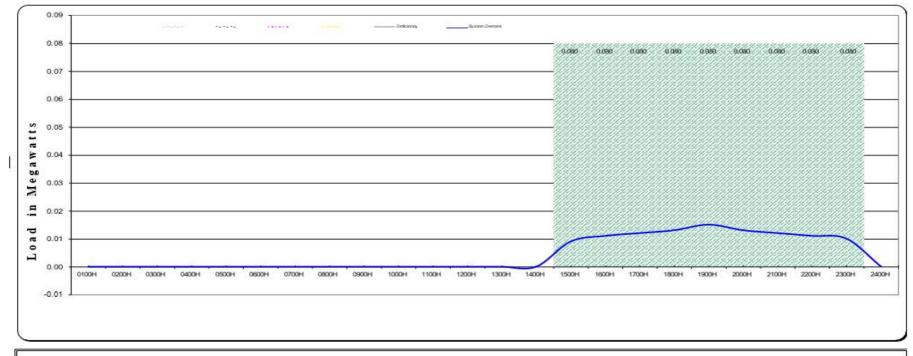

ŝ.																							
0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
20	5.7 g	S	D 30			5.7	r	n 30		TOT	AL CA	PABIL	ITY	174		92) //		5 30		947	925 A	0 3	
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080
700								A 30		SY	STEM	DEMA	N D	1.0		On A				941	77: 8		
0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.009	0.011	0.012	0.013	0.015	0.013	0.012	0.011	0.010	0.000
j.				9 12					. 2	RESER	VED/	DEFIC	IENCY)		On A		0 0		947	7		
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.071	0.069	0.068	0.067	0.065	0.067	0.068	0.069	0.070	0.080


PR NO. HO-PMD25-003

National Power Corporation SMALL POWER UTILITIES GROUP

Revised November 2001

BITON DIESEL POWER PLANT

August 25 - September 25, 2024

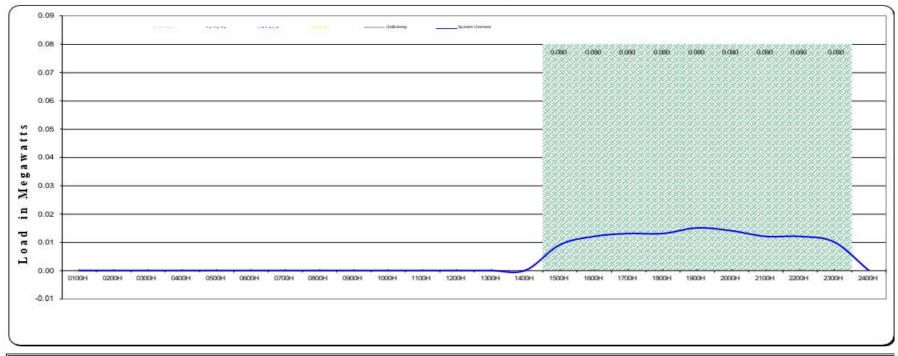

0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
- 3		œ	90. S		\$ 33	3	50 5	0	Se (2)	TOT	AL CA	PABIL	LITY	9 9	2 33		20		& 33	3 3	9	(A)	St :
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080
***		(a)	200	9	0. 00	\$		S 5	3	SY	STEM	DEMA	N D	3			200		\$0 W	30		\$00°	Ø4 1
0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.009	0.012	0.013	0.013	0.015	0.014	0.012	0.012	0.010	0.000
									- 1	RESER	VED/	DEFIC	IENCY)									
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.071	0.068	0.087	0.087	0.085	0.066	0.068	0.068	0.070	0.080


National Power Corporation

SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE BITON DIESEL POWER PLANT

September 25 - October 25, 2024



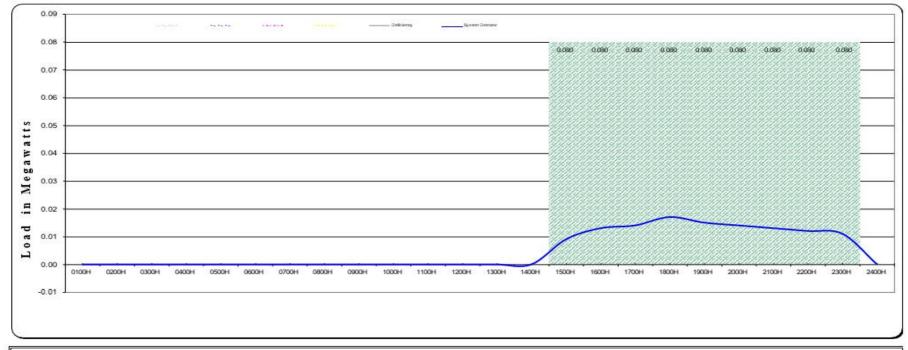

0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
2		3: 3	27	2	X5		50		8 8	TOT	AL CA	PABIL	ITY	18		W: 3	27 3		\$ 35°		50	55	6 -
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080
10		200	S S		(9)		(C)	8	(c) (c)	SY	STEM	DEMA	N D			(a)	(5)				(E)		3.0
0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.009	0.013	0.014	0.017	0.015	0.014	0.013	0.012	0.011	0.000
									1	RESER	VED /	DEFIC	IENCY)									
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.071	0.067	0.066	0.063	0.065	0.066	0.067	0.068	0.069	0.080


PR NO. HO-PMD25-003

National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE BITON DIESEL POWER PLANT

October 25 - November 25, 2024



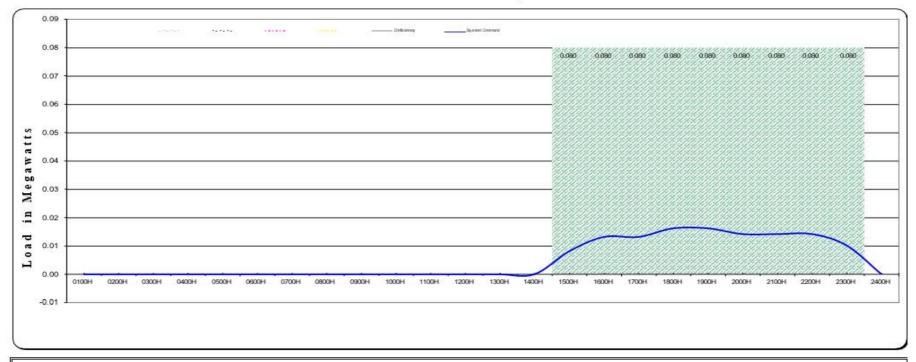

0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
		(6)	88 8		Q 33		50. 9	9 9	76 (3	TOT	AL CA	PABIL	ITY	9 9	2 55		85 9	9	5 33	9		70-	(A)
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080
***		(4)	(C)	84 99	(v)		(4)	(a) (b)	1	SY	STEM	DEMA	N D	30 33	(3)		200		(c = 0)			Çer	Ž2 - 1
0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.008	0.013	0.013	0.016	0.016	0.014	0.014	0.014	0.010	0.000
									- 1	RESER	VED /	DEFIC	IENCY)									
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.072	0.067	0.087	0.064	0.064	0.066	0.066	0.066	0.070	0.080


PR NO. HO-PMD25-003

National Power Corporation SMALL POWER UTILITIES GROUP

BITON DIESEL POWER PLANT

November 25 - December 25, 2024



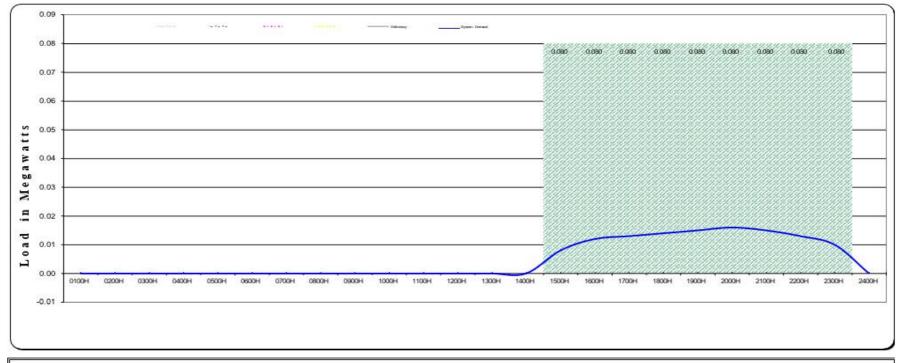


8	85 98	5 - 53	8 89		33. 8		E 28	370		30 8	50 50	5 E		(4)	95 E	6 - 63	98		33 8		56 58		a 2
0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	45. V	0			(3)		N (2)			TOT	AL CA	PABIL	ITY	20 2	0) 0	0	C (2)		and o	v. 0	0 .0		
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080
	o		9 99		· ·					SY	STEM	DEMA	N D	20 9					179		0 10		
0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.008	0.012	0.013	0.014	0.015	0.016	0.015	0.013	0.010	0.000
			6 40		(O)		e es			RESER	VED /	(DEFIC	IENCY)					100-		0 0		
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.072	0.068	0.087	0.066	0.065	0.064	0.065	0.067	0.070	0.080

National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Casian Diesel Power Plant

DECEMBER 25, 2023 - JANUARY 25, 2024

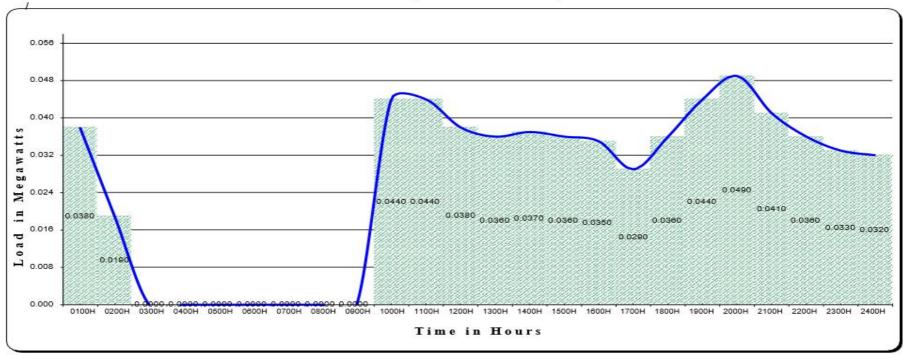


0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	30 20		2 22		5 3	21	3:	28 3		TOT	AL C	APAB	ILITY		d 30	20 10	30 3			3	8 8		0.0
0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140
ř										SY	STEM	DEM	AND										
0.038	0.019	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.044	0.044	0.038	0.036	0.037	0.036	0.035	0.029	0.036	0.044	0.049	0.041	0.036	0.033	0.032
			5 (2 V (2			8 8			R	ESER	VED /	(DEF	CIEN	CY)	\$ X			70 Z		30 3			20
0.102	0.121	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.096	0.096	0.102	0.104	0.103	0.104	0.105	0.111	0.104	0.096	0.091	0.099	0.104	0.107	0.108

National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Casian Diesel Power Plant

JANUARY 25, 2024 - FEBRUARY 25, 2024

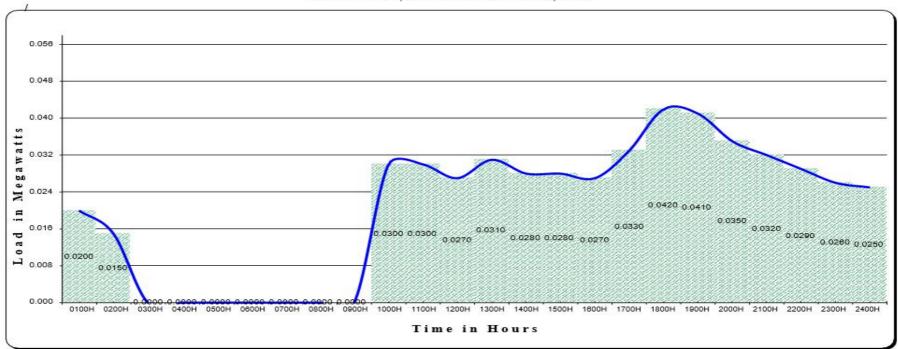


0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	8 10		3				2			TOT	AL C	APAB	ILITY					9	4	90 0			
0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140
				c :			· · · · · ·			SY	STEM	DEM	AND	: .			·	On a		20 0	0		
0.020	0.015	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.030	0.030	0.027	0.031	0.028	0.028	0.027	0.033	0.042	0.041	0.035	0.032	0.029	0.026	0.025
									R	ESER	VED /	(DEF	CIEN	CY)									
0.120	0.125	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.110	0.110	0.113	0.109	0.112	0.112	0.113	0.107	0.098	0.099	0.105	0.108	0.111	0.114	0.115

National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Casian Diesel Power Plant

FEBRUARY 25, 2024 - MARCH 25, 2024

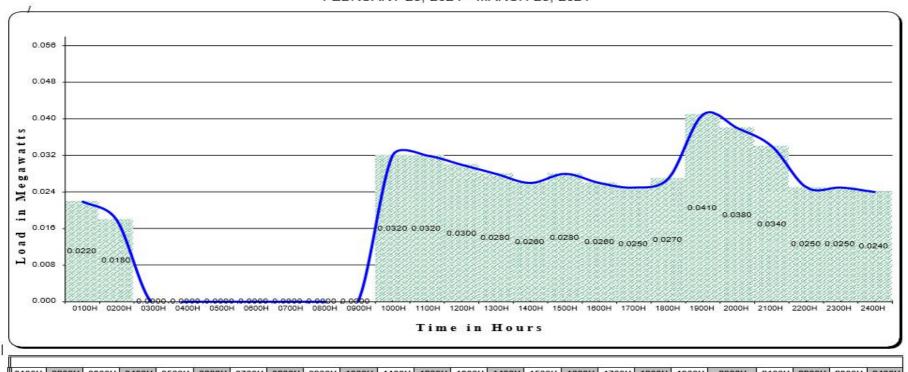


				1=	77.	500 100			4 3					1= 7	77.	N. 100		200		X74			4 9
0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
		5 3	6 3	1=	77	507 305				TOT	AL C	APAB	ILITY		77	N. 1.02	- 00			2012			4 (4
0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140
										SY	STEM	DEM	AND										
0.022	0.018	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.032	0.032	0.030	0.028	0.026	0.028	0.026	0.025	0.027	0.041	0.038	0.034	0.025	0.025	0.024
									R	ESER	VED /	(DEFI	CIEN	C Y)									
0.118	0.122	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.108	0.108	0.110	0.112	0.114	0.112	0.114	0.115	0.113	0.099	0.102	0.106	0.115	0.115	0.116

National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Casian Diesel Power Plant

MARCH 25, 2024 - APRIL 25, 2024

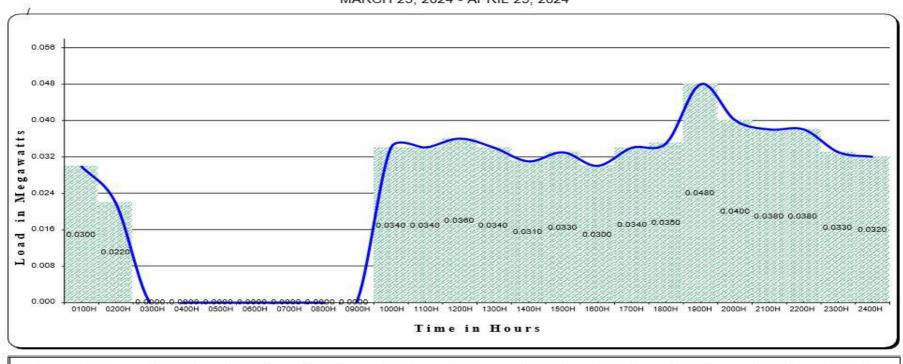

0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
3 70	100		: 20		E 9		32 3	8:	53	TOT	AL C	APAB	ILITY		8 8	8 8	82 3	87:	31 3	00 0	3 3	25	82
0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140
										SY	STEM	DEM	AND										
0.030	0.022	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.034	0.034	0.036	0.034	0.031	0.033	0.030	0.034	0.035	0.048	0.040	0.038	0.038	0.033	0.032
523	135					85 3		90.	R	ESER	VED /	(DEF	CIEN	CY)			% ·	8: 3	27		S		600 V
0 110	0.118	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.106	0.106	0.104	0.106	0.109	0.107	0.110	0.106	0.105	0.092	0.100	0.102	0.102	0.107	0.108


PR NO. HO-PMD25-003

National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Casian Diesel Power Plant

APRIL 25, 2024 - MAY 25, 2024

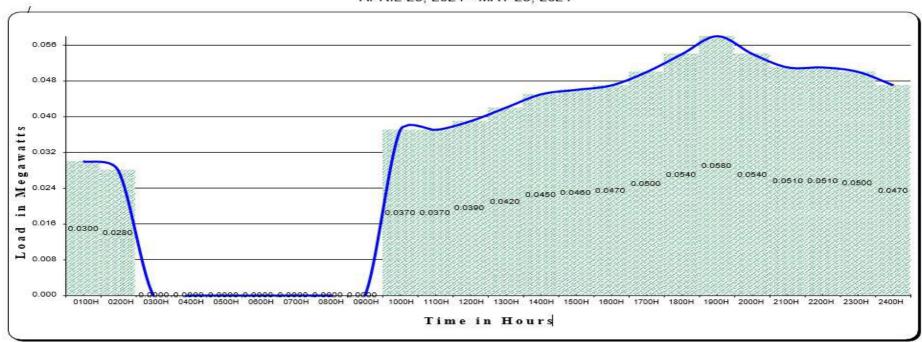


																							was also
0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
20 10				0 3			0.0			TOT	AL C	APAB	ILITY							x0 9			X.0
0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140
85 3				C 0	8	10	32	R 30)	855	SY	STEM	DEM	AND	0 0	8 8	0 5		N 102		8	2 3	Ø:	30 %
0.030	0.028	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.037	0.037	0.039	0.042	0.045	0.046	0.047	0.050	0.054	0.058	0.054	0.051	0.051	0.050	0.047
									R	ESER	VED /	(DEF	CIEN	CY)									
0.110	0.112	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.103	0.103	0.101	0.098	0.095	0.094	0.093	0.090	0.086	0.082	0.086	0.089	0.089	0.090	0.093

LOAD AND DEMAND CURVE

Casian Diesel Power Plant

MAY 25, 2024 - JUNE 25, 2024

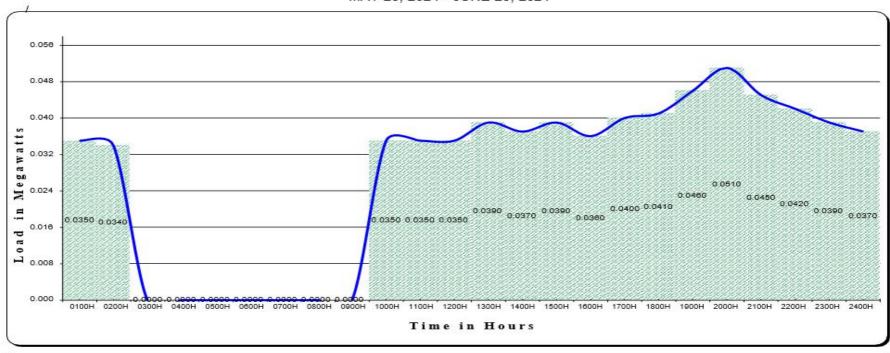


	× .v	3			0 8	(V)	K.S	20 10			c .50				0 3		· ·	90 60		6.	00.	Cov	Yes - 19
0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	30				0 .					TOT	AL C	APAB	ILITY				40				0.	Co-	70 00
0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140
85 5	SYSTEM DEMAND															Ø 8							
0.035	0.034	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.035	0.035	0.035	0.039	0.037	0.039	0.036	0.040	0.041	0.046	0.051	0.045	0.042	0.039	0.037
									R	ESER	VED /	(DEF	CIEN	CY)									
0.105	0.106	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.105	0.105	0.105	0.101	0.103	0.101	0.104	0.100	0.099	0.094	0.089	0.095	0.098	0.101	0.103

LOAD AND DEMAND CURVE

Casian Diesel Power Plant

JUNE 25, 2024 - JULY 25, 2024

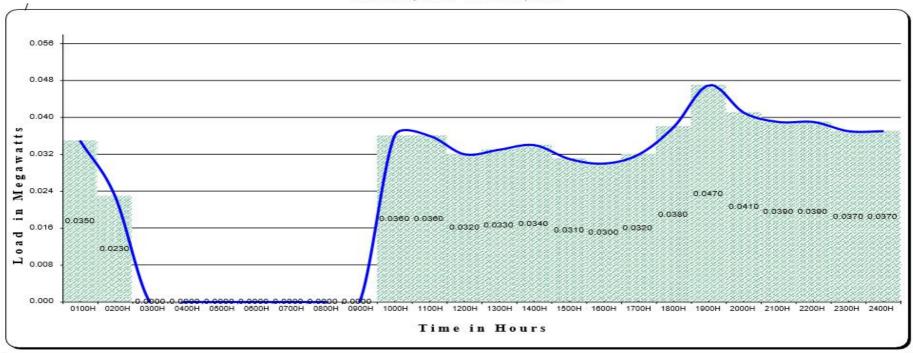


																							- 3
0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
										TOT	AL C	APAB	ILITY	8									
0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140
	140 0.															32 31							
0.035	0.023	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.036	0.036	0.032	0.033	0.034	0.031	0.030	0.032	0.038	0.047	0.041	0.039	0.039	0.037	0.037
	& 3 ~ =		(E)		Š.	734		=10	R	ESER	VED /	(DEF	CIEN	CY)		3-		=10		254	i de	5-1	100
0.105	0.117	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.104	0.104	0.108	0.107	0.106	0.109	0.110	0.108	0.102	0.093	0.099	0.101	0.101	0.103	0.103

LOAD AND DEMAND CURVE

Casian Diesel Power Plant

JULY 25, 2024 - AUGUST 25, 2024

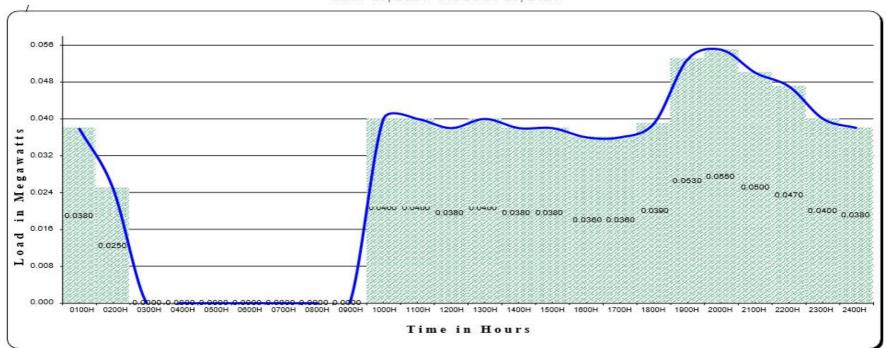


	SC 8		25	(4)	33 33		3		5 30	5 5	30 8	23 5	35		33 33	-58				(a) (a)	28		2
0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	H0060	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	s 8		55	(c)	32 23		is 58	- 3	: 33	TOT	AL C	APAB	ILITY		33 33	-58				(a) (a)	10		E 8
0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140
										SY	STEM	DEM	AND										-
0.038	0.025	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.040	0.040	0.038	0.040	0.038	0.038	0.036	0.036	0.039	0.053	0.055	0.050	0.047	0.040	0.038
	0 0		to a				5 (d) 7 (d)		R	ESER	VED /	(DEFI	CIEN	CY)			(2	18			- 33		6 8
0.102	0.115	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.100	0.100	0.102	0.100	0.102	0.102	0.104	0.104	0.101	0.087	0.085	0.090	0.093	0.100	0.102

LOAD AND DEMAND CURVE

Casian Diesel Power Plant

AUGUST 25, 2024 - SEPTEMBER 25, 2024

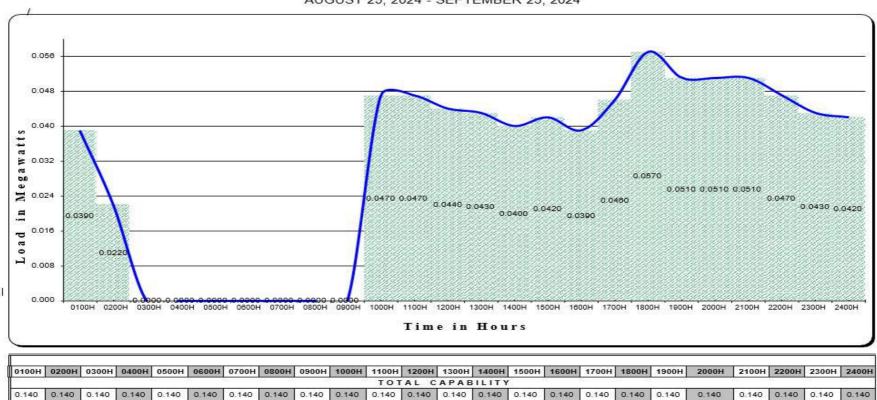


0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
600	× 8	9 9	3 3	0 1	8 3	č.	22 22	-38		TOT	AL C	APAB	ILITY	5	8 3	0-	82 35	-35		30 3	\$5.	89.	EX 33
0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140
										SY	STEM	DEM	AND							25			
0.039	0.022	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.047	0.047	0.044	0.043	0.040	0.042	0.039	0.046	0.057	0.051	0.051	0.051	0.047	0.043	0.042
	~ ~								R	ESER	VED /	(DEF	CIEN	CY)									
0.101	0.118	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.093	0.093	0.096	0.097	0.100	0.098	0.101	0.094	0.083	0.089	0.089	0.089	0.093	0.097	0.098

LOAD AND DEMAND CURVE

Casian Diesel Power Plant

SEPTEMBER 25, 2024 - OCTOBER 25, 2024

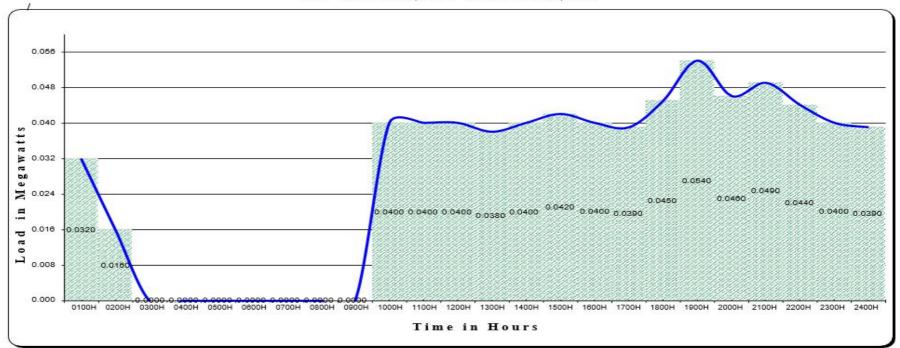


																							77
0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
St. 35	9 92				Sec	50	22	(4)	525	TOT	AL C	APAB	ILITY		200	10	200	(4) (3)		35	500	90-	500 200
0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140
	2 22									SY	STEM	DEM	AND								200	Co.	
0.032	0.016	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.040	0.040	0.040	0.038	0.040	0.042	0.040	0.039	0.045	0.054	0.046	0.049	0.044	0.040	0.039
3									R	ESER	VED /	(DEF	ICIEN	CY)									
0.108	0.124	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.100	0.100	0.100	0.102	0.100	0.098	0.100	0.101	0.095	0.086	0.094	0.091	0.096	0.100	0.101

National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Casian Diesel Power Plant

OCTOBER 25, 2024 - NOVEMBER 25, 2024

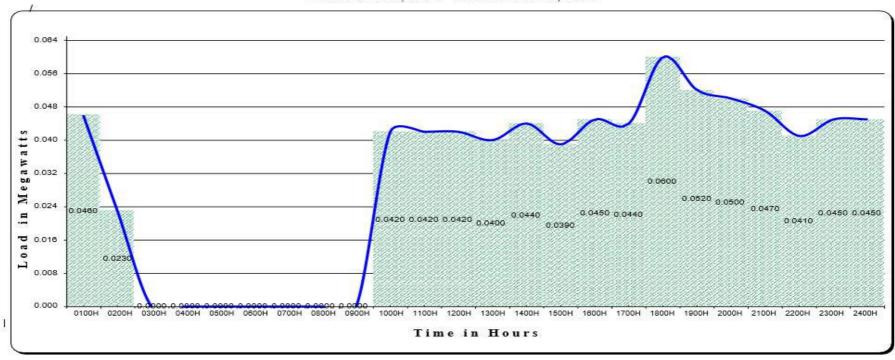


0100H	0200H	0300H	0400H	0500H	0600H	0700H	0800H	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	68 - 3	0	S.	37	20 13	- 22		120		TOT	AL C	APAB	ILITY	8	22 22	-38	- 3	: 50		207 (2)			5 3
0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140
						100				SY	STEM	DEM	AND			10							
0.046	0.023	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.042	0.042	0.042	0.040	0.044	0.039	0.045	0.044	0.060	0.052	0.050	0.047	0.041	0.045	0.045
				-	204 200				R	ESER	VED /	(DEFI	CIEN	CY)	224 225					224 20			
0.094	0.117	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.098	0.098	0.098	0.100	0.096	0.101	0.095	0.096	0.080	0.088	0.090	0.093	0.099	0.095	0.095

LOAD AND DEMAND CURVE

Casian Diesel Power Plant

NOVEMBER 25, 2024 - DECEMBER 25, 2024

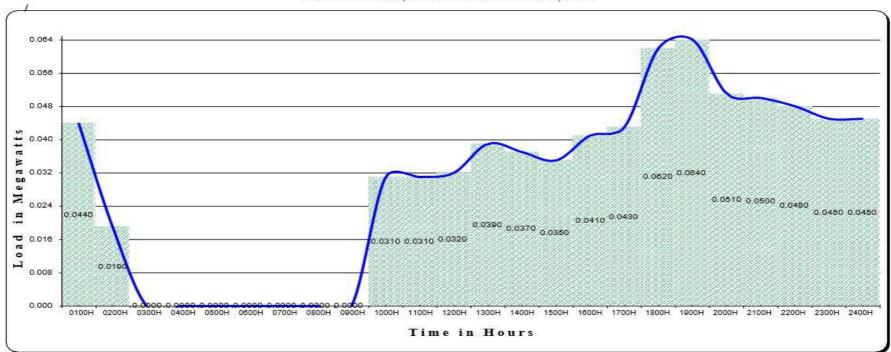


0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
		172	en nes	555	720	100				TOT	AL C	APAB	ILITY		723	100			- 12	ž 190			
0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.140
	SYSTEM DEMAND																						
0.044	0.019	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.031	0.031	0.032	0.039	0.037	0.035	0.041	0.043	0.062	0.064	0.051	0.050	0.048	0.045	0.045
									R	ESER	VED /	(DEFI	CIEN	CY)									
0.096	0.121	0.140	0.140	0.140	0.140	0.140	0.140	0.140	0.109	0.109	0.108	0.101	0.103	0.105	0.099	0.097	0.078	0.076	0.089	0.090	0.092	0.095	0.095

National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Paly Diesel Power Plant


December 25, 2023 to January 25, 2024

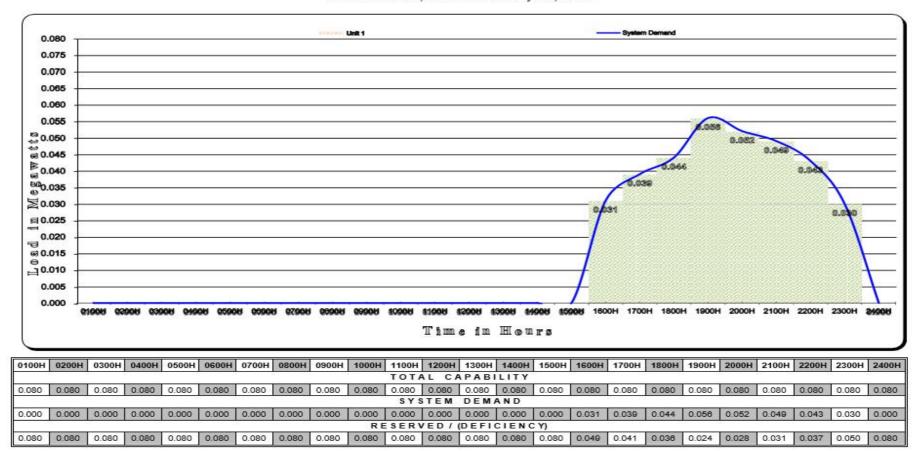

LOAD AND DEMAND CURVE

Paly Diesel Power Plant

January 25, 2024 to February 25, 2024

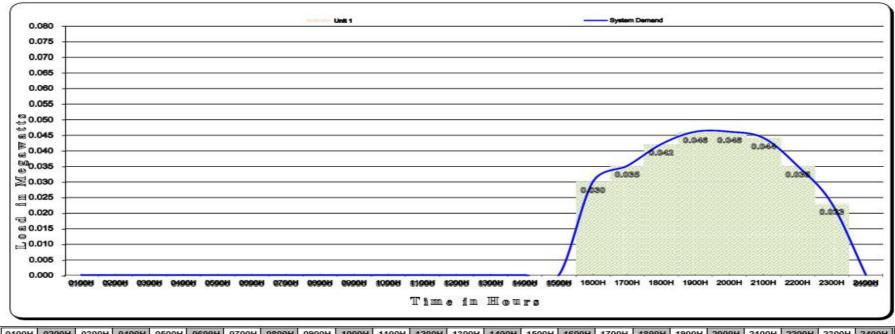


0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	7.0	202			0.	20 40				TOTA	LCA	PABI	LITY						TH 65				
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080
										SYS	TEM	DEM	ND										
0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.030	0.035	0.042	0.046	0.046	0.044	0.035	0.023	0.000
					0				RE	SERV	ED/	DEFI	CIENC	Y)									
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.050	0.045	0.038	0.034	0.034	0.036	0.045	0.057	0.080

LOAD AND DEMAND CURVE

Paly Diesel Power Plant

February 25, 2024 to March 25, 2024

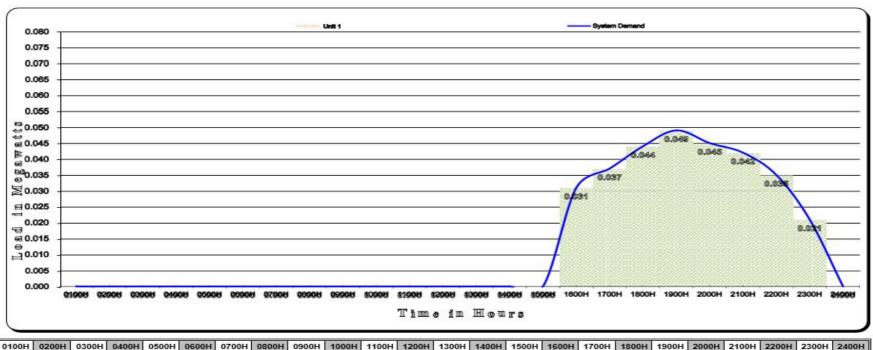


0100H	0200H	0300H	0400H	0500H	0600H	0700H	H0080	0900H	1000H	1100H	1200H	1300H	1400H	1500H	1600H	1700H	1800H	1900H	2000H	2100H	2200H	2300H	2400H
	200	(e)	- 20			(e) 39	3 93	9 9	90	TOTA	LCA	PABI	LITY	(e. (a)	(3)			7	20			50	100
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080
										SYS	TEM	DEM	AND										
0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.031	0.037	0.044	0.049	0.045	0.042	0.035	0.021	0.000
									RE	SERV	ED/	DEFI	CIENC	Y)									- 3
0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.049	0.043	0.038	0.031	0.035	0.038	0.045	0.059	0.080

LOAD AND DEMAND CURVE

Paly Diesel Power Plant

March 25, 2024 to April 25, 2024

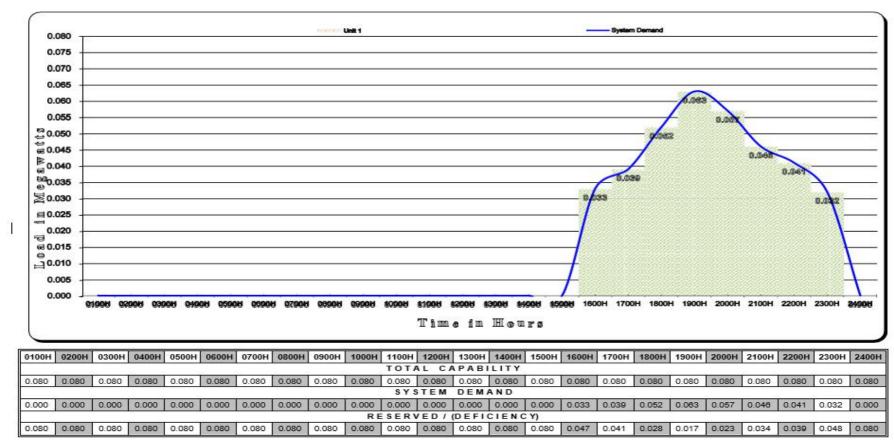

0.052

0.028 0.033

0.028 0.019

0.047

0.043

0.037

0.032 0.000

0.080

0.048

0.000

0.080

0.000

0.080

0.000 0.000

0.080 0.080 0.080

0.000

0.000 0.000


0.080 0.080

0.000

National Power Corporation SMALL POWER UTILITIES GROUP

Paly Diesel Power Plant

April 25, 2024 to May 25, 2024

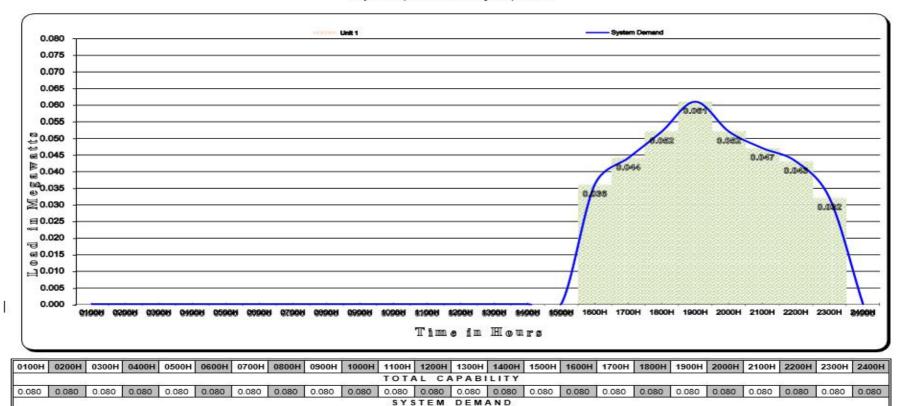

RESERVED / (DEFICIENCY)


0.080 0.080 0.080 0.080 0.080 0.080 0.080 0.044 0.038

0.000 0.000 0.000 0.000 0.000 0.000 0.038 0.044 0.052 0.061

National Power Corporation SMALL POWER UTILITIES GROUP

Paly Diesel Power Plant

May 25, 2024 to June 25, 2024

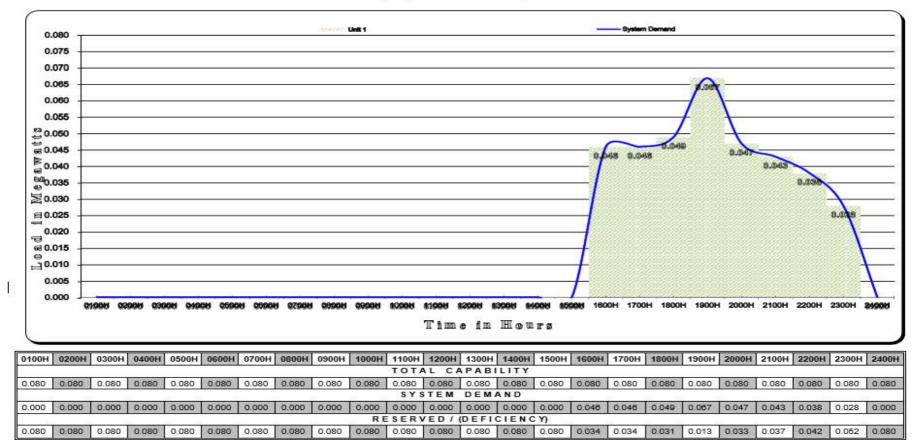


National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Paly Diesel Power Plant


June 25, 2024 to July 25, 2024

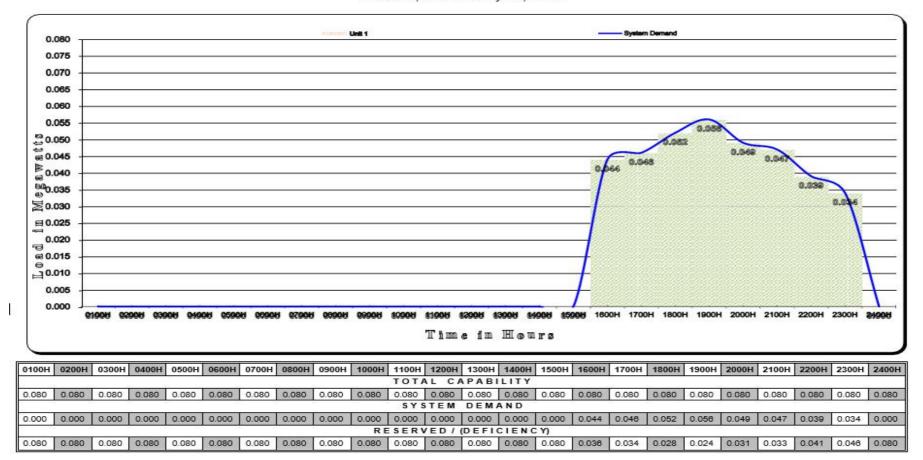

LOAD AND DEMAND CURVE

Paly Diesel Power Plant


July 25, 2024 to August 25, 2024

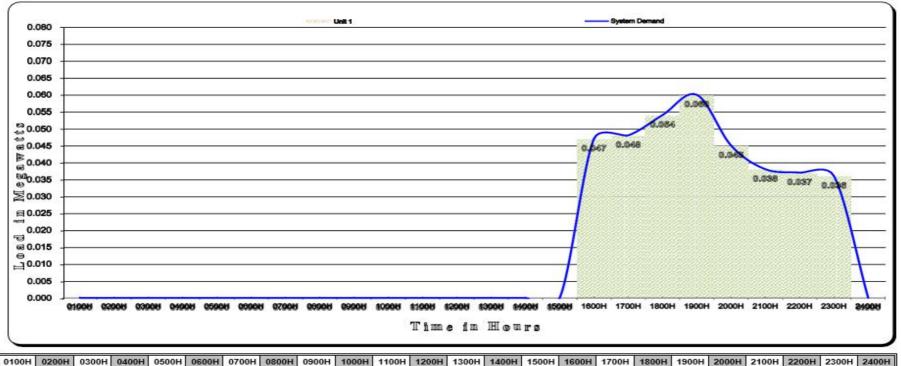

LOAD AND DEMAND CURVE

Paly Diesel Power Plant

August 25, 2024 to September 25, 2024

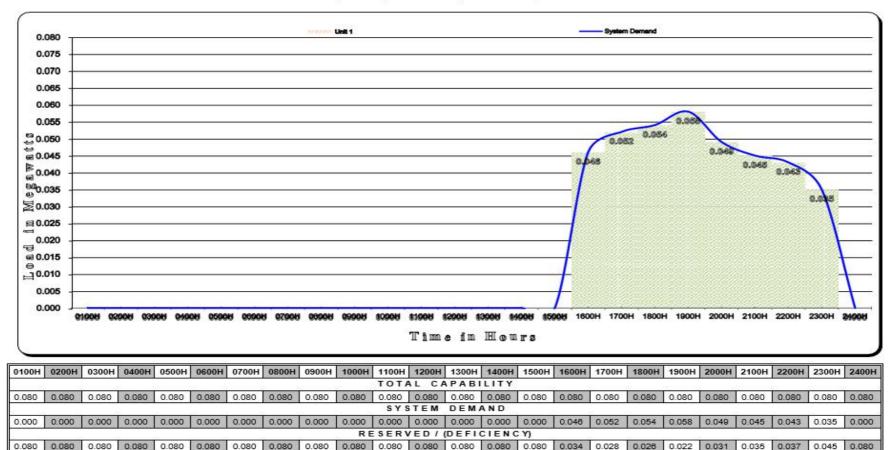


National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Paly Diesel Power Plant


September 25, 2024 to October 25, 2024

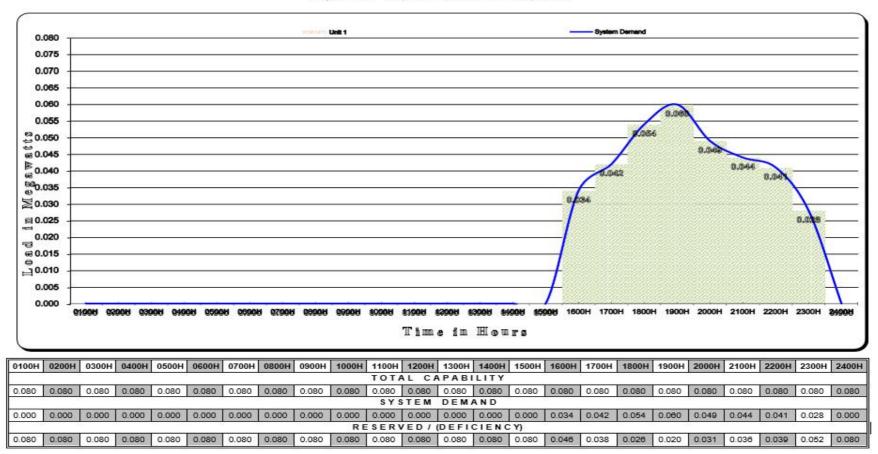

LOAD AND DEMAND CURVE

Paly Diesel Power Plant


October 25, 2024 to November 25, 2024

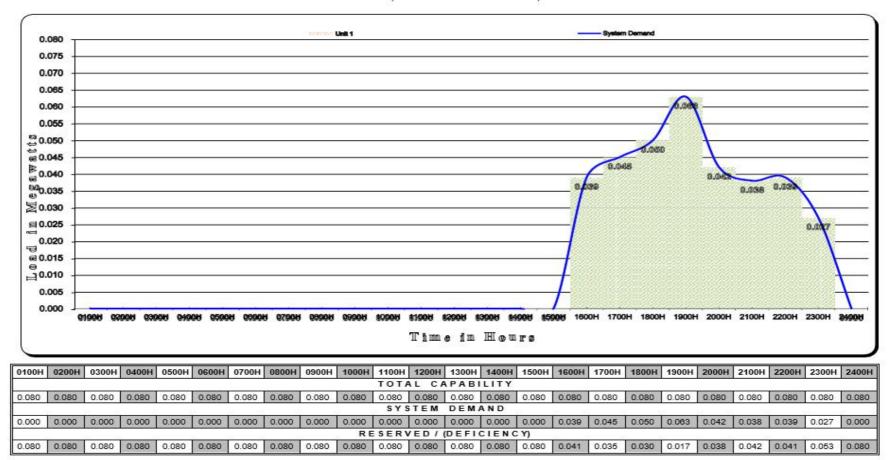

LOAD AND DEMAND CURVE

Paly Diesel Power Plant


November 25, 2024 to December 25, 2024

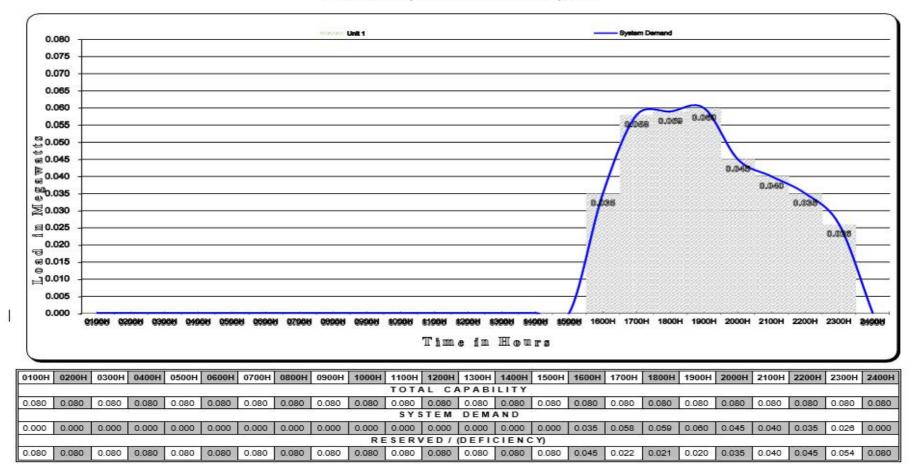

SMALL POWER UTILITIES GROUP LOAD AND DEMAND CURVE


Nangalao Diesel Power Plant

December 25, 2023 to January 25, 2024

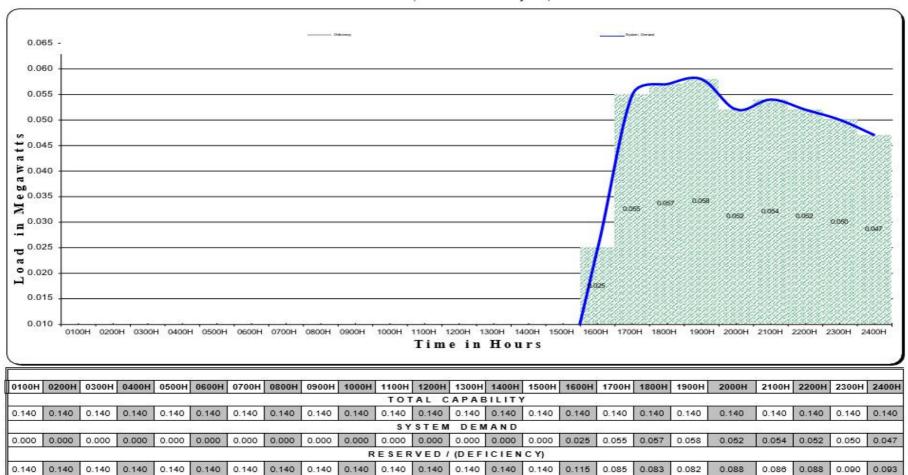

SMALL POWER UTILITIES GROUP LOAD AND DEMAND CURVE Nangalao Diesel Power Plant


January 25, 2024 to February 25, 2024

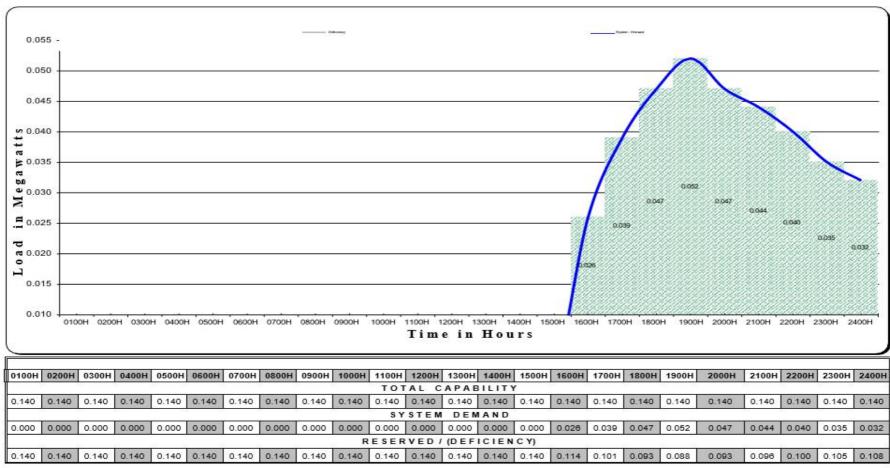

SMALL POWER UTILITIES GROUP LOAD AND DEMAND CURVE

Nangalao Diesel Power Plant


February 25, 2024 to March 25, 2024

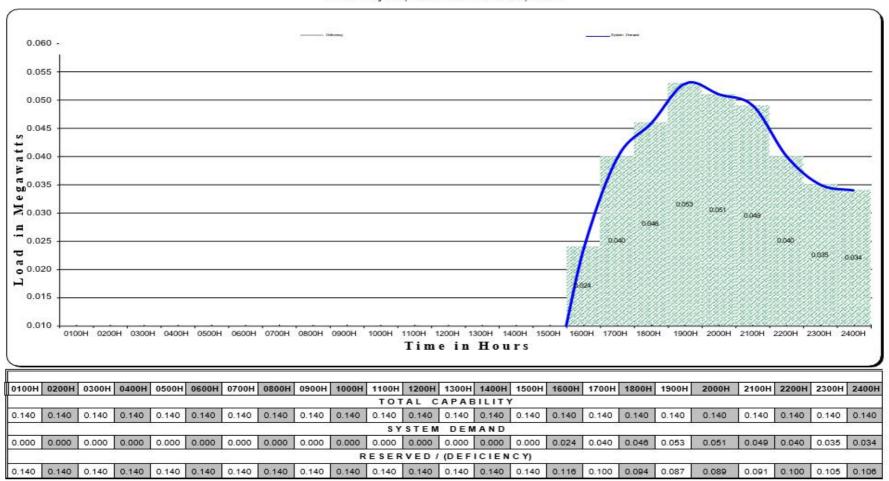

SMALL POWER UTILITIES GROUP LOAD AND DEMAND CURVE

Nangalao Diesel Power Plant

March 25, 2024 to April 25, 2024

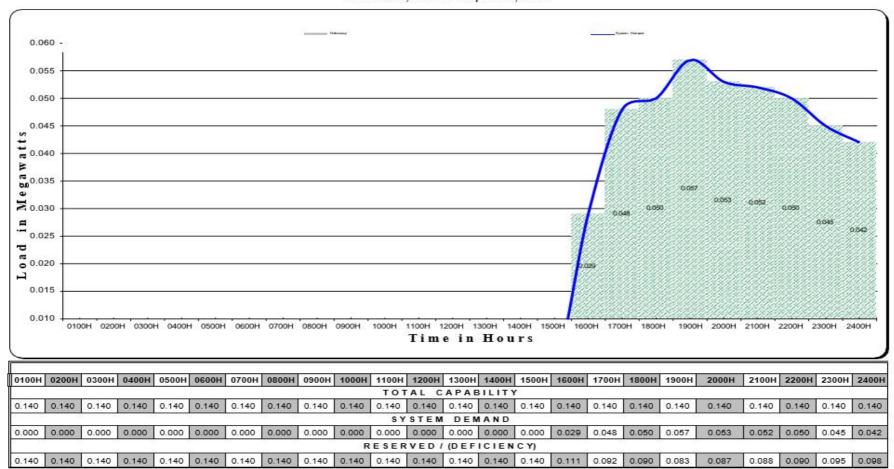


PR NO. HO-PMD25-003

SMALL POWER UTILITIES GROUP LOAD AND DEMAND CURVE

Nangalao Diesel Power Plant


April 25, 2024 to May 25, 2024

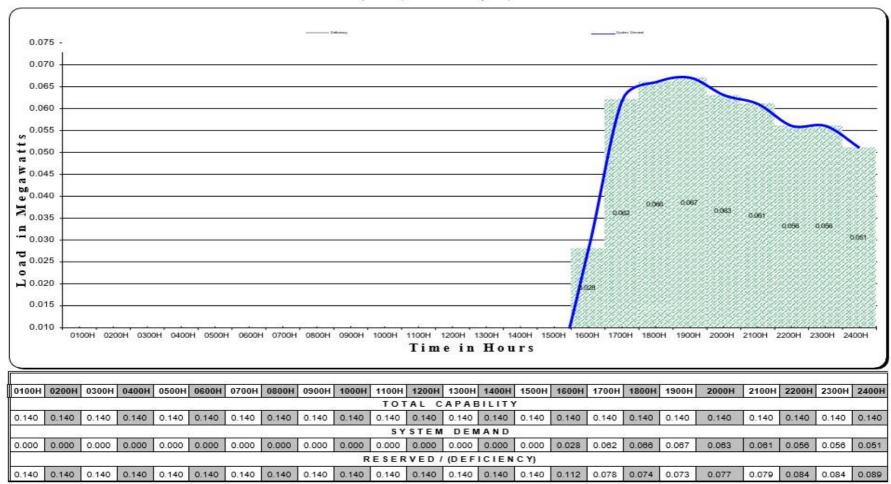

SMALL POWER UTILITIES GROUP LOAD AND DEMAND CURVE

Nangalao Diesel Power Plant


May 25, 2024 to June 25, 2024

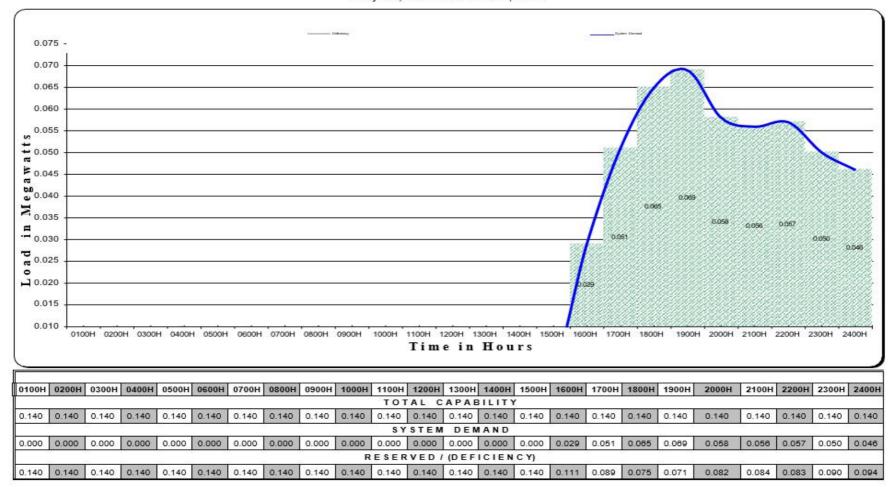

SMALL POWER UTILITIES GROUP LOAD AND DEMAND CURVE

Nangalao Diesel Power Plant

June 25, 2024 to July 25, 2024

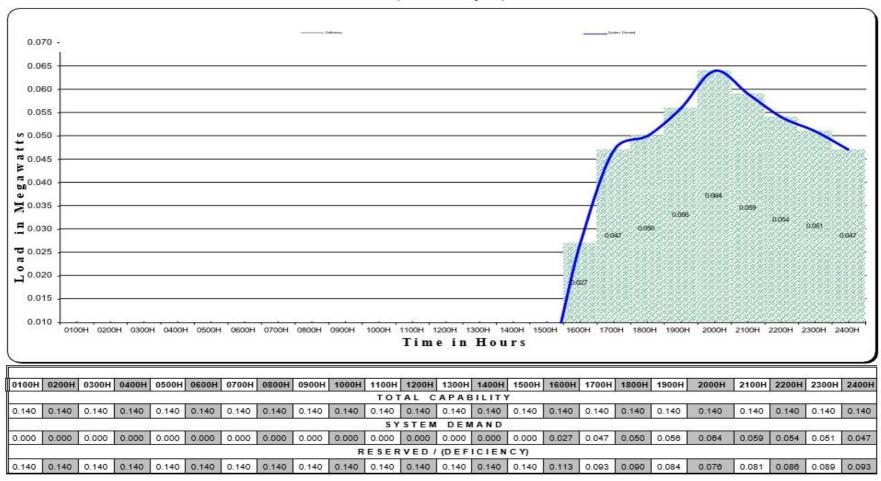


PR NO. HO-PMD25-003

SMALL POWER UTILITIES GROUP LOAD AND DEMAND CURVE

Nangalao Diesel Power Plant


July 25, 2024 to August 25, 2024

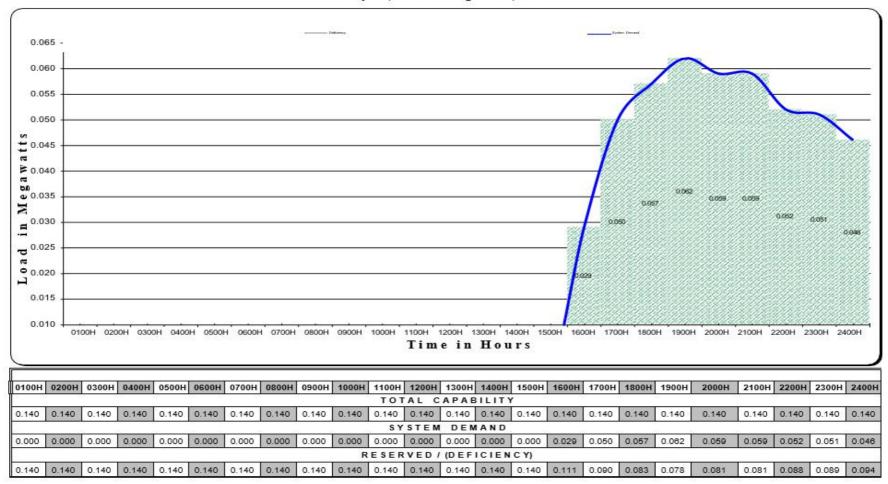

SMALL POWER UTILITIES GROUP LOAD AND DEMAND CURVE

Nangalao Diesel Power Plant


August 25, 2024 to September 25, 2024

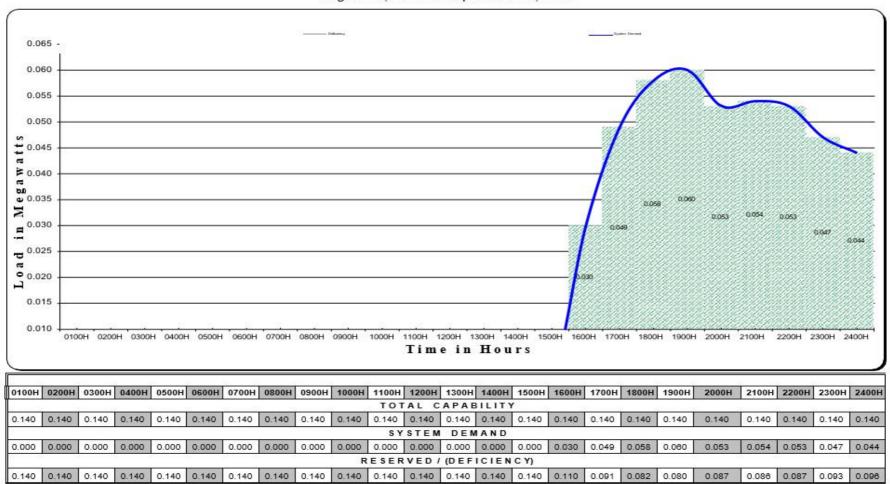

SMALL POWER UTILITIES GROUP LOAD AND DEMAND CURVE

Nangalao Diesel Power Plant

September 25, 2024 to October 25, 2024

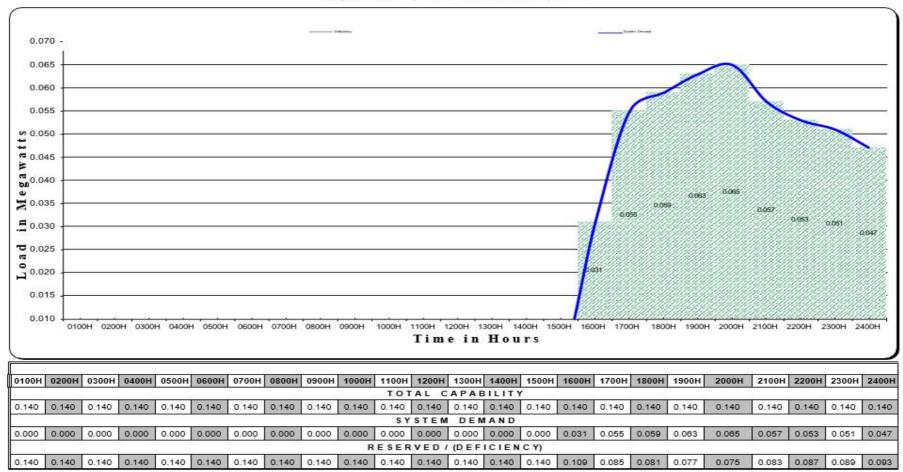


PR NO. HO-PMD25-003

SMALL POWER UTILITIES GROUP LOAD AND DEMAND CURVE

Nangalao Diesel Power Plant


October 25, 2024 to November 25, 2024

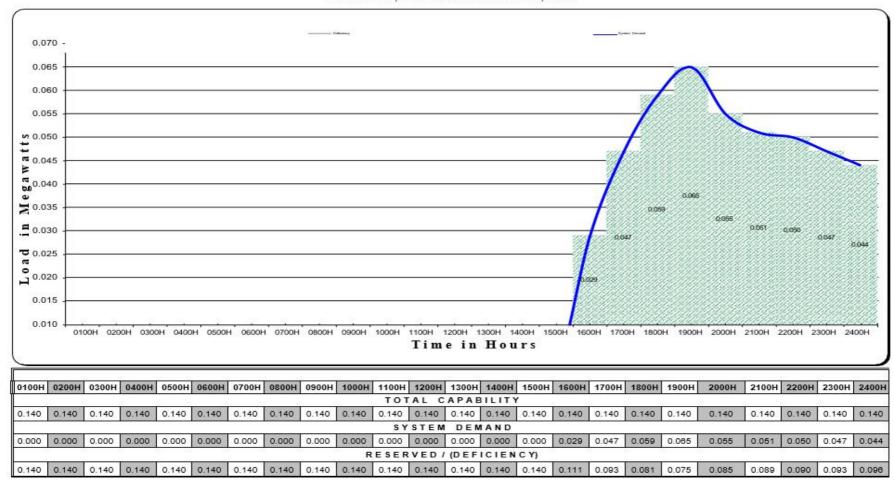

SMALL POWER UTILITIES GROUP LOAD AND DEMAND CURVE

Nangalao Diesel Power Plant

November 25, 2024 to December 25, 2024

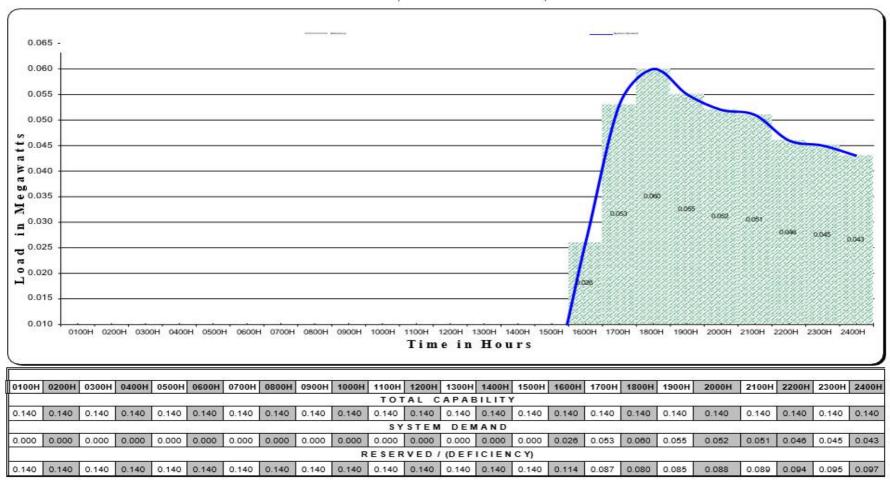

PR NO. HO-PMD25-003


National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Tara Diesel Power Plant

DEC 25 - JAN 25, 2024



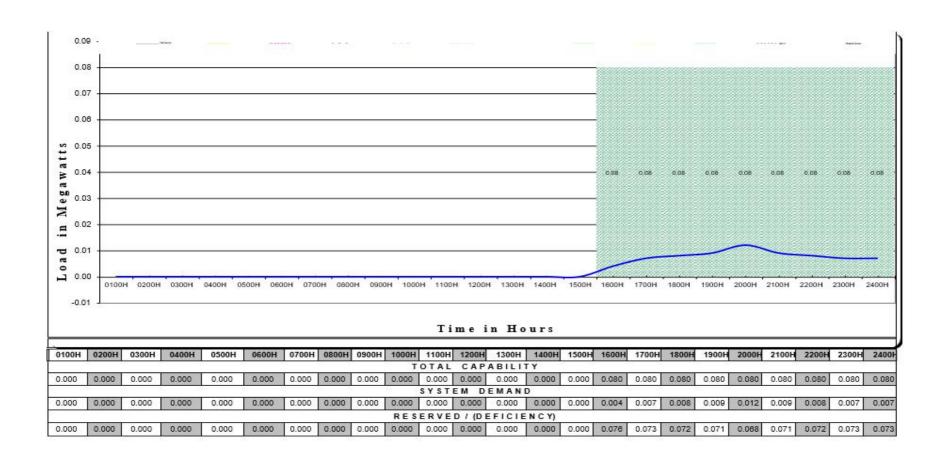


PR NO. HO-PMD25-003


National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Tara Diesel Power Plant

JAN 25 -FEB 25, 2024



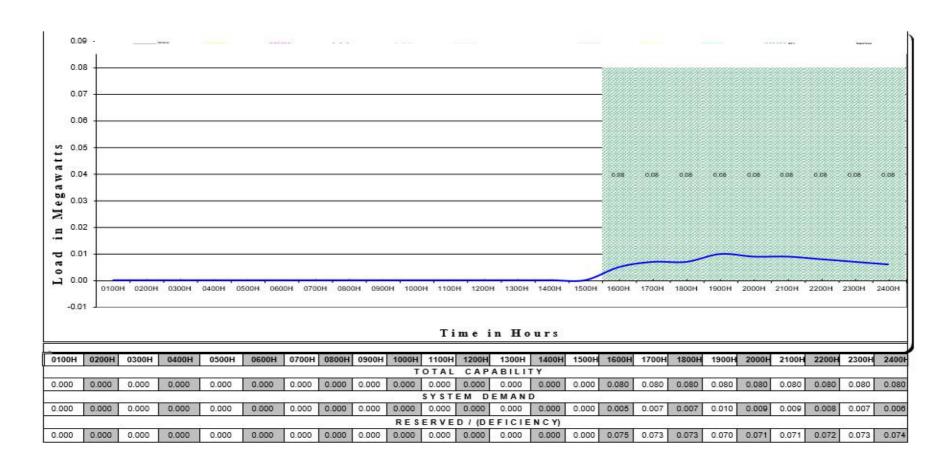

PR NO. HO-PMD25-003


National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Tara Diesel Power Plant

FEB 25 -MAR 25, 2024



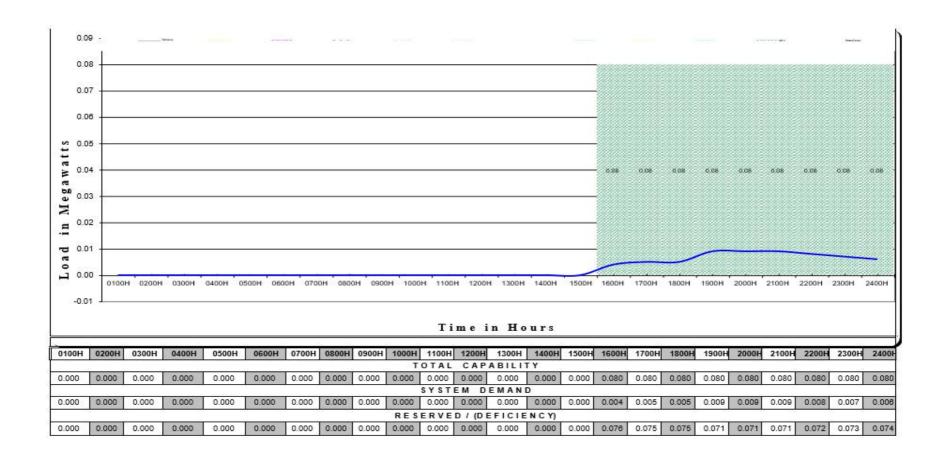


PR NO. HO-PMD25-003


National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Tara Diesel Power Plant

MAR 25 - APR 25, 2024



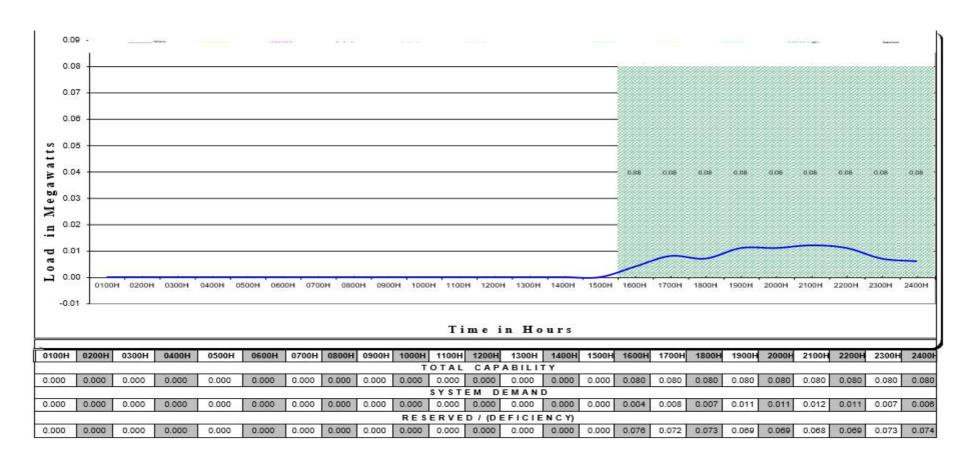

PR NO. HO-PMD25-003


National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Tara Diesel Power Plant

APR 25 -MAY 25, 2024



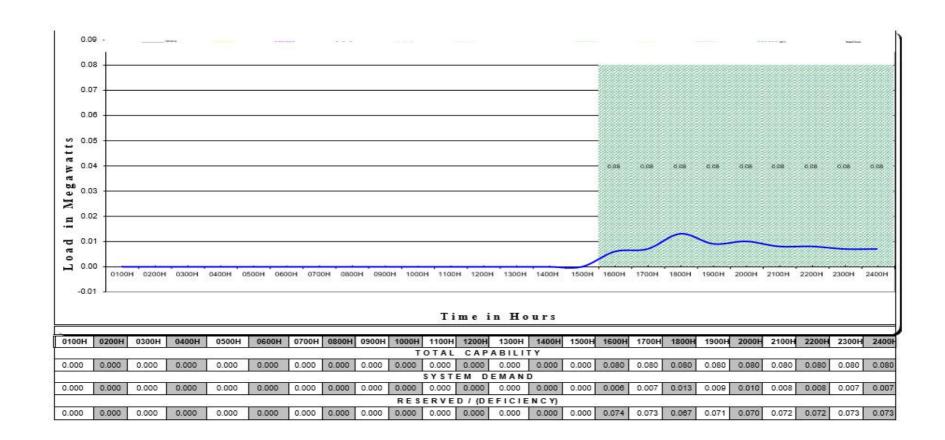

PR NO. HO-PMD25-003

National Power Corporation


SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Tara Diesel Power Plant

MAY 25 - JUN 25, 2024



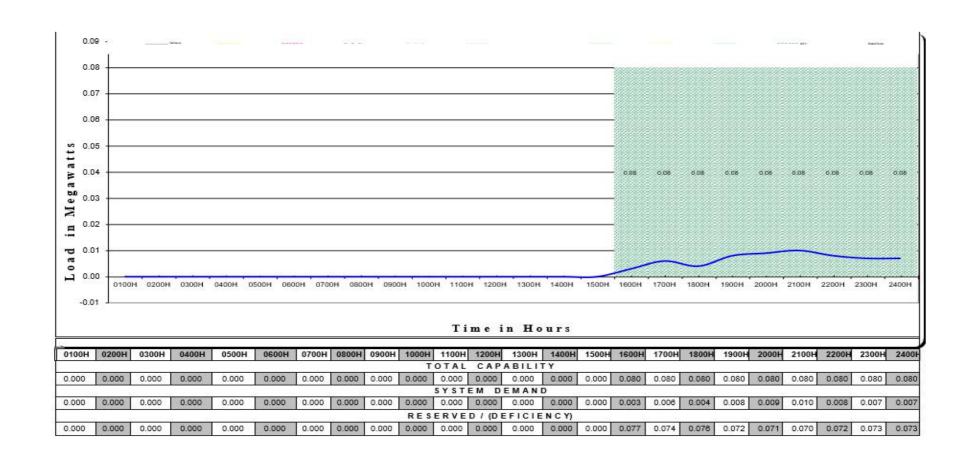

SECTION IX - APPENDICES

PR NO. HO-PMD25-003


National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Tara Diesel Power Plant

JUN 25 - JUL 25, 2024



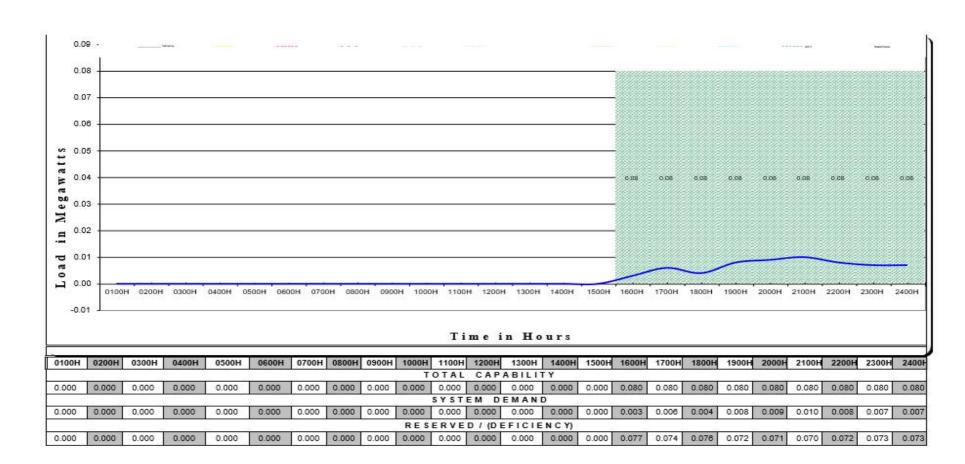

SECTION IX - APPENDICES

PR NO. HO-PMD25-003


National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Tara Diesel Power Plant

JUL 25 - AUG 25, 2024



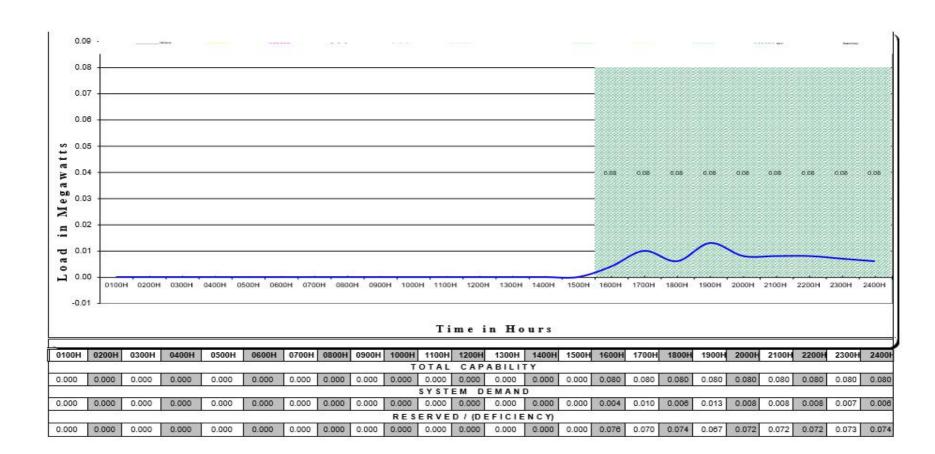

SECTION IX – APPENDICES


PR NO. HO-PMD25-003


National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Tara Diesel Power Plant

AUG 25 - SEP 25, 2024



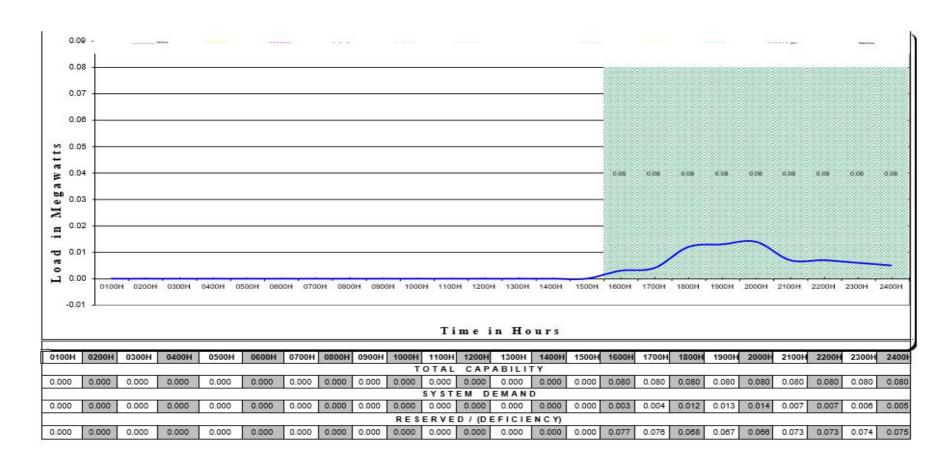

SECTION IX - APPENDICES

PR NO. HO-PMD25-003

National Power Corporation


SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Tara Diesel Power Plant

SEPT 25 - OCT 25, 2024



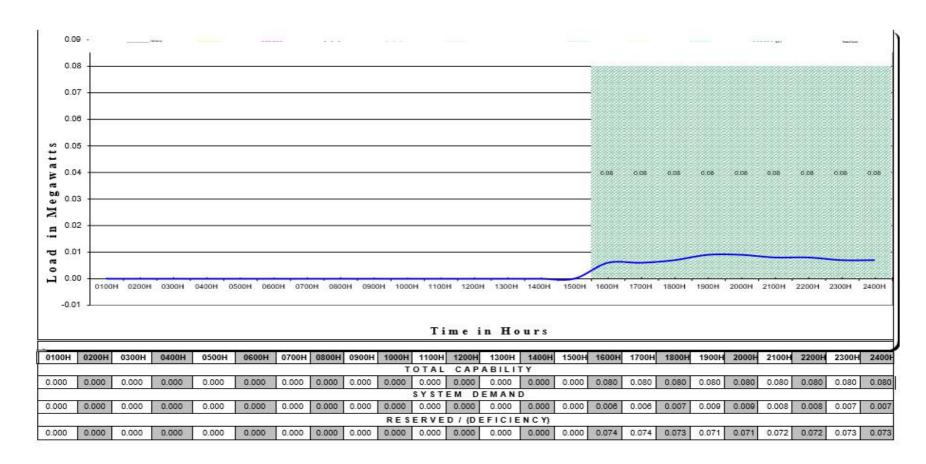

SECTION IX - APPENDICES


PR NO. HO-PMD25-003


National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Tara Diesel Power Plant

OCT 25 - NOV 25, 2024



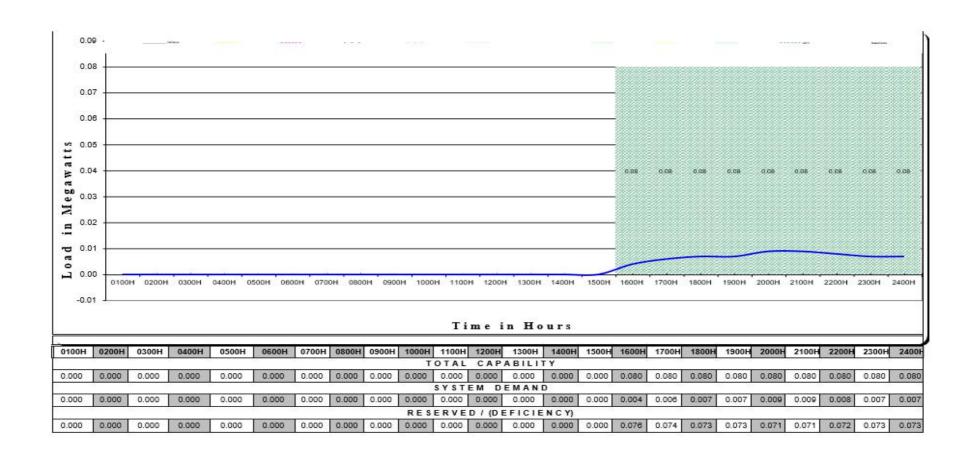

Revised November 2001

SECTION IX - APPENDICES


PR NO. HO-PMD25-003

National Power Corporation SMALL POWER UTILITIES GROUP

LOAD AND DEMAND CURVE

Tara Diesel Power Plant

NOV 25 - DEC 25, 2024

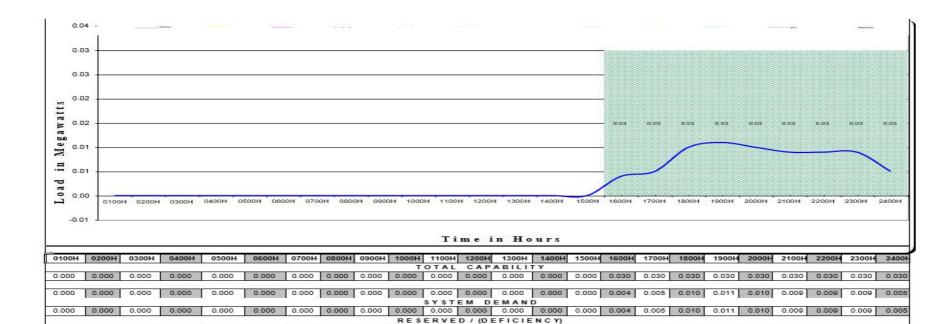

0.000 0.000 0.000 0.000 0.000 0.000 0.000 0.000 0.000 0.000 0.000 0.000 0.025 0.025 0.020 0.019 0.020 0.021 0.021 0.021 0.025

0.000 0.000 0.000

0.000

0.000

0.000


APPENDIX D DISTRIBUTION SYSTEM SINGLE LINE DIAGRAM


NOTE: PLEASE BE ADVISED THAT THE ATTACHED DRAWING IS INTENDED FOR REFERENCE PURPOSES ONLY. THE DISTRIBUTION LINE DIAGRAM AND ITS CONTENT ARE SUBJECT TO CHANGE AND MAY VARY WITHOUT PRIOR NOTICE. FOR THE MOST ACCURATE AND UP-TO-DATE INFORMATION, ALWAYS REFER TO THE LATEST OFFICIAL DOCUMENTATION OR CONTACT THE CONCERNED DISTRIBUTION UTILITY/ELECTRIC COOPERATIVE.

CABIGSING CATADMAN R1 TUCADAN LAGAORIAO R2 IGABAS PAWA **IGABAS** LUCBUAN

CUYO DISTRIBUTION SYSTEM SINGLE LINE DIAGRAM

RIZAL DISTRIBUTION SYSTEM SINGLE LINE DIAGRAM

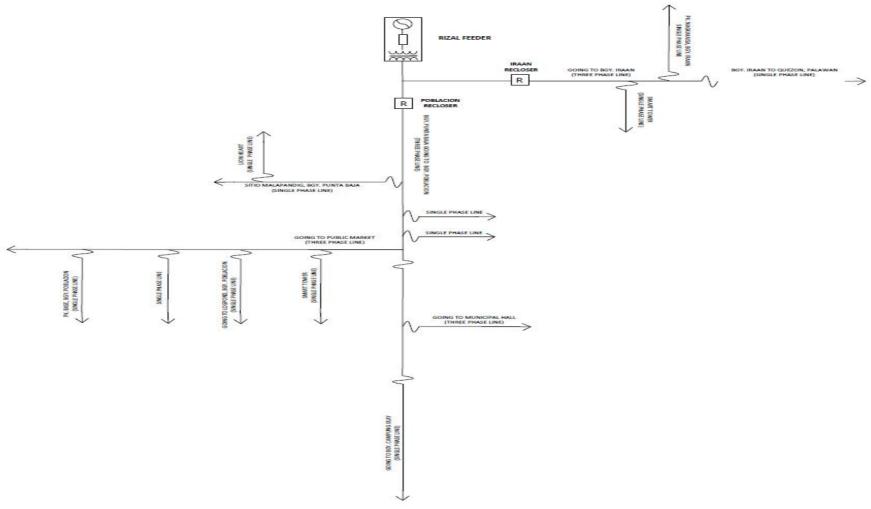


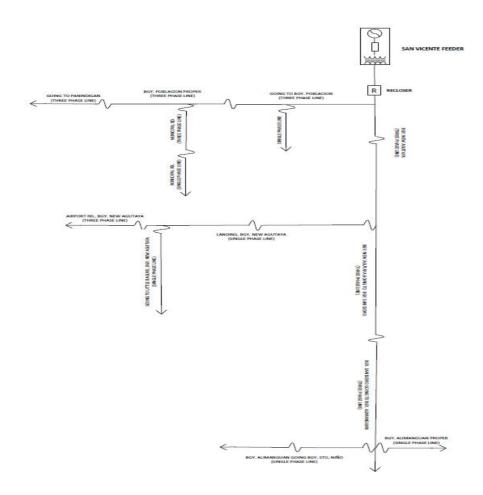


SAN VICENTE DISTRIBUTION SYSTEM SINGLE LINE DIAGRAM


NATIONAL POWER CORPORATION IX-A-104

SECTION IX - APPENDICES PR NO. HO-PMD25-003

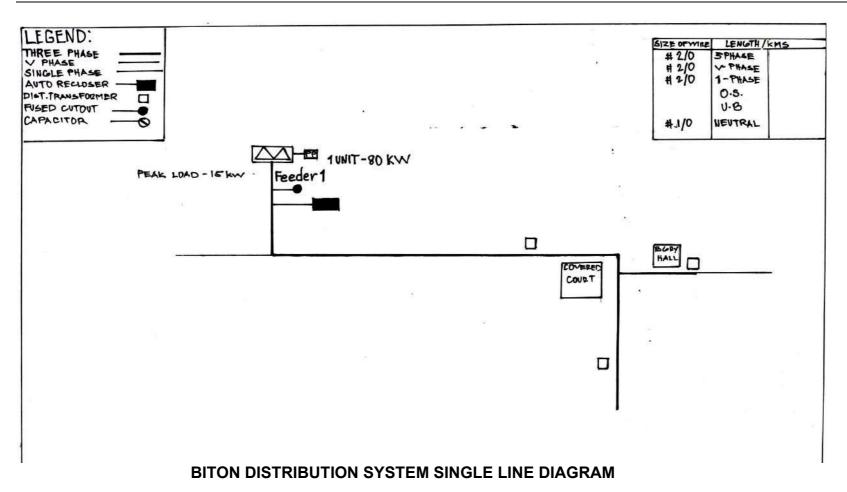

NATIONAL POWER CORPORATION IX-A-105




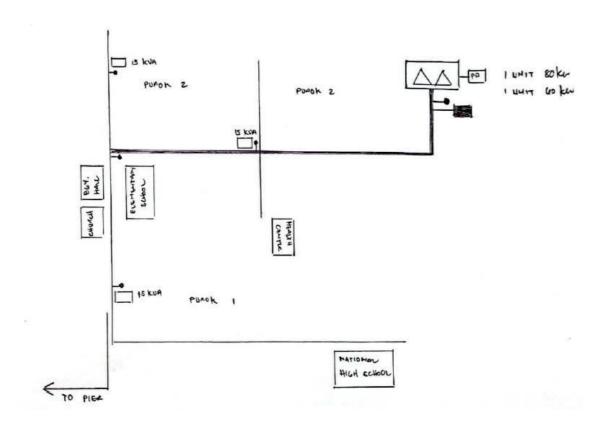

CASIAN DISTRIBUTION SYSTEM SINGLE LINE DIAGRAM


IX-A-107

SECTION IX - APPENDICES PR NO. HO-PMD25-003

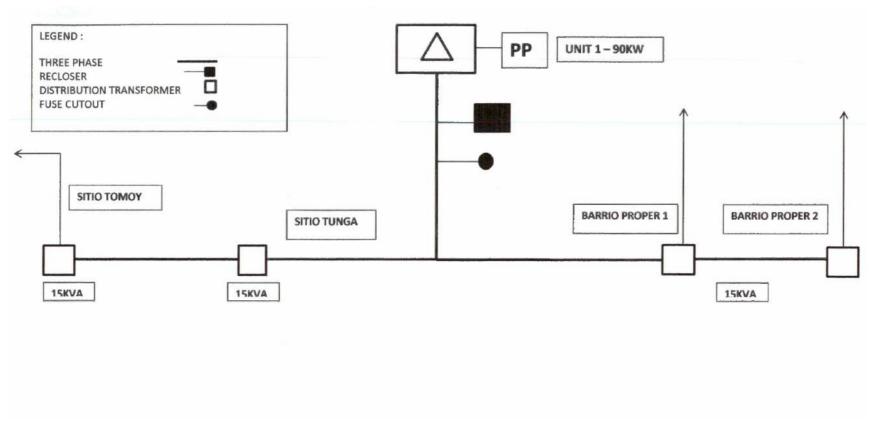


PALY DISTRIBUTION SYSTEM SINGLE LINE DIAGRAM

SECTION IX - APPENDICES PR NO. HO-PMD25-003

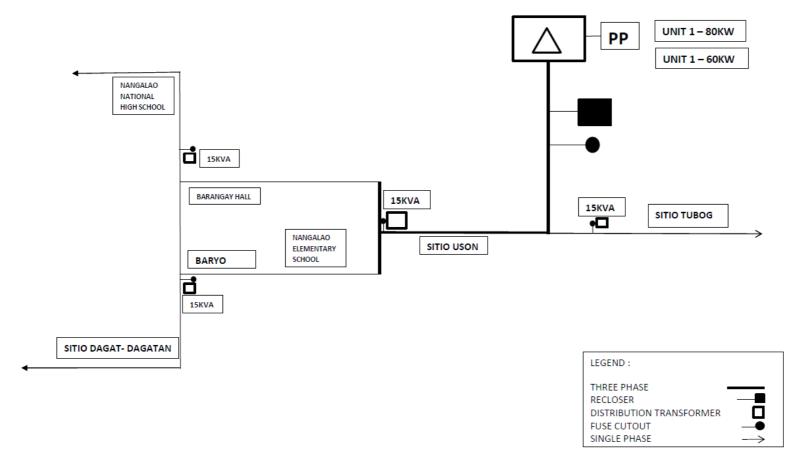

NAGARAO DISTRIBUTION SYSTEM SINGLE LINE DIAGRAM

SECTION IX - APPENDICES PR NO. HO-PMD25-003

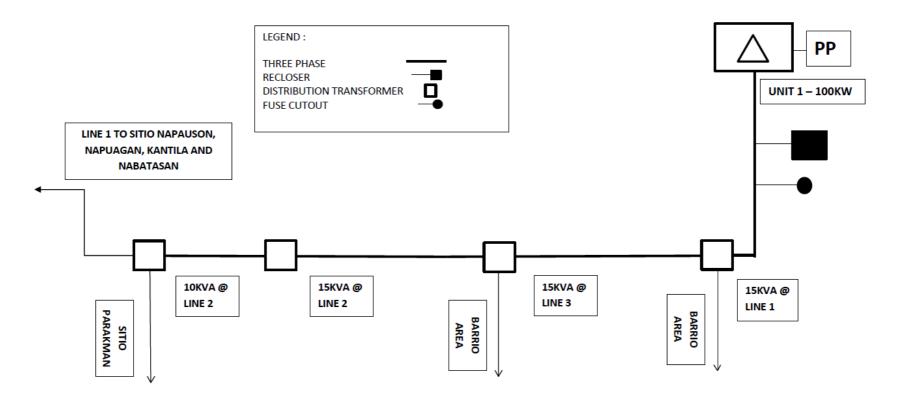

TARA DISTRIBUTION SYSTEM SINGLE LINE DIAGRAM

PR NO. HO-PMD25-003

APPENDIX E

RENEWABLE ENERGY POWER PURCHASED AGREEMENT (REPPA)

RENEWABLE ENERGY POWER PURCHASE AGREEMENT (REPPA)

BETWEEN

NATIONAL POWER CORPORATION

Supply and Delivery of Renewable Energy for the Hybridization of Diesel Power Plant's under Schedule III Cluster 4A - Palawan

Table of Contents

RENEWABLE ENERGY POWER PURCHASE AGREEMENT (REPPA)	3
ANNEX A: DEFINITION OF TERMS	19
ANNEX B: JOINT COORDINATION PROTOCOL	23
ANNEX C: ALLOWABLE DOWNTIME SCHEDULE	26
ANNEX D: BILLING AND PAYMENT PROCESS FLOW	27
ANNEX E: DOCUMENTATION FOR THE ENERGY FEE INVOICE	. 28

Renewable Energy Power Purchase Agreement NPC and	
Page 3 of 29	

This Renewable Energy Power Purchase Agreement (REPPA) entered between:

The NATIONAL POWER CORPORATION (NPC), a government-owned and controlled corporation duly organized and existing by virtue of Republic Act No. 6395, as amended, with principal office address at Gabriel Y. Itchon Building, Senator Miriam P. Defensor-Santiago Ave. (formerly BIR Road) cor. Quezon Ave., Diliman, Quezon City, Philippines, represented by its President and CEO, FERNANDO MARTIN Y. ROXAS, who is duly authorized to represent it in this transaction, hereinafter referred to as "NPC";


-a	nd-
	with principal office address at _ , Philippines,
represented wh	by its, no is duly authorized to represent it in this
	ne "Renewable Energy Power Provider
(Each of NPC and REPP shall be referred referred to as the "Parties")	I to individually as a "Party" and jointly

WITNESSETH THAT:

WHEREAS, Section 70 of Republic Act No. 9136 or the Electric Power Industry Reform Act (EPIRA) mandated NPC, through its Small Power Utilities Group (SPUG) to be responsible in providing power generation and its associated power delivery systems in areas that are not connected to the transmission system;

WHEREAS, under Section 3 of the EPIRA IRR, the NPC-SPUG, is mandated to periodically assess the requirements and prospects of bringing power generation and associated power delivery systems to commercial viability on an area-by-area basis including a program to encourage private sector participation;

WHEREAS, the ERC, based on the application of NPC, has determined the Subsidized Approved Generation Rate (SAGR) of each franchise area being charged by NPC to its customers based on the Missionary Electrification Development Plan (MEDP) that the Department of Energy (DOE) formulates in consultation and coordination with NPC, National Electrification Administration(NEA), New Power Providers (NPPs), Independent Power Producers (IPPs), Electric Cooperatives (ECs)/Distribution Utilities (DUs) and Qualified Third Parties (QTPs).



WHEREAS, Section 2 of Republic Act No. 9513 or the "Renewable Energy Act of 2008" or "RE Act" states the policy of the State to increase the utilization of Renewable Energy (RE) resources by institutionalizing the development of national and local capabilities in the use of renewable energy systems, and promoting its efficient and cost-effective commercial application by providing fiscal and non-fiscal incentives, among others;

WHEREAS, DOE Department Circular 2023-05-0014 requires NPC or its successor interest to source a minimum percentage or procure a portion of all of its energy requirements or supply from eligible Renewable Energy (RE) in order to fulfill its sacred duty to provide missionary electrification in the Off-Grid Areas. NPC is thereby mandated to formulate its Hybridization Program where the existing NPC SPUG diesel power plants shall be hybridized with RE system leading to the most optimal configuration in the concerned Off-Grid and Missionary Areas.

the NPC-SPUG may enter into bilateral contracts with generation purpose of carrying out its missionary electrification under the EPIF	•
WHEREAS, after a competitive tender,	was determined as
the bidder with the highest rated responsive bid price offer of $_$	_per kWh and was
awarded with the contract for a _kW supply of electricity to NPC us	sing
technology for Cluster No,	and
within the franchise area of .	

WHEREAS, the Department of Justice issued Opinion No. 14, S. 2019 declaring that

NOW, THEREFORE, for and in consideration of the foregoing premise and the mutual covenants hereinafter contained, the Parties agree as follows:

SECTION 1 - DEFINITION OF TERMS

1. Definitions, Interpretation, and Abbreviation. The Definition of Terms attached herewith as **ANNEX A** shall form an integral part of this REPPA.

In the same manner, all documents annexed to this REPPA and all Tender Documents shall form an integral part thereof and shall be considered part of this REPPA.

SECTION 2 - SCOPE OF AGREEMENT

- **2.1** This Agreement governs the relationship between **NPC** and **REPP** for the sale and supply of the Renewable Energy (RE) requirement of the (EC/DU Name).
- **2.2** NPC shall purchase and receive electricity from the REPP. There shall be no Capacity Fees and take-or-pay obligations in this REPPA.

<u>SECTION 3 - EFFECTIVITY AND TERMS OF AGREEMENT</u>

- 3.1 This REPPA shall take effect on the date of confirmation by the REPP on the NPC issued Notice to Proceed ("Effective Date") which must coincide with the execution of the REPPA by the Parties.
- **3.2** This REPPA shall remain in full force and effect from the Effective Date up to the end of the Contract Period of twenty-two (22) years covering the two (2) years preconstruction and construction and twenty (20) years plant operation or at the exhaustion of the **Contract Amount**.
- **3.3** The REPP's committed Commercial Operation Start Date (COSD) must not exceed a period of twenty-four (24) months from the Effective Date of the REPPA.

SECTION 4 – OBLIGATIONS OF THE PARTIES

The **REPP** shall have the following obligations:

4.1 The **REPP** shall design, finance, develop, construct, test, commission, operate and maintain the following renewable energy power plants (with Battery Energy Storage Systems (BESS) as needed) in the following NPC-SPUG plants and areas:

Contract Area: Cluster 4A - PALAWAN			
ITEM	DESCRIPTION	REPP's DATA	
	Plant: Cuyo DPP		
1.0	RE Type		
2.0	Capacity* (kW in AC)		
3.0	BESS (kWh), as applicable		
4.0	Availability, (PCF or Annual Daily Average in Hours)		
5.0	Minimum Annual Generation (MAG _{Plant1})		
6.0	Commercial Operation Start Date (COSD)		
	Plant: Rizal PP		
1.0	RE Type		
2.0	Capacity* (kW in AC)		
3.0	BESS (kWh), as applicable		
4.0	Availability, (PCF or Annual Daily Average in Hours)		
5.0	Minimum Annual Generation (MAG _{Plant2})		

	Commercial Operation Start			
6.0	Commercial Operation Start Date (COSD)			
Plant: San Vicente DPP				
1.0	RE Type			
2.0	Capacity* (kW in AC)			
3.0	BESS (kWh), as applicable			
4.0	Availability, (PCF or Annual Daily Average in Hours)			
5.0	Minimum Annual Generation (MAGPlant3)			
6.0	Committed Commercial Operation Start Date (COSD)			
	Plant: Biton DPP			
1.0	RE Type			
2.0	Capacity* (kW in AC)			
3.0	BESS (kWh), as applicable			
4.0	Availability, (PCF or Annual Daily Average in Hours)			
5.0	Minimum Annual Generation (MAGPlant4)			
6.0	Committed Commercial Operation Start Date (COSD)			
	Plant: Casian DPP			
1.0	RE Type			
2.0	Capacity* (kW in AC)			
3.0	BESS (kWh), as applicable			
4.0	Availability, (PCF or Annual Daily Average in Hours)			
5.0	Minimum Annual Generation (MAGPlant5)			
6.0	Committed Commercial Operation Start Date (COSD)			
Plant: Paly DPP				
1.0	RE Type			
2.0	Capacity* (kW in AC)			

3.0	BESS (kWh), as applicable	
4.0	Availability, (PCF or Annual Daily Average in Hours)	
5.0	Minimum Annual Generation (MAGPlant6)	
6.0	Committed Commercial Operation Start Date (COSD)	
	Plant: Nangalao DPP	
1.0	RE Type	
2.0	Capacity* (kW in AC)	
3.0	BESS (kWh), as applicable	
4.0	Availability, (PCF or Annual Daily Average in Hours)	
5.0	Minimum Annual Generation (MAGPlant7)	
6.0	Committed Commercial Operation Start Date (COSD)	
	Plant: Tara DPP	
1.0	RE Type	
2.0	Capacity* (kW in AC)	
3.0	BESS (kWh), as applicable	
4.0	Availability, (PCF or Annual Daily Average in Hours)	
5.0	Minimum Annual Generation (MAGPlant8)	
6.0	Committed Commercial Operation Start Date (COSD)	
Total Minimu Cluster (MAG	um Annual Generation for the REPP) (kWh)	

Notes:

- 1. * Shall be determined based on the given load curve data in Annex C.
- 2. Any offer not meeting the NPC minimum requirements shall be grounds for disqualification.
- 3. The BESS with at least 25% of the committed capacity will be used to support the shifting operation from RE to diesel and vice versa. However, REPP may opt to install higher capacity if it intends to offer a longer availability period.
- 4. Offered MAGPLANT lower than the minimum annual generation requirement of NPC OR higher than the product of REPP's committed Capacity and Availability multiplied by 365 days will be grounds for disqualification.
- 5. MAGREPP = MAGPLANT1 + MAGPLANT2 + MAGPLANT3

4.2 The REPP shall provide Performance Security for the development, construction, and operation of the RE Facility.

- 4.2.1. To post and maintain a Development and Construction Performance Security until completion of the RE Facility.
 - a. Within ten (10) calendar days from receipt of the Notice of Award by the REPP from the Procuring Entity but in no case later than the Effective Date, the successful Bidder shall furnish the Development and Construction Performance Security in any forms prescribed in Section 39 of the 2016 revised IRR of RA 9184 wherein the amount of which shall be based on Total Cost of RE Facility.
- 4.2.2 To post an Operation Performance Security annually for the entire Cooperation Period.
 - a. Within ten (10) calendar days from the Commercial Operation Start Date (COSD) of the RE facility, the REPP shall furnish the Operation Performance Security in any forms prescribed in Section 39 of the 2016 revised IRR of RA 9184.
 - b. Within ten (10) calendar days before the expiration of the annual Performance Security within the cooperation period, the REPP shall renew the Operation Performance Security in any forms prescribed in Section 39 of the 2016 revised IRR of RA 9184.
- 4.2.3 The performance security to be posted by the REPP shall comply with the requirements specified in the SCC.
- 4.3 The REPP shall be responsible for the site acquisition or lease, site investigation/assessment, securing of and compliance with regulatory requirements which include but not limited to service contracts, licenses, permits, clearances, certifications, and interconnection of its renewable energy power plant facility with NPC's transmission/ distribution and switchyard facility or assigned connection point prior to its committed COSD. The interconnection shall include the installation of Tie Line and Revenue Meter.
- **4.4** The **REPP** shall begin to operate and sell its generated power to **NPC** on its committed COSD.

In the event of inexcusable delay in the committed COSD, penalty shall be imposed to the **REPP** by paying Liquidated Damages ("LD") per RA 9184 to be computed using the formula shown below:

 $LD = 1/10 \times [0.01((Offered Annual Generation in kWh/365)*(Bid Price Offer$

in Php/kWh)*(No. of days delayed))]

- **4.5** The **REPP**, subject to Section 4.6, shall provide a continuous and stable supply of electricity in accordance with Good Industry Practice, for a Monthly Daily Average of ____ hours or the equivalent total Committed Annual Generation of ___ kWh.
- **4.6** The REPP's supply of energy shall be available continuously except for interruption or reduction due to:
 - a. Causes beyond the control of the **REPP** including Force Majeure;
 - b. Distribution/transmission line failure;
 - c. Allowable Downtime Schedule (Annex C).
- **4.7** There shall be a Monthly Revalidation by NPC of the submitted Energy Fee Invoice by the REPP every 5TH day of the following month after the conduct of the Monthly Meter Reading in order to review the **REPP**'s meeting the Annual Generation Committed by the REPP requirement subject to the reductions provided in the preceding section above or corresponding computed Penalty Charges as provided in Section 4.8.
- 4.8 During the cooperation period, in the event that the REPP will not be able to meet the MAG as determined under Section 4.7, a Penalty Charge shall be imposed to the REPP to cover any shortfall, except those mentioned in 4.6. The Penalty Charges shall be computed monthly and reconciled at the end of the year as shown in the formula below:

 $P = M_{(Jan)} + M_{(Feb)} + M_{(Mar)} + \dots + M_{(Dec)}$

Where: **P** = Yearly Penalty to be imposed to REPP due to shortfall on Generated Electricity

M = Computed Monthly Penalty = [(Mc - MA) x FR x D]-[(Mc - Ma) x WBTR)

Mc = Committed Energy (kwh) for the Month

MA = Actual Generated Energy (kwh) for the Month

FR = Fuel Rate at 0.30 Liters/kwh

D = Peso per Liter Cost of Diesel for the Month

WBTR = Winning Bidder's Tariff Rate

The Annual Reconciliation covering January to December Monthly Billing of the previous year, shall take place on the 1st Week of January of the succeeding year. The Penalty Charge for shortfall, if there are any, shall be deducted from the claim of the REPP on the same month or may still be deducted in the succeeding months until the total Penalty Charge is paid.

Penalty computation on the 20th year shall be computed monthly and corresponding penalty charge for the month, if there are any, shall be deducted on the billing of the succeeding month.

4.9 The **REPP** shall exclusively sell its generated energy to **NPC** and shall not sell or contract out any capacity and energy to any other off-taker considering that investment cost recovery form part of its bid price offer for the project.

The **NPC** shall have the following obligations:

- **4.10 NPC** shall pay the **REPP** for the energy received and delivered in accordance with Section five below.
- 4.11 Notwithstanding the MAG requirement for the REPP, NPC is not under any obligation to pay any generated energy other than what was only received by NPC as metered except for cases where the inability to take or receive any generated energy is due to the sole fault of NPC except for reasons other than force majeure.
- **4.12 NPC** shall be responsible for Transmission Wheeling and Metering Services to the Distribution Utilities.
- **4.13 NPC** shall witness the conduct of Testing and Commissioning, Final Inspection of the RE facility of the REPP, and attest to its successful commissioning.
- **4.14 NPC** shall issue a Certificate of COSD for each RE facility based on the actual start date of operation in which the Cooperation Period will be based.

<u>SECTION 5 – CHARGES AND ADJUSTMENTS</u>

- 5.1 The **NPC** shall pay for energy at the rate of P_____ per kWh ("Contract Price") on a take-and-pay basis. The Contract Price shall be fixed for the duration of the Cooperation Period.
- **5.2 NPC** will receive and pay for all the energy generated measured at the **NPC** assigned Delivery/ Tapping/ Metering Point, which shall also be the Connection Point of energy. There shall be no capacity fee payment, except for energy delivered.
- 5.3 The REPP shall conduct a meter reading every 25th day of the month and NPC shall be allowed to witness the reading. The full documentation of the meter reading must be included in the Energy Fee Invoice. Within five (5) business days from the end of each Monthly Billing period, REPP shall deliver to NPC, Energy Fee Invoice covering the actual energy delivered/ generated.

5.4 Each Energy Fee Invoice shall be due and payable within thirty-seven (37) calendar days from NPC's receipt of said Invoice, provided that the REPP shall comply with the following at all times:

- 5.4.1 Complete supporting documents. To ensure timely payment of Energy Fee, REPP shall submit the Energy Fee Invoice with complete supporting documents and references (Refer to Annex E). An Energy Fee Invoice with incomplete supporting documents and references shall not be processed by NPC. Failure of REPP to comply therewith shall preclude REPP to charge interest or any form of penalty against NPC.
- 5.4.2 Manner of Payment. All sums indicated in the Energy Fee Invoice shall be paid in Philippine Pesos to REPP thru NPC's regular check, maintained either at the Land Bank of the Philippines ("LBP"), in the account name of the REPP
- 5.4.3 No Deduction. All payments shall be free and clear of any deductions, bank draft or delivery charges, off-set, counterclaims, taxes and other similar fees and charges, unless mandated by law or agreed upon by the parties.
- 5.4.4 For cases where the REPP is able to deliver electricity, but NPC is unable to receive electricity for reasons other than force majeure, the undelivered volume of energy shall be computed based on the available capacity of the renewable energy resource and the number of hours that the volume should have been delivered but not to exceed the winning offered operating hours in a day. This undelivered volume shall be considered and added to the committed MAG of the REPP and shall be paid accordingly by NPC based on the Contract Price.
- **5.5 Process Flow**. The procedure to be followed for Section 5.2, 5.3 and 5.4 shall be laid out in Annex D.
- **5.6** <u>Value Added Tax</u>. Value-Added Tax, when applicable, shall be taken into consideration in the computation of the Energy Fee.
- **5.7 Billing Dispute.** In the event NPC disputes any amount of the Energy Fee, then the following provisions shall apply:
 - 5.7.1 NPC shall notify REPP in writing within fifteen (15) calendar days from the date of receipt of the Energy Fee Invoice together with the disputed amount and the basis thereof (the "Billing Dispute"). Except for a Force Majeure event, any Energy Fee Invoice which remains undisputed in full or in part within the fifteen (15) days period shall be deemed

confirmed and shall be paid to REPP in accordance with Section 5.4 of this REPPA. In case of partial dispute in the amount of Energy Fee billed, NPC shall disburse only the undisputed portion of the Energy Fee Invoice. Any billing dispute shall be addressed in the manner specified in Section 9.4 of this REPPA.

- 5.7.2 Within seven (7) calendar days from receipt of the Billing Dispute, the Parties' respective officers responsible for the billing and disbursement shall then communicate, meet and resolve the matter within thirty (30) calendar days or within such longer period as the Parties may agree.
- 5.7.3 If the Billing Dispute is not resolved by the Parties within the period indicated in Section 5.7.2 hereof, the procedure for settlement of disputes as provided for in Section 9.4 shall then be observed.

SECTION 6 – COORDINATION PROTOCOL

For proper coordination of the Parties on certain operational matters, particularly during power interruption, a **Joint Coordination Protocol** is attached as **ANNEX B** indicating the responsibilities and actions expected of each Party, shall be followed as well as the applicable provisions of the Distribution Code.

SECTION 7 – TERMINATION

- 7.1 The occurrence of the following events shall constitute just cause for the termination of the REPPA without prejudice to the provisions under Section Eight (Indemnification):
 - A. Default. Failure by either Party in the due observance or performance of any term, covenant, or agreement contained herein, which breach or failure continues unremedied or uncorrected for a period of sixty (60) days after written notice, specifying the breach and requiring it to be remedied, shall have been given to the breaching Party by the other Party.
 - B. Incapacity. An assignment by either Party for the benefit of creditors; the filing of a petition for bankruptcy by either Party; adjudication of insolvency or bankruptcy of either Party; application or petition to any tribunal for the appointment of receiver/s.
 - C. Breach. At least three repeated acts of violation of the provisions of this Agreement, notwithstanding the cure or correction of the breach within the time allowed.
 - D. Cessation by either party of its business, operations, or legal existence.
 - E. Non-occurrence of the Commercial Operation Start Date after a period of six (6) months from the committed COSD due to the fault of the REPP.

- F. Other applicable grounds under Annex "I" of RA 9184 and its IRR.
- 7.2 The termination of this REPPA, however, based on the foregoing grounds/reasons shall not excuse any Party from payment of any outstanding obligations to the other Party incurred prior to the said termination.

Notwithstanding any other provisions in the foregoing, the REPP shall not be excused from the payment of Liquidated Damages for Delay. NPC shall have the right to cause the forfeiture of its Development and Construction Performance Security upon Termination by reason of the non-occurrence of the committed COSD after a period of six (6) months.

SECTION 8 – INDEMNIFICATION

CROSS INDEMNITY

- 8.1 The Defaulting Party shall indemnify, defend and hold harmless the Aggrieved Party, its officers, directors, employees, contractors, and agents from and against all damages, losses and reasonable expenses, including but not limited to reasonable legal fees, suffered or paid by the Aggrieved Party as a result of any and all claims for personal injury, death or property damage, except economic loss, to third parties due to an event occurring during the Term of this Agreement and arising directly out of or resulting from any act or omission of the Defaulting Party or its agents or employees, except to the extent that it was caused by any act or omission of the Aggrieved Party or the failure by the latter to take reasonable steps to mitigate the damage or harm. In the event such injury or damage results from the joint or concurrent negligence of the Parties, each shall bear its own loss or damage.
- 8.2 **REPP**, in performing its duties and responsibilities in this agreement, shall hold NPC free and harmless from any damages, liability or responsibility to any person or property arising out of or as a consequence of the fault or negligence of REPP, its agents, employees, or guests. REPP hereby assume full responsibility for any damage or injury that may be caused to the person or property of third parties, including wrongful death, while performing any of its duties and responsibilities in this agreement, and further binds itself to hold NPC free and harmless from any such claim for injury or damage. REPP shall indemnify the NPC for all damages which the latter may sustain on account of any process or order of a court or administrative body concerning any case relative to the activities and performance of the duties of REPP. Likewise, **REPP** shall hold the **NPC** free and harmless from any and all suits, claims, or damages that may be instituted by any party by reason of this Agreement, including its implementation, and the non-observance of any rule, regulation, or law applicable, or the non-performance of any obligations herein contained. Lastly, REPP shall likewise protect NPC from any complaints

arising from the former's operations and performance of its obligations under this Agreement.

NOTICE OF CLAIM

8.3 A Notice of Claim for indemnification pursuant to the immediately preceding Section shall be sent by one Party to the other within twenty (20) calendar days from the occurrence of the event or knowledge thereof which gave rise to such damage or injury.

CONSEQUENTIAL LOSSES

8.4 In no case shall any Party be entitled to any indirect or consequential losses or damages, whether or not such losses or damages are subject to the indemnities.

SURVIVAL

8.5 The Provisions of this Section shall survive termination of this Agreement with respect to an event occurring before the termination.

SECTION 9 - MISCELLANEOUS PROVISIONS

9.1 VALIDITY AND BINDING EFFECT

This Agreement shall bind the Parties, their respective assigns, buyers, transferees, or successors-in-interest. If any part or parts of this Agreement is or are declared invalid by competent courts during its effectivity, the other parts shall not be affected or impaired.

9.2 LIABILITIES

NPC shall not be liable for any damage suffered by **REPP** if **NPC** generates or transmits electricity in accordance with the prescribed standards of distribution code for missionary areas.

REPP shall be liable for any damages to **NPC** diesel power plant/ distribution facilities due to non-compliance with electrical regulations/ standards or distribution codes.

9.3 FORCE MAJEURE

Force Majeure is an extraordinary event which cannot be foreseen or which though foreseen, cannot be avoided. The event must render it impossible for a Party to fulfill its obligation in a normal manner despite the exercise of due care. Force Majeure shall not excuse either Party from exercising due care to prevent it or minimize its effects. Force Majeure shall only be limited to a storm, typhoon, lightning, flood, drought, earthquake, tsunami, fire, war, rebellion, insurrection, riot, naval or other blockade, labor disturbance, civil

unrest, and other analogous circumstances natural or man-made. For the avoidance of doubt, force majeure does not include absence or limited RE resources like sunlight, wind, water, etc. that limits energy production.

In the event of Force Majeure and there are facilities that can still be operated by either of the Parties, said party shall continue to perform its obligations under this Agreement to the extent not affected by Force Majeure.

Restructuring of the electricity industry, unbundling of business functions or power rates, insolvency or business losses shall not be considered as an event of Force Majeure.

A Party may be excused from the prompt performance of its obligations under this Agreement by reason of Force Majeure, subject to the provisions herein.

The affected Party shall notify the other in writing of a Force Majeure situation within the period of thirty (30) days from its occurrence. The other Party shall have sixty (60) days to verify or deny in writing that such a situation exists.

A verified event of Force Majeure which prevents a Party from supplying or taking electricity for at least six (6) months or agreed upon by both parties to

prevent the supply or taking of electricity for a continuous period of at least six (6) months shall entitle either Party to terminate this Agreement.

9.4 SETTLEMENT OF DISPUTES

The Parties shall exert reasonable efforts to amicably and extra-judicially settle all disputes arising from, or in connection with this Agreement within thirty (30) days from the time the dispute arose which is understood to be the date the Defaulting Party receives the formal extrajudicial demand or notice to comply with the terms of the agreement.

Should the Parties fail to arrive at an amicable settlement within the period stipulated, any of the Parties can initiate proceeding with the ERC pursuant to Section 43 (u) of Republic Act 9136 without prejudice to the filing of the legal action with the appropriate court in Quezon City, but only in the event that the dispute is declared by ERC or any competent authority to be outside of its jurisdiction.

9.5 NOTICES

Any notice, demand, or request by the Parties to this Agreement shall be deemed properly served upon actual receipt of the notice, demand, or request notwithstanding the form of transmittal of the said notice, demand, or request. Any notice, demand, or request shall likewise be deemed served if it is delivered personally to the signatories or their duly authorized representatives at their indicated address, which in this case is the office address in the first page of this Agreement.

9.6 NON-WAIVER CLAUSE

Failure of **NPC** to enforce any of the provision of this Agreement or any rights with respect thereto shall in no way be considered to be a waiver of such provisions or rights, or in any way affect the validity of this Agreement.

9.7 ASSIGNABILITY

NPC may assign, cede, transfer, allocate wholly and/or partly its rights and obligations under this REPPA to any of its successor in interest or as provided under any applicable rules.

NPC may assign the REPPA to the Successor Entity of NPC SPUG or to the concerned Electric Cooperative/Distribution Utility (EC/DU) which must include any existing REPPA in their Power Supply Procurement Plan (PSPP).

Section 5(a)(ii) under the Department Circular (DC) No. DC2023-05-0014, "Promulgating the Revised Rules and Guidelines Governing the Operationalization of the Renewable Portfolio Standards for Off-Grid Areas Pursuant to Section 12 of the Renewable Energy Act of 2008", or known as the "Revised RPS Off-Grid Rules" prescribes that the concerned DU, NPP and NPC-SPUG shall prepare and agree on a Take Over Program (TOP) defining the transition to full service by NPP in the area. The TOP shall include plans and programs covering the transition from existing NPC-SPUG supply to full assumption by the NPP of the power generation business, and the needed enhancement in transition and/or distribution facilities.

REPP shall not be authorized to assign, cede, transfer, allocate wholly or partly any of its rights and/or obligations under this Agreement without the prior written consent of NPC, which notice must be given by the REPP sixty (60) days from the intended date of assignment, and provided that the assignee is a subsidiary of REPP of which the latter shall remain solidary liable in case of default or violation under this REPPA.

Effectivity of any such assignment shall be subject to the payment by **REPP** of any outstanding obligations with NPC, if there be any AMENDMENT

Any change, alteration, modification, or addition to this Agreement shall not be effective unless in writing and properly executed by the Parties.

9.8 ENTIRE AGREEMENT

This Agreement shall supersede and cancel all other previous understanding and practices, if any, between NPC and REPP on the sale of electricity relative to this Agreement.

Renewable Energy Power Purchase Agreement NPC a Page 17 of 29	and
IN WITNESS WHEREOF, each of the Partie executed in more than one copy each of whi as of the date of this Agreement.	G
NATIONAL POWER CORPORATION (NPC)	REPP

Signed in the presence of:

FERNANDO MARTIN Y. ROXAS

President and CEO

Renewable Energy Power Purchase Agreement NPC and Page 18 of 29
REPUBLIC OF THE PHILIPPINES) QUEZON CITY) S.S.
ACKNOWLEDGMENT
Before me, a Notary Public for and in, Philippines, this _ day of, 202, personally appearedknown to me and known to be the same person who executed the foregoing Renewable Energy Power Purchase Agreement, consisting of pages, including the page where this Acknowledgment is written, all pages signed by both Parties and their instrumental witnesses, and she acknowledged before me that the same is her free and voluntary act and deed and that of the entity she represents. WITNESS MY HAND AND SEAL, on the date and place first above written.
Doc. No; Page No; Book No; Series of 202

Renewable Energy Power Purchase Agreement NPC andPage 19 of 29
REPUBLIC OF THE PHILIPPINES)) S.S.
ACKNOWLEDGMENT
Before me, a Notary Public for and in, Philippines, this _ day of, 202, personally appearedknown to me and known to be the same person who executed the foregoing Renewable Energy Power Purchase Agreement, consisting of pages, including the page where this Acknowledgment is written, all pages signed by both Parties and their instrumental witnesses, and she acknowledged before me that the same is her free and voluntary act and deed and that of the entity she represents.
WITNESS MY HAND AND SEAL, on the date and place first above written.
Doc. No; Page No; Book No; Series of 2023

ANNEX A: DEFINITION OF TERMS

Definitions. Wherever used in this Agreement, its Schedules, Attachments or Annexes, unless the context otherwise requires, the following items shall have the following meanings:

- (a) "Actual Total Cost of Generation Rate" means the total cost incurred by NPC to generate the supply of electricity to its customers
- (b) "Allowable Scheduled Downtime" means the maintenance days or schedule approved by NPC to ensure system stability and for safety reasons as may be provided by laws, rules or regulations.
- (c) "Minimum Annual Generation (MAG)" means the minimum energy committed to be supplied by the REPP equivalent to 3.8 Hours per day multiplied by the number of days of the specific month.
- (d) "Assignability" means by reason of private sector participation in the generation function in the franchise area, NPC shall assign, sell or transfer a part or all of its rights under this Agreement.
- (e) "Basic Rate" is the Subsidized/Approved Generation Rate (SAGR) duly approved by ERC for the year of the Commercial Operations Start Date.
- (f) "Commercial Operations Start Date" or "COSD" is defined as the date after which all testing and commissioning has been completed and is the initial date to which the REPP can start producing electricity for sale to NPC.
- (g) "Competitive Selection Process" or "CSP" shall be consistent with the principles of Department Circular No. DC 2018-02-0003 of the DOE and have the meaning referred in the Guidelines for the Setting and Approval of Electricity Generation Rates and Subsidies for Missionary Electrification Areas, approved in ERC Resolution No. 11, Series of 2005, and subsequent amendment, if any.
- (h) "Contract Energy" means the actual energy in kilowatt-hour (kWh) delivered per billing period allocated by REPP to NPC.
- (i) "Contract Price" means the price offered by the REPP during the Tender Process and accepted by NPC as the Highest Rated Responsive Bid (HRRB).

- (j) "Contract Year" means each successive period of twelve (12) consecutive Billing Months during the Commercial Operations Period.
- (k) "Cooperation Period" means the period of twenty (20) years of operations counted from the Effective Date.
- (I) "Defaulting Party" means the Party causing the Event of Default.
- (m) "Delivery" means the transmission of electricity from the generating plant to the Delivery Point of NPC.
- (n) "Connection Point" means the delivery/ tapping/metering point assigned by NPC
- (o) "Department of Energy" or "DOE" means the government agency created pursuant to Republic Act No. 7638, as amended by Republic Act No. 9136 and Republic Act No. 9513.
- (p) "Distribution Utility" or "DU" as defined in Republic Act No. 9136 including existing Local Government Units which has an exclusive franchise to operate a distribution system.
- (q) "Energy Fee Invoice" means the document that contains the Contract Energy and the amount in pesos payable to REPP.
- (r) "Energy Regulatory Commission" or "ERC" means the agency created under Section 38 of Republic Act No. 9136.
- (s) "Event of Force Majeure" and "Force Majeure" means the condition provided for in Section 9 in this Agreement.
- (t) "Missionary Electrification" means the provision of basic electricity service in Unviable Areas with the ultimate aim of bringing the operations in these areas to viability levels, including the provision of power generation and its associated power delivery systems in areas that are not connected to the national grid transmission system.
- (u) "Monthly Billing" means the billing period beginning 12:00 pm every 25th day of the current month until 12:00 pm of the 25th day of the following month.
- (v) "National Power Corporation-Small Power Utilities Group" or "NPC-SPUG" means the unit in NPC that directly administers and performs the missionary electrification function of NPC pursuant to Section 70 of Republic Act No. 9136.

- (w) "Penalty Charge" shall mean the penalty imposed on the REPP for not meeting the MAG committed by the REPP which must not be lower than the minimum annual generation requirement of NPC and must not be higher than the product of REPP's committed Capacity and Availability multiplied by 365 days. The above Penalty Charge for shortfall shall be replaced upon effectivity of the RPS Penalty in the off-grid areas per DOE Circular No. 2023-005-0014.
- (x) "Renewable Energy Power Provider" or "REPP" means the private entity who designs, finances, develops, constructs, operates and maintains a renewable energy power plant and Battery Energy Storage Systems (BESS) and sells the energy generated to NPC.
- (y) "Renewable Energy Power Purchase Agreement" or "REPPA" of "Agreement" means this agreement and its annexes including the Tender Documents.
- (aa) "Subsidized Approved Generation Rate" or "SAGR" refers to the generation tariff approved by the ERC for the SPUG plants.
- (bb) "Tender Documents" means all the documents used in the bidding process and which shall form an integral part of this Agreement..

All definitions regarding tariff shall be based on ERC definitions.

Interpretation. In this Agreement, its Schedules, Attachments or Annexes, unless the context otherwise requires:

- (a) headings are for convenience only and do not affect the interpretation of this Agreement;
- (b) the singular includes the plural and vice versa;
- (c) reference to a natural person includes any corporation or legal entity;
- (d) reference to a party in any document includes that party's successors and permitted assigns;
- (e) reference to an Article, Section, Schedule, Attachment or Annex is to an article, section of, attachment to, or annex to this Agreement, and any such Annex or Schedule referred to should be incorporated by this reference and is an integral part of this Agreement;

- (f) unless otherwise provided herein, reference to a document includes an amendment or supplement to, or replacement or novation of, that document but disregarding any amendment, supplement, replacement or novation made in breach of this Agreement;
- (g) "including" shall not be construed as being by way of limitation and "otherwise" shall not be construed as limited by words with which it associated;
- (h) any reference to a governmental ministry, department, authority or agency shall be construed as including a reference to any governmental ministry, department, authority or agency which succeeds to the functions thereof;
- (i) the word "reasonable" appearing before "approval", "consent", "satisfaction" or any similar word shall mean that the approval, consent, expression of satisfaction or other decision to be made as to the particular matter or thing concerned shall not unreasonably be withheld or delayed. Conversely, if the word "reasonable" does not so appear, the approval, consent, expression of satisfaction or other decision to be made may be given or made solely at the unfettered discretion of the Party concerned; and,
- (j) the expression "to the best of its knowledge" shall mean to the best of the knowledge and belief of the Party concerned, having made all due and reasonable inquiry.

Abbreviations. In this Agreement, its Schedules, Attachments or Annexes:

- (a) "kV" means kilovolt;
- (b) "kW" means kilowatt;
- (c) "kWh" means kilowatt-hour;
- (d) "MW" means megawatt; and
- (e) "PhP" and "Peso(s)" mean the lawful currency of the Republic of the Philippines.

ANNEX B: JOINT COORDINATION PROTOCOL

EVENT/ISSUE	EC/DU	REPP	NPC-SPUG
A. Line Tripping	1. Lineman from ECs/DUs shall conduct inspection of distribution line to determine the cause of line tripping. 3. Lineman from ECs/DUs shall perform necessary corrective action to clear any line fault on distribution line. 4. The lineman/personne I from ECs/DUs shall certify to NPC plant personnel that the distribution line is clear and no lineman working on the circuit to avoid accident. 5. Lineman/personnel from ECs/DUs shall give clearance to NPC plant/REPP plant that the circuit is ready for energization.		1. Coordinate with ECs/DUs lineman/personnel to verify the occurrence of line fault on distribution line and to be recorded. 2. Inform the REPP Plant personnel the cause of line tripping. 3. Verify from ECs/DUs that the line is clear then advice the REPP Plant personnel to re- start the RE operation for synchronization to line circuit/ distribution lines.

EVENT/ISSUE	EC/DU	REPP	NPC-SPUG
B. Plant Tripping		1. inform NPC Plant personnel the cause of RE Facility tripping. 2. Verify the plant trouble and inform the NPC plant. 3. Conduct necessary corrective action to be ready to re- energize line/system once the plant is available and secure clearance to NPC plant personnel.	1. Inform the ECs/DUs for the cause of the plant tripping either NPC or RE Facility who are in operation and the estimated downtime. 2. Conduct necessary corrective action/s to bring unit/plant to operation. 3. inform ECs/DUs when the plant shall be ready and available.
C. Scheduled Plant Maintenance	On the scheduled date of ECs/DUs maintenance on its system. The ECs/Dus shall inform NPC five (5) days ahead	Inform NPC plant five (5) days ahead for its maintenance schedule on RE Facility.	1. Operate its generating sets during the RE Facility is scheduled for maintenance. 2. And in accordance to the power requirement of the ECs/DUs.
D . Plant/Line Restoration	Upon completion of its maintenance activities, ECs/DUs shall inform NPC Power Plant of its readiness to reenergize its line. ECs/DUs shall give clearance		1. Upon completion of its maintenance activities, NPC Power Plant shall inform ECs/DUs of its readiness to resume plant operation. 2. NPC Power Plant startup shall only

EVENT/ISSUE	EC/DU	REPP	NPC-SPUG
	before re- energization of line/system can take place. ECs/DUs can be held liable for subsequent tripping of power plant due to line fault upon re- energization. 3. ECs/DUs shall then inform NPC Power Plant once its system operation has been restored to normal status		be undertaken after the ECs/DUs has given clearance for the energization of its line/system.
E. Emergencies	1. ECs/DUs shall inform NPC Plantof any emergency, existing or foreseen, that will affect operation of its distribution system and/or will impact on the power plant operation. 2. ECs/DUs shall likewise inform NPC Plant once the previously declared emergency has cleared or stopped.	1. Inform NPC plant of any emergency, existing or foreseen, that will affect its RE Facility generation and/or the supply of power to its line system. 2. Inform the NPC plant the cessation or end of any previously declared emergency.	1. Inform ECs/DUs of any emergency, existing or foreseen, that will affect its power plant generation and/or the supply of power to its line system. 2. Inform the ECs/DUs of the cessation or end of any previously declared emergency.
F. Contractual Matter/s	1. Matters pertaining to the terms and conditions of the Power Supply Agreement, such as amendment or revision of Contract Demand/Energy,	Billing kWh Meter of RE Facility should be test annually for accuracy test.	NPC shall act timely on ECs/DUs issues and concerns re PSA terms and conditions.


Renewable Energy Power Purchase Agreement NPC and	
Page 27 of 29	

EVENT/ISSUE	EC/DU	REPP	NPC-SPUG
	shall be brought to the attention of NPC through formal communication, observing the required advance notification or lead time.		

ANNEX C: ALLOWABLE DOWNTIME SCHEDULE

(Note: The winning Bidder will propose its downtime schedule subject to NPC's approval/confirmation)

ANNEX D: BILLING AND PAYMENT PROCESS FLOW

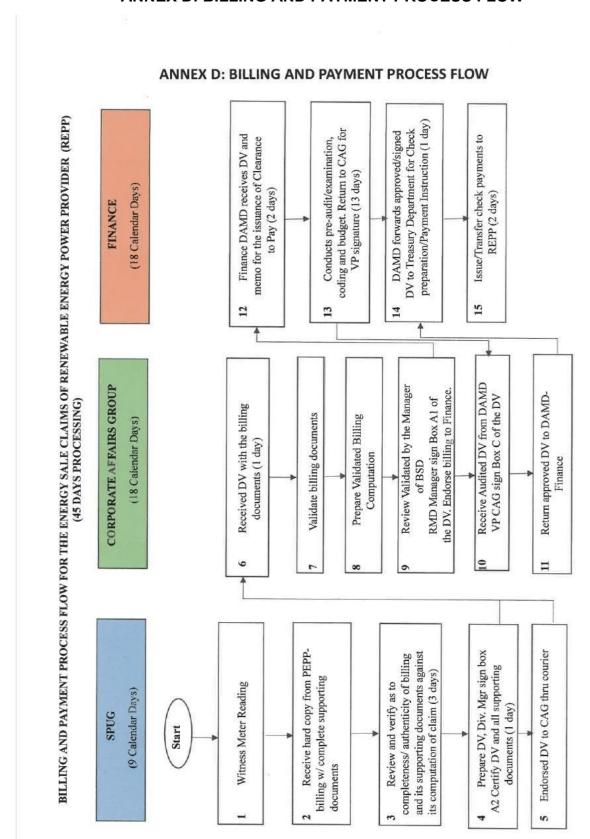

ANNEX E: DOCUMENTATION FOR THE ENERGY FEE INVOICE

AUDIT REQUIREMENTS FOR PAYMENT OF POWER PURCHASE TO RENEWABLE ENERGY POWER PROVIDER (REPP)

<u>FIRS</u>	SOURCE	
1.	Approved/Signed Renewable Energy Power Purchase Agreement (REPPA)	-REPP
2.	Notice of Award	-REPP
3.	Issuance of DCE/Cost Center Number/Monitoring	-NPC-FIN/ CAG
4.	Certificate of Commercial Operation	-REPP & NPC
5.	Performance Security for the development, construction of the RE Facility	-REPP
6.	Operation Performance Security to be submitted annually	-REPP
7.	Name and designation of NPC-SPUG's authorized Representative/witness	-NPC-SPUG
<u>FIRS</u>	T & SUCCEEDING BILLINGS:	
8.	Disbursement voucher duly signed by respective SPUG signatories as per Manual of Approvals	-NPC-SPUG/ BSD/CAG
9.	Original Energy Fee Invoice	-REPP
10.	Original picture of meter reading as witnessed/	
	signed by NPC-SPUG representative	-REPP/NPC- SPUG

Notes:

11.

12.

1. All other attachments that are not original shall be authenticated.

-NPC/REPP

-REPP

2. Additional audit requirements may be requested as deemed necessary.

Joint certification of Energy (kWh) delivered/received

Letter Request for payment from Contractor/Supplier