



REPUBLIC OF THE PHILIPPINES
NATIONAL POWER CORPORATION
(Pambansang Korporasyon sa Elektrisidad)

TERMS OF REFERENCE

Name of Project: SUPPLY, DELIVERY, INSTALLATION, TEST, AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT & BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREA IN JINTOTOLO IS., BALUD, MASBATE

Project Location: Jintotolo Is., Balud, Masbate

Specification No.: Luzp22Z1435se

Contents : Volume 1 of 2

- | | |
|--------------------|--------------------------------------|
| SECTION I | - INSTRUCTION TO BIDDERS |
| SECTION II | - GENERAL CONDITIONS OF THE CONTRACT |
| SECTION III | - TECHNICAL SPECIFICATIONS |
| | PART I - TECHNICAL SPECIFICATIONS |
| | PART II - TECHNICAL DATA SHEETS |

Design and Development Department





National Power Corporation

NEGOTIATED PROCUREMENT

NP 2024-0004

1. The NATIONAL POWER CORPORATION (NPC), through its approved Corporate Budget of CY 2024 intends to apply the sum of **(Please see schedule below)** being the Approved Budget for the Contract (ABC) to payments under the contract. Bids received in excess of the ABC shall be automatically rejected at Bid opening.

PR Nos./PB Ref No. & Description	Similar Contracts	Pre-Nego Conference	Bid Submission / Opening	ABC
HO-PIG23-001 / PB230321-NA00039 (NP) Supply, Delivery, Installation, Test & Commissioning of 2 x 150kW Modular Diesel Generating Sets and Associated Electrical Equipment & Balance of Plant for the Electrification of New Area in Jintotolo Is., Balud, Masbate	Supply, Delivery, Installation, Test and Commissioning or Construction of Power Facilities, Installation, Test and Commissioning of Diesel Generating Set/s with at least one unit capacity of 150kW Prime or Continuous Power with transformer/s of at least 225kVA rating	22 February 2024 9:30 AM	05 March 2024 9:30 AM	₱ 26,498,200.00
Venue: Kañao Function Room, NPC Bldg. Diliman, Quezon City				

2. The NPC now invites Bids for Items listed above. Delivery of the items is required within **(see table below)** in the Technical Specifications in the Terms of Reference. Bidders should have completed from the date of submission and receipt of bids, a contract similar to the Project., must be at least equivalent to an amount as stated in the Terms of Reference.

PR Nos./PB Ref Nos.	Delivery Period / Contract Duration	Relevant Period of SLCC reckoned from the date of submission & receipt of bids
HO-PIG23-001	Three Hundred (300) Calendar Days	-

3. Bidding will be conducted through Negotiated Procurement procedures using a non-discretionary "pass/fail" criterion as specified in the Implementing Rules and Regulations (IRR) of Republic Act (RA) 9184, otherwise known as the "Government Procurement Reform Act".
4. Interested bidders may obtain further information from BAC Secretariat at the address given below during office hours.

5. A complete set of TOR will be provided to the interested Bidders from the address below. It may also be downloaded from the websites of the Philippine Government Electronic Procurement System (PhilGEPS) <http://www.philgeps.gov.ph> and National Power Corporation <http://www.napocor.gov.ph>.
6. NPC will hold a Pre-Negotiation Conference on the date, time and venue stated above.

Only registered bidder/s shall be allowed to participate for the conduct of virtual pre-bid conference. **Unregistered bidders** may attend the Pre-Bid Conference at the Kafiao Room, NPC subject to the following:

- a. Only a maximum of two (2) representatives from each bidder / company shall be allowed to participate
 - b. Wearing of Face Masks is recommended but not required in view of Proclamation No. 297 S.2023 lifting the State of Public Health Emergency Throughout the Philippines
 - c. The requirements herein stated including the medium of submission shall be subject to GPPB Resolution No. 09-2020 dated 07 May 2020
 - d. The Guidelines on the Implementation of Early Procurement Activities (EPA) shall be subject to GPPB Circular No. 06-2019 dated 17 July 2019
7. Bids must be delivered to the address below on the date stated above. Late bids shall not be accepted.
 8. NPC reserves the right to accept or reject any bid, to annul the bidding process, and to reject all bids at any time prior to the contract award, without thereby incurring any liability to the affected bidder or bidders.
 9. For further information, please refer to:

**Bids and Contracts Services Division,
Logistics Department**
Gabriel Y. Itchon Building
Senator Miriam P. Defensor-Santiago Ave. (formerly BIR Road)
Cor. Quezon Ave., Diliman, Quezon City, 1100
Tel Nos.: 8921-3541 local 5564/5713
Fax No.: 8922-1622
Email: bcsd@napocor.gov.ph



ATTY. MELCHOR P. RIDULME
Vice President, Office of the Legal Counsel and
Chairman, Bids and Awards Committee

SECTION I

INSTRUCTIONS TO BIDDERS

SECTION I – INSTRUCTIONS TO BIDDERS**TABLE OF CONTENTS**

A. GENERAL	1
1. Scope of Bid	1
2. Source of Funds	2
3. Corrupt, Fraudulent, Collusive, and Coercive Practices	2
4. Conflict of Interest	3
5. Eligible Bidders	4
6. Bidder's Responsibilities	6
7. Origin of Goods	8
8. Subcontracts	8
9. Negotiation	9
10. Clarification and Amendment of TOR	9
B. PREPARATION OF BIDS	9
11. Language of Bids	9
12. Documents Comprising the Bid: Eligibility and Technical Components	10
13. Documents Comprising the Bid: Financial Component	12
14. Alternative Bids	13
15. Bid Prices	13
16. Bid Currencies	15
17. Bid Validity	15
18. Format and Signing of Bids	15
19. Sealing and Marking of Bids	16
C. SUBMISSION AND OPENING OF BIDS	17
20. Deadline for Submission of Bids	17
21. Opening and Preliminary Examination of Bids	17
D. EVALUATION AND COMPARISON OF BIDS	18
22. Process to be Confidential	18
23. Clarification of Bids	19
24. Domestic Preference	19
25. Detailed Evaluation and Comparison of Bids	19
26. Post-Qualification	21
27. Reservation Clause	25
E. AWARD OF CONTRACT	26
28. Contract Award	26
29. Signing of the Contract	27
30. Performance Security	27
31. Notice to Proceed	29
32. Protest Mechanism	29

SECTION I – INSTRUCTIONS TO BIDDERS**A. General****1. Scope of Bid**

- 1.1. The National Power Corporation (NPC) wishes to conduct the negotiated procurement for the **SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT & BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREA IN JINTOTOLO IS., BALUD, MASBATE (LuzP22Z1435Se)** to selected Bidders in accordance with the revised IRR of R.A. 9184.
- 1.2. NPC's address is:
- Office : **Bids and Contracts Services Division (BCSD)**
 Address : Ground Floor, Building No. 1
 National Power Corporation
 Sen. Miriam P. Defensor-Santiago Ave.,
 (formerly BIR Road) cor. Quezon Blvd.,
 Diliman, Quezon City, Metro Manila 1100
- Tel Nos. : 8924-52-11 and 8921-3541 Loc. 5564
 Tel/Fax No. : 8922-16-22
 Email : bcsd@napocor.gov.ph
- 1.3 For such purpose, the BAC may send its official letters/correspondences/notices through email. Upon securing the bidding documents, Bidders shall be required to indicate their official email and alternate email addresses. All letters/correspondences/notices sent by the BAC through the designated/official email shall be considered officially received by all bidders on the date indicated in National Power Corporation's sent folder.
- 1.4 Contract scope shall be as specified in the Technical Specifications and Bid Price Schedule. All appurtenances and associated supplies/works required to complete the works shall be deemed included in the scope of the contract.
- 1.5 The goods are grouped together in one (1) lot and will be awarded to one (1) bidder in one complete contract. Partial bid is not allowed. The lot is further divided into sub-lots for the purpose of bid evaluation. The sub-lots are as follows:

DESCRIPTION	ABC (PhP)
a. Generating Set(s)	6,705,100.00
b. Power Transformers	2,962,000.00
c. Other Mechanical Works	3,863,800.00
d. Other Electrical Works	4,430,600.00
e. Civil and Architectural Works	5,852,200.00
f. Spare Parts	2,010,800.00
g. Miscellaneous Work	673,700.00
TOTAL ABC	26,498,200.00

The bidders bid offer must be within the ABC of the lot/sub-lots. Bid offers that exceed the ABC of the lot/sub-lots, or with incomplete price, shall be rejected

2. Source of Funds

- 2.1. The Funding Source is the Government of the Philippines (GOP) through the 2023 Corporate Budget of NPC, in the total amount of **TWENTY SIX MILLION FOUR HUNDRED NINETY EIGHT THOUSAND TWO HUNDRED PESOS (P 26,498,200.00)** shall be used to finance the cost of this procurement.
- 2.2. Payments will be made by NPC upon approval of the claims in accordance with the provisions, terms and conditions of the contract and existing and applicable law.

3. Corrupt, Fraudulent, Collusive, and Coercive Practices

- 3.1. NPC as well as the bidders and suppliers shall observe the highest standard of ethics during the procurement and execution of the contract. In pursuance of this policy, NPC:
 - (a) defines, for purposes of this provision, the terms set forth below as follows:
 - (i) "corrupt practice" means behavior on the part of officials in the public or private sectors by which they improperly and unlawfully enrich themselves, others, or induce others to do so, by misusing the position in which they are placed, and includes the offering, giving, receiving, or soliciting of anything of value to influence the action of any such official in the procurement process or in contract execution; entering, on behalf of the government, into any contract or transaction manifestly and grossly disadvantageous to the same, whether or not the public officer profited or will profit thereby, and similar acts as provided in RA 3019.
 - (ii) "fraudulent practice" means a misrepresentation of facts in order to influence a procurement process or the execution of a contract to the detriment of NPC, and includes collusive practices among Bidders (prior to or after bid submission) designed to establish bid prices at artificial, non-competitive levels and to deprive NPC of the benefits of free and open competition.
 - (iii) "collusive practices" means a scheme or arrangement between two or more Bidders, with or without the knowledge of NPC, designed to establish bid prices at artificial, non-competitive levels.
 - (iv) "coercive practices" means harming or threatening to harm, directly or indirectly, persons, or their property to influence their participation in a procurement process, or affect the execution of a contract;

- (v) "obstructive practice" is
 - (aa) deliberately destroying, falsifying, altering or concealing of evidence material to an administrative proceedings or investigation or making false statements to investigators in order to materially impede an administrative proceedings or investigation of NPC or any foreign government/foreign or international financing institution into allegations of a corrupt, fraudulent, coercive or collusive practice; and/or threatening, harassing or intimidating any party to prevent it from disclosing its knowledge of matters relevant to the administrative proceedings or investigation or from pursuing such proceedings or investigation; or
 - (bb) acts intended to materially impede the exercise of the inspection and audit rights of NPC or any foreign government/foreign or international financing institution herein.
 - (b) will reject a proposal for award if it determines that the Bidder recommended for award has engaged in any of the practices mentioned in this Clause for purposes of competing for the contract.
- 3.2. Further, NPC will seek to impose the maximum civil, administrative, and/or criminal penalties available under applicable laws on individuals and organizations deemed to be involved in any of the practices mentioned in ITB Clause 3.1(a).
- 3.3. Furthermore, NPC reserve the right to inspect and audit records and accounts of a bidder or supplier in the bidding for and performance of a contract themselves or through independent auditors as reflected in the GCC Clause 3.

4. Conflict of Interest

- 4.1. All Bidders found to have conflicting interests shall be disqualified to participate in the procurement at hand, without prejudice to the imposition of appropriate administrative, civil, and criminal sanctions. A Bidder may be considered to have conflicting interests with another Bidder in any of the events described in paragraphs (a) through (c) below and a general conflict of interest in any of the circumstances set out in paragraphs (d) through (g) below:
- (a) A Bidder has controlling shareholders in common with another Bidder;
 - (b) A Bidder receives or has received any direct or indirect subsidy from any other Bidder;

- (c) A Bidder has the same legal representative as that of another Bidder for purposes of this bid;
 - (d) A Bidder has a relationship, directly or through third parties, that puts them in a position to have access to information about or influence on the bid of another Bidder or influence the decisions of NPC regarding this bidding process;
 - (e) A Bidder submits more than one bid in this bidding process. However, this does not limit the participation of subcontractors in more than one bid;
 - (f) A Bidder who participated as a consultant in the preparation of the design or technical specifications of the Goods and related services that are the subject of the bid; or
 - (g) A Bidder who lends, or temporarily seconds, its personnel to firms or organizations which are engaged in consulting services for the preparation related to procurement for or implementation of the project, if the personnel would be involved in any capacity on the same project.
- 4.2. In accordance with Section 47 of the IRR of RA 9184, all Bidding Documents shall be accompanied by a sworn affidavit of the Bidder that it is not related to the Head of Procuring Entity/NPC (HoPE), members of the Bids and Awards Committee (BAC), members of the Technical Working Group (TWG), members of the BAC Secretariat, the head of the Project Management Office (PMO) or the end-user unit, and the project consultants, by consanguinity or affinity up to the third civil degree. On the part of the Bidder, this Clause shall apply to the following persons:
- (a) If the Bidder is an individual or a sole proprietorship, to the Bidder himself;
 - (b) If the Bidder is a partnership, to all its officers and members;
 - (c) If the Bidder is a corporation, to all its officers, directors, and controlling stockholders;
 - (d) If the Bidder is a cooperative, to all its officers, directors, and controlling shareholders or members; and
 - (e) If the Bidder is a joint venture (JV), the provisions of items (a), (b), (c), or (d) of this Clause shall correspondingly apply to each of the members of the said JV, as may be appropriate.

Relationship of the nature described above or failure to comply with this Clause will result in the automatic disqualification of a Bidder.

5. Eligible Bidders

- 5.1. The following persons shall be eligible to participate in this bidding:

- (a) Duly licensed Filipino citizens/sole proprietorships;

- (b) Partnerships duly organized under the laws of the Philippines and of which at least sixty percent (60%) of the interest belongs to citizens of the Philippines;
 - (c) Corporations duly organized under the laws of the Philippines, and of which at least sixty percent (60%) of the outstanding capital stock belongs to citizens of the Philippines;
 - (d) Cooperatives duly organized under the laws of the Philippines; and
 - (e) Persons/entities forming themselves into a Joint Venture (JV), i.e., a group of two (2) or more persons/entities that intend to be jointly and severally responsible or liable for a particular contract: Provided, however, that Filipino ownership or interest of the JV concerned shall be at least sixty percent (60%).
- 5.2. Foreign bidders may be eligible to participate when any of the following circumstances exist:
- (a) When a Treaty or International or Executive Agreement as provided in Section 4 of RA 9184 and its IRR allow foreign bidders to participate;
 - (b) Citizens, corporations, or associations of a country, the laws or regulations of which grant reciprocal rights or privileges to citizens, corporations, or associations of the Philippines;
 - (c) When the Goods sought to be procured are not available from local suppliers; or
 - (d) When there is a need to prevent situations that defeat competition or restrain trade.
- 5.3. Government owned or – controlled corporations (GOCCs) may be eligible to participate only if they can establish that they (a) are legally and financially autonomous, (b) operate under commercial law, and (c) are not attached agencies of NPC.
- 5.4. The Bidder must have completed a Single Largest Completed Contract (SLCC) similar to the Project and the value of which, adjusted, if necessary, by the Bidder to current prices using the Philippine Statistics Authority (PSA) consumer price index, must be at least equivalent to Fifty Percent (50%) of the ABC.

For this purpose, similar contracts shall refer to Supply, Delivery, Installation, Test and Commissioning or Construction of Power Facilities, Installation, Test and Commissioning of Diesel Generating set/s with at least one unit capacity of 150kW Prime or Continuous Power with power transformer/s of at least 225kVA rating.

The Single Largest Completed Contract (SLCC) as declared by the bidder shall be verified and validated to ascertain such completed contract. Hence, bidders must ensure access to sites of such projects/equipment to NPC representatives for verification and validation purposes during post-qualification process.

It shall be a ground for disqualification, if verification and validation cannot be conducted for reasons attributable to the Bidder.

- 5.5. The Bidder must submit a computation of its Net Financial Contracting Capacity (NFCC), which must be at least equal to the ABC to be bid, calculated as follows:

$NFCC = [(Current\ assets\ minus\ current\ liabilities)\ (15)]$ minus the value of all outstanding or uncompleted portions of the projects under ongoing contracts, including awarded contracts yet to be started, coinciding with the contract to be bid.

The values of the domestic bidder's current assets and current liabilities shall be based on the latest Audited Financial Statements submitted to the BIR.

For purposes of computing the foreign bidders' NFCC, the value of the current assets and current liabilities shall be based on their audited financial statements prepared in accordance with international financial reporting standards.

If the prospective bidder opts to submit a Committed Line of Credit (CLC), it must be at least equal to ten percent (10%) of the ABC to be bid. If issued by a foreign universal or commercial bank, it shall be confirmed or authenticated by a local universal or commercial bank.

Further, if the Bidder opted to submit a Committed Line of Credit (CLC), the bidder must submit a granted credit line valid/effective at the date of bidding.

6. Bidder's Responsibilities

- 6.1. The Bidder or its duly authorized representative shall submit an Omnibus sworn statement in the form prescribed in **Section V – Bidding Forms** as required in **ITB Clause 12.1(b)(ii)**.
- 6.2. The Bidder is responsible for the following:
- (a) Having taken steps to carefully examine all of the Bidding Documents;
 - (b) Having acknowledged all conditions, local or otherwise, affecting the implementation of the contract;
 - (c) Having made an estimate of the facilities available and needed for the contract to be bid, if any;
 - (d) Having complied with its responsibility to inquire or secure Supplemental/Bid Bulletin(s) as provided under **ITB Clause 10.3**.
 - (e) Ensuring that it is not "blacklisted" or barred from bidding by the GOP or any of its agencies, offices, corporations, or LGUs, including foreign government/foreign or international financing institution whose blacklisting rules have been recognized by the GPPB;

- (f) Ensuring that each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
- (g) Authorizing the HoPE or its duly authorized representative/s to verify all the documents submitted;
- (h) Ensuring that the signatory is the duly authorized representative of the Bidder, and granted full power and authority to do, execute and perform any and all acts necessary and/or to represent the Bidder in the bidding, with the duly notarized Secretary's Certificate attesting to such fact, if the Bidder is a corporation, partnership, cooperative, or joint venture;
- (i) Complying with the disclosure provision under Section 47 of RA 9184 and its IRR in relation to other provisions of RA 3019;
- (j) Complying with existing labor laws and standards, in the case of procurement of services; Moreover, bidder undertakes to:
 - (i) Ensure the entitlement of workers to wages, hours of work, safety and health and other prevailing conditions of work as established by national laws, rules and regulations; or collective bargaining agreement; or arbitration award, if and when applicable.

In case there is a finding by NPC or the DOLE of underpayment or non-payment of workers' wage and wage-related benefits, bidder agrees that the performance security or portion of the contract amount shall be withheld in favor of the complaining workers pursuant to appropriate provisions of Republic Act No. 9184 without prejudice to the institution of appropriate actions under the Labor Code, as amended, and other social legislations.
 - (ii) Comply with occupational safety and health standards and to correct deficiencies, if any.

In case of imminent danger, injury or death of the worker, bidder undertakes to suspend contract implementation pending clearance to proceed from the DOLE Regional Office and to comply with Work Stoppage Order; and
 - (iii) Inform the workers of their conditions of work, labor clauses under the contract specifying wages, hours of work and other benefits under prevailing national laws, rules and regulations; or collective bargaining agreement; or arbitration award, if and when applicable, through posting in two (2) conspicuous places in the establishment's premises; and

- (k) Ensuring that it did not give or pay, directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.

Failure to observe any of the above responsibilities shall be at the risk of the Bidder concerned.

- 6.3. The Bidder is expected to examine all instructions, forms, terms, and specifications in the Bidding Documents.
- 6.4. It shall be the sole responsibility of the Bidder to determine and to satisfy itself by such means as it considers necessary or desirable as to all matters pertaining to the contract to be bid, including: (a) the location and the nature of this Project; (b) climatic conditions; (c) transportation facilities; and (d) other factors that may affect the cost, duration, and execution or implementation of this Project.
- 6.5. NPC shall not assume any responsibility regarding erroneous interpretations or conclusions by the prospective or eligible bidder out of the data furnished by NPC. However, NPC shall ensure that all information in the Bidding Documents, including bid/supplemental bid bulletin/s issued, are correct and consistent.
- 6.6. Before submitting their bids, the Bidder is deemed to have become familiar with all existing laws, decrees, ordinances, acts and regulations of the Philippines which may affect this Project in any way.
- 6.7. The Bidder shall bear all costs associated with the preparation and submission of his bid, and NPC will in no case be responsible or liable for those costs, regardless of the conduct or outcome of the bidding process.
- 6.8. The Bidder should note that NPC will accept bids only from those that have paid the applicable fee for the Bidding Documents at the office indicated in the Invitation to Bid.

7. Origin of Goods

There is no restriction on the origin of goods other than those prohibited by a decision of the United Nations Security Council taken under Chapter VII of the Charter of the United Nations, subject to ITB Clause 24.1.

8. Subcontracts

Subcontracting may be allowed on transport, local/non-skilled labor under the supervision of the Bidder. The Bidder shall not be relieved from any liability or obligation that may arise from the performance of the Subcontractor. The Bidder shall also submit the complete eligibility documents of proposed sub-contractor, if any.

9. Negotiation

- 9.1. Negotiation shall be held at the venue and on the date indicated in the invitation, to clarify concerns on the technical and financial components of this procurement.
- 9.2. Bidders are encouraged to attend the negotiation to ensure that they fully understand NPC's requirements. Non-attendance of the Bidder will in no way prejudice its bid; however, the Bidder is expected to know the changes and/or amendments to the TOR discussed during the negotiation.
- 9.3. Any statement made at the negotiation shall not modify the Terms of Reference unless such statement is specifically identified in writing as an amendment thereto and issued as a Supplemental/Bid Bulletin.
- 9.4. Following completion of the negotiations, NPC shall request all Bidders remaining in the proceedings to submit, on a specified date, a best and final offer with respect to all aspects of their bid proposals.

10. Clarification and Amendment of TOR

- 10.1. Bidders may request for clarifications on any part of the documents for an interpretation during the negotiation meeting.
- 10.2. Supplemental/Bid Bulletins may be issued upon NPC's initiative for purposes of clarifying or modifying any provision of the Bidding Documents not later than seven (7) calendar days before the deadline for the submission and receipt of bids. Any modification to the Bidding Documents shall be identified as an amendment.
- 10.3. Any Supplemental/Bid Bulletin issued by the BAC shall also be posted on the Philippine Government Electronic Procurement System (PhilGEPS) and the website of NPC, if available. It shall be the responsibility of all Bidders who secure the Bidding Documents to inquire and secure Supplemental/Bid Bulletins that may be issued by the BAC.

B. Preparation of Bids**11. Language of Bids**

- 11.1. The eligibility requirements or statements, the bids, and all other documents to be submitted to the BAC must be in English. If the eligibility requirements or statements, the bids, and all other documents submitted to the BAC are in foreign language other than English, it must be accompanied by a translation of the documents in English. The documents shall be translated by the relevant foreign government agency, the foreign government agency authorized to translate documents, or a registered translator in the foreign bidder's country; and shall be authenticated by the appropriate Philippine foreign service establishment/post or the equivalent office having jurisdiction over the foreign bidder's affairs in the Philippines. The English translation shall govern, for purposes of interpretation of the bid.

12. Documents Comprising the Bid: Eligibility and Technical Components

12.1. The first envelope shall contain the following eligibility and technical documents:

(a) Eligibility Documents –

Class "A" Documents:

- (i) The prospective bidder shall submit a valid and updated Certificate of PhilGEPS Registration under Platinum Membership (all pages including the Annex A of the said Certificate). **Non-compliance shall be a ground for disqualification.**
- (ii) Statement of all its ongoing government and private contracts, including contracts awarded but not yet started, if any, whether similar or not similar in nature and complexity to the contract to be bid; and

Statement of the Bidder's SLCC similar to the contract to be bid, in accordance with ITB Clause 5.4.

The two statements required shall indicate for each contract the following:

- (ii.1) name of the contract;
- (ii.2) date of the contract;
- (ii.3) contract duration;
- (ii.4) owner's name and address;
- (ii.5) kinds of Goods;
- (ii.6) For Statement of Ongoing Contracts - amount of contract and value of outstanding contracts;
- (ii.7) For Statement of SLCC - amount of completed contracts, adjusted by the Bidder to current prices using PSA's consumer price index, if necessary for the purpose of meeting the SLCC requirement;
- (ii.8) date of delivery; and
- (ii.9) end user's acceptance or official receipt(s) or sales invoice issued for the contract, if completed, which shall be attached to the statements.

The Statement of the bidder's Single Largest Completed Contract (SLCC) similar to the contract to be bid (Form No.

NPCSF-GOODS-03) shall be supported by the following documents to be submitted during Bid Opening:

1. Certificate of Acceptance; or Certificate of Completion; or Official Receipt (O.R); or Sales Invoice

The list of on-going contracts (Form No. NPCSF-GOODS-02) shall be supported by the following documents for each on-going contract to be submitted during Post-Qualification:

1. Contract/Purchase Order and/or Notice of Award
2. Certification coming from the project owner/client that the performance is satisfactory as of the bidding date

The bidder shall declare in this form all his on-going government and private contracts including contracts where the bidder (either as individual or as a Joint Venture) is a partner in a Joint Venture agreement other than his current joint venture where he is a partner. Non declaration will be a ground for disqualification of bid.

- (iii) NFCC computation in accordance with ITB Clause 5.5 or a committed Line of Credit from a universal or commercial bank.

Class "B" Document:

- (iv) If applicable, the Joint Venture Agreement (JVA) in case the joint venture is already in existence, or duly notarized statements from all the potential joint venture partners in accordance with Section 23.1(b) of the revised IRR of R.A. 9184.

Each partner of the joint venture shall submit their respective PhilGEPS Certificates of Registration in accordance with Section 8.5.2 of this IRR. The submission of technical and financial eligibility documents by any of the joint venture partners constitutes compliance: *Provided*, That the partner responsible to submit the NFCC shall likewise submit the Statement of all of its ongoing contracts and Audited Financial Statements.

Any single bidder/s who already procured/secured the bidding documents but want to avail the Joint Venture Agreement (JVA) shall inform the BAC in writing prior to the bid opening for records and documentation purposes.

(b) Technical Documents –

- (i) Drawings & Documents to be submitted with the Proposal as specified in Sections M-1.0, M-2.0, Annexes A.1 to A.3 for Mechanical Works and Sections E-1.0 and E-2.0 for Electrical Works, Section III – Part II Technical Data Sheets.

Manufacturer's brochures, manuals and other supporting documents of equipment, materials, hardware and tools proposed by the bidders must comply with the technical specifications of such equipment, materials, hardware and tools. It shall be a ground for rejection of the said equipment, materials, hardware and tools if the submitted brochures, manuals and other supporting documents are determined not complying with the specifications during the contract implementation.

Equipment, materials, hardware and tools proposed by the winning bidder to be supplied, which were evaluated to be complying with the technical specifications, shall not be replaced and must be the same items to be delivered/installed/used during the contract implementation. Any proposed changes/replacement of said items may be allowed on meritorious reasons subject to validation and prior approval by NPC.

- (ii) Omnibus Sworn statement in accordance with Section 25.2(a) (vii) of the IRR of RA 9184 and using the form prescribed in Section V – Bidding Forms.
- (iii) Complete eligibility documents of the proposed sub-contractor, if any

- 12.2. In the case of foreign bidders, except for the Tax Clearance, the eligibility requirements under Class "A" Documents may be substituted by the appropriate equivalent documents, if any, issued by the country of the foreign bidder concerned. The eligibility requirements or statements, the bids, and all other documents to be submitted to the BAC must be in English. If the eligibility requirements or statements, the bids, and all other documents submitted to the BAC are in foreign language other than English, it must be accompanied by a translation of the documents in English. The documents shall be translated by the relevant foreign government agency, the foreign government agency authorized to translate documents, or a registered translator in the foreign bidder's country; and shall be authenticated by the appropriate Philippine foreign service establishment/post or the equivalent office having jurisdiction over the foreign bidder's affairs in the Philippines.

These documents shall be accompanied by a Sworn Statement in a form prescribed by the GPPB stating that the documents submitted are complete and authentic copies of the original, and all statements and information provided therein are true and correct. Upon receipt of the said documents, the PhilGEPS shall process the same in accordance with the guidelines on the Government of the Philippines – Official Merchants Registry (GoP-OMR).

13. Documents Comprising the Bid: Financial Component

- 13.1. The financial component of the bid shall contain the following:

- (a) Duly signed Bid Letter indicating the total bid amount in accordance with the form prescribed in Section V – Bidding Forms;
- (b) Duly signed and completely filled-out Bid Price Schedule/Schedule of Requirements (Section IV) indicating the unit and total prices per item and the total amount in the prescribed Price Schedule form.

13.2. Price proposals that exceed the ABC shall be rejected.

13.3. In case a bidder will not submit bid for reason that his cost estimate is higher than the ABC, said bidder is required to submit his letter of non-participation/regret supported by corresponding detailed estimates. Failure to submit the two (2) documents shall be understood as acts that tend to defeat the purpose of public bidding without valid reason as stated under Section 69.1.(i) of the revised IRR of R.A. 9184.

14. Alternative Bids

14.1 Alternative Bids shall be rejected. For this purpose, alternative bid is an offer made by a Bidder in addition or as a substitute to its original bid which may be included as part of its original bid or submitted separately therewith for purposes of bidding. A bid with options is considered an alternative bid regardless of whether said bid proposal is contained in a single envelope or submitted in two (2) or more separate bid envelopes.

14.2 Each Bidder shall submit only one Bid, either individually or as a partner in a JV. A Bidder who submits or participates in more than one bid (other than as a subcontractor if a subcontractor is permitted to participate in more than one bid) will cause all the proposals with the Bidder's participation to be disqualified. This shall be without prejudice to any applicable criminal, civil and administrative penalties that may be imposed upon the persons and entities concerned.

15. Bid Prices

15.1. The Bidder shall complete the appropriate Schedule of Prices included herein, stating the unit prices, total price per item, the total amount and the expected countries of origin of the Goods to be supplied under this Project.

15.2. The Bidder shall fill in rates and prices for all items of the Goods described in the Schedule of Prices. Bids not addressing or providing all of the required items in the Bidding Documents including, where applicable, Schedule of Prices, shall be considered non-responsive and, thus, automatically disqualified. In this regard, where a required item is provided, but no price is indicated, the same shall be considered as non-responsive, but specifying a zero (0) or a dash (-) for the said item would mean that it is being offered for free to the Government, except those required by law or regulations to be accomplished.

15.3. The terms Ex Works (EXW), Cost, Insurance and Freight (CIF), Cost and Insurance Paid to (CIP), Delivered Duty Paid (DDP), and other trade terms used to describe the obligations of the parties, shall be governed by the rules

prescribed in the current edition of the International Commercial Terms (INCOTERMS) published by the International Chamber of Commerce, Paris.

15.4. Prices indicated on the Price Schedule shall be entered separately in the following manner:

(a) For Goods offered from within the Philippines:

- (i) The price of the Goods quoted EXW (ex works, ex factory, ex warehouse, ex showroom, or off-the-shelf, as applicable);
- (ii) The cost of all customs duties and sales and other taxes already paid or payable;
- (iii) The cost of transportation, insurance, and other costs incidental to delivery of the Goods to their final destination; and
- (iv) The price of other (incidental) services, specified in Clause 6.2 of the GCC and the Technical Specifications.

(b) For Goods offered from abroad:

- (i) The price of the Goods shall be quoted DDP with the place of destination in the Philippines as specified in the Technical Specifications. In quoting the price, the Bidder shall be free to use transportation through carriers registered in any eligible country. Similarly, the Bidder may obtain insurance services from any eligible source country.
- (ii) The price of other (incidental) services, if any.

(c) For Services, based on the form which may be prescribed by NPC, in accordance with existing laws, rules and regulations

15.5. Prices quoted by the Bidder shall be fixed during the Bidder's performance of the contract and not subject to variation or price escalation on any account. A bid submitted with an adjustable price quotation shall be treated as non-responsive and shall be rejected, pursuant to ITB Clause 21.

All bid prices for the given scope of work in the contract as awarded shall be considered as fixed prices, and therefore not subject to price escalation during contract implementation, except under extraordinary circumstances. Upon the recommendation of NPC, price escalation may be allowed in extraordinary circumstances as may be determined by the National Economic and Development Authority in accordance with the Civil Code of the Philippines, and upon approval by the GPPB. Nevertheless, in cases where the cost of the awarded contract is affected by any applicable new laws, ordinances, regulations, or other acts of the GOP, promulgated after the date of bid opening, a contract price adjustment shall be made or appropriate relief shall be applied on a no loss-no gain basis.

16. Bid Currencies

16.1. Prices shall be quoted in the following currencies:

- (a) For Goods that the Bidder will supply from within the Philippines, the prices shall be quoted in Philippine Pesos.
- (b) For Goods that the Bidder will supply from outside the Philippines, the prices may be quoted in the currency(ies) acceptable to NPC. However, for purposes of bid evaluation, bids denominated in foreign currencies shall be converted to Philippine currency based on the exchange rate as published in the *Bangko Sentral ng Pilipinas* (BSP) reference rate bulletin on the day of the bid opening.

16.2. If so allowed in accordance with ITB Clause 16.1, NPC for purposes of bid evaluation and comparing the bid prices will convert the amounts in various currencies in which the bid price is expressed to Philippine Pesos at the foregoing exchange rates.

16.3. Payment of the contract price shall be made in Philippine Pesos.

17. Bid Validity

17.1. Bids shall remain valid for the period of **ONE HUNDRED TWENTY (120) CALENDAR DAYS** from the date of the opening of bids.

17.2. In exceptional circumstances, prior to the expiration of the bid validity period, NPC may request Bidders to extend the period of validity of their bids. The request and the responses shall be made in writing. A Bidder may refuse the request, but his bid shall no longer be considered for further evaluation and award. A Bidder granting the request shall not be required or permitted to modify its bid.

18. Format and Signing of Bids

18.1. Bidders shall submit their bids through their duly authorized representative using the appropriate forms provided in **Section V – Bidding Forms** on or before the deadline specified in the ITB Clauses 20 in two (2) separate sealed bid envelopes, and which shall be submitted simultaneously. The first shall contain the technical component of the bid, including the eligibility requirements under ITB Clause 12.1, and the second shall contain the financial component of the bid. This shall also be observed for each lot in the case of lot procurement.

18.2. Forms as mentioned in ITB Clause 18.1 must be completed without any alterations to their format, and no substitute form shall be accepted. All blank spaces shall be filled in with the information requested.

18.3. Each and every page of the Bid Letter, including the **Schedule of Requirements (Bid Price Schedule)**, under Section IV hereof, shall be signed by the duly authorized representative/s of the Bidder. Failure to do so shall be a ground for the rejection of the bid.

- 18.4. Any interlineations, erasures, or overwriting shall be valid only if they are signed or initialed by the duly authorized representative/s of the Bidder.

19. Sealing and Marking of Bids

Each Bidder shall submit Two (2) copies of the first and second components of its Bid, marked **Original** and photocopy. Only the original copy will be read and considered for the bid.

Any misplaced document outside of the **Original** copy will not be considered. The photocopy is ONLY FOR REFERENCE.

The Procuring Entity may request additional hard copies and/or electronic copies of the Bid. However, failure of the Bidders to comply with the said request shall not be a ground for disqualification.

If the Procuring Entity allows the submission of bids through online submission to the given website or any other electronic means, the Bidder shall submit an electronic copy of its Bid, which must be digitally signed. An electronic copy that cannot be opened or is corrupted shall be considered non-responsive and, thus, automatically disqualified.

Bidders must also comply with the Disclaimer and Data Privacy Notice specified below:

All bid submissions and related correspondences are confidential and for viewing only by the intended recipient/s. Any unauthorized access to review, reproduce, or disseminate the information contained therein is strictly prohibited. The National Power Corporation (NAPOCOR) does not guarantee the security of any information electronically transmitted.

Bid submissions and related correspondences may contain personal and sensitive personal information, and are subject to the Data Privacy Act of 2012, its implementing rules, regulations and issuances of the National Privacy Commission of the Philippines ("Privacy Laws"). By viewing, using, storing, sharing and disposing (collectively "Processing"), such bids submissions and correspondences, you agree to comply with the Privacy Laws. By responding to correspondence, you consent to the Processing by NAPOCOR of the Personal Data contained in your submission/reply in accordance with NAPOCOR's Personal Data Privacy Policy which you can find at <http://www.napocor.gov.ph>.

To report any privacy issue, contact the Data Privacy Officer at dpo@napocor.gov.ph.

NAPOCOR is not liable for the proper and complete transmission of the information contained in bid submission/correspondences nor for any delay in its receipt.

C. Submission and Opening of Bids

20. Deadline for Submission of Bids

- 20.1. Proposals must be received by the BAC on the date and time agreed upon during negotiation meeting.
- 20.2. Any bid submitted after the deadline for submission and receipt of bids prescribed by NPC, pursuant to **ITB** Clause 20, shall be declared "Late" and shall not be accepted by NPC. The BAC shall record in the minutes of bid submission and opening, the Bidder's name, its representative and the time the late bid was submitted.
- 20.3. In case the bids cannot be opened as scheduled due to justifiable reasons, the BAC shall take custody of the bids submitted and reschedule the opening of bids on the next working day or at the soonest possible time through the issuance of a Notice of Postponement to be posted in the PhilGEPS website and the website of NPC.

21. Opening and Preliminary Examination of Bids

- 21.1. The BAC shall open the bids in public, immediately after the deadline for the submission and receipt of bids. In case the Bids cannot be opened as scheduled due to justifiable reasons, the BAC shall take custody of the Bids submitted and reschedule the opening of Bids on the next working day or at the soonest possible time through the issuance of a Notice of Postponement to be posted in the PhilGEPS website and the website of NPC.
- 21.2. The BAC shall open the first bid envelopes and determine each Bidder's compliance with the documents prescribed in **ITB** Clause 12, using a non-discretionary "pass/fail" criterion. If a Bidder submits the required document, it shall be rated "passed" for that particular requirement. In this regard, bids that fail to include any requirement or are incomplete or patently insufficient shall be considered as "failed". Otherwise, the BAC shall rate the said first bid envelope as "passed".
- 21.3. Immediately after determining compliance with the requirements in the first envelope, the BAC shall forthwith open the second bid envelope of each remaining eligible bidder whose first bid envelope was rated "passed". The second envelope of each complying bidder shall be opened within the same day. In case one or more of the requirements in the second envelope of a particular bid is missing, incomplete or patently insufficient, and/or if the submitted total bid price exceeds the ABC unless otherwise provided in **ITB** Clause 13.1(b), the BAC shall rate the bid concerned as "failed". Only bids that are determined to contain all the bid requirements for both components shall be rated "passed" and shall immediately be considered for evaluation and comparison.
- 21.4. Letters of non-participation/regret shall be read out and recorded during bid opening.

- 21.5. All members of the BAC who are present during bid opening shall initial every page of the original copies of all bids received and opened.
- 21.6. In the case of an eligible foreign bidder as described in ITB Clause 5, the following Class "A" Documents may be substituted with the appropriate equivalent documents, if any, issued by the country of the foreign Bidder concerned, which shall likewise be uploaded and maintained in the PhilGEPS in accordance with Section 8.5.2 of the IRR:
- (a) Registration certificate from the Securities and Exchange Commission (SEC), Department of Trade and Industry (DTI) for sole proprietorship, or CDA for cooperatives;
 - (b) Mayor's/Business permit issued by the local government where the principal place of business of the bidder is located; and
 - (c) Audited Financial Statements showing, among others, the prospective bidder's total and current assets and liabilities stamped "received" by the Bureau of Internal Revenue or its duly accredited and authorized institutions, for the preceding calendar year which should not be earlier than two years from the date of bid submission.
- 21.7. Each partner of a joint venture agreement shall likewise submit the requirements in ITB Clause 12.1(a)(i). Submission of other documents required under ITB Clauses 12.1 by any of the joint venture partners constitutes compliance.
- 21.8. NPC shall prepare the minutes of the proceedings of the bid opening that shall include, as a minimum: (a) names of Bidders, their bid price (per lot, if applicable, and/or including discount, (if any), findings of preliminary examination, and whether there is a withdrawal or modification; and (b) attendance sheet. The BAC members shall sign the abstract of bids as read.
- 24.8 The bidders or their duly authorized representatives may attend the opening of bids. The BAC shall ensure the integrity, security, and confidentiality of all submitted bids. The Abstract of Bids as read and the minutes of the bid opening shall be made available to the public upon written request and payment of a specified fee to recover cost of materials.
- 24.9 To ensure transparency and accurate representation of the bid submission, the BAC Secretariat shall notify in writing all bidders whose bids it has received through its PhilGEPS-registered physical address or official e-mail address. The notice shall be issued within seven (7) calendar days from the date of the bid opening.

D. Evaluation and Comparison of Bids

22. Process to be Confidential

- 22.1. Members of the BAC, including its staff and personnel, as well as its Secretariat and TWG, are prohibited from making or accepting any kind of

communication with any bidder regarding the evaluation of their bids until the issuance of the Notice of Award, unless otherwise allowed in the case of ITB Clause 26.

- 22.2. Any effort by a bidder to influence NPC in its decision in respect of bid evaluation, bid comparison or contract award will result in the rejection of the Bidder's bid.

23. Clarification of Bids

To assist in the evaluation, comparison, and post-qualification of the bids, NPC may ask in writing any Bidder for a clarification of its bid. All responses to requests for clarification shall be in writing. Any clarification submitted by a Bidder in respect to its bid and that is not in response to a request by NPC shall not be considered.

24. Domestic Preference

- 24.1. NPC will grant a margin of preference for the purpose of comparison of bids in accordance with the following:

- (a) The preference shall be applied when the lowest Foreign Bid is lower than the lowest bid offered by a Domestic Bidder.
- (b) For evaluation purposes, the lowest Foreign Bid shall be increased by fifteen percent (15%).
- (c) In the event that the lowest bid offered by a Domestic Bidder does not exceed the lowest Foreign Bid as increased, then NPC shall award the contract to the Domestic Bidder at the amount of the lowest Foreign Bid.

- 24.2. If the Domestic Bidder refuses to accept the award of contract at the amount of the Foreign Bid within two (2) calendar days from receipt of written advice from the BAC, NPC shall award to the bidder offering the Foreign Bid, subject to post-qualification and submission of all the documentary requirements under these Bidding Documents.

- 24.3. A Bidder may be granted preference as a Domestic Bidder subject to the certification from the DTI that the Bidder is offering unmanufactured articles, materials or supplies of the growth or production of the Philippines, or manufactured articles, materials, or supplies manufactured or to be manufactured in the Philippines substantially from articles, materials, or supplies of the growth, production, or manufacture, as the case may be, of the Philippines.

25. Detailed Evaluation and Comparison of Bids

- 25.1. NPC will undertake the detailed evaluation and comparison of bids which have passed the opening and preliminary examination of bids, pursuant to ITB Clause 21, in order to determine the Lowest Calculated Bid.

- 25.2. The Lowest Calculated Bid shall be determined in two steps:

- (a) The detailed evaluation of the financial component of the bids, to establish the correct calculated prices of the bids; and
 - (b) The ranking of the total bid prices as so calculated from the lowest to the highest. The bid with the lowest price shall be identified as the Lowest Calculated Bid.
- 25.3. NPC's BAC shall immediately conduct a detailed evaluation of all bids rated "passed," using non-discretionary pass/fail criteria. The BAC shall consider the following in the evaluation of bids:
- (a) Completeness of the bid. Bids not addressing or providing all of the required items in the Schedule of Requirements including, where applicable, Schedule of Prices, shall be considered non-responsive and, thus, automatically disqualified. In this regard, where a required item is provided, but no price is indicated, the same shall be considered as non-responsive, but specifying a zero (0) or a dash (-) for the said item would mean that it is being offered for free to NPC, except those required by law or regulations to be provided for; and
 - (b) Arithmetical corrections. Consider computational errors and omissions to enable proper comparison of all eligible bids. It may also consider bid modifications. Any adjustment shall be calculated in monetary terms to determine the calculated prices. In case of discrepancies between:
 - 1. bid prices in figures and in words, the latter shall prevail;
 - 2. total price per item and unit price for the item as extended or multiplied by the quantity of that item, the latter shall prevail;
 - 3. the total Bid amount and the sum of total costs per item, the sum of the total costs per item shall prevail and the total Bid amount will be corrected;
 - 4. unit cost in the detailed estimate and unit cost in the Bid Price Schedule, the latter shall prevail;
 - (c) The goods are grouped in a single lot and the lot shall not be divided into sub-lots for the purpose of bidding, evaluation, and contract award. The Bidders bid offer for each item must be within the ABC. Bidders with bid offers that exceed the ABC or with incomplete price shall be rejected.
- 25.4. Bids shall also be further evaluated based on the Computed Fuel Consumption Cost. The formula and its application are stated below. It is understood however, that the award of contract shall be at the Bidder's submitted bid price or its calculated bid price due to computational errors, omissions and discount, whichever is lower. Contract amount shall be exclusive of computed Fuel Consumption Cost

Fuel Consumption Cost:

Fuel Consumption for one (1) year for each bidder for their guaranteed fuel rate at Guaranteed Rated Output, shall be computed based on the accomplished Bid Forms, (*Section M-2.0 – Fuel Consumption Form for Diesel Engine-Generator Sets*), which shall be accomplished and submitted by the Bidders. The formula for the Fuel Consumption Cost (FCC) is:

FCC = (Bidder's Guaranteed Fuel Rate, in lit./kW-Hr) multiplied
by (fuel cost per liter) multiplied by (3,427 operating hours per year)
multiplied by (Guaranteed Rated Output in kW) multiplied by the
number of D/G units

The corrected bid price (calculated bid) due to computational errors, omissions and discounts, PLUS: the computed Fuel Consumption Cost shall become the total evaluated bid price, for bid comparison purposes.

- 25.5. Based on the detailed evaluation of bids, those that comply with the above-mentioned requirements shall be ranked in the ascending order of their total calculated bid prices, as evaluated and corrected for computational errors, discounts and other modifications, to identify the Lowest Calculated Bid. Total calculated bid prices, as evaluated and corrected for computational errors, discounts and other modifications, which exceed the ABC shall not be considered.
- 25.6. NPC's evaluation of bids shall be based on the bid price quoted in the Bid Letter, which includes the Schedule of Prices.
- 25.7. Bids shall be evaluated on an equal footing to ensure fair competition. For this purpose, all bidders shall be required to include in their bids the cost of all taxes, such as, but not limited to, value added tax (VAT), income tax, local taxes, and other fiscal levies and duties which shall be itemized in the bid form and reflected in the detailed estimates. Such bids, including said taxes, shall be the basis for bid evaluation and comparison.
- 25.8. If so indicated pursuant to ITB Clause 1.2, Bids are being invited for individual lots or for any combination thereof, provided that all Bids and combinations of Bids shall be received by the same deadline and opened and evaluated simultaneously so as to determine the Bid or combination of Bids offering the lowest calculated cost to NPC. Bid prices quoted shall correspond to all items specified for each lot and to all quantities specified for each item of a lot.

26. Post-Qualification

- 26.1. The BAC shall determine to its satisfaction whether the Bidder that is evaluated as having submitted the Lowest Calculated Bid complies with and is responsive to all the requirements and conditions specified in ITB Clauses 5, 12, and 13.
- 26.2. Within a non-extendible period of five (5) calendar days from receipt by the bidder of the notice from the BAC that it submitted the Lowest Calculated Bid, the Bidder shall submit the following documents and other appropriate licenses and permits required by law:

- a. Latest Income Tax Returns filed and paid through the BIR Electronic Filing and Payment System (eFPS);
- b. Business Tax/VAT Returns within the last six (6) months preceding the date of the bid submission, filed and paid through the BIR (eFPS);
- c. Class A – Eligibility Documents listed on the Annex A of Certificate of PhilGEPs Registration under Platinum Membership pursuant to Section 34.3 of the Revised IRR of R.A. 9184;
- d. Valid and current Mayor's/Business, if under renewal during bidding;
- e. Joint Venture Agreement (JVA) duly notarized, if not yet submitted with bid, if applicable;
- f. Contract/Purchase Order and/or Notice of Award for the contracts stated in the List of all Ongoing Government & Private Contracts Including Contracts Awarded but not yet Started (NPCSF-GOODS-02);
- g. Certification coming from the project owner/client that the performance is satisfactory as of the bidding date for all ongoing contracts stated in Form NPCSF-GOODS-02;
- h. Contract/Purchase Order for the contract stated in the Statement of the bidder's Single Largest Completed Contract (SLCC) similar to the contract to be bid (Form No. NPCSF-GOODS-03);
- i. The website, name, address, contact person, telephone number and e-mail address of the principal supplier of the Diesel Gensets to be supplied for this project;
- j. The name, address, telephone number and e-mail address of the manufacturer's technical coordinator or specialist with whom NPC can interface throughout the contract duration
- k. The name, address, contact person and number of the Bidder's Local Service Center in the Philippines declared in the Bid Proposal, that will efficiently cater to the maintenance, repair, and spare parts requirements of the supplied unit/s during the warranty period as prescribed in the Conditions of Contract and/or Technical Specifications. Bidders shall also submit the Bio-data/work experience of at least two (2) of its personnel in the Local Service Center. A certification from Manufacturer/Authorized Representative to prove that the said personnel has undergone required training to service the unit/s to be supplied for this project shall also be submitted

In case the Local Service Center is not owned by the Bidder, a Memorandum of Agreement (or any similar document) between the Bidder and the Manufacturer/Authorized Representative of the supplied unit/s shall be submitted by the Bidder subject to verification/approval of NPC. Non-submission of this requirement shall be grounds for disqualification of the bid

- I. Drawings and documents to be submitted during post-qualification process Sections M-3.0 to M-5.0 for Mechanical Works and Sections E-3.0 to E-12.0 for Electrical Works, Section III – Part II Technical Data Sheets

Failure to submit any of the post-qualification requirements on time, or a finding against the veracity thereof, shall disqualify the bidder for award. Provided in the event that a finding against the veracity of any of the documents submitted is made, it shall cause the forfeiture of the bid security in accordance with Section 69 of the IRR of RA 9184.

- 26.3. The determination shall be based upon an examination of the documentary evidence of the Bidder's qualifications submitted pursuant to ITB Clauses 12 and 13, as well as other information as NPC deems necessary and appropriate, using a non-discretionary "pass/fail" criterion, which shall be completed within a period of twelve (12) calendar days.
- 26.4. The post-qualification shall verify, validate, and ascertain all statements made and documents submitted by the bidder with the Lowest Calculated Bid/Highest Rated Bid, using non-discretionary criteria, as stated in the Bidding documents. These criteria shall consider, but shall not be limited to, the following:
 - a. Legal Requirements. To verify, validate, and ascertain licenses, certificates, permits, and agreements submitted by the bidder, and the fact that it is not included in any "blacklist" as provided in Section 25.3 of IRR-A of RA 9184.
 - b. Technical Requirements. To determine compliance of the goods offered with the requirements specified in the Bidding Documents, including, where applicable:
 - i. Verification and/or inspection and testing of the goods/product, after-sales and/or maintenance capabilities, in applicable cases, as well as checking the following:
 - a. Delay in the partial delivery of goods amounting to ten percent (10%) of the contract price in its ongoing government and private contracts;
 - b. If any of these contracts shows the bidder's failure to deliver or perform any or all of the goods or services within the period(s) specified in the contract or within any extension thereof granted by NPC pursuant to a request made by the supplier prior to the delay, and such failure amounts to at least ten percent (10%) of the contract price; or
 - c. Unsatisfactory performance of the supplier's obligations as per contract terms and conditions at the time of inspection.

- ii. Verification and validation of the bidder's stated competence and experience, and the competence and experience of the bidder's key personnel to be assigned to the project.
- iii. Verification of availability and commitment, and/or inspection and testing for the required capacities and operating conditions, of equipment units to be owned/leased/under purchase by the bidder for use in the contract under bidding, as well as checking the performance of the bidder in its ongoing government and private contracts, if any of these ongoing contracts shows:
 - a. Negative slippage of at least fifteen percent (15%) in any one project or a negative slippage of at least ten percent (10%) in each of two (2) or more contracts;
 - b. Failure of the contractor to commence repair works on ongoing contracts within seven (7) calendar days and to complete them within thirty (30) calendar days after receipt of NPC's notice of defects and deficiencies;
 - c. Failure of the contractor to commence repair works on contracts with pending certificates of acceptance within thirty (30) calendar days and complete them within ninety (90) days after receipt of NPC's notice of defects and failures; or
 - d. Substandard quality of work as per contract plans and specifications, or unsatisfactory performance of the contractor's obligations as per contract terms and conditions, at the time of inspection.

If the BAC verifies any of these deficiencies to be due to the bidder's fault or negligence, the BAC shall disqualify the bidder from the award.

- c. Financial Requirements. To verify, validate and ascertain the bid price proposal of the bidder and, whenever applicable, the required committed Line of Credit in the amount specified and over the period stipulated in the Bidding Documents or the bidder's NFCC to ensure that the bidder can sustain the operating cash flow of the transaction.
- 26.5. If the BAC determines that the Bidder with the Lowest Calculated Bid passes all the criteria for post-qualification, it shall declare the said bid as the LCRB, and recommend to the HoPE the award of contract to the said Bidder at its submitted price or its calculated bid price, whichever is lower.
- 26.6. A negative determination shall result in rejection of the Bidder's Bid, in which event NPC shall proceed to the next Lowest Calculated Bid with a fresh period to make a similar determination of that Bidder's capabilities to perform satisfactorily. If the second Bidder, however, fails the post qualification, the procedure for post qualification shall be repeated for the Bidder with the next Lowest Calculated Bid, and so on until the LCRB is determined for recommendation for contract award.

- 26.7. Within a period not exceeding fifteen (15) calendar days from the determination by the BAC of the LCRB and the recommendation to award the contract, the HoPE or his duly authorized representative shall approve or disapprove the said recommendation.
- 26.8. In the event of disapproval, which shall be based on valid, reasonable, and justifiable grounds as provided for under Section 41 of the IRR of RA 9184, the HoPE shall notify the BAC and the Bidder in writing of such decision and the grounds for it. When applicable, the BAC shall conduct a post-qualification of the Bidder with the next Lowest Calculated Bid. A request for reconsideration may be filed by the bidder with the HoPE in accordance with Section 37.1.3 of the IRR of RA 9184.

27. Reservation Clause

- 27.1. Notwithstanding the eligibility or post-qualification of a Bidder, NPC reserves the right to review its qualifications at any stage of the procurement process if it has reasonable grounds to believe that a misrepresentation has been made by the said Bidder, or that there has been a change in the Bidder's capability to undertake the project from the time it submitted its eligibility requirements. Should such review uncover any misrepresentation made in the eligibility and bidding requirements, statements or documents, or any changes in the situation of the Bidder which will affect its capability to undertake the project so that it fails the preset eligibility or bid evaluation criteria, NPC shall consider the said Bidder as ineligible and shall disqualify it from submitting a bid or from obtaining an award or contract.
- 27.2. Based on the following grounds, NPC reserves the right to reject any and all bids, declare a Failure of Bidding at any time prior to the contract award, or not to award the contract, without thereby incurring any liability, and make no assurance that a contract shall be entered into as a result of the bidding:
- (a) If there is *prima facie* evidence of collusion between appropriate public officers or employees of NPC, or between the BAC and any of the Bidders, or if the collusion is between or among the bidders themselves, or between a Bidder and a third party, including any act which restricts, suppresses or nullifies or tends to restrict, suppress or nullify competition;
 - (b) If NPC's BAC is found to have failed in following the prescribed bidding procedures; or
 - (c) For any justifiable and reasonable ground where the award of the contract will not redound to the benefit of the GOP as follows:
 - (i) If the physical and economic conditions have significantly changed so as to render the project no longer economically, financially or technically feasible as determined by the HoPE;
 - (ii) If the project is no longer necessary as determined by the HoPE; and

- (iii) If the source of funds for the project has been withheld or reduced through no fault of NPC.

27.3. In addition, NPC may likewise declare a failure of bidding when:

- (a) No bids are received;
- (b) All prospective Bidders are declared ineligible;
- (c) All bids fail to comply with all the bid requirements or fail post-qualification; or
- (d) The bidder with the LCRB refuses, without justifiable cause to accept the award of contract, and no award is made in accordance with Section 40 of the IRR of RA 9184.

E. Award of Contract

28. Contract Award

- 28.1. Subject to **ITB** Clause 26, the HoPE or its duly authorized representative shall award the contract to the Bidder whose bid has been determined to be the LCRB, at its submitted price or its calculated bid price, whichever is lower. Contract amount shall be exclusive of computed Fuel Consumption Cost (FFC).
- 28.2. Prior to the expiration of the period of bid validity, NPC shall notify the successful Bidder in writing that its bid has been accepted, through a Notice of Award duly received by the Bidder or its representative personally or sent by registered mail or electronically, receipt of which must be confirmed in writing within two (2) days by the Bidder with the LCRB and submitted personally or sent by registered mail or electronically to NPC.
- 28.3. Notwithstanding the issuance of the Notice of Award, award of contract shall be subject to the following conditions:
 - (a) Submission of the following documents within ten (10) calendar days from receipt of the Notice of Award:
 - (i) Valid JVA, if applicable; or
 - (ii) In the case of procurement by a Philippine Foreign Service Office or Post, the PhilGEPS Registration Number of the winning foreign Bidder;
 - (b) Posting of the performance security in accordance with **ITB** Clause 30;
 - (c) Signing of the contract as provided in **ITB** Clause 29; and
 - (d) Approval by higher authority, if required, as provided in Section 37.3 of the IRR of RA 9184.

- 28.4. At the time of contract award, NPC shall not increase or decrease the quantity of goods originally specified in **Section IV – Schedule of Requirements (Bid Price Schedule)**.

29. Signing of the Contract

- 29.1. At the same time as NPC notifies the successful Bidder that its bid has been accepted, NPC shall send the Contract Form to the Bidder, which contract has been provided in the Bidding Documents, incorporating therein all agreements between the parties.
- 29.2. Within ten (10) calendar days from receipt of the Notice of Award, the successful Bidder shall post the required performance security, sign and date the contract and return it to NPC.
- 29.3. NPC shall enter into contract with the successful Bidder within the same ten (10) calendar day period provided that all the documentary requirements are complied with.
- 29.4. The following documents shall form part of the contract:
- (a) Contract Agreement;
 - (b) Bidding Documents;
 - (c) Winning bidder's bid, including the Technical and Financial Proposals, and all other documents/statements submitted (e.g., bidder's response to request for clarifications on the bid), including corrections to the bid, if any, resulting from NPC's bid evaluation;
 - (d) Notice of Award of Contract; and
 - (e) Other contract documents that may be required by existing laws and/or NPC under these Bidding Documents.

30. Performance Security

- 30.1. To guarantee the faithful performance by the winning Bidder of its obligations under the contract, it shall post a performance security within a maximum period of ten (10) calendar days from the receipt of the Notice of Award from NPC and in no case later than the signing of the contract.
- 30.2. The Performance Security shall be denominated in Philippine Pesos and posted in favor of NPC in an amount not less than the percentage of the total contract price in accordance with the following schedule:

Form of Performance Security	Amount of Performance Security (Not less than the Percentage of the Total Contract Price)
(a) Cash or cashier's/manager's check issued by a Universal or Commercial Bank.	Five percent (5%)

(b) Bank draft/guarantee or irrevocable letter of credit issued by a Universal or Commercial Bank: Provided, however, that it shall be confirmed or authenticated by a Universal or Commercial Bank, if issued by a foreign bank.	
(c) Surety bond callable upon demand issued by a surety or insurance company duly certified by the Insurance Commission as authorized to issue such security.	Thirty percent (30%)

- 30.3. Failure of the successful Bidder to comply with the above-mentioned requirement shall constitute sufficient ground for the annulment of the award and forfeiture of the bid security, in which event NPC shall have a fresh period to initiate and complete the post qualification of the second Lowest Calculated Bid. The procedure shall be repeated until the LCRB is identified and selected for recommendation of contract award. However if no Bidder passed post-qualification, the BAC shall declare the bidding a failure and conduct a re-bidding with re-advertisement, if necessary.
- 30.4. The performance bond to be posted by the Contractor must also comply with following additional requirements:
1. The following must be indicated in the performance bond to be posted by the Contractor:
 - i. Company Name
 - ii. Correct amount of the Bond
 - iii. Contract/Purchase Order Reference Number
 - iv. Purpose of the Bond:
 "To guarantee the faithful performance of the Principal's obligation to undertake (Contract/Purchase Order Description) in accordance with the terms and conditions of (Contract No. & Schedule/Purchase Order No.) entered into by the parties."
 2. The bond shall remain valid and effective until the duration of the contract (should be specific date reckoned from the contract effectivity) plus sixty (60) days after NPC's acceptance of the last delivery/final acceptance of the project.
 3. In case of surety bond, any extension of the contract duration or delivery period granted to the CONTRACTOR shall be considered as given, and any modification of the contract shall be considered as authorized, as if with the expressed consent of the surety, provided that such extension or modifications falls within the effective period of the said surety bond. However, in the event that the extension of the contract duration or

delivery schedule would be beyond the effective period of the surety bond first posted, it shall be the sole obligation of the CONTRACTOR to post an acceptable Performance Security within ten (10) calendar days after the contract duration/delivery period extension has been granted by NPC.

4. Other required conditions in addition to the standard policy terms issued by the Bonding Company:
 - i. The bond is a penal bond, callable on demand and the entire amount thereof shall be forfeited in favor of the Obligee upon default of the Principal without the need to prove or to show grounds or reasons for demand for the sum specified therein;
 - ii. The amount claimed by the Obligee under this bond shall be paid in full and shall never be subject to any adjustment by the Surety;
 - iii. In case of claim, the Surety shall pay such claim within sixty (60) days from receipt by the Surety of the Obligee's notice of claim/demand letter notwithstanding any objection thereto by the Principal.

31. Notice to Proceed

Within seven (7) calendar days from the date of approval of the contract by the appropriate government approving authority, NPC shall issue the Notice to Proceed (NTP) together with a copy or copies of the approved contract to the successful Bidder. All notices called for by the terms of the contract shall be effective only at the time of receipt thereof by the successful Bidder.

32. Protest Mechanism

Decisions of NPC at any stage of the procurement process may be questioned in accordance with Section 55 of the IRR of RA 9184.

SECTION II

GENERAL CONDITIONS OF CONTRACT

SECTION II – GENERAL CONDITIONS OF CONTRACT**TABLE OF CONTENTS**

1.	Definitions.....	1
2.	Corrupt, Fraudulent, Collusive, and Coercive Practices	2
3.	Inspection and Audit by the Funding Source.....	3
4.	Governing Law and Language.....	3
5.	Notices	3
6.	Scope of Contract.....	4
7.	Subcontracting.....	8
8.	Procuring Entity's Responsibilities	8
9.	Prices	8
10.	Payment	8
11.	Advance Payment and Terms of Payment.....	9
12.	Taxes and Duties.....	11
13.	Performance Security	11
14.	Use of Contract Documents and Information	12
15.	Standards.....	12
16.	Inspection and Tests.....	12
17.	Warranty.....	13
18.	Delays in the Supplier's Performance	14
19.	Liquidated Damages.....	14
20.	Settlement of Disputes.....	16
21.	Liability of the Supplier.....	16
22.	Force Majeure	17
23.	Termination for Default	17
24.	Termination for Insolvency.....	18
25.	Termination for Convenience.....	18
26.	Termination for Unlawful Acts	18
27.	Procedures for Termination of Contracts	19
28.	Assignment of Rights.....	20
29.	Contract Amendment.....	20
30.	Application.....	20

SECTION II – GENERAL CONDITIONS OF CONTRACT

1. Definitions

1.1. In this Contract, the following terms shall be interpreted as indicated:

- (a) "The Contract" means the agreement entered into between NPC and the Supplier, as recorded in the Contract Form signed by the parties, including all attachments and appendices thereto and all documents incorporated by reference therein.
- (b) "The Contract Price" means the price payable to the Supplier under the Contract for the full and proper performance of its contractual obligations.
- (c) "The Goods" means all of the supplies, equipment, machinery, spare parts, other materials and/or general support services which the Supplier is required to provide to NPC under the Contract.
- (d) "The Services" means those services ancillary to the supply of the Goods, such as transportation and insurance, and any other incidental services, such as installation, commissioning, provision of technical assistance, training, and other such obligations of the Supplier covered under the Contract.
- (e) "GCC" means the General Conditions of Contract contained in this Section.
- (f) NPC is **National Power Corporation (NPC or NAPOCOR)** with office address at BIR Road cor. Quezon Avenue, Diliman, Quezon City.
- (g) "NPC's country" is the Philippines.
- (h) "The Supplier" means the individual contractor, manufacturer distributor, or firm supplying/manufacturing the Goods and Services under this Contract.
- (i) "The Project Site," where applicable, means the place or places named in the Technical Specifications.
- (j) "Day" means calendar day.
- (k) The "Effective Date" of the contract will be the date of signing the contract, however the Supplier shall commence performance of its obligations only upon receipt of the Notice to Proceed and copy of the approved contract.
- (l) "Verified Report" refers to the report submitted by the Implementing Unit to the HoPE setting forth its findings as to the existence of

grounds or causes for termination and explicitly stating its recommendation for the issuance of a Notice to Terminate.

2. Corrupt, Fraudulent, Collusive, and Coercive Practices

2.1. NPC as well as the bidders, contractors, or suppliers shall observe the highest standard of ethics during the procurement and execution of this Contract. In pursuance of this policy, NPC:

- (a) defines, for the purposes of this provision, the terms set forth below as follows:
 - (i) "corrupt practice" means behavior on the part of officials in the public or private sectors by which they improperly and unlawfully enrich themselves, others, or induce others to do so, by misusing the position in which they are placed, and it includes the offering, giving, receiving, or soliciting of anything of value to influence the action of any such official in the procurement process or in contract execution; entering, on behalf of the Government, into any contract or transaction manifestly and grossly disadvantageous to the same, whether or not the public officer profited or will profit thereby, and similar acts as provided in Republic Act 3019.
 - (ii) "fraudulent practice" means a misrepresentation of facts in order to influence a procurement process or the execution of a contract to the detriment of NPC, and includes collusive practices among Bidders (prior to or after bid submission) designed to establish bid prices at artificial, non-competitive levels and to deprive NPC of the benefits of free and open competition.
 - (iii) "collusive practices" means a scheme or arrangement between two or more Bidders, with or without the knowledge of NPC, designed to establish bid prices at artificial, non-competitive levels.
 - (iv) "coercive practices" means harming or threatening to harm, directly or indirectly, persons, or their property to influence their participation in a procurement process, or affect the execution of a contract;
 - (v) "obstructive practice" is
 - (aa) deliberately destroying, falsifying, altering or concealing of evidence material to an administrative proceedings or investigation or making false statements to investigators in order to materially impede an administrative proceedings or investigation of NPC or any foreign government/foreign or international financing institution into allegations of a corrupt, fraudulent, coercive or collusive practice; and/or

threatening, harassing or intimidating any party to prevent it from disclosing its knowledge of matters relevant to the administrative proceedings or investigation or from pursuing such proceedings or investigation; or

(bb) acts intended to materially impede the exercise of the inspection and audit rights of NPC or any foreign government/foreign or international financing institution herein.

(b) will reject a proposal for award if it determines that the Bidder recommended for award has engaged in any of the practices mentioned in this Clause for purposes of competing for the contract.

2.2. Further the Government of the Philippines (GOP) or NPC, as appropriate, will seek to impose the maximum civil, administrative and/or criminal penalties available under the applicable law on individuals and organizations deemed to be involved with any of the practices mentioned in GCC Clause 2.1(a).

3. Inspection and Audit by the Funding Source

The Supplier shall permit NPC to inspect the Supplier's accounts and records relating to the performance of the Supplier and to have them audited by auditors appointed by the Government of the Philippines (GOP), if so required.

4. Governing Law and Language

4.1. This Contract shall be interpreted in accordance with the laws of the Republic of the Philippines.

4.2. This Contract has been executed in the English language, which shall be the binding and controlling language for all matters relating to the meaning or interpretation of this Contract. All correspondence and other documents pertaining to this Contract exchanged by the parties shall be written in English.

5. Notices

5.1. Any notice, request, or consent required or permitted to be given or made pursuant to this Contract shall be in writing. Any such notice, request, or consent shall be deemed to have been given or made when received by the concerned party, either in person or through an authorized representative of the Party to whom the communication is addressed, or when sent by registered mail, telex, telegram, or facsimile to such Party at the address specified below, which shall be effective when delivered and duly received or on the notice's effective date, whichever is later.

NPC's address for Notices is:

FERNANDO MARTIN Y. ROXAS
President and CEO

National Power Corporation
Sen. Miriam P. Defensor-Santiago Ave.,
(formerly BIR Road) cor. Quezon Blvd.,
Diliman, Quezon City 1100

- 5.2. A Party may change its address for notice hereunder by giving the other Party notice of such change pursuant to the provisions listed in **GCC Clause 5.1**.

6. Scope of Contract

- 6.1. The Goods and Related Services to be provided shall be as specified in in **Sections III – Technical Specifications and Section IV – Schedule of Requirements**.
- 6.2. This Contract shall include all such items, although not specifically mentioned, that can be reasonably inferred as being required for its completion as if such items were expressly mentioned herein. Any additional requirements for the completion of this Contract are provided below:

a. Delivery and Documents –

The delivery terms applicable to the Contract is DDP delivered to the project site specified in the technical specifications, in accordance with INCOTERMS. Risk and title will pass from the Supplier to NPC upon receipt and final acceptance of the Goods at their final destination.

Delivery of the Goods shall be made by the Supplier in accordance with the terms specified in Section III – Technical Specifications. The details of shipping and/or other documents to be furnished by the Supplier are as follows:

For Goods supplied from within the Philippines

Upon delivery of the Goods to the Project Site, the Supplier shall notify NPC and present the following documents to NPC:

- (i) Original and four copies of the Supplier's invoice showing Goods' description, quantity, unit price, and total amount;
- (ii) Original and four copies of Supplier's factory test/inspection report;
- (iii) Original and four copies of the certificate of origin (for imported Goods);
- (iv) Delivery receipt detailing number and description of items received signed by NPC's representative at the Project Site;
- (v) Certificate of Completion/Inspection Report signed by NPC's representative at the Project Site;
- (vi) Original and four copies of the Inspection Receiving Report signed by NPC's representative at the Project Site;

- (vii) Original and four copies of the Manufacturer's and/or Supplier's warranty certificate; and
- (viii) Documents specified in the Technical Specifications, if any.

For Goods supplied from abroad:

Upon shipment, the Supplier shall notify NPC and the insurance company by e-mail the full details of the shipment, including Contract Number, description of the Goods, quantity, vessel, bill of lading number and date, port of loading, date of shipment, port of discharge etc. Upon delivery to the Project Site, the Supplier shall notify NPC and present the following documents as applicable with the documentary requirements of any letter of credit issued taking precedence:

- (i) Original and four copies of the Supplier's invoice showing Goods' description, quantity, unit price, and total amount;
- (ii) Original and four copies of the negotiable, clean shipped on board bill of lading marked "freight pre-paid" and five copies of the non-negotiable bill of lading ;
- (iii) Original and four copies of Supplier's factory test/inspection report;
- (iv) Delivery receipt detailing number and description of items received signed by NPC's representative at the Project Site;
- (v) Certificate of Completion/Inspection Report signed by NPC's representative at the Project Site;
- (vi) Original and four copies of the Inspection Receiving Report signed by NPC's representative at the Project Site;
- (vii) Original and four copies of the certificate of origin (for imported Goods); and
- (viii) Original and four copies of the Manufacturer's and/or Supplier's warranty certificate including all other documents specified in the Technical Specifications, if any.

For purposes of this Clause NPC's Representative at the Project Site is the **Vice President - SPUG or duly authorized representative.**

b. Incidental Services –

The Supplier is required to provide the following services, including additional services specified in Technical Specifications, if necessary:

- (a) performance or supervision of on-site assembly and/or start-up of the supplied Goods;

- (b) furnishing of tools required for assembly and/or maintenance of the supplied Goods;
- (c) furnishing of a detailed operations and maintenance manual for each appropriate unit of the supplied Goods;
- (d) performance or supervision or maintenance and/or repair of the supplied Goods, for a period of time agreed by the parties, provided that this service shall not relieve the Supplier of any warranty obligations under this Contract; and
- (e) training of NPC's personnel, at the Supplier's plant and/or on-site, in assembly, start-up, operation, maintenance, and/or repair of the supplied Goods.

The Contract price for the Goods shall include the prices charged by the Supplier for incidental services and shall not exceed the prevailing rates charged to other parties by the Supplier for similar services.

c. Spare Parts –

The Supplier is required to provide all of the following materials, notifications, and information pertaining to spare parts manufactured or distributed by the Supplier:

- (a) such spare parts as NPC may elect to purchase from the Supplier, provided that this election shall not relieve the Supplier of any warranty obligations under this Contract; and
- (b) in the event of termination of production of the spare parts:
 - i. advance notification to NPC of the pending termination, in sufficient time to permit NPC to procure needed requirements; and
 - ii. following such termination, furnishing at no cost to NPC, the blueprints, drawings, and specifications of the spare parts, if requested.

The spare parts required are listed in the Technical Specifications and the cost thereof are included in the Contract Price.

The Supplier shall carry sufficient inventories to assure ex-stock supply of consumable spares for the Goods for the period specified in the Technical Specifications.

Other spare parts and components shall be supplied as promptly as possible, but in any case within three (3) months of placing the order.

d. Packaging –

The Supplier shall provide such packaging of the Goods as is required to prevent their damage or deterioration during transit to their final destination, as indicated in this Contract. The packaging shall be

sufficient to withstand, without limitation, rough handling during transit and exposure to extreme temperatures, salt and precipitation during transit, and open storage. Packaging case size and weights shall take into consideration, where appropriate, the remoteness of the GOODS' final destination and the absence of heavy handling facilities at all points in transit.

The packaging, marking, and documentation within and outside the packages shall comply strictly with such special requirements as shall be expressly provided for in the Contract, including additional requirements, if any, specified below, and in any subsequent instructions ordered by NPC.

The outer packaging must be clearly marked on at least four (4) sides as follows:

Name of the Procuring Entity
Name of the Supplier
Contract Description
Final Destination
Gross weight
Any special lifting instructions
Any special handling instructions
Any relevant HAZCHEM classifications

A packaging list identifying the contents and quantities of the package is to be placed on an accessible point of the outer packaging if practical. If not practical the packaging list is to be placed inside the outer packaging but outside the secondary packaging.

e. Insurance –

The Goods supplied under this Contract shall be fully insured by the Supplier in a freely convertible currency against loss or damage incidental to manufacture or acquisition, transportation, storage, and delivery. The Goods remain at the risk and title of the Supplier until their final acceptance by NPC.

f. Transportation –

The Supplier is required under Contract to deliver the Goods DDP to the project site. Transport of the Goods to the port of destination in the Philippines, including insurance and storage, as specified in this Contract, shall be arranged and paid for by the Supplier, and the related cost thereof shall be included in the Contract Price.

NPC accepts no liability for the damage of Goods during transit. Risk and title will not be deemed to have passed to NPC until their receipt and final acceptance by NPC at the final destination.

g. Patent Rights –

The Supplier shall indemnify NPC against all third-party claims of infringement of patent, trademark, or industrial design rights arising from use of the Goods or any part thereof.

7. Subcontracting

- 7.1. Subcontracting of any portion of the Goods, if allowed in the **ITB**, does not relieve the Supplier of any liability or obligation under this Contract. The Supplier will be responsible for the acts, defaults, and negligence of any subcontractor, its agents, servants or workmen as fully as if these were the Supplier's own acts, defaults, or negligence, or those of its agents, servants or workmen.
- 7.2. If subcontracting is allowed, the Supplier may identify its subcontractor during contract implementation. Subcontractors disclosed and identified during the bidding may be changed during the implementation of this Contract. In either case, subcontractors must submit the documentary requirements under **ITB** Clause 12 and comply with the eligibility criteria specified therein. In the event that any subcontractor is found by NPC to be ineligible, the subcontracting of such portion of the Goods shall be disallowed.

8. Procuring Entity's Responsibilities

- 8.1. Whenever the performance of the obligations in this Contract requires that the Supplier obtain permits, approvals, import, and other licenses from local public authorities, NPC shall, if so needed by the Supplier, make its best effort to assist the Supplier in complying with such requirements in a timely and expeditious manner.
- 8.2. NPC shall pay all costs involved in the performance of its responsibilities in accordance with **GCC** Clause 6.

9. Prices

- 9.1. For the given scope of work in this Contract as awarded, all bid prices are considered fixed prices, and therefore not subject to price escalation during contract implementation, except under extraordinary circumstances and upon prior approval of the GPPB in accordance with Section 61 of R.A. 9184 and its IRR or except as provided in this Clause.
- 9.2. Prices charged by the Supplier for Goods delivered and/or services performed under this Contract shall not vary from the prices quoted by the Supplier in its bid, with the exception of any change in price resulting from a Change Order issued in accordance with **GCC** Clause 29.

10. Payment

- 10.1. Payments shall be made only upon a certification by the HoPE to the effect that the Goods have been rendered or delivered in accordance with the terms of this Contract and have been duly inspected and accepted. Except with the

prior approval of the President no payment shall be made for services not yet rendered or for supplies and materials not yet delivered under this Contract. At least one percent (1%) but not to exceed five percent (5%) of the amount of each payment shall be retained by NPC to cover the Supplier's warranty obligations under this Contract as described in **GCC Clause 17**.

- 10.2. The Supplier's request(s) for payment shall be made to NPC in writing, accompanied by an invoice describing, as appropriate, the Goods delivered and/or Services performed, and by documents submitted pursuant to **GCC Clause 6.2**, and upon fulfillment of other obligations stipulated in this Contract.
- 10.3. Pursuant to **GCC Clause 10.2**, payments shall be made promptly by NPC, but in no case later than sixty (60) days after submission of an invoice or claim by the Supplier.
- 10.4. The currency in which payment is made to the Supplier under this Contract shall be in Philippine Pesos.

11. Advance Payment and Terms of Payment (The applicable Terms of Payment for this Contract is Clause 10.3, Item No. 3)

- 11.1. Advance payment not to exceed fifteen percent (15%) of the contract amount shall be allowed and paid within sixty (60) calendar days from effectivity of the contract and upon the submission to and acceptance by NPC of an irrevocable letter of credit or bank guarantee issued by a Universal or Commercial Bank. The irrevocable letter of credit or bank guarantee must be for an equivalent amount, shall remain valid until the goods are delivered, and accompanied by a claim for advance payment.
- 11.2. All progress payments shall first be charged against the advance payment until the latter has been fully exhausted.
- 11.3. The terms of payment shall be as follows:
 - 1) **For Supply and Delivery Contracts:**
 - (a) On Contract Effectivity: Advance payment of Fifteen percent (15%) of the total Contract Price shall be paid within sixty (60) days from effectivity of the Contract and upon submission of a claim and an irrevocable letter of credit or bank guarantee issued by a Universal or Commercial Bank for the equivalent amount valid until the Goods are delivered and in the form provided in Section V- Bidding Forms.
 - (b) On Delivery: Eighty percent (80%) of the Contract Price of the **delivered Goods** shall be considered for payment, less the total amount of advance payment, if any and other deductions. If the amount is sufficient to fully recoup the advance payment, the remainder after deductions shall be paid to the Supplier within sixty (60) days after the date of receipt of the Goods and upon submission of the documents (i) through (vi) specified in the **GCC Clause 6.2** provision on Delivery and Documents. Otherwise, the total delivery payment shall be charged against the advance payment and

the remaining advance payment will be fully recouped from the succeeding claims.

- (c) On Acceptance: The remaining twenty percent (20%) of the Contract Price of the **delivered Goods** shall be paid to the Supplier within sixty (60) days after the date of submission of the acceptance and inspection certificate for the respective delivery issued by NPC's authorized representative. In the event that no acceptance certificate is issued by NPC's authorized representative within forty five (45) days after successful test and commissioning, if required, the Supplier shall have the right to claim payment of the remaining twenty percent (20%) subject to NPC's own verification of the reason(s) for the failure to issue documents (vii) and (viii) as described in the GCC Clause 6.2 provision on Delivery and Documents.

2) For Supply, Delivery, Installation, Test and Commissioning Contracts:

- (a) On Contract Effectivity: Advance payment of Fifteen percent (15%) of the total Contract Price shall be paid within sixty (60) days from effectivity of the Contract and upon submission of a claim and an irrevocable letter of credit or bank guarantee issued by a Universal or Commercial Bank for the equivalent amount valid until the Goods are delivered and in the form provided in Section V- Bidding Forms.

- (b) On Delivery: Eighty percent (80%) of the price of the **delivered Goods**, excluding price for installation, test and commissioning shall be considered for payment, less the total amount of advance payment, if any and other deductions. If the amount is sufficient to fully recoup the advance payment, the remainder after deductions shall be paid to the Supplier within sixty (60) days after the date of receipt of the Goods and upon submission of the documents (i) through (vi) specified in the GCC Clause 6.2 provision on Delivery and Documents. Otherwise, the total delivery payment shall be charged against the advance payment and the remaining advance payment will be fully recouped from the succeeding claims.

- (c) On Acceptance: The remaining twenty percent (20%) of the price of the **delivered Goods** plus price for installation, test and commissioning shall be paid to the Supplier within sixty (60) days after the date of submission of the acceptance and inspection certificate for the respective delivery issued by NPC's authorized representative. In the event that no acceptance certificate is issued by NPC's authorized representative within forty five (45) days after successful test and commissioning, the Supplier shall have the right to claim payment subject to NPC's own verification of the reason(s) for the failure to issue documents (vii) and (viii) as described in the GCC Clause 6.2 provision on Delivery and Documents.

3) For Supply, Delivery, Installation, Test and Commissioning Contracts where Installation, Test and Commissioning prices are included in the supply price:

- (a) On Contract Effectivity: Advance payment of Fifteen percent (15%) of the total Contract Price shall be paid within sixty (60) days from effectivity of the Contract and upon submission of a claim and an irrevocable letter of credit or bank guarantee issued by a Universal or Commercial Bank for the equivalent amount valid until the Goods are delivered and in the form provided in Section V- Bidding Forms.
- (b) On Delivery: Sixty percent (60%) of the price of the **delivered Goods** shall be considered for payment, less the total amount of advance payment, if any and other deductions. If the amount is sufficient to fully recoup the advance payment, the remainder after deductions shall be paid to the Supplier within sixty (60) days after the date of receipt of the Goods and upon submission of the documents (i) through (vi) specified in the **GCC** Clause 6.2 provision on Delivery and Documents. Otherwise, the total delivery payment shall be charged against the advance payment and the remaining advance payment will be fully recouped from the succeeding claims.
- (c) On Acceptance: The remaining forty percent (40%) of the price of the **delivered Goods** shall be paid to the Supplier within sixty (60) days after the date of submission of the acceptance and inspection certificate for the respective delivery issued by NPC's authorized representative. In the event that no acceptance certificate is issued by NPC's authorized representative within forty five (45) days after successful test and commissioning, the Supplier shall have the right to claim payment subject to NPC's own verification of the reason(s) for the failure to issue documents (vii) and (viii) as described in the **GCC** Clause 6.2 provision on Delivery and Documents.

12. Taxes and Duties

The Supplier, whether local or foreign, shall be entirely responsible for all the necessary taxes, stamp duties, license fees, and other such levies imposed for the completion of this Contract.

13. Performance Security

- 13.1. Within ten (10) calendar days from receipt of the Notice of Award from NPC but in no case later than the signing of the contract by both parties, the successful Bidder shall furnish the performance security in any the forms prescribed in the **ITB** Clause 30.2.
- 13.2. The performance security posted in favor of NPC shall be forfeited in the event it is established that the winning bidder is in default in any of its obligations under the contract.
- 13.3. The performance security shall remain valid until issuance by NPC of the Certificate of Final Acceptance.
- 13.4. The performance security may be released by NPC and returned to the Supplier after the issuance of the Certificate of Final Acceptance subject to the following conditions:

- (a) There are no pending claims against the Supplier or the surety company filed by NPC;
- (b) The Supplier has no pending claims for labor and materials filed against it;

13.5. In case of a reduction of the contract value, NPC shall allow a proportional reduction in the original performance security, provided that any such reduction is more than ten percent (10%) and that the aggregate of such reductions is not more than fifty percent (50%) of the original performance security.

14. Use of Contract Documents and Information

14.1. The Supplier shall not, except for purposes of performing the obligations in this Contract, without NPC's prior written consent, disclose this Contract, or any provision thereof, or any specification, plan, drawing, pattern, sample, or information furnished by or on behalf of NPC. Any such disclosure shall be made in confidence and shall extend only as far as may be necessary for purposes of such performance.

14.2. Any document, other than this Contract itself, enumerated in **GCC Clause 14.1** shall remain the property of NPC and shall be returned (all copies) to NPC on completion of the Supplier's performance under this Contract if so required by NPC.

15. Standards

The Goods provided under this Contract shall conform to the standards mentioned in the **Section III – Technical Specifications**; and, when no applicable standard is mentioned, to the authoritative standards appropriate to the Goods' country of origin. Such standards shall be the latest issued by the institution concerned.

16. Inspection and Tests

16.1. NPC or its representative shall have the right to inspect and/or to test the Goods to confirm their conformity to the Contract specifications at no extra cost to NPC. The **Section III – Technical Specifications** shall specify what inspections and/or tests NPC requires and where they are to be conducted. NPC shall notify the Supplier in writing, in a timely manner, of the identity of any representatives retained for these purposes.

16.2. If applicable, the inspections and tests may be conducted on the premises of the Supplier or its subcontractor(s), at point of delivery, and/or at the goods' final destination. If conducted on the premises of the Supplier or its subcontractor(s), all reasonable facilities and assistance, including access to drawings and production data, shall be furnished to the inspectors at no charge to NPC. The Supplier shall provide NPC with results of such inspections and tests.

- 16.3. NPC or its designated representative shall be entitled to attend the tests and/or inspections referred to in this Clause provided that NPC shall bear all of its own costs and expenses incurred in connection with such attendance including, but not limited to, all traveling and board and lodging expenses.
- 16.4. NPC may reject any Goods or any part thereof that fail to pass any test and/or inspection or do not conform to the specifications. The Supplier shall either rectify or replace such rejected Goods or parts thereof or make alterations necessary to meet the specifications at no cost to NPC, and shall repeat the test and/or inspection, at no cost to NPC, upon giving a notice pursuant to GCC Clause 5.
- 16.5. The Supplier agrees that neither the execution of a test and/or inspection of the Goods or any part thereof, nor the attendance by NPC or its representative, shall release the Supplier from any warranties or other obligations under this Contract.

17. Warranty

- 17.1. The Supplier warrants that the Goods supplied under the Contract are new, unused, of the most recent or current models, and that they incorporate all recent improvements in design and materials, except when the technical specifications required by NPC provides otherwise.
- 17.2. The Supplier further warrants that all Goods supplied under this Contract shall have no defect, arising from design, materials, or workmanship or from any act or omission of the Supplier that may develop under normal use of the supplied Goods in the conditions prevailing in the country of final destination.
- 17.3. In order to assure that manufacturing defects shall be corrected by the Supplier, a warranty shall be required from the Supplier for a minimum period specified in Section III – Part I (Technical Specifications). The obligation for the warranty shall be covered by, at the Supplier's option, either retention money in an amount equivalent to at least one percent (1%) but not to exceed five percent (5%) of every progress payment, or a special bank guarantee equivalent to at least one percent (1%) but not to exceed five percent (5%) of the total Contract Price. The said amounts shall only be released after the lapse of the warranty period specified in Section III – Part I (Technical Specifications); provided, however, that the Supplies delivered are free from patent and latent defects and all the conditions imposed under this Contract have been fully met.

Certificate of Acceptance of the entire contract shall be issued only after complete delivery, inspection, test (if required) and acceptance of all Goods and services required in the contract

- 17.4. NPC shall promptly notify the Supplier in writing of any claims arising under this warranty. Upon receipt of such notice, the Supplier shall, within the period not exceed thirty (30) days upon receipt of the notice from NPC and with all reasonable speed, correct/repair or replace the defective Goods or parts thereof, without cost to NPC.

- 17.5. If the Supplier, having been notified, fails to remedy the defect(s) within the period specified in **GCC Clause 17.4**, NPC may proceed to take such remedial action as may be necessary, at the Supplier's risk and expense and without prejudice to any other rights which NPC may have against the Supplier under the Contract and under the applicable law.

17.6. CORRECTION OF PUNCHLIST ITEMS:

After to the conduct of Test and Commissioning/Joint Final Inspection or upon the advice by the NPC, the Contractor/Supplier must correct any remaining works and work deficiencies identified in the punchlist issued for the project within one (1) month considering the approved remaining contract time.

Failure to comply with this provision shall be grounds for non-issuance of Certificate of Satisfactory Performance which is a requirement for future bidding with the NPC. This, however, shall not preclude NPC's claim for liquidated damages, imposition of any other penalties and/or filing of blacklisting actions in accordance with the blacklisting guidelines issued by the Government Procurement Policy Board (GPPB).

18. Delays in the Supplier's Performance

- 18.1. Delivery of the Goods and/or performance of Services shall be made by the Supplier in accordance with the time schedule prescribed by NPC in **Section III – Technical Specifications**.
- 18.2. If at any time during the performance of this Contract, the Supplier or its Subcontractor(s) should encounter conditions impeding timely delivery of the Goods and/or performance of Services, the Supplier shall promptly notify NPC in writing of the fact of the delay, its likely duration and its cause(s). As soon as practicable after receipt of the Supplier's notice, and upon causes provided for under **GCC Clause 22**, NPC shall evaluate the situation and may extend the Supplier's time for performance, in which case the extension shall be ratified by the parties by amendment of Contract.
- 18.3. Except as provided under **GCC Clause 22**, a delay by the Supplier in the performance of its obligations shall render the Supplier liable to the imposition of liquidated damages pursuant to **GCC Clause 19**, unless an extension of time is agreed upon pursuant to **GCC Clause 29** without the application of liquidated damages.

19. Liquidated Damages

- 19.1. Subject to **GCC Clauses 17.1 and 22**, if the Supplier fails to satisfactorily deliver any or all of the Goods and/or to perform the Services within the period(s) specified in this Contract inclusive of duly granted time extensions if any, NPC shall, without prejudice to its other remedies under this Contract and under the applicable law, deduct from the Contract Price, as liquidated damages, the applicable rate of one tenth (1/10) of one (1) percent of the cost of the unperformed portion for every day of delay until actual delivery or performance. Once the amount of liquidated damages reaches ten percent

(10%), NPC may rescind or terminate the Contract pursuant to **GCC Clause 23**, without prejudice to other courses of action and remedies open to it.

19.2. Aside from the Liquidated Damages, the PROCURING ENTITY shall also implement the following additional penalties:

1. Penalty for Failure to Meet Guaranteed Rated Output

Aside from the Liquidated Damages, the PROCURING ENTITY shall impose a penalty in case the Supplier fails to attain the guaranteed rated output of the diesel gensets.

If the diesel gensets fails to attain the guaranteed kW output at site during the performance test as measured at the generator output terminals, a penalty shall be imposed to the Supplier for each diesel genset that failed to attain the guaranteed kW output, computed in accordance with the formula specified below:

$$\text{Penalty/Unit} = \text{TCP} \times \left(1 - \frac{\text{ATRO}}{\text{GRO}}\right) \times 2$$

Where:

TCP = Total Contract price for one DG Set (Item 1 of the Bid Price Schedule)

ATRO= Actual Tested Rated Output of the DG Set at site corrected to ISO 3046 conditions

GRO= Guaranteed Rated Output of the DG Set at ISO 3046 conditions

2 = Penalty Constant

2. Penalty for Failure to Meet Guaranteed Fuel Rate

Aside from the Liquidated Damages and Penalty for Failure to Meet Guaranteed Rated Output, the PROCURING ENTITY shall impose a penalty in case the Supplier fails to attain the guaranteed fuel rate of the diesel gensets.

The penalty to be imposed to the Supplier for each diesel genset that failed to attain the guaranteed fuel rate shall be in accordance with the formula specified below:

$$\text{Penalty/Unit} = (\text{AFR}-\text{GFR}) \times \text{GRO} \times \text{PCF} \times 3427 \times 2$$

Where:

AFR = Actual Fuel Rate for each DG Set at site corrected to ISO 3046 conditions, li/kW-hr

GFR = Guaranteed Fuel Rate of the DG Set at ISO 3046 conditions, li/kW-hr

GRO = Guaranteed Rated Output of the DG Set at ISO 3046 conditions, kW

PCF = Prevailing cost of fuel per liter (delivered at site)

3427 = Number of operating hours for one (1) year period computed to be equal to 16 hours per day, 25 days PMS, 10% Outages and assumed 70% Utilization Factor

2 = Penalty Constant

3. Penalty for Failure to Meet Transformer Guarantees

Aside from the Liquidated Damages, Penalty for Failure to Meet Guaranteed Output and Penalty for Failure to Meet Guaranteed Fuel Rate, the PROCURING ENTITY shall also impose a penalty in case the Supplier fails to meet the transformer guarantees.

The penalty to be imposed to the Supplier shall be in accordance with Section VI - Part I, Technical Specifications (Electrical Works).

20. Settlement of Disputes

- 20.1. If any dispute or difference of any kind whatsoever shall arise between NPC and the Supplier in connection with or arising out of this Contract, the parties shall make every effort to resolve amicably such dispute or difference by mutual consultation.
- 20.2. If after thirty (30) days, the parties have failed to resolve their dispute or difference by such mutual consultation, then either NPC or the Supplier may give notice to the other party of its intention to commence arbitration, as hereinafter provided, as to the matter in dispute, and no arbitration in respect of this matter may be commenced unless such notice is given.
- 20.3. Any dispute or difference in respect of which a notice of intention to commence arbitration has been given in accordance with this Clause shall be settled by arbitration. Arbitration may be commenced prior to or after delivery of the Goods under this Contract.
- 20.4. In the case of a dispute between NPC and the Supplier, the dispute shall be resolved in accordance with Republic Act 9285 ("R.A. 9285"), otherwise known as the "Alternative Dispute Resolution Act of 2004."
- 20.5. Notwithstanding any reference to arbitration herein, the parties shall continue to perform their respective obligations under the Contract unless they otherwise agree; and NPC shall pay the Supplier any monies due the Supplier.

21. Liability of the Supplier

- 21.1. The Supplier's liability under this Contract shall be as provided by the laws of the Republic of the Philippines. For joint venture, all partners to the joint venture shall be jointly and severally liable to NPC.
- 21.2. Except in cases of criminal negligence or willful misconduct, and in the case of infringement of patent rights, if applicable, the aggregate liability of the Supplier to NPC shall not exceed the total Contract Price, provided that this limitation shall not apply to the cost of repairing or replacing defective equipment.

22. Force Majeure

- 22.1. The Supplier shall not be liable for forfeiture of its performance security, liquidated damages, or termination for default if and to the extent that the Supplier's delay in performance or other failure to perform its obligations under the Contract is the result of a *force majeure*.
- 22.2. For purposes of this Contract the terms "*force majeure*" and "fortuitous event" may be used interchangeably. In this regard, a fortuitous event or *force majeure* shall be interpreted to mean an event which the Supplier could not have foreseen, or which though foreseen, was inevitable. It shall not include ordinary unfavorable weather conditions; and any other cause the effects of which could have been avoided with the exercise of reasonable diligence by the Supplier. Such events may include, but not limited to, acts of NPC in its sovereign capacity, wars or revolutions, fires, floods, epidemics, quarantine restrictions, and freight embargoes.
- 22.3. If a *force majeure* situation arises, the Supplier shall promptly notify NPC in writing of such condition and the cause thereof. Unless otherwise directed by NPC in writing, the Supplier shall continue to perform its obligations under the Contract as far as is reasonably practical, and shall seek all reasonable alternative means for performance not prevented by the *force majeure*.

23. Termination for Default

- 23.1. NPC may rescind or terminate a contract for default, without prejudice to other courses of action and remedies available under the circumstances when, outside of *force majeure*, the Supplier fails to deliver or perform any or all of the Goods within the period(s) specified in the contract, or within any extension thereof granted by NPC pursuant to a request made by the Supplier prior to the delay, and such failure amounts to at least ten percent (10%) of the contract price.
- 23.2. NPC may terminate the contract when, as a result of *force majeure*, the Supplier is unable to deliver or perform any or all of the Goods, amounting to at least ten percent (10%) of the contract price, for a period of not less than sixty (60) calendar days after receipt of the notice from NPC stating that the circumstance of *force majeure* is deemed to have ceased.
- 23.3. NPC shall terminate the contract when the Supplier fails to perform any other obligation under the Contract.
- 23.4. In the event NPC terminates this Contract in whole or in part, for any of the reasons provided under GCC Clauses 23 to 26, NPC may procure, upon such terms and in such manner as it deems appropriate, Goods or Services similar to those undelivered, and the Supplier shall be liable to NPC for any excess costs for such similar Goods or Services. However, the Supplier shall continue performance of this Contract to the extent not terminated.
- 23.5. In case the delay in the delivery of the Goods and/or performance of the Services exceeds a time duration equivalent to ten percent (10%) of the specified contract time plus any time extension duly granted to the Supplier, NPC may terminate this Contract, forfeit the Supplier's performance security and award the same to a qualified Supplier.

24. Termination for Insolvency

NPC shall terminate this Contract if the Supplier is declared bankrupt or insolvent as determined with finality by a court of competent jurisdiction. In this event, termination will be without compensation to the Supplier, provided that such termination will not prejudice or affect any right of action or remedy which has accrued or will accrue thereafter to NPC and/or the Supplier.

25. Termination for Convenience

25.1. NPC may terminate this Contract, in whole or in part, at any time for its convenience. The HoPE may terminate a contract for the convenience of the Government if he has determined the existence of conditions that make Project Implementation economically, financially or technically impractical and/or unnecessary, such as, but not limited to, fortuitous event(s) or changes in law and national government policies.

25.2. The Goods that have been delivered and/or performed or are ready for delivery or performance within thirty (30) calendar days after the Supplier's receipt of Notice to Terminate shall be accepted by NPC at the contract terms and prices. For Goods not yet performed and/or ready for delivery, NPC may elect:

- (a) to have any portion delivered and/or performed and paid at the contract terms and prices; and/or
- (b) to cancel the remainder and pay to the Supplier an agreed amount for partially completed and/or performed goods and for materials and parts previously procured by the Supplier.

25.3. If the Supplier suffers loss in its initial performance of the terminated contract, such as purchase of raw materials for goods specially manufactured for NPC which cannot be sold in open market, it shall be allowed to recover partially from this Contract, on a *quantum meruit* basis. Before recovery may be made, the fact of loss must be established under oath by the Supplier to the satisfaction of NPC before recovery may be made.

26. Termination for Unlawful Acts

26.1. NPC may terminate this Contract in case it is determined *prima facie* that the Supplier has engaged, before or during the implementation of this Contract, in unlawful deeds and behaviors relative to contract acquisition and implementation. Unlawful acts include, but are not limited to, the following:

- (a) Corrupt, fraudulent, and coercive practices as defined in ITB Clause 3.1(a);
- (b) Drawing up or using forged documents;
- (c) Using adulterated materials, means or methods, or engaging in production contrary to rules of science or the trade; and
- (d) Any other act analogous to the foregoing.

27. Procedures for Termination of Contracts

27.1. The following provisions shall govern the procedures for termination of this Contract:

- (a) Upon receipt of a written report of acts or causes which may constitute ground(s) for termination as aforementioned, or upon its own initiative, the Implementing Unit shall, within a period of seven (7) calendar days, verify the existence of such ground(s) and cause the execution of a Verified Report, with all relevant evidence attached;
- (b) Upon recommendation by the Implementing Unit, the HoPE shall terminate this Contract only by a written notice to the Supplier conveying the termination of this Contract. The notice shall state:
 - (i) that this Contract is being terminated for any of the ground(s) afore-mentioned, and a statement of the acts that constitute the ground(s) constituting the same;
 - (ii) the extent of termination, whether in whole or in part;
 - (iii) an instruction to the Supplier to show cause as to why this Contract should not be terminated; and
 - (iv) special instructions of NPC, if any.
- (c) The Notice to Terminate shall be accompanied by a copy of the Verified Report;
- (d) Within a period of seven (7) calendar days from receipt of the Notice of Termination, the Supplier shall submit to the HoPE a verified position paper stating why this Contract should not be terminated. If the Supplier fails to show cause after the lapse of the seven (7) day period, either by inaction or by default, the HoPE shall issue an order terminating this Contract;
- (e) NPC may, at any time before receipt of the Supplier's verified position paper described in item (d) above withdraw the Notice to Terminate if it is determined that certain items or works subject of the notice had been completed, delivered, or performed before the Supplier's receipt of the notice;
- (f) Within a non-extendible period of ten (10) calendar days from receipt of the verified position paper, the HoPE shall decide whether or not to terminate this Contract. It shall serve a written notice to the Supplier of its decision and, unless otherwise provided, this Contract is deemed terminated from receipt of the Supplier of the notice of decision. The termination shall only be based on the ground(s) stated in the Notice to Terminate;
- (g) The HoPE may create a Contract Termination Review Committee (CTRC) to assist him in the discharge of this function. All decisions recommended by the CTRC shall be subject to the approval of the HoPE; and

- (h) The Supplier must serve a written notice to NPC of its intention to terminate the contract at least thirty (30) calendar days before its intended termination. The Contract is deemed terminated if it is not resumed in thirty (30) calendar days after the receipt of such notice by NPC.

28. Assignment of Rights

The Supplier shall not assign his rights or obligations under this Contract, in whole or in part, except with NPC's prior written consent.

29. Contract Amendment

Subject to applicable laws, no variation in or modification of the terms of this Contract shall be made except by written amendment signed by the parties.

30. Application

These General Conditions shall apply to the extent that they are not superseded by provisions of other parts of this Contract.

SECTION III

TECHNICAL SPECIFICATIONS

PART I – TECHNICAL SPECIFICATIONS

GW – GENERAL WORKS

PART I – TECHNICAL SPECIFICATIONS**GW – GENERAL WORKS****TABLE OF CONTENTS**

<u>CLAUSE NO.</u>	<u>TITLE</u>	<u>PAGE NO.</u>
GW-1.0	GENERAL	1
GW-1.1	Project Description.....	2
GW-1.2	Project Location.....	2
GW-1.3	Project Duration.....	2
GW-2.0	SCOPE OF WORK.....	3
GW-2.1	General.....	3
GW-2.2	Architectural Works.....	4
GW-2.3	Civil Works.....	4
GW-2.4	Mechanical Works	5
GW-2.5	Electrical Works.....	7
GW-2.6	Other Works and Services.....	7
GW-3.0	DESIGN AND DUTY CONDITIONS.....	10
GW-3.1	Site Conditions	10
GW-3.2	Earthquake and Wind Design Requirements.....	11
GW-3.3	Sound Control.....	12
GW-3.4	Emission Standards.....	12
GW-3.5	Fuel Specifications Requirement.....	12
GW-3.6	Torsional Critical Speeds.....	13
GW-3.7	Plant Operating Characteristics	13
GW-3.8	Power System Characteristics.....	15
GW-3.9	Service Life.....	15
GW-4.0	MATERIALS AND EQUIPMENT.....	15
GW-4.1	General.....	15
GW-4.2	Applicable Codes and Standards	16
GW-4.3	Test of Materials	18
GW-4.4	Tropical Serviceability.....	18
GW-4.4.1	General.....	18
GW-4.4.2	Metals	19
GW-4.4.3	Screws, Nuts, Springs, Pivots, etc.	19
GW-4.4.4	Fabrics, Cork, Paper, etc.	19
GW-4.4.5	Adhesives	19
GW-4.5	Interchangeability	19
GW-4.6	Workmanship.....	20
GW-5.0	EQUIPMENT MARKING, LABELING & MISCELLANEOUS REQUIREMENTS.....	20
GW-5.1	Nameplates	20

GW-5.2	Labels	21
GW-5.3	Tag Numbers/Standard Plant Identification Number (SPIN).....	21
GW-5.4	Erection Marks.....	21
GW-5.5	Locks	22
GW-5.6	Guards.....	22
GW-5.7	Lifting Lugs	22
GW-6.0	DRAWINGS AND INSTRUCTION MANUALS.....	22
GW-6.1	Drawings Contained in the Tender Document.....	22
GW-6.2	Drawings and Documents to be submitted with the Bid.....	23
GW-6.3	Supplier's/Manufacturer's Drawings and Instruction Manuals	23
GW-6.3.1	General	23
GW-6.3.2	Bar Chart	25
GW-6.3.3	General and Detailed Drawings and Specifications for Electro-Mechanical Equipment	25
GW-6.3.4	General and Detailed Design Drawings for Civil Works ...	26
GW-6.3.5	Working Plan	26
GW-6.3.6	Progress Report.....	26
GW-6.3.7	Instruction Manuals.....	26
GW-6.3.8	As-Built Drawings.....	29
GW-6.3.9	Documents for NPC's Records	29
GW-6.4	Processing of Drawings/Documents.....	29
GW-7.0	DISMANTLING AND HAULING REQUIREMENTS (NOT APPLICABLE)	30
GW-8.0	INSTALLATION REQUIREMENTS.....	30
GW-8.1	General.....	30
GW-8.2	Inspection at Site	30
GW-8.3	Installation Requirements	31
GW-8.4	Nameboards and Advertisements	32
GW-8.5	Signs.....	33
GW-8.5.1	General	33
GW-8.5.2	Traffic Signs.....	33
GW-8.5.3	Signs for Emergencies.....	33
GW-8.5.4	Warning Signs.....	33
GW-8.5.5	Prohibition Signs	34
GW-9.0	INSPECTION AND TESTS	34
GW-9.1	General.....	34
GW-9.2	Tests at Supplier's Premises	35
GW-9.2.1	Inspection at Supplier's Premises.....	35
GW-9.2.2	Factory Acceptance Tests (FAT)	36
GW-9.3	Pre-Commissioning/Commissioning Test.....	38
GW-9.3.1	General	38
GW-9.3.2	Pre-Commissioning Test.....	39
GW-9.3.3	Commissioning Test	39
GW-9.4	Performance Tests	40

GW-9.4.1 Diesel Generating (DG) Set.....	41
GW-9.4.2 Auxiliaries and Associated Electrical Equipment	42
GW-9.5 Reliability Test (8 hours).....	42
GW-9.6 Tests Failures	43
GW-9.7 Test Reports/Certificates	43
GW-9.8 Waiver of Factory Tests Witnessing/Inspection by NPC for Equipment to be Furnished by the Supplier.....	44
GW-10.0 TRAINING OF NPC PERSONNEL.....	44
GW-10.1 General.....	44
GW-10.2 Operation and Maintenance Training at Site	45
GW-11.0 CORROSION PROTECTION AND PAINTING	46
GW-11.1 General.....	46
GW-11.2 Treatment for Shipping	46
GW-11.3 Application of Paint.....	47
GW-11.4 Hot Dip Galvanizing	48
GW-12.0 SPARE PARTS AND TOOLS	48
GW-12.1 Spare Parts.....	49
GW-12.2 Tools and Appliances	49
GW-13.0 PACKING, SHIPMENT AND STORAGE	50
GW-13.1 Packing/Crating	50
GW-13.2 Shipment/Transport.....	52
GW-13.3 Storage.....	53
GW-14.0 CLEAN UP	54
GW-15.0 CERTIFICATE OF COMPLETION AND ACCEPTANCE.....	54
GW-16.0 GUARANTEE.....	54
GW-17.0 MEASUREMENT OF PAYMENT	56

PART I – TECHNICAL SPECIFICATIONS

GW - GENERAL WORKS

GW-1.0 GENERAL

This section covers the general technical requirements for furnishing all labor, materials, supplies, tools and equipment in accordance with specifications contained herein and as shown on the accompanying drawings for the **Supply, Delivery, Installation, Test, and Commissioning of 2 x 150 kW Modular Diesel Generating Sets, Associated Electrical Equipment & Balance of Plant for the Electrification of New Area in Jintotolo Is., Balud, Masbate.**

All materials, equipment, devices and accessories to be supplied under this contract shall be new and unused, free from defects and imperfections and best suited for the purpose intended.

All equipment shall essentially be the standard products of the Manufacturer which best meets the conditions of sound engineering economy of manufacture and procurement of any necessary spare parts.

It is not the intent to specify completely herein all details of design and construction of the Works. However, the Works shall conform in all respects to high standards of engineering, design and workmanship, and shall be capable of performing its continuous commercial operation up to the Supplier's guarantees in a manner acceptable to NPC, who shall be entitled to reject any work or material which in his judgment is not in full accordance therewith.

The Supplier shall be fully responsible for its work in the design, manufacturing, assembly, documentation, reports, corrosion protection, shop testing, preparation for shipment, field testing and commissioning, warranty provisions and compliance with the applicable codes and standards and the requirements of this specification.

All necessary corrections and deviations from the specification of the equipment arising either from error in the workmanship or design made by the Supplier/Manufacturer with the resulting extra expenses and related damages shall be solely charged to the account of the Supplier.

The Supplier shall strictly observe the general requirements of this specification (General Works) in conjunction with the specific requirements described in the relevant specific technical specifications (Mechanical, Electrical and Civil Works). The specific technical specifications shall take precedence over the general requirements (General Works) in case of any inconsistency.

GW-1.1 Project Description

The Project calls for site development as required for the supply, delivery, installation/erection, test and commissioning of 2 x 150 kW DG sets and auxiliaries including its associated electrical equipment.

Each DG Set shall be designed for Prime Duty operation as defined in ISO 8528, capable of delivering the required Guaranteed Prime Rated Power of not less than 2 x 150 kW measured and/or adjusted to the Reference Site Conditions in Clause MW-4.1 of the Mechanical Works specifications.

Each DG Set's engine shall be designed to burn on diesel fuel oil with characteristics as specified in the relevant section of this specification.

Each DG Set shall be fully enclosed in a sound attenuated and weatherproof enclosure designed to provide a sound pressure level of not more than 85 dBA at 1-meter distance measured at any point of the unit.

Each DG Set shall be provided with separate Generator Control and Protection Panel to be installed in the existing control room.

The new DG Sets and associated electrical equipment shall be installed in the area as shown on the drawings. The new DG sets shall be designed to operate in parallel with other generating sets (future) of different make and capacity.

GW-1.2 Project Location

The project which consists of two (2) DG sets and associated electrical equipment shall be located in new plant site in Jintotolo Is., Masbate.

Table 1.2 below shows the existing mode of transport from port of Manila to the plant site/location, subject to verification by the Supplier.

TABLE 1.2

EXISTING MODE OF TRANSPORT FROM MANILA				
PLANT SITE	1	2	3	4
Jintotolo Is. Balud, Masbate	L – Pilar Port, Sorsogon	S – Masbate City Port	L – Calumpang Port	S – Jintotolo Is.

GW-1.3 Project Duration

The Supplier shall complete the works as specified within **Three Hundred (300) Calendar Days** which shall become effective from receipt of the Notice to Proceed. The total contract period is inclusive of twenty (20) rainy/unworkable days, considered unfavorable for the execution of works at each site.

GW-2.0 SCOPE OF WORK**GW-2.1 General**

It is not the intent of this specification to specify all technical requirements or to set forth those requirements covered by applicable codes and standards. The Supplier shall furnish high quality work, materials and equipment meeting the requirements of this specification and industry standards and shall be capable of performing and meeting the Supplier's guarantees in a manner acceptable to NPC, who shall be entitled to reject any work or material which in his judgment is not in full accordance therewith.

The Supplier/Manufacturer shall have an established local service center (owned or accredited in the Philippines) with experienced technical personnel that will promptly and efficiently cater to the repair and maintenance requirements of the supplied unit/s during the warranty period.

The Supplier shall be responsible for visiting the project site and thoroughly investigate and familiarize himself with all the conditions at site, the surrounding area and take particular reference to its accessibility, means of communication and transportation, determine possible sources of materials and equipment to be supplied/utilized during the project execution, verify the actual scope of works and relative costs, and all other factors that could hamper the smooth execution of the contract.

The Supplier shall also be responsible to assess and determine all and every work and service although not specifically detailed but are deemed required to fully complete the work and placing ready for the safe and reliable operation of the DG sets and associated electrical equipment. Relative costs of any additional works or materials which the Supplier deemed required or necessary to complete the works shall be included in the bid proposal.

Any and/or all expenses arising through the lack of knowledge or understanding regarding the existing conditions of each site shall be the responsibility of the Supplier and no additional payment thereof shall be made by NPC.

Any discrepancies of the scope of work specified in this section with those specified in the relevant specific technical specifications (Mechanical, Electrical and Civil Works), the specific technical specifications shall govern. However, anything mentioned in the specific technical specifications and not shown on the drawings, or shown in the drawings but not mentioned in the specifications but which are obviously necessary to make a complete installation shall be considered under the Supplier's Scope of Works.

The Supplier's scope of work under this Project shall generally consist of the following:

- a) Design, manufacture, factory test, deliver, installation of electro-mechanical equipment, associated auxiliaries and electrical equipment;

- b) Delivery of labor and supervision, materials and supplies, tools and equipment for the construction of civil works including detailed design of associated civil/structural works for all equipment to be supplied by the Supplier and as specified herein;
- c) Inspection, test and commissioning of equipment and machinery to ascertain that they are functioning in accordance with the contract provisions and guarantees.
- d) Training of NPC personnel covering electrical, mechanical, instrumentation and control systems, troubleshooting including the supply of manufacturer's software needed in programming the DG Sets control setting and electro/digital governing system including other digital components that require exclusive programs from the Manufacturer with free update throughout the operating life of the DG sets.

The Supplier also provide all other related works not specifically mentioned in the Specifications but are necessary to complete the Works so as to be ready for commercial operation in accordance with the intent of the Contract. It is understood that all costs pertinent thereto are included in the Schedule of Requirements.

The scope of works shall consist of the design, furnishing/supply, delivery, installation, test and commissioning of DG Sets and auxiliaries, electrical equipment and associated civil works, but not limited to the following:

GW-2.2 Architectural Works

- a) Furnishing and Installation of containerized/pre-fabricated control room and bunkhouse/storage room (collapsible type);
- b) Furnishing and installation of guard post wall finishes, floor finishes, roofing and building blankets, painting and ceiling;
- c) Furnishing and installation of hazardous waste & solid waste storage area wall finishes, floor finishes, roofing and building blankets and fenestation;
- d) Furnishing and installation of pumphouse wall finishes, floor finishes, painting and fenestation;
- e) All other works and services required to complete the project.

GW-2.3 Civil Works

- a) Mobilization, demobilization, clean-up, provision of temporary office & housing and storage, and all miscellaneous works required for the implementation of the project;
- b) Site development and grading to required elevations of designated areas/equipment location for modular generating sets and transformers in accordance with the details shown on the drawings;

- c) Design and construction of new reinforced concrete foundations for modular gensets and transformers, including anchor bolts/machine bolts to ensure proper anchoring and installation. Design calculations and detailed drawings shall be submitted for NPC's review and approval prior to construction;
- d) Construction of concrete foundations for containerized/pre-fabricated control room and bunkhouse/storage room (collapsible type);
- e) Structural excavation and backfill for foundations of modular diesel generating set/s and its auxiliaries, transformers, fuel oil day tanks and its structural supports, elevated water tank and its structural supports and for all miscellaneous Balance-of-Plant (BOP) structures required;
- f) Concreting works, including fabrication (cutting/bending) and installation of reinforcement, for foundations of modular diesel generating set/s and its auxiliaries, transformers, fuel oil day tanks and its structural supports, elevated water tank and its structural supports, and for all miscellaneous Balance-of-Plant (BOP) structures required;
- g) Furnishing and installation of drainage systems and appurtenant structures;
- h) Fabrication and erection/installation of structural steel supports for elevated water storage tank and fuel oil day tanks;
- i) Complete construction of oil-water separator, drain pit and septic tank;
- j) Complete construction (erection/installation) of flag pole, perimeter light foundation, perimeter fence, seclusion fence, concrete walk, zocalo wall, entrance gate, guard post, pump house, hazardous waste and solid waste storage;
- k) Complete construction of F.O.S.T. containment wall, foundation and other appurtenant drainage s
- l) Laying of gravel at the switchyard area and genset area;
- m) Supply and erection of steel poles complete with appropriate steel cross arms, braces and structure dressing as specified and/or as shown on the bid drawings; and
- n) All other works and services required to complete the project.

GW-2.4 Mechanical Works

The scope of work shall cover the supply, delivery, installation, test and commissioning of the diesel generating sets and its auxiliaries including balance-of-plant, but not limited to the following:

- a) Two (2) x 150 kW (Guaranteed Prime Power Output) Modular DG Sets, 1800 rpm maximum, In-line multi-cylinder arrangement, 480 V, 3-phase, 60 Hz, each equipped with turbocharger and air-to-air charge

air cooler, electronic governor, direct injection, sound attenuated and weatherproof enclosure and complete with auxiliary equipment, engine mounted selective control/monitoring and protection panel, battery system with charger, including anchor/foundation bolts and other devices/accessories as described in the relevant technical specifications.

- b) One (1) unit of Diesel Oil Storage Tank, 10 m³ nominal capacity, cylindrical and vertical, complete with level indicator, vertical ladder, handrailings, manhole, tank nozzles, associated valves, fuel oil sounding tape and painting works including tank calibration, weld inspection, testing (liquid penetrant) and accessories;
- c) One (1) set of fuel oil unloading/transfer pump, 10 m³/hr capacity, 30m head, gear type, complete with local control box, isolation & check valves, pressure gauges at pump inlet and outlet, strainers, flowmeter, spare parts, anchor/foundation bolts to ensure proper anchoring to its concrete foundation;
- d) Two (2) sets of 900L elevated fuel day tank, complete with accessories, associated structural supports, isolation valves, instruments and other accessories as shown on the bid drawings. The fuel day tank shall be provided with high and low level alarm contacts for annunciation in the generator control and protection panel;
- e) One (1) lot Fuel Oil Piping System complete with valves, strainers, pipe and fittings, gaskets, flanges, bolts and nuts, pipe supports and other required accessories to complete the piping systems for the fuel oil unloading, transfer of fuel oil from storage tank to day tanks, day tanks to and from diesel gensets, fuel oil storage tank's overflow and drain to oil water separator, waste water/oil from tank farm and DG set area's drain pit to oil water separator including necessary excavation, backfilling and asphalt jute application to embedded pipes;
- f) One (1) lot of Well Drilling Works consisting of casing installation, well development, pumping test and disinfection;
- g) One (1) set of Elevated Water Storage Tank (polyethylene), 600 liters capacity complete with accessories and jetmatic hand pump;
- h) One (1) lot of Domestic Water Supply Piping System, including valves, pipe, fittings, pipe supports, excavation and backfilling of embedded pipes and other pipe accessories including disinfection of the system;
- i) Two (2) units of Inverter/Window type Air Conditioner, 16,000 kJ/h & 8,500 kJ/h, minimum cooling capacity for control house and bunkhouse, and two (2) units of Wall mounted Exhaust Fan for toilets, 100 m³/h minimum capacity, propeller type, direct motor driven, 220V, 60 hz, 1-phase power supply for all air conditioning and ventilation units, all complete with mounting accessories and controls;

- j) Three (3) sets of Portable Type Fire Extinguishers, Clean Agent (HCFC or Halotron I Type), 7.1 kg. (15.5 lbs), non-expiry, multi shots, wall-hung type and shall be in certified/ approved by the certifying body specified in Section VI, Part I, MW-7.0;
- k) One (1) unit of Foam (AFFF/F3) wheeled type fire extinguisher complete with self-contained cylinder mounted on a frame with handle, floorstand and steel wheels, 125 L min. (33 gallons) capacity complete with associated valves, dial gauge indicator, nitrogen expellant tank for unit pressurization, appropriate size of discharge hose of 15 m long fitted with couplings and foam nozzle assembly and shall be in certified/ approved by the certifying body specified in Section VI, Part I, MW-7.0;
- l) One (1) lot of various Miscellaneous Equipment and Materials;
- m) Hydrostatic testing of field-installed piping systems under the presence of NPC;
- n) One (1) lot of Painting Materials to be applied to all equipment, pipes, steel structures, tanks, pipe supports and other incidentals; and
- o) All other works and services including those not specifically detailed herein but are required to fully complete the project.

GW-2.5 Electrical Works

- a) Supply, Installation and Test of 2 x 150 kW, 480V, 3-phase, 60Hz AC Generator and associated auxiliary electrical equipment including grounding materials;
- b) Supply, Installation and Test of Generator Control and Protection Panel (GCPP) for 2 x 150 kW D/G sets equipped with monitoring, metering, control, protection and synchronizing equipment/devices;
- c) Supply of One (1) Spare each of Circuit Breaker, GCPP Module/ Controller, Automatic Voltage Regulator (AVR), and Rotating Diodes for 150 kW D/G Set;
- d) Supply, Installation and Test of 2 x 225kVA, 480V/13.8kV, 3-Phase, 60Hz Generator Transformer;
- e) Supply, Installation and Test of 20kVA, 7.97kV/240V, 1-Phase, 60 Hz Station Service Transformer;
- f) Supply, Installation and Test of 800A, 60 Hz, 15kV, 12kA, Automatic Circuit Recloser;
- g) Supply, Installation and Test of 15 kV Fuse Disconnect Switches with Lightning Arrester Combination;
- h) Supply, Installation and Test of Kilowatt-hour Demand Meter and associated Instrument Transformers and Accessories;
- i) Supply, Installation and Test of Bus Conductor and Line Materials and Hardware;

- j) Supply, Laying and Test of Power, Control and Instrumentation Cables including ground conductors and other appurtenances required for the interfacing of supplied equipment;
- k) Supply, Installation and Test of Grounding System;
- l) Supply, Installation and Test of Lightning Protection System;
- m) Supply, Installation and Test of Lighting & Power System and its Accessories;
- n) Supply, Installation and Test of Fuel Pump Motor Power Supply including necessary control, monitoring and protective devices;
- o) Supply and Installation of Conduit System;
- p) Supply and Delivery of Special Tools;
- q) Supply, Delivery and Test of two (2) sets of Job Site Cameras to be installed before the start of construction and/or installation of equipment; and
- r) All other works and services including those not specifically detailed herein but are required to fully complete the project.

GW-2.6 Other Works and Services

- a) Supply and delivery of Spare Parts required during the warranty period including labor and travel time necessary for repair works (consumables are by supply and delivery only). The supply shall include spare parts specified in the Technical Specification and Technical Data Sheets and those to be consumed and/or replacement parts required during the test and commissioning and the duration of the warranty period.
- b) Supply and delivery of Special Tools and Appliances as specified in the specification or technical data sheets and as recommended by the manufacturer including tool box required for start-up, test and commissioning, operation and normal maintenance. It shall include one (1) set of laptop Portable Computer needed in programming the genset control setting complete with licensed software of genset control system and electronic/digital governing system including other digital components that require exclusive programs from the Manufacturer and/or Supplier with free update throughout the operating life of the genset;
- c) Provision of fuel oil, lubricating oil, lubricants, chemicals, coolant and other consumables required during initial filling, start-up, test and commissioning.

Cost of fuel consumed during the start-up, pre-testing/pre-commissioning and re-test of the performance test shall be borne by the Supplier. Fuel used/consumed during the performance and reliability tests (where generated loads are already exported to the grid/consumers) shall be supplied by NPC;

- d) Furnish measuring and testing instruments, tools and devices to be used during the test and commissioning;
- e) Conduct actual inspection at the project site and make assessment on the physical conditions of any existing equipment and facilities, if applicable, to be affected by the works (such as cable trench and associated cables and trays including terminal points, interconnection points for fuel supply and cooling water supply lines), determine possible sources of materials and equipment to be supplied/utilized during project execution, and verify the extent of the scope of works required for the proper installation and reliable operation of the generating sets and associated equipment.

NPC-SPUG plant personnel shall extend any assistance that the Supplier may require during his inspection/assessment (such as dimensional measurement, megger and wiring continuity test, etc.) at the site including existing facilities, as applicable;

- f) Conduct training of all NPC plant operators at the site who will be assigned to operate and maintain the diesel generating sets regarding proper operation, preventive maintenance and troubleshooting including proper maintenance during standby condition.

The training program shall be conducted by expert/s who are knowledgeable and well trained by the genset manufacturer or his authorized distributor;

- g) Provide the services of competent engineer/s and/or technical staff/s from the equipment Manufacturer/Supplier or his authorized local representative to be assigned at the plant to conduct relative activities during the period of test and commissioning.

The services shall include plant visits of not less than two (2) days in two (2) separate visits which will coincide on the first two (2) scheduled periods of preventive maintenance (every 250 hours or per manufacturer's recommended hours) of at least one generating set during the warranty period to perform the services as described in the relevant clause of this specification. This shall include any maintenance/repair services rendered upon request of NPC in the event of any abnormality occurs within the warranty period. The costs of said services shall be included in the bid price proposal;

- h) Conduct test and commissioning of the diesel generating sets including balance of plant in accordance with the approved test procedure submitted by the Supplier. It shall include compiling, recording and submitting test reports to NPC.

The Supplier may request NPC to provide operations and maintenance personnel to assist the Supplier during the conduct of the test and commissioning.

The Supplier shall provide highly qualified and experience technical personnel/engineers during the test and commissioning

- i) Submit five (5) sets of drawings and documents for NPC's approval prior to procurement of materials and equipment such as dimensioned assembly drawings of generating sets and its auxiliary equipment, sound attenuated and weatherproof enclosure, schematics and wiring diagrams, control and protection panels, transformers, interconnecting diagrams identified by terminal numbers and equipment foundation details. Submittal shall include seven (7) sets of approved operation and maintenance manual to be submitted prior to test and commissioning. Plant site with generating sets of different model/ratings shall be supplied with respective seven (7) sets of O & M Manuals. O & M manuals shall include Part List and Preventive Maintenance Schedule during the operating life of the generating sets and other information specified in the relevant sections of this specification.
- j) Corrosion protection and painting;
- k) Provide Labels or Standard Plant Identification Number (SPIN) for all equipment, valves, piping and instruments supplied;
- l) Clean up of work areas after the completion of works covered by the contract; and
- m) Other works and services as specified in the relevant specifications including those that are not specifically detailed herein but are required to fully complete and placing ready for the safe and reliable operation of the Diesel Generating sets.

GW-3.0 DESIGN AND DUTY CONDITIONS

GW-3.1 Site Conditions

The Supplier shall be responsible for visiting the plant site and thoroughly investigate and familiarize himself with all the conditions at each site, the surrounding area and take particular reference to its accessibility, means of communication and transportation, and all other factors that could hamper the smooth execution of the contract.

Any and/or all expenses arising through the lack of knowledge or understanding regarding the existing conditions of the site shall be the responsibility of the Supplier and no additional payment thereof shall be made by NPC.

The conditions stated below shall be taken into consideration in the design, manufacture and selection of the equipment and materials to be supplied by the Supplier, unless otherwise specifically indicated in the relevant technical specifications.

Elevation above sea level	: 0 to 500 M
Ambient temperature	: up to 45°C
Barometric pressure	: 0.974 - 1.03 kg/cm ² abs
% Relative humidity	: up to 85 %
Design for seismic loads	: Seismic zone factor 0.4
Max. wind velocity	: 250 km/hr and/or as specified in the latest edition of National Structural Code of the Philippines

There are two (2) pronounced seasons in the province, the dry and wet season. The wettest months are from July to November. The other months of the year are generally dry with occasional rain showers.

The prevailing atmospheric condition is generally warm, humid, and salt laden.

GW-3.2 Earthquake and Wind Design Requirements

Plant and equipment may be subjected to both horizontal and vertical seismic induced accelerations of 0.40 g. or more depending on:

- a) Natural period and mode of vibration
- b) Damping (inherent or specifically provided)
- c) Manner of failure (ductile or brittle)
- d) Location (at ground level or at a higher level)

The plant and equipment required under this contract shall meet the seismic design requirement for earthquake conditions to conform with the latest edition of National Structural Code of the Philippines.

It is evident from the design response spectra that the degree of response varies markedly with the period of vibration. It is essential, therefore, that any equipment, or its supporting structure which has modes of vibration or components with modes of vibration with a natural period longer than 0.1 second be identified.

Provision shall be made for seismic movement by providing seismic movement joints between components which are interconnected and may have different vibratory characteristics. These joints shall be capable of withstanding the sum of the maximum deflection of each component resulting from a design earthquake.

The plant and equipment under this contract shall meet the requirements for a wind velocity of not less than 250 km/hr gust and/or as specified in the latest edition of National Structural Code of the Philippines.

GW-3.3 Sound Control

The Supplier shall ensure that the sound level of equipment covered by this specification, including those equipment and tools to be used during the performance of his works, are within the permissible limits for personnel as defined in DOLE's Occupational Safety & Health Standards for Noise and contractual requirements for overall plant noise levels.

The sound pressure level for the modular DG set and auxiliary equipment shall not exceed 85 dBA measured at 1 meter distance from any point around the unit's enclosure or source. Sound pressure levels shall be indicated in the Suppliers proposal for review and evaluation by NPC.

If the Supplier expects the maximum sound level of the equipment to exceed the specified level at a distance of 1 meter, the Supplier shall use acoustical treatment features, subject to NPC's review and acceptance, to achieve the sound control design objectives.

GW-3.4 Emission Standards

The DG sets shall also comply with the Emission Standards of the Philippine Clean Air Act, including but not limited to the following:

Pollutant	Max. Permissible Limit (mg/Ncm)	Method of Sampling	Method of Analysis
NOx	2000 as NO ₂	USEPA Methods 1 thru 4 & Method 7	Phenol-disulfonic Acid Method or as per sampling method
SOx	700 as SO ₂	USEPA Methods 1 thru 4 & Method 6 or 8 as appropriate	As per sampling method
CO	500 as CO	USEPA Method 3 or 10	Orsat Analysis or NDIR
Particulates	200	USEPA Methods 1 through 5	Gravimetric per sampling method

GW-3.5 Fuel Specifications Requirement

The basic specification for the diesel fuel oil to be used by the diesel engine unit will be as follows:

Property	Unit	ASTM Method	Min.	Max.
1. Density @ 15 C	kg/L	D-1289	0.82	0.88
2. Kinematic Viscosity @ 40 °C	cSt	D-445	1.7	5.5
3. Flash point	°C (°F)	D-93	55(131)	

4. Pour Point	°C (°F)	D-97		10 (50)
5. Cloud Point	°C (°F)	D-2500		16 (60.8)
6. Ash	% wt.	D-482		0.01
7. Sulfur	% wt.	D-4294/D-129		0.3
8. Water & Sediment	% vol.	D-2709		0.1
9. Water Content (by distillation)	% vol.	D-95		0.1
10. Calorific Value				
HHV	BTU/lb	D-240/D4868	19,600	
LHV	BTU/lb	D-4809	18,400	
11. Others				
a) Distillation Temperature 90% Recovery	°C	D-86		370
b) Carbon Residue, 10% Bottoms	% wt.	D-4530-85		0.35
c) Cetane Index		D-976	45	
d) ASTM Colour		D-1500		5.0
e) Sediment (by extraction)	% wt.	D-473		0.01
f) Copper strip corrosion, 3 h at 50 °C		ASTM D-130		No. 1
g) FAME content	% vol.	PNS EN 14078 modified	1.7	
h) Methyl laurate (C12 ME)	% wt.	PNS EN 14331 modified	0.8	
i) Free Water	% vol.			1.0

Although this is the base specification that will be used for Performance Test, NPC prefers that the engine be able to run on a wide range of fuels.

GW-3.6 Torsional Critical Speeds

The Supplier shall ensure that the torsional vibration conditions of the units under dynamic conditions are satisfactory. Calculations shall be produced, if called for, showing the torsional vibrational stresses in the engine crankshaft, generator and exciter shafts resulting from torsional critical speeds.

GW-3.7 Plant Operating Characteristics

DG Sets shall be capable of providing the specified **prime power output** as defined in ISO 8528, under the most adverse ambient condition as specified in the technical specifications.

Speed and voltage control systems shall be designed to maintain the frequency and voltage within acceptable limits for the following loading conditions:

- a) Under steady state (i.e., slowly changing) conditions, the frequency and voltage shall be maintained within one half percent of rated or set value, respectively.
- b) At no time during any loading sequence shall the voltage fall below 85 percent of rated value and the frequency fall below 95 percent of rated value.
- c) Rejection of the total short time capability load shall not cause an overspeed trip nor shall rejection of the largest single load, when the unit is carrying the maximum load, cause a speed rise in excess of 15% of rated speed.

The governor and excitation control systems shall be designed to permit the operation of the unit either isolated or in parallel with the system specified herein, without exceeding the active and reactive power limitations of the engine and generator.

DG Sets shall be designed for remote start-up and speed control including automatic and manual control. It shall be equipped with all necessary instrumentation to provide adequate monitoring and control of the unit under all operating conditions including "standby".

The start-up operation of the unit shall generally be performed remotely from the generator control and protection panel (to be installed in the control room) with provision of selective manual operation of the diesel generator set and applicable auxiliary equipment from the local control panel mounted/installed (per manufacturer's standard) on the DG Set skid.

DG Set shall be capable of operation at fraction of its rated speed and at no load for reasonable periods of time as recommended by the Manufacturer. If the speed at which idle operation is permissible is lower than the rated speed, the Supplier shall state both the idle speed and the minimum load required at rated speed for satisfactory operation of the unit.

During the above condition, engine and generator design, i.e. overspeed, over & under frequency capability & relay setting, must be fully coordinated and made compatible with the generator excitation limits to ensure that the generator does not suffer damage due to over excitation, continuous field flashing and other frequency related events.

DG Set shall be capable of starting from the "cold" condition, and of operating for specified time (to be specified by the Supplier) under load, without AC power available for motor-driven auxiliaries, if applicable.

Vibration and over-speed requirements shall be met by the DG Set as follows:

- a) Harmful vibration stresses shall not occur during acceleration, deceleration and at rated speed.

- b) Harmful torsional vibration stresses shall not occur within a range from 10 percent below rated idle speed and from 5 percent above to 5 percent below rated synchronous speed.
- c) Moving parts shall be designed to withstand, without damage, the level of overspeed that is caused by the following:
 - c.1 Full short-time load rejection; plus
 - c.2 Margin to allow the overspeed device to be set sufficiently high to guarantee that the unit will not trip on full short time load rejection.

As minimum, the generator, exciter and flywheel shall be designed to withstand an overspeed of 25 percent of the rated speed without damage.

GW-3.8 Power System Characteristics

The DG Set to be supplied shall be capable of parallel operation both at regulation and base load with the DG sets of different make/manufacturers and rating/s or to the power system.

The power system with which parallel operation may be required shall have the following characteristics:

- a) Voltage variation: $\pm 5\%$ Nominal Voltage: 480 volts, 3 phase
- b) Frequency variation: $\pm 5\%$ Nominal Frequency: 60 Hz

GW-3.9 Service Life

The DG Sets and its auxiliary equipment shall be designed based on a minimum service life of ten (10) years or 61,000 running hours. Components for which ten (10) years life expectancy cannot reasonably be assured shall be designed and installed to permit safe and convenient replacement.

GW-4.0 MATERIALS AND EQUIPMENT

GW-4.1 General

All materials, equipment, devices and accessories to be supplied under this contract shall be new and unused, free from defects and imperfections and best suited for the purpose intended. Materials used in the manufacture and installation of all equipment to be furnished shall be of the required quality used in commercial products of reputable manufacturers.

All materials shall comply with the latest revisions or editions, of the specified standards for each material specification unless otherwise specified or permitted by NPC. The materials selected shall be appropriately matched to other items complying with all applicable regulations, quality and dimension standards. All materials or components used shall be tested in conformance with the applicable specifications and purchased with certified mechanical and chemical properties.

The names of manufacturers of equipment and articles contemplated for incorporation in the work together with performance capacities and other significant information pertaining to the equipment shall be furnished for approval. Equipment or articles supplied or used without such approval shall be at the Supplier's risk of subsequent rejections.

The equipment and materials to be furnished under this specification shall be essentially the current standard products of the respective manufacturer regularly engaged in the production of such equipment and materials. It shall be designed and manufactured for maximum safety and reliability in accordance with quality specifications.

Original brochures, catalogues and other related technical data sheets of materials and equipment to be supplied by the Supplier under this contract, in binder with cover, shall be submitted with the bid by the Supplier and/or for NPC's review and approval prior to fabrication.

Certified mill test reports as required in the relevant sections of this specification and the governing codes and standards shall be furnished by the Supplier for NPC's record. Copies of each mill test report shall be submitted to NPC prior to fabrication of materials covered.

The relative experience of the Manufacturer in the business of manufacturing the equipment and materials shall not be less than the number of years specified in the relevant specifications. Experience less than what is required will be ground for rejection.

GW-4.2 Applicable Codes and Standards

All equipment and materials to be furnished shall be in accordance with, but not limited to, the latest codes and standards issued by the following authorities:

ABS	American Bureau of Shipping
ANSI	American National Standard Institute
ASME	American Society of Mechanical Engineers
ASTM	American Society for Testing and Materials
AWS	American Welding Society
BSI	British Standards Institute
CE	European Commission
CSA	Canadian Standard Association
DEMA	Diesel Engine Manufacturer's Association
DIN	Deutsches Institut für Normung
FM	Factory Mutual Engineering
HIS	Hydraulic Institute Standards
IBC	International Building Code
ICS	General Standards for Industrial Control and Systems

	MG-1	Motors and Generators
	MG-2	Safety Standard for Construction & Guide for Selection, Installation and Use of Electric Motors and Generators
IEC	International	Electrotechnical Commission
	60044	Instrument Transformer
	60071	Insulation Coordination
	60060	High Voltage Test Technique
IEEE	Integrated Institute of Electrical Engineers	
ISO	International Organization for Standardization	
	9001	Quality Management System
JEC	Japanese Electrotechnical Committee	
JEM	Japan Electrical Manufacturer's Association	
JIS	Japanese Industrial Standard	
LR	Lloyd's Register	
NEC	National Electrical Code	
NEMA	National Electrical Manufacturer's Association	
	MG 1	Standard for Motors and Generators
	WC-5	Thermoplastic-Insulated Wire and Cable for the Transmission and Distribution of Electrical Energy
	ICS2	Industrial Controls and Systems: Controllers, Contactors and Overload Relays rated 600 Volts
NESC	National Electrical Safety Code	
NFPA	National Fire Protection Association	
	272	Standard Method of Test for Fire and Smoke Characteristics of Wires and Cables
NKK	Nippon Kaiji Kyokai	
OHSAS	Occupational Health and Safety Assessment Series	
PEC	Philippine Electrical Code	
SSPC	Steel Structures Painting Council	
TEMA	Standards for the Tubular Exchanger Manufacturers Association	
UL	Underwriter's Laboratories	
	44	Rubber-Insulated Wires and Cables
	508A	Industrial Control Equipment
	2200	Standard for Stationary Engine Generator Assemblies

DG Set Model should be certified by any of the following internationally recognized certifying body/organization: CSA, UL, JIS, CE, LR, GL, NKK and ABS. Accordingly, supporting documents shall be submitted by the Bidder during the contract implementation.

In addition to the above codes and standards, the Supplier shall comply with all applicable national and local laws, codes, regulations, statutes, and ordinances.

Other internationally recognized national standards may be accepted, such will guarantee a quality not inferior to that guaranteed by the above standards. The list of these alternative standards which the Bidder proposes to adopt must be attached to his Bid for acceptance. In every case, Bidders must list fully the standards they will conform to for this Contract.

In case of conflicting requirements between authorities cited above or between authorities cited and those specified, such disagreement shall be resolved by NPC and its decision shall be final. The responsibility shall be on the Bidder to show the suitability of any alternative standard he may wish to use.

All units, dimensions and calculations shall be in metric system.

GW-4.3 Test of Materials

All materials, parts and assemblies to be used shall be tested conforming to the latest specifications and provisions of approved Standards of Testing Materials. Results of the test shall be made to provide means of determining compliance with the applicable specifications. When requested, all test or trials shall be made in the presence of NPC or his duly authorized representative.

All units, dimensions and calculations used for the project under this contract shall be in metric.

GW-4.4 Tropical Serviceability

GW-4.4.1 General

In choosing materials and their finishes, due regard shall be given to the humid tropical conditions under which the equipment is to work. Cubicles used for switchgear and control cabinets in outdoor plant shall be vermin-proof and fungus-proof. Some relaxation of the following provisions may be permitted where equipment is hermetically sealed but it is preferred that tropical grade materials should be used wherever possible.

Totally enclosed motors and enclosures containing electrical control and switching equipment and instrument for outdoor installations shall be equipped with temperature controlled electrical heaters. The construction of the enclosures and installation of heaters shall be as to ensure effective circulation of air while ensuring that no damage to equipment occurs due to overheating.

GW-4.4.2 Metals

Iron and steel are in general to be galvanized or painted, as appropriate. Small iron and steel plate (other than SUS 316 stainless steel) of all instruments and electrical equipment, the cores of electromagnets and the metal parts or relays and mechanisms are to be treated in an approved manner to prevent rusting. Cores or other components which are laminated, or which cannot be rust-proofed, shall have all the expected parts thoroughly cleaned and heavily enameled, lacquered or compounded.

GW-4.4.3 Screws, Nuts, Springs, Pivots, etc.

The use of iron and steel is to be avoided in instruments and electrical relays wherever possible. Steel screws, when used, are to be zinc, cadmium or chromium plated or, when plating is not possible owing to tolerance limitations, are to be of corrosion-resistant steel. All wood screws are to be of dull nickel-plated brass or of other approved finish.

Instrument screws (except those forming part of a magnetic circuit) shall be stainless steel or cadmium plated steel. Springs are to be of non-rusting materials, e.g. phosphor bronze or nickel silver, as far as possible.

Pivots and other parts for which non-ferrous material is unsuitable are to be of approved rustless steel where possible.

GW-4.4.4 Fabrics, Cork, Paper, etc.

Fabrics, cork, paper and similar materials, which are subsequently to be protected by impregnation, are to be adequately treated with an approved fungicide. Fabrics treated with linseed oil or linseed oil varnishes shall not be used.

GW-4.4.5 Adhesives

Adhesives are to be specially selected to ensure that the type to be used shall be impervious and resistant to attack of mildew and insects. Synthetic resin cement only shall be used for joining wood.

GW-4.5 Interchangeability

The DG Sets and its associated auxiliary equipment shall be of the same Brand/Model to allow interchangeability and easy procurement of spare parts.

Corresponding parts throughout shall be interchangeable and shall perform in identical manner if fitted in another unit. Likewise, all spare parts must fit accurately in place without additional machining and shall perform in no inferior manner to the original part.

GW-4.6 Workmanship

Workmanship shall be of first class quality and in accordance with the best modern engineering practice for the manufacture, assembly, test and commissioning of equipment, notwithstanding any omissions from the specifications and drawings. To have quality workmanship, only technicians skilled in their respective trades shall be employed.

GW-5.0 EQUIPMENT MARKING, LABELING & MISCELLANEOUS REQUIREMENTS**GW-5.1 Nameplates**

All equipment and auxiliaries to be supplied by the Supplier under this contract shall be provided with 1 mm thick of stainless steel or approved equivalent corrosion-resistant nameplate with clearly legible writing of approved size and pattern which shall be permanently attached to each assembled piece of equipment at an easily visible location subject to approval by NPC.

Nameplates generally contain the brief technical specifications or characteristics of each component or equipment has been designed to operate and shall include the following: manufacturer's name, type of equipment, serial number, year of manufacture, weight, Standard Plant Identification Number (SPIN) if assigned/designated by NPC or indicated on drawings and other relevant information in compliance with applicable standards. Nameplate of the DG Set shall indicate the "Prime" kW Rating, speed (RPM), voltage, frequency and power factor. Any special instructions shall also be shown and suitably attached, as much as practicable, to the equipment or other visible location near the subject equipment.

For other major components, i.e. pumps, motors, etc., the following shall be added: rated horsepower, speed, total head, capacity, direction of rotation and any other pertinent information.

Nameplates for panels, boards, etc. shall be made of laminated black and white plastic. The lettering shall be bold-engraved through the black layer so that the letters appear white.

Each equipment and plant areas (engine room, switchyard area, etc.) wherever necessary, shall be provided with cautionary and warning plates and signs in accordance with the prescribed ANSI/IEEE or equivalent IEC Standards for the particular equipment.

Nameplates shall be attached by screws, the use of glue is only permitted for fixing labels on inside of a panel where screws are not applicable due to physical size of equipment.

Nameplates, labels and warning plates shall be in English.

GW-5.2 Labels

Labels contain only the Standard Plant Identification Number (SPIN) of each component or equipment for maintenance management and record purposes. In case SPIN is already factory fixed in the nameplate, labels are no longer required.

Labels for pumps and other rotary equipment shall be securely attached or installed adjacent to the equipment or as directed by NPC. For large equipment, i.e. tanks, piping, etc, the labels may be printed directly on the equipment's external surface which shall be fixed at readily visible locations. In addition to labels, a direction of flow for pipelines shall also be identified by arrows painted with color different from the pipe base color. Size of labels varies with the size of the equipment.

All valves shall be provided with suitable labels attached to the valve handwheel and engraved in it the valve number or SPIN and other inscriptions as applicable. Valve body mounted shall be applied where handwheel top mounted labels are not applicable.

Labels shall be provided on both front and rear sides of MCC's, boards, panels, etc.

Standard Plant Identification Number (SPIN) for instruments and other devices shall also be provided and inscribed in the label or nameplate as applicable.

Labels shall be secured by screws or by flexible wires if screws are not applicable such as for valves, instruments, etc.

GW-5.3 Tag Numbers/Standard Plant Identification Number (SPIN)

Tag Numbers or SPIN for all supplied equipment and materials shall be provided by the Supplier.

Tag Numbers/SPIN are designation codes which shall be used to achieve uniformity and standardization in identifying each component and equipment for installation, maintenance, documentation and record purposes. The Tag Numbers/SPIN shall be clearly inscribed in a stainless steel or equivalent corrosion resistant metal in accordance with the NPC Standard Specifications.

Tag Numbers/SPIN are generally specified or indicated on the Bid drawings. In case of supplied equipment, valves, instruments or devices are not designated with tag numbers or SPIN, the Supplier shall assign a number subject to the approval of NPC.

GW-5.4 Erection Marks

All members comprising multi-part assemblies are to be marked with distinguishing numbers and/or letters corresponding to those of the approved drawings or material lists. These erection marks, if impressed before painting or galvanizing, shall be clearly readable.

Color banding of a code approved by NPC is to be employed to identify members of similar shape or type but of differing strengths or grades.

GW-5.5 Locks

Where locks are called for in the Specification, they shall be of the barrel type. Whenever possible, they shall be incorporated in the appropriate door handle. Padlocks will be acceptable on valves and are preferred for all outdoor equipment.

In general, all locks shall be supplied with three keys, and all locks and keys are to be non-interchangeable. However, in the case of an electric switchboard containing a number of lockable doors, all locks shall be operated by one key. In all other cases where a set of locks is provided under any section of the equipment, a group master key shall also be supplied. Where a group of locks is supplied under any part of the Contract, a key cabinet is to be supplied for the accommodation of all padlocks and/or keys while not in use. Padlocks and keys are to be engraved with a suitable identifying code or inscription and this is to be repeated in the cabinet on engraved labels.

GW-5.6 Guards

Protection guards shall be provided for rotating components such as coupling, drive shafts, fans, etc. These shall comply with ANSI Standard B15.1, Safety Code for Mechanical Power Transmission Apparatus.

GW-5.7 Lifting Lugs

Each item of equipment or component which requires to be removed for servicing and which weighs more than 20 kg shall be provided with lifting lugs. Each lug shall be capable of supporting the entire unit. Lifting lugs shall be welded to and be of the same material as the equipment. Lug location shall minimize tilting of the equipment when suspended by the lugs.

GW-6.0 DRAWINGS AND INSTRUCTION MANUALS

GW-6.1 Drawings Contained in the Tender Document

The drawings contained in relevant section of this tender document shall be the Bid Drawings and/or Reference Drawings which shall be utilized for bidding purposes only. They are considered as defining the minimum requirements for the design of the equipment to be furnished and to show the general layout and equipment arrangement which indicate limiting or mandatory dimensions and elevations. However, if such indicated dimensions are found deemed inadequate during the implementation stage, changes or adjustments may be made subject to NPC's review and approval.

Bid drawings which show the work to be done as definitely and in as much detail as possible may be used as guide by the Supplier in the performance of his works. Bid drawings particularly plant layout, equipment layout and

pipings layout, which require changes or adjustments to suit with actual site conditions or which may be modified in design/details to conform with the configuration of the supplied equipment shall be prepared/submitted by the Supplier for NPC's review and approval. Accordingly, soft copies of said bid drawings may be furnished upon receipt of request by the Supplier for their ready reference/perusal.

Anything mentioned in the specifications and not shown on the drawings, or shown in the drawings but not mentioned in the specifications but which are obviously necessary to make a complete installation shall be considered/ included under the Supplier's Scope of Works.

Discrepancies between the drawings and actual field conditions or between drawings and specifications shall immediately be brought to the attention of NPC for proper resolution. All works involving discrepancies shall not be started without NPC's formal approval.

All drawings submitted by the Supplier or by any Sub-Supplier shall contain in the lower right-hand corner, in addition to the Supplier's name with signature, the date, drawing scale, drawing number and title, and contract number as given in the Specification. Drawing Title Blocks per NPC standard specifications shall be provided to the Supplier during the contract stage.

The drawings shall be adequate to demonstrate full compliance with the Contract requirements and provide NPC complete understanding of the equipment and its associated auxiliaries and associated works.

All data and information to be submitted shall be in the English language and all drawings shall be drawn using the metric system as unit of measurement.

GW-6.2 Drawings and Documents to be submitted with the Bid

The Supplier shall submit with his Bid the required copies of all the documents specified in Section III – (Part II) Technical Data sheets under the Section "Annexes" including other documents specified in the relevant Clauses of the bid documents (Refer to Form No. NPCSF-GOODS-01-Checklis of Technical and Financial Envelope Requirements for Bidders, Section V-Bidding Forms).

Drawings and other data or information that the Bidders may deem useful in the evaluation of their bids may be submitted with the bid.

GW-6.3 Supplier's/Manufacturer's Drawings and Instruction Manuals

GW-6.3.1 General

The Supplier shall submit to NPC five (5) copies for approval or reference, drawings, plans, brochures, equipment technical specifications or data sheets, erection manuals, calculations as required, codes and standards, operation and maintenance instructions and all other documents necessary for rendering the Works, prior to fabrication, manufacturing and/or

purchasing all equipment and materials to be supplied under this Contract. The sequence of submission shall be such that information is available for checking or approval of each drawing or document received.

To provide the basis for programming the checking of the Supplier's drawings, the Supplier shall, within fifteen (15) Calendar Days from effectivity date of the contract, prepare and submit to NPC for approval a drawing and document lists summarizing the drawings he proposes to submit in accordance with the requirements specified herein, together with the dates on which he proposes to submit such drawings. These lists shall be updated monthly to show the status of the drawings and documents submitted and any additional proposed drawings. NPC shall have the right to require the Supplier to submit additional information as may reasonably be required.

The name and signatures of the Supplier/Manufacturer's designer and approving officer who process the drawing for NPC's approval shall be included in the title block for each drawing/document submitted.

Drawings approved by NPC shall in no way relieve the Supplier from entire responsibility for engineering, design, workmanship, material and all other liabilities under the Contract.

Any manufacturing, test, installation of equipment and appurtenances and construction of any particular structure or portion thereof prior to the approval of drawings pertinent thereto shall be at the Supplier's risk. The Supplier shall be responsible for any extra cost that may arise in consequence to such risks or in correcting the work already done to conform with the drawings as revised and approved.

The Supplier shall be responsible for any discrepancies, errors or omissions in the drawings and other particulars supplied by him whether such drawings and particulars have been approved by NPC or not, provided that such discrepancies, errors or omissions are not due to inaccurate information or particulars furnished in writing to the Supplier by NPC.

NPC shall have the right to require the Supplier to make any changes to the drawings necessary to make the works conform to the intent of the Contract.

Should an error be found in the Supplier's drawings during approval, or during construction/erection, the correction including any field change considered necessary shall be noted on the drawings and shall be resubmitted for approval.

NPC reserves the right to reproduce any drawings or prints received from the Supplier as may be required despite any notice prohibiting the same appearing on the drawing or the print. All drawings are preferred in a computer-aided format. However, if unable to comply with this requirement, manual drafted drawings will be acceptable. All CAD produced drawings are to be submitted in Autocad formats. All other computer-generated documents are to conform to Microsoft Office.

GW-6.3.2 Bar Chart

A Bar Chart must be submitted by the Supplier/Contractor within fifteen (15) calendar days from the effectivity of the Contract for NPC review and approval indicating the schedule of various activities for the project such as design, engineering, approval (brochures/drawings), manufacturing, testing, delivery, erection, site test and commissioning.

The "Agreed Bar Chart" shall not be revised or modified without the prior approval/confirmation of NPC or except where extension of the contract period is approved in accordance with relevant provisions of the specification.

If the Works is not being adequately or properly performed in any respect, NPC shall require the Supplier to submit a new "Agreed Bar Chart" providing for the proper and timely completion of the Works covered by this Contract.

The Supplier shall see to it that the "Agreed Bar Chart" is followed as much as possible. The percentage which will be the basis for judgment of the progress of the Works shall be computed in percent of progress in each different item of work and integrated on the "Agreed Bar Chart". The actual value or quantity of work done divided by the value or quantity of the total work, respectively, and multiplied by 100 shall be the Contractor's percentage of accomplishment.

The percentage of accomplishment subtracted from anticipated percentage on the "Agreed Bar Chart" is the percentage the Supplier is behind or ahead in his work.

GW-6.3.3 General and Detailed Drawings and Specifications for Electro-Mechanical Equipment

Before proceeding with the manufacture of the equipment, the Supplier shall submit for approval the applicable designs, design computations as required, brochures, detailed specifications or equipment data sheets, general assembly drawings, outline/arrangement drawings, system drawings (flow diagrams), and sufficient sub-assembly drawings, P & I diagrams, schematic and control wiring diagrams, site training program, test and commissioning procedures, test reports and details to demonstrate fully that all parts will conform with the provisions and intent of the Specifications and with the requirements of their installation, operation and maintenance.

The drawings shall show all necessary dimensions and tolerances, field joints, and sub-assemblies in which the equipment will be shipped, terminal boxes and wire sizes for electrical circuits and wiring diagram for power and control circuits.

Formats and symbols for electrical drawings and logic diagram shall be standardized for all the plant systems under this Contract subject to NPC's approval.

GW-6.3.4 General and Detailed Design Drawings for Civil Works

The above drawings shall indicate, besides relative calculations and instructions, all data necessary for the design of supporting structures such as dimensions, weights, loads and stresses under operating conditions, dimensions and weights for installation, assembly and maintenance.

In addition, these drawings shall indicate all necessary details such as foundations, anchor, tie rods, trenches for cables and pipes, catwalks and supports and any other data used in the design of Civil Works.

The structures shall not substantially differ from those shown in the bid drawings.

GW-6.3.5 Working Plan

The Working Plan shall include the organization, working system, temporary yard installation, construction method, overall construction schedule, a list of Construction Equipment/Temporary Facilities to be used, etc.

GW-6.3.6 Progress Report**a) Monthly Reports**

The Supplier shall submit to NPC on the seventh (7th) day of every month or as agreed prior to project implementation, written detailed progress report, in an approved form, indicating the stage reached and anticipated completion dates for the design, ordering, procurement, manufacture, delivery and erection of the components. The report should be forwarded promptly so that on receipt by NPC the information is not unduly out of date.

From the commencement of manufacturing works, the Supplier shall provide color photographs of the Works which will be attached to the monthly progress reports. Each photographic print shall bear a printed description, a serial number and the date when taken. Inscriptions shall be in English. Each photograph shall record or illustrate specific events.

b) Weekly Summary Report

The Supplier shall also prepare a weekly summary report covering all the site activities and submit it to NPC. This report shall include projected work activities for at least 2 weeks ahead of those being reported upon.

GW-6.3.7 Instruction Manuals

Supplier shall submit five (5) sets of the draft of Operation and Maintenance Manuals required for all equipment supplied under this Contract, at least forty five (45) days prior to test and commissioning for NPC review and approval. Upon approval, the Supplier shall submit seven (7) final copies of the O & M Manuals per plant site for distribution to the following:

Number of Copies/Rating	Delivery Site/Group
3	Plant Site
2	Workshop, Maintenance and Technical Services Division
1	Bicol Operations Division
1	Luzon Operations Department

The Manuals shall include Parts List and Preventive Maintenance Schedule during the life span of the DG sets and shall be submitted at least 1 month prior to the delivery of the DG sets.

Instruction Manuals shall be furnished by the Supplier and assembled on standard metric A4 sheets. Covers and binders to be used for the manuals shall be robust and oil-resistant.

Manuals shall contain data relevant to the equipment or system design and its installation, start-up, operation, lay-up, preventive maintenance, troubleshooting, testing and repair. Drawings and schedules which are to be bound into the manual shall also be A4 or A3 folded to A4.

The descriptions shall not be general or applicable to any type and size of Supplier's equipment, but shall be specific with (whenever possible) references to drawings submitted by the Supplier.

The following requirements shall be included but not limited to:

- a) List of all equipment and systems supplied and its accessory components complete with respective descriptions, operating requirements at all processes and ambient conditions, storage requirements, reference codes and standards, Supplier's/manufacturer's specification or technical data sheets supported with illustrative catalogues and brochures as applicable;
- b) Applicable drawings including equipment outline drawings, assembly drawings, system flow diagrams, single line diagram, schematic and control circuit diagrams (alarm and trip), interconnection diagrams of the generator, exciter, governor and other integral devices and other relevant drawings;
- c) Mechanical and Electrical Parts lists itemizing type, number, rating, performance limits, and services required including electric power, water (cooling and seal), fuel and lube oil;
- d) Instrument lists (including switches and probes) itemizing function, set points, type, catalogue number, and range;

- e) Piping Line and Valve lists itemizing type, size, material, and ANSI class;
- f) Lists of trips and alarms complete with set points;
- g) Operating procedures and instructions shall provide the operator with information that tells him when and how to operate the equipment, including precautions, limitations and set points. Procedures listed in step-by-step sequence shall include start-up, shutdown, normal operation and load variation. Troubleshooting charts and tables shall be used to list likely evidence of malfunction and what could be responsible. The effect of loss of normal power and effect of electrical supply frequency drop shall be addressed;
- h) Preventive Maintenance Schedule for all equipment with servicing procedures including instructions for dismantling and/or replacing components, routine electrical and mechanical procedures, performance check and tests, checks for cleaning, lubricating and otherwise caring for equipment. These procedures shall include instrument calibration and maintenance of interlocks and other safety features;
- i) Maintenance and overhaul instructions with step-by-step procedures for all anticipated equipment repairs including control system troubleshooting, alignment and calibration, assembly and disassembly. Dimension record with clearances and tolerances and torque values for all bolts shall be provided for reference;
- j) Special/standard tools list;
- k) Parts list including ASTM designation (if applicable). The spare parts list shall be in the form of a report that provides sufficient data necessary for computerized information processing. The set of data for a particular piece of equipment shall include, but not limited to the following:
 - k.1 Equipment identification number or SPIN
 - k.2 Description of part
 - k.3 Manufacturer/Supplier part number
 - k.4 Manufacturer's drawing number
 - k.5 Self life
 - k.6 Ordering lead time
 - k.7 Unit cost
 - k.8 Weight
 - k.9 Quantity required
 - k.10 Outline sketch diagram

GW-6.3.8 As-Built Drawings

The Supplier shall provide and keep an up-to-date "As-Built" drawings of all structures constructed and all equipment and accessories and miscellaneous works erected or installed. These drawings shall show all changes and revisions from the original drawings and specifications, including the exact "as-built" locations, sizes and kinds of equipment and accessories, miscellaneous metal works, embedded piping and electrical systems and other concealed items of work.

These drawings shall be kept in the Supplier's field office but shall be made available at all times for review of NPC. At the end of every work, all entries, changes or revisions made in the drawings by the Supplier shall be checked and approved by NPC.

The complete and duly checked and approved "As-Built" drawings shall be submitted by the Supplier within thirty (30) calendar days from the completion of the contract in five (5) prints and one (1) set of electronic copy on CD/DVD. Such CD/DVD shall be suitable for any optical drive of computer system.

GW-6.3.9 Documents for NPC's Records

The Supplier shall furnish five (5) copies of the following documents for NPC's records:

- a) Material Data, Material Certifications and Test Reports required by governing Codes and Standards;
- b) Factory Test/Site Test (Performance) Results; and
- c) Other Documents as may be required.

GW-6.4 Processing of Drawings/Documents

All drawings and documents to be prepared by the Supplier for NPC's review and approval shall be on A4 size or A3 size folded to A4 and submitted to, except otherwise mutually agreed during the implementation stage:

The Manager, Design and Development Department
National Power Corporation
BIR Road corner Quezon Avenue,
Diliman, Quezon City 1100

NPC shall review, comment or note corrections to be made and return two (2) copies to the Supplier within twenty (20) calendar days after receipt of the drawing. If corrections are required, the Supplier shall make all necessary corrections and re-submit within fourteen (14) calendar days for NPC's review and approval. However, if the Supplier/Contractor has not received any reply from NPC within the twenty (20) calendar days, said drawings and documents are deemed approved and the Supplier/Contractor may proceed with the design and manufacture of equipment or materials. The Supplier/Contractor however, shall not be relieved to meet all the requirements of this specification nor of the

responsibility for the correctness of the Supplier's/Contractors Drawings/Documents.

Five (5) prints with dark lines on a white background shall be furnished to NPC for each drawing submitted for approval. Two (2) copies will be returned to the Supplier either marked "Approved", "Approved with Corrections Indicated", or "Returned for Corrections". Prints marked "Approved" or "Approved with Corrections Indicated" authorize the Supplier to proceed with the procurement/fabrication, assembly and construction of the works shown on the drawings, with corrections, if any, indicated thereon.

When prints of drawings are marked "Approved with Corrections Indicated" or "Returned for Corrections", the Supplier shall finalize the drawings and re-submit it in five (5) copies each for final approval. Every revision shall be shown by number, date and subject in a revision block.

If minor revisions are made after a drawing has been approved, the Supplier shall incorporate the corrections on the as-built drawings to be submitted by the Supplier. No major revision affecting the design shall be made after a drawing has been marked "Approved" without re-submitting the drawing for formal approval of said revision.

Drawings and documents marked "Noted" without comments are deemed approved. If comments/corrections are indicated thereon, the Supplier shall finalize the drawings/documents and resubmit for NPC review and reference.

Failure of the Supplier to submit the approved "As-Built" Drawings and "Operation and Maintenance" Manuals to NPC on the respective dates specified in this section, NPC shall withhold Five percent (5%) of contract amount from payments due to the Supplier.

GW-7.0 DISMANTLING AND HAULING REQUIREMENTS (NOT APPLICABLE)

GW-8.0 INSTALLATION REQUIREMENTS

GW-8.1 General

The Works to be carried out at Site shall be undertaken in a safe and efficient manner in accordance with generally modern and industry accepted practice and applicable standards.

GW-8.2 Inspection at Site

Erection procedures and proposed erection check lists, if required, shall be submitted to NPC at least three months prior to the erection works all in English language. The erection procedures for each item of Plant shall be provided in hard-bound copies in a format and in sufficient detail to allow NPC to appreciate fully how the works are to be erected, and at which stages inspections, alignment checks, grouting, etc. are to be carried out.

For each part of the Contract Works to be erected it shall be examined and passed by NPC. This particularly applies to the accurate plumbing of all stanchions and columns, and to the leveling, setting and aligning of the various parts, and to the fitting and adjusting of bearings and other parts. NPC reserves the right to inspect all parts of equipment in the Works and/or on Site but at the discretion of NPC inspection may be waived on certain items. This shall in no way absolve the Supplier from his responsibilities.

Full assistance and facilities are to be afforded by the Supplier for NPC's representatives to check the works. The Supplier shall be required to carry out dimensional checks at various stages of completion and these shall be witness by NPC.

The maximum personal safety must be afforded to personnel directly engaged under the Contract or who in the normal course of their occupation find it necessary to utilize temporary works erected by the Supplier or who frequent the working area.

The Supplier shall provide such protection and watchmen as he may consider necessary to safeguard the materials and stores in the area allocated to him together with the works on the site. NPC will not accept responsibility for any losses or damage which may occur during the execution of the Contract.

GW-8.3 Installation Requirements

The Supplier shall prepare detailed design of concrete foundations and associated structures of all his supplied equipment including construction thereof to ensure proper anchoring of the new equipment and associated structures in accordance with the Manufacturer's/Supplier's recommendation and the requirements of the relevant civil works specifications and/or drawings subject to NPC's review and approval.

All electro-mechanical equipment and associated structures shall be installed, tested and commissioned in accordance with the manufacturer's drawings, instruction manuals, and drawings provided thereto. In the event of conflict within these documents, the Supplier shall inform NPC of the conflict in writing for written resolution prior to the execution of the Work.

Materials and equipment shall be handled with care at all times to prevent damage and defects during handling, hauling, packing/crating, loading, transportation, unloading, assembly, erection and any such damage and defects shall be repaired, replaced or otherwise make good by the Supplier to the satisfaction of and at no cost to NPC.

Assembly, erection and installation of all materials, equipment and its associated structures shall be carried out by skilled and qualified personnel with special training and experience in the appropriate trade.

During installation, the Supplier shall provide adequate lifting gears and other protective devices that may be required to prevent damage to the equipment during and after erection. The Supplier shall be responsible for the correct positioning and leveling of the equipment and auxiliaries, and

any checking made by NPC during the course of the work shall not relieve the Supplier from his responsibility. The equipment shall be carefully lifted or glided on their respective foundations by using only approved methods and devices on a manner that will prevent damage during erection/installation. They shall be positioned on locations as shown on the drawings.

The equipment shall be set level and checked true to grade and alignment. Foundation bolts/bed plates of the number and sizes required shall be supplied and installed by the Supplier. The cost of which shall be included in the cost for the installation of respective equipment.

The pouring of concrete to secure in place any equipment on its concrete foundation shall not be made until NPC has verified the correct location of the foundation. Should incorrect positioning be ascertained after the concrete pouring, the Supplier shall make the correction at his own expense.

Welding works for structural steels and piping system shall be by an electric arc process. The procedure, testing and inspection shall conform generally with the relevant approved standards and to the approval of NPC. Weld joint preparations shall be in accordance with approved standard and to NPC's approval. Approval of the welding procedure, etc. shall not relieve the Supplier of his responsibility for correct welding, electrodes and for minimizing distortion in the finished structure and piping systems.

The Supplier shall identify the most convenient access and manner of moving the equipment out of a fixed structure/s. The Supplier shall provide temporary shelter/cover (tarpaulin or equivalent type of cover) on the torn down part until it is properly packed and crated as required.

Any part of existing fixed structures that has to be temporarily torn down or damaged shall be brought back to its original form to the satisfaction of NPC.

If applicable, the access area identified or used during the removal of the existing equipment and associated structures shall also be utilized in moving-in the new DG sets and auxiliaries. Any part of fixed structures that has been torn down and used as temporary access during the removal of the existing DG sets may be left open and provided with temporary tarpaulin or equivalent type of cover until the new DG sets have been unloaded and installed inside. Such temporary access shall be brought back to its original form by the Supplier to the satisfaction of NPC.

GW-8.4 Nameboards and Advertisements

All nameboards on and adjacent to the Project Site shall only be erected after written approval from NPC. Before approval is given, the Supplier shall submit details of the location, size and layout of the proposed nameboard.

The use of any advertisements, publicity photographs and the like relating to or including reference to the Project shall be required to be approved by NPC prior to publication.

GW-8.5 Signs

GW-8.5.1 General

All signs mentioned below shall be located at suitable location within the sight of people or the people to whom they apply. The sign shall be properly displayed. For temporary dangerous area (e.g. construction site), the signs shall be of the portable type. To avoid misunderstanding, all signs shall be complete, easy to understand and are mounted in the designated location.

The signs shall be of weather-resistant material with sufficient life span under site conditions.

GW-8.5.2 Traffic Signs

For the safety of traffic on Site, adequate number of warning signs and prohibiting signs are to be erected at the appropriate places by NPC working in the area. Special attention shall be considered to Right of Way, One-way Streets, Speed Limits, Maximum Height or Width restrictions, weight restrictions, Fire-access roads, etc.

Information signs shall be used to provide the necessary information to personnel working on site. Examples of information signs are load-carrying capacities including marking of floor areas, working loads of cranes, lifting gear and lifts, room identification, etc.

GW-8.5.3 Signs for Emergencies

Areas which are prone to accident shall be equipped with adequate emergency signs of appropriate size. The emergency sign shall be stored and permanently displayed at the proper place to provide correct information which will result in fast action and also safe guard of personnel working on site.

Escape routes, emergency exits, fire alarms, fire extinguishers, instruction for special fire extinguishing agents, warnings against fire-extinguishing agents, first-aid equipment, telephones, etc.

GW-8.5.4 Warning Signs

Refers to the existing or possible existing danger, such as inflammable substances, explosive substances, corrosive or noxious substances, suspended loads, general danger, width/height restriction, danger or trapping, steps, slipping, falling, etc.

The signs shall be coloured with appropriate black and yellow strips to attract the attention of the people working in the area by keeping them aware of such existing or possible existing danger.

GW-8.5.5 Prohibition Signs

Prohibition sign shall be displayed by the Supplier in areas where the following rules need to be closely adhered to prevent accidents such as the outbreak of fire, damage of equipment caused by water, etc.

Examples of prohibition signs are No smoking; no fire or no naked lights; no entry to pedestrians; use no water; no entry; do not start; etc.

GW-9.0 INSPECTION AND TESTS**GW-9.1 General**

The Supplier shall perform at his own expense all tests required to ensure adequacy of material, workmanship and conformance of equipment to the guaranteed data and other requirements of the specifications and standards.

The Supplier shall submit five (5) copies of test procedures for NPC's review/approval for all his supplied materials and equipment covered by the Contract at least forty five (45) calendar days prior to the conduct of actual test.

NPC and/or its duly authorized representatives shall be entitled to attend and witness all applicable tests detailed in the relevant sections. NPC shall be notified by the Supplier thirty (30) days in advance about any tests requiring the presence of NPC or at least sixty (60) calendar days for factory test to be conducted outside the country.

Tests not requiring the presence of NPC shall be, in any case, notified in advance. In such case, the Supplier shall then proceed with the tests and shall submit test reports in five (5) copies to NPC at least two (2) weeks after the conduct of the tests. NPC's acceptance of the work by waiving the inspection of tests and receipt of the Supplier's Certified Test Reports and Inspection & Testing Certificate shall in no way relieve the Supplier of his responsibility in accordance with the requirement of the Specifications.

For inspected or tested goods that fail to conform with the Specification, the Supplier shall either replace or make any alternations necessary to meet the requirements of the Specifications at no costs to NPC.

During the site test and commissioning period, the Supplier may request NPC to provide plant operations and maintenance personnel to assist in the performance of the required tests under the direct supervision and coordination of the Supplier for the purpose of on-the-job training.

Fuel oil, lubricating oil, lubricants, coolant, chemicals and other consumables required during initial filling, start-up, test and commissioning shall be borne by the Supplier. Cost of fuel consumed during the start-up, pre-testing/pre-commissioning and re-test of the performance test shall be borne by the Supplier. Fuel used/consumed during the performance and

reliability tests (where generated load are already exported to the grid/consumers) shall be supplied by NPC.

NPC shall provide the fuel requirements of the DG sets during the performance/reliability tests. However, if any equipment fails to pass the performance tests, fuel oil requirements for the re-test of the DG set shall be provided by the Supplier at his own cost. The Supplier shall therefore provide NPC the recommended quantity at least sixty (60) calendar days prior to the conduct of site test and commissioning.

Calibrated measuring and testing instruments, tools, and devices shall also be furnished by the Supplier. Any relevant instruments supplied and installed by the Supplier in the various systems of the DG sets shall preferably be used during the fuel consumption test. However, any other applicable measuring devices other than the installed instruments may be used as mutually agreed during the witnessing of the test or as specifically described in the relevant Clauses of this Specification. The cost of all tests and relative activities shall be borne by the Supplier.

The Supplier shall carry out all tests in accordance with the requirements described in the pertinent clauses of these specifications and test procedures duly approved by NPC. Certified test reports/results of all tests conducted at manufacturer's shop/factory and at the site/s shall be submitted to NPC for evaluation and acceptance.

The Supplier shall be responsible in compiling, recording, and submitting the relative test reports. Five (5) certified test reports shall be submitted by the Supplier within a maximum of fifteen (15) days after the completion of tests.

Provide service personnel from the equipment Manufacturer/Supplier or his authorized local representative to be assigned at the plant for selective periods stated in Clause GW-16.0 from date of completion or start of the warranty period, to perform preventive maintenance of the DG sets and auxiliaries; such as checking/evaluation of operating parameters, safety adjustment of controls, components, assessment of operating conditions, cleaning, etc. This shall include any maintenance services rendered upon request of NPC in the event of any abnormality occurs within the warranty period.

Acceptance or completion certificate shall be issued only after all the required tests are satisfactorily conducted and results are within the acceptable range and the guaranteed values are met.

GW-9.2 Tests at Supplier's Premises

GW-9.2.1 Inspection at Supplier's Premises

NPC reserves the right to inspect all shop and assembly work associated with the Works, verify quantities consigned to stores and inspect quality control and assurance records as well as shop and purchase order records.

When scheduled, and as often as NPC deems appropriate, progress will be monitored with respect to Milestone Dates in the Contract Schedule and the sequence of events and activities on the Supplier's Detailed Contract Schedule.

GW-9.2.2 Factory Acceptance Tests (FAT)

Prior to shipment and final inspection, each equipment supplied by the Supplier shall be given the manufacturer's standard factory test and/or as required in the relevant sections of the technical specifications.

The Supplier shall carry out tests, as may be required by the specified Standards and the Quality Control and Assurance Program, as well as the entire test program approved by NPC. Prior to the witnessing of Factory Test the Supplier shall remove all faults found and correct all failures noted to the best of his knowledge such that no functional or procedural errors will occur during the test.

At the commencement of the witnessing of Factory Test, all applicable equipment and materials shall be brought together in one place, integrated, and the configuration/set-up at the factory shall be identical to that to be installed at the site and any equipment and software necessary for the proper operation of the equipment shall have reached its final form, not to be changed during the Factory Test and until commencement of commissioning at site.

The Supplier shall immediately advise NPC should failures occur, take remedial action subject to NPC's approval, and proceed with the Factory Test as and when directed by NPC. It shall be NPC's prerogative to order a repeat of all such tests that he deems may have been affected by the failure.

The Supplier shall ensure that during the test, all hard copies from output devices are retained and that no outside parties interfere in any way with testing, equipment or test instruments, fixtures and jigs for the entire duration of the Factory Test. Only Supplier's personnel who are needed on the testing of the equipment shall be allowed in the test area.

The Supplier shall also be responsible that an accurate record of tests are kept and each individual test is duly initialed and dated by the Supplier and stamped or marked either "passed" or "failed" with annotations of antecedents and observations concerning the test.

For each day of testing, the Supplier shall submit to NPC the proposed disposition of each criterion that failed during the previous day of testing, prior to commencement of the tests scheduled for that day.

Tests witnessed by NPC will be initialed accordingly by him on the test record. The test record and dispositions, and any other pertinent supporting data and documents shall form part of a test report to be submitted in accordance with the specification.

a) Diesel Generating (DG) Sets

Before leaving the factory, each DG Set shall be carefully tested, using diesel fuel oil, by the Supplier in the presence of NPC and/or its duly authorized representative. Also, the Supplier shall provide the photograph of each DG Set nameplate to NPC prior to the shipment of the equipment.

The diesel engine shall be subjected to the following tests in direct connection with the main generator:

a.1 Starting Test and Maneuvering Test at no load

a.2 Load Test

<u>Load</u>	<u>Duration</u>
50%	0.5 hour
75%	0.5 hour
100%	1.0 hour
110 %	0.5 hour

a.3 Governor Regulation Test

a.4 Overspeed Trip Test

a.5 Engine High Temperature, Low Oil Pressure and
Emergency Device Trip Test

a.6 Fuel Oil Consumption Test

a.7 Test for Vibration and Sound Level at 1m distance from DG set

After the factory test, each DG set shall be thoroughly checked and inspected to determine the condition of the external and internal parts. If defective parts are found, those parts shall be replaced or remedied and necessary adjustments shall be made at the expense of the Supplier.

Notes: 1. The use of Weighing Scale shall be the basis for the acceptance of Fuel Rate requirement during the conduct of Factory Acceptance Test (FAT) or as specified in the approved Test Procedures.

2. The conduct of Sound and Vibration Tests shall be done only once, either during Factory Acceptance Test (FAT) or at Site Acceptance Test.

b) Auxiliary Equipment

Certified Test Reports of the following auxiliary equipment shall be submitted for NPC's review and evaluation:

- b.1 Pumps performance test
- b.2 Heat Exchangers hydraulic test

c) Electrical Equipment

Electrical equipment such as generators, circuit breakers, control and protection panels, transformers, etc. shall be subjected to factory tests in accordance with the requirements as specified in the relevant Electrical Works specifications.

d) Sound Attenuated/Weather Proof Enclosure

The enclosure shall be tested for Sound level @ 1-meter distance from any point of the unit which shall not exceed 85 dBA. Water tightness shall also be tested to ensure that rain water is prevented from entering the enclosure by conducting Rain Test equal to 100 mm per hour.

Note: *The conduct of Sound, Vibration and Rain Tests shall be done only once, either during Factory Acceptance Test (FAT) or at Site Acceptance Test.*

GW-9.3 Pre-Commissioning/Commissioning Test

GW-9.3.1 General

After installation of the equipment and its associated auxiliaries, the Supplier shall notify NPC of the date when the plant is ready for pre-commissioning/commissioning test at site. The timing and duration of the test shall be as mutually agreed by NPC and Supplier and shall be satisfactorily completed as required under the Contract.

The Supplier shall submit personal data sheet of at least one (1) of its proposed Commissioning Engineers/technical staffs for NPC's evaluation and approval at least one (1) month prior to testing. A certification from Manufacturer/Authorized Representative to prove that the said personnel has undergone previous test and commissioning services of similar unit/s to be supplied for this project shall also be submitted.

During the test and commissioning period, NPC shall provide operations and maintenance personnel, upon request of the Supplier, who shall assist in the performance of the commissioning test. The said personnel shall be placed under direct supervision of the Supplier/Commissioning Engineer and shall also serve the purpose of on-the-job training in the field of operation and maintenance of the plant.

The Supplier, with the assistance of NPC personnel involved in the test and commissioning, shall be responsible in compiling, recording and submitting the test reports to NPC.

Calibrated measuring and testing instruments, tools, and devices shall also be furnished by the Supplier. The cost of all tests and relative activities shall be borne by the Supplier.

GW-9.3.2 Pre-Commissioning Test

The typical Pre-Commissioning Test shall include but not limited to the following:

- a) Alignment of engine-generator;
- b) Wiring continuity test;
- c) Megger testing of equipment and power cables;
- d) Checking of safety valve settings;
- e) Checking of settings for switches and instrument transmitters;
- f) Calibration and test of C & I equipment and measuring instruments;
- g) Checking and testing of AVR, electrical relays, CT's and PT's;
- h) H.V. test for relevant equipment;
- i) Functional test of all supplied equipment;
- j) Checking for tightness, rotation, direction of auxiliary electrical motors, etc.;
- k) Setting/calibration of relays and other protective devices;
- l) Fuel injectors, fuel injection pump calibration and settings;
- m) Conduct the following tests/works, as applicable:
 - m.1 Hydrostatic and pneumatic tests of field assembled equipment and piping
 - m.2 Lube Oil flushing of field installed engine lube oil pipe
 - m.3 Chemical cleaning of field installed engine piping system

GW-9.3.3 Commissioning Test

The Commissioning Test shall be carried-out after the Pre-Commissioning Test has been conducted to ascertain its fitness for operation and shall include the following:

- a) Trial run of individual auxiliary equipment;
- b) System sequential operation;
- c) Generating unit tripping device test;
- d) No load operation of DG sets;
- e) Test of control systems safety and operating functions (Control and Protection Relays);
- f) Unit synchronization;
- g) Unit load test and load rejection test (at 50%, 75%, 100% and 110%);
- h) Unit start-up/stop tests;
- i) Automatic change-over of standby equipment;
- j) Parallel Operation and Load sharing test;
- k) Guaranteed Prime Power Output & Guaranteed Fuel Rate tests;
- l) Reliability Test (8 hours);
- m) Tests for Sound Pressure and Vibration; and
- n) Tests for Electrical Equipment per ANSI and IEC standard.

Considering the expected unavailability of reliable load at the plant site, the Supplier may conduct the performance test to determine the Guaranteed Prime Power Output and Guaranteed Fuel Consumption at 100% load and

other loads (50%, 75%, and 110%) including other applicable/required tests specified above at its local facility or at any local facility acceptable to NPC. The Supplier shall provide a load bank if the performance test will be conducted after installation at the plant site. Accordingly, fuel cost to be used during the performance test at the Supplier's facility shall be borne by the Supplier.

GW-9.4 Performance Tests

The performance test shall be carried out during the period of commissioning test to verify the guaranteed or specified values of the supplied equipment in accordance with the requirements of the specifications which include the guaranteed Prime power output, guaranteed fuel rate, enclosure sound pressure level and water tightness, Vibration and others as required or specified in the relevant clauses of the technical specifications.

Performance test to determine the guaranteed prime power output and guaranteed fuel rate of each DG set shall be carried out in accordance with the approved test procedure.

All instruments, materials, and devices necessary to perform the required testing as well as to measure and analyze data shall be furnished by the Supplier. Any relevant instruments supplied and installed by the Supplier in each of the DG set shall preferably be used during the fuel consumption test to verify its accuracy in comparison with the fuel rate test results taken during the FAT. Any other applicable measuring devices other than the installed instruments may be used as mutually agreed during the witnessing of the test.

The Supplier shall provide key test personnel who will supervise the tests and collaborate closely with NPC's representatives who are duly designated to participate in the conduct/performance of the test and commissioning.

All tests shall be coordinated with NPC and shall be timed to conform with the grid requirements. Correction factors for variations of test conditions from the specified design conditions shall be stated in the Test Procedure to be submitted by the Supplier for NPC's review and approval.

Performance Test Procedures to be submitted by the Supplier shall include the following:

- a) Introduction;
- b) Purpose of Test;
- c) Procedure for the Test;
- d) Simplified diagrams indicating test envelope, test points and measuring equipment;
- e) Test data and parameters to be measured;
- f) Step by step calculations indicating how the test data are used to arrive at the final results;
- g) Forms to be used; and
- h) Correction curves and other curves or tables to be used in the test (correction curves shall be submitted with the Bid)

Acceptance of the equipment shall be on the basis of the satisfactory results of the performance tests meeting the guaranteed values.

In the event of unavailability of required load at site during the period of testing, the performance test shall be conducted at its local facility or at any local facility acceptable to NPC. The supplier has the option to provide the dummy load if the performance test will be conducted after installation at the plant site at his own cost.

GW-9.4.1 Diesel Generating (DG) Set

All tests shall be performed in accordance with the approved Test Procedures submitted by the Supplier and shall include but not limited to the following:

- a) Governing Test: gradual speed change from zero to full load and instantaneous speed change with 25% load on or off
- b) Overspeed Trip Test
- c) Low Pressure, High Temperature and Emergency Device Trip
- d) Load Test & Fuel Oil Consumption Test

50% load	0.5 hour
75% load	0.5 hour
100% load	1.0 hour
110% load	0.5 hour

Before each test, the DG set shall be stabilized at a given load for duration of thirty (30) minutes or as recommended by the Manufacturer. After the stabilization period, initial readings shall be recorded and succeeding readings shall be taken every ten (10) minutes thereafter for a period as specified above. As minimum, there shall be three (3) test runs at each test point for both the power output and fuel oil consumption. The computed results shall be the time-weighted average of related readings.

Ten percent (10%) overload test shall be carried out no more than one (1) hour every twelve hours. 100% load test may be separated in several times.

The results of the test at 100% load for one (1) hour shall be the basis in determining the required guaranteed rated power output and guaranteed fuel consumption.

- e) Test for Enclosure Sound Pressure Level, Water Tightness, and Vibration.

The above test shall be determined during the Load Test at 100% Load. *Refer also to the requirements as noted in item "d)" of Clause GW-9.2.2.*

GW-9.4.2 Auxiliaries and Associated Electrical Equipment

All applicable auxiliary equipment shall be tested to assure proper operation and performance to conform with the guaranteed and expected performance values specified in the technical data sheets. Tests shall be performed in accordance with the approved test procedures submitted by the Supplier.

GW-9.5 Reliability Test (8 hours)

After the Supplier has notified NPC that the DG set is ready for commercial service including its associated auxiliary equipment, and provided NPC is satisfied that the DG sets are ready for commercial service, the DG sets with all its associated auxiliaries are required to operate under the normal working conditions of the power plant and within the limits of output specified or at any load available at site and operating continuously without major failure for a period of eight (8) hours or at any programmed/scheduled operating hours available at the plant site.

The plant will be operated by the NPC staff under the supervision of the Supplier's Commissioning Engineer during the reliability test period.

The Reliability Test shall be carried out in accordance with the applicable codes and standards and the approved test procedures.

Should any major failure occur in the DG set or any portion of the supplied associated equipment due to, or arising from, faulty design and materials, sufficient to prevent safe and full commercial use of the plant, the reliability test shall be considered void and the reliability test period of eight (8) hours shall be recommenced after the Supplier has remedied the cause of defect.

Reliability Test would be considered a failure for any one of the following major causes:

- a) Plant tripping due to above causes;
- b) Failure to start-up/shut-down as and when required according to normal procedure;
- c) Major defects to warrant plant shut-down or interruption for repair which would otherwise affect safety or personnel and/or plant and equipment; and
- d) Failure to respond correctly during the run back or emergency trip when initiated accidentally.

In case of the above failure, the reliability test period of eight (8) hours or at any programmed/scheduled operating hours available at the plant site shall recommence after the Supplier has remedied the cause of defect.

In the event that the programmed or scheduled operating hours available at the site are less than eight (8) hours per day, the remaining unused

reliability test hours as required shall be continued the following day to complete the required 8-hour test.

GW-9.6 Tests Failures

If any equipment or component fails to pass any test, NPC may direct the Supplier to make any necessary corrections or alterations for defects or order equipment/component replacement, as maybe deemed appropriate. Any and all expenses due to additional tests or retests made necessary by failure of Supplier's supplied equipment/component, i.e. failure to meet the guarantees and other requirements of the specification, shall be borne by the Supplier. The costs of witnessing the Factory Tests by NPC or its representative(s) as a result of re-test to be conducted on the equipment shall also be borne by the Supplier.

If the results of the performance test at site show that the equipment failed to meet the guaranteed Prime power output and/or the guaranteed fuel oil rate, the Supplier shall be given two (2) weeks maximum from the completion date of the performance test to make any necessary corrections or alterations of defects before conducting the retest. The Supplier may request time extension for any corrections subject to NPC's evaluation/approval of corresponding justification for such extension. One (1) retest is allowed only during the required two (2) weeks maximum period including trial runs. If the results of the latest test/retest failed to meet the guaranteed prime power output and/or the guaranteed fuel oil rate, then these results shall become the basis in applying the applicable penalties.

Penalties specified in the relevant sections of this Specification shall be applied in case tests or retests at site for the DG sets, transformers and associated equipment have failed to meet the relative guaranteed data.

NPC shall have the right to reject DG sets whose fuel oil rate during test deviates to more than +5% of its guaranteed fuel oil rate and/or the prime power output is less than its guaranteed power output.

NPC shall also have the right to reject the DG sets if it fails during tests to comply with the Standards of the Philippine Clean Air Act and Sound Pressure Level as required in the Technical Specifications.

GW-9.7 Test Reports/Certificates

Five (5) certified copies of the reports of all NPC's specified tests and other manufacturer standard tests shall be furnished to NPC within a maximum of fifteen (15) days following the completion of the tests.

Test certificates shall include, in addition to the test results, the following information:

- a) Date of the performance of test;
- b) Equipment data; and
- c) The equipment serial number.

The Supplier shall bear the cost of furnishing these records and reports.

GW-9.8 Waiver of Factory Tests Witnessing/Inspection by NPC for Equipment to be Furnished by the Supplier

If NPC opted not to witness the Factory Tests, NPC will issue a Certificate of Waiver of Tests Witnessing/Inspection for the equipment and materials. In such case, the Supplier shall proceed with the Factory Tests in accordance with the requirement of the specification and the manufacturer's test procedures as approved by NPC.

Issuance of the Certificate of Waiver of Tests Witnessing/Inspection for equipment required to be witnessed by NPC or its authorized representative(s) however, shall in no way relieve the Supplier of his responsibility to conform to the approved test procedures and the requirements of the Specifications.

GW-10.0 TRAINING OF NPC PERSONNEL**GW-10.1 General**

The Supplier/Manufacturer shall extend all possible assistance and cooperation to NPC regarding the transfer of technology and developing expertise in the area of engineering, operation and maintenance of the DG sets and associated electrical equipment.

The Supplier shall plan, develop training module and program schedule which shall be submitted to NPC for approval and shall cover all plant systems such as mechanical and electrical equipment, auxiliary equipment and associated facilities, control and instrumentation system, maintenance and operational considerations.

The components of the training modules shall include but not limited to the training procedures/methodology, instructional materials such as audio visual materials, tapes and slides, and manuals for each trainee.

The training course shall be conducted in as short period as possible but enough to be able to properly train and make ready NPC technical personnel who will be responsible for the safe and reliable operation/maintenance of the plant.

The training program shall be adequate for the trainee to acquire the necessary expertise and competence in the area of engineering, operation and maintenance and as trainers for in-house technology transfer program of NPC.

Five (5) sets of materials included in the training modules shall be turned over to NPC upon completion of the training. An evaluation shall be jointly undertaken by the Contractor and NPC's representative on the adequacy, appropriateness and relevance of the training and the program effectiveness after the training.

The training program shall be conducted by expert/s who are knowledgeable and well trained by the DG set manufacturer or his authorized representative.

The Supplier shall employ qualified English speaking instructors and training coordinators during the conduct of the training program.

The Supplier shall conduct the training program preferably at the plant site or at any venue convenient and acceptable to both NPC and Supplier.

The cost of training of all involved NPC personnel at Plant site shall be borne by the Supplier and shall be included in the bid price.

Upon completion of the training, the Supplier shall issue the participants with Certificate of Completion.

GW-10.2 Operation and Maintenance Training at Site

The Supplier shall conduct training at the Plant Site of NPC's personnel who will be assigned to operate and maintain the plant. All the existing O & M Plant Personnel, but not less than four (4) NPC Personnel from plant, shall participate in the training program. The Supplier shall provide a comprehensive training program related to design application, operation and maintenance, including trouble shooting of the Supplier's supplied system and equipment starting from Start of Pre-Commissioning/Commissioning and thereafter up to the issuance of Certificate of Completion.

The contents of the training program shall include but not limited to:

- a) Lectures on Diesel Power Plant principles in management and practices for operators, technicians and in maintenance personnel;
- b) Hands-On Training on Operation and Maintenance training program covering electrical, mechanical and instrumentation and control which include an understanding of the software and a working knowledge of the database for additions, modifications, deletions and the practical use of diagnostic programs.
- c) Proper maintenance during long period of standby condition.

Said training program shall be submitted to NPC for approval. The program shall contain the schedule of activities summarizing the time and duration (not less than three days) and the corresponding topics/content of the program.

The timing of the training should be such that the participants will be equipped with sufficient know-how to participate in the pre-commissioning and commissioning tests of the Plant.

During pre-commissioning, commissioning, and performance test period, the Supplier may request NPC to provide operations and maintenance personnel to assist the Supplier in the operation and maintenance of his

supplied equipment under the direction of the Supplier for the purpose of on-the-job training.

NPC shall have the right to send to the Site its personnel intended to operate and maintain the equipment supplied under this Contract. The Supplier shall use his staff to instruct these personnel relative to the operation and maintenance of the equipment.

GW-11.0 CORROSION PROTECTION AND PAINTING

GW-11.1 General

The Supplier shall apply corrosion protection and painting to all equipment and materials to be furnished in accordance with the minimum requirements specified in this section.

Generally, the DG sets and associated equipment including its enclosure shall be shop primed and finish coated in accordance with the Manufacturer's standard practice. An adequate supply of touch-up paint shall be supplied by the Manufacturer/Supplier which shall be used for painting surfaces that will be damaged during transport and installation works including surfaces that show signs of corrosion. Color of Final painting shall be per Manufacturer's standard, unless otherwise specified in the pertinent provisions of the specifications. Preferably, final color shall be similar to the existing color of the equipment and structures or as directed/approved by NPC.

The Supplier shall be responsible for the adoption of preparation procedures and protective coating systems which are suitable for the environment experienced by the various components/elements of the Plant.

Where a specific coating system is mentioned elsewhere in the specification, the Supplier shall accept responsibility for the suitability for such system. The Supplier has the option to nominate an alternative coating system for the approval of NPC.

Within sixty (60) calendar days from the award of the Contract, the Supplier shall submit for the approval of NPC, a full schedule of coating systems including the following information:

- a) Plant item name;
- b) Protective coating systems including number and thickness of coats;
- c) Short list of protective coating manufacturers and applicators;
- d) Surface preparation;
- e) Workshop action; and
- f) Final color schedule which NPC will provide during the Contract stage or as specified in the relevant sections of this specification.

GW-11.2 Treatment for Shipping

The various items which do not fall under the paintings or lining specifications in the documents shall be surface treated for shipping.

The various items to be shipped shall be thoroughly cleaned before shipment so as to eliminate dirt, rust and grease, all welding slugs and spatters, and loose metals.

All metallic machined surfaces shall be covered with a protective coating. This coating shall be effective against salty air and shall be easily removable at site.

All iron or steel external surfaces shall be covered with two (2) coats of protective anti-rust paint.

All internal surfaces of tanks shall be coated with an easily washable corrosion preventive compound.

Piping, valves and other parts that have undergone hydraulic tests and which cannot be completely dried should be treated with water-absorbing corrosion inhibitor before the application of protective coating.

GW-11.3 Application of Paint

Before any painting is made, all surfaces must be prepared properly by removing all rusts, scales, welding slugs and spatters, grease and encrustation of any nature. Steel surfaces shall be white blasted in accordance with Steel Structures Painting Council Standard. The various paints to be used shall be of approved quality and type.

No painting shall take place outdoor during the presence of rain, fog, dew or where the surfaces may be otherwise damp; in particular and no application of paint should be made on plaster surfaces that are not completely dry. No coating shall be applied unless the surface is at minimum of 3°C above dew point.

For successive coats, first coat shall be dried hard before the second coat. The color of successive coats must be sufficiently different to allow easy identification of the sequence of painting of surfaces for control purposes.

Paint shall not be applied to machined surfaces, corrosion resistant materials or linings, unless otherwise specified in the relevant sections of the specifications.

All contact surfaces of field-welded connections shall be masked at a distance of 100 mm back from the weld joint and shall be suitably protected against corrosion.

For non-insulated surfaces exposed to high temperature two (2) coats of aluminum modified silicone with a volume solid of 42% \pm 2% high temperature paint shall be applied.

For internal surfaces for the receipt of oil, three (3) coats of paint having a phenolic-base or equivalent shall be applied. As minimum, first coat shall be applied with 80 microns DFT of zinc rich polyamide epoxy primer. Second and final coat shall be applied with 100 microns DFT polyamide

epoxy for each coat. External surfaces shall be painted with 80 microns DFT of zinc rich polyamide epoxy primer on first coat. On second coat, 160 microns FTF of intermediate chlorinated rubber shall be applied and 80 microns DFT chlorinated rubber topcoat as final coat.

All other equipment and piping shall be prime coated with 80 microns DFT zinc rich epoxy paint and 80 microns DFT of chlorinated rubber for each intermediate and top coat.

Exposed fabrication, erection, or shipping marks shall be cleaned off and the areas touched-up shall be painted to match the adjacent surfaces.

For surfaces where blast cleaning and a wash primer are specified, touch-up painting shall include application of the wash primer before the touch-up coats.

Equipment and auxiliaries which are shop-fabricated/assembled and have already been provided with final painting shall no longer require painting at the site except for painted surfaces which have been damaged during transport and/or installation works, shall require touch-up painting. Color of final painting shall be as designated and approved by NPC.

Final tests and inspection shall be carried out by the Supplier to ascertain the correspondence of the paintwork to the prescribed color and treatment. These tests will indicate whether or not the paintwork is correctly applied and is free from wrinkles or roughness which might affect the adhesion of the protective coating.

Should the measured dry film thickness result to less than the specified one, the Supplier shall apply additional paint to the coat inspected or shall increase the thickness of succeeding coat, as applicable, to assure the specified total dry film thickness.

GW-11.4 Hot Dip Galvanizing

The zinc protective coat shall be adherent, smooth and free from discontinuity and imperfections such as bubble, porosity, cracks, or other irregularities of the protective layer.

The thickness of applied layer shall correspond to a minimum rate of 600 gm/m² or as approved by NPC.

GW-12.0 SPARE PARTS AND TOOLS

The lists of Spares and Tools in a form to be filled up by the Supplier as specified in Part II - Technical Data Sheets, are preliminary and subject to changes to conform with the final design and model/brand of the proposed equipment (per manufacturer's standard).

The Bidder shall indicate "N/A" to the respective items in the said lists if found not applicable to the brand/model of the proposed equipment. However, NPC reserves the right to request the Supplier to provide the

same or its equivalent if it is determined to be "required or necessary" during the evaluation, checking and review/approval of the final lists to be submitted by the Supplier during the Contract Stage at no cost to NPC.

GW-12.1 Spare Parts

The Supplier must have an established local Service Center (Owned or Officially Accredited) with experienced technical personnel that will promptly and efficiently cater to the repair, maintenance and spare parts requirements of the supplied unit/s during the warranty period.

The Supplier shall supply, deliver and install as required (consumables are by supply and delivery only like filter elements, fan belts, lubricants, oils and coolants, injector tips, etc.) all the spare parts including labor and travel time necessary for replacement or repair works during the warranty period. The supply shall include all the spare parts specified in the specification and Technical Data Sheets, and all other replacement parts required to sustain the operation of all the DG sets during the warranty period. Quantity of specified/listed spare parts which are not sufficient and will require additional spares during the warranty period shall be provided by the Supplier at no cost to NPC.

Spare parts shall include all the items that are expected to be consumed or replaced during the test and commissioning stage and these shall be identified and submitted in the form as specified in the Spare Parts List in Part II – Technical Data Sheets. However, should the Supplier borrow any items from the supplied Spare Parts during the test and commissioning, a replacement shall be ordered immediately.

All the spare parts shall be delivered/arrived at the plant site before the start of test and commissioning, complete with markings showing the description or code numbers to facilitate identification and retrieval.

All spare parts shall be delivered into storage areas nominated by NPC and the delivery will be deemed to be complete when the packages have been opened by the Supplier, their contents checked by NPC, and articles reprotected and replaced by the Supplier to the satisfaction of such representatives or assembled into units at NPC's option and stored as directed by NPC. Damaged or incorrect item shall be replaced by the Supplier at his own cost.

All bidders are required to submit in their proposal the detailed list of spare parts to be supplied with its corresponding costs and in the form as specified in Part II – Technical Data Sheets. This list is preliminary and subject to changes in order to conform with the final design without any additional cost. The final list of spare parts shall be submitted to NPC for approval not later than one (1) month prior to the delivery of the equipment.

GW-12.2 Tools and Appliances

The tools and appliances recommended by the manufacturer and are deemed required for the following specific purpose of the equipment to be supplied under this Contract shall be provided by the Supplier including

tools that are specified below and in the relevant Electrical Works specifications. A complete detail shall be listed in the Schedule of Tools and Appliances and shall be submitted with the bid in the form as specified in Part II – Technical Data Sheets, of the bid document.

- a) One (1) set of special/standard tools and instruments required for start-up, test and commissioning, operation and normal/overhaul maintenance of the whole of the equipment and auxiliaries furnished by the Supplier.
- b) Any special tools or appliances required solely for erection purposes.

Special tools are defined as all tools required for installation, assembling, dismantling and adjustment of all the works and usually not available in a standard machine shop or retailing store.

Each tool or appliance is to be clearly marked with its sign for purposes of identifying the function of each tool and the specific item(s) for which it is used. Each set of tools and appliances listed above shall be fitted into a custom built lockable box clearly marked with the name of the item or equipment for which they are used and with a list of the tools contained, stamped and attached on an attached metal tab.

If the weight of any box, or its size, is such that it cannot be conveniently carried, it shall be supported on steerable rubber tired wheels. All large tools and wrenches shall be mounted on a suitable shadow board arranged for wall mounting.

Every special tool and instrument shall be accompanied or furnished with maintenance or instruction manuals in English language.

All tools and appliances supplied shall be handed over to NPC in perfect condition at the time of taking over.

All bidders are required to submit in their proposal the detailed list of special tools to be supplied in a form specified in Part II – Technical Data sheets. This list is preliminary and subject to changes in order to conform with the final design without any additional cost. The final list with the corresponding brochures/catalogues shall be submitted to NPC for approval not later than one (1) month prior to the delivery of the equipment.

GW-13.0 PACKING, SHIPMENT AND STORAGE

GW-13.1 Packing/Crating

The Supplier shall effect proper packing/crating to ensure that equipment and components are adequately protected from damage during shipment and subsequent storage. Utmost care shall be observed in packing/crating delicate equipment and electronic devices such as control panels, instruments, and other sensitive parts or components.

Equipment shall be completely drained of all water and thoroughly dry prior to shipment. When such draining requires removal of plugs, drain valves, etc., the Supplier shall make sure that these parts are re-inserted or reassembled prior to shipment. Other fluids (coolant, fuel oil, lube oil, etc.) shall be drained only if the Supplier deems it necessary.

All openings and machined surfaces shall be provided with protection to prevent damage, corrosion and entrance of foreign matter during shipment and storage.

Flanged connections shall be protected by a ½ inch (13 mm) or thicker plywood disc, or suitable alternate, bolted to the face of the flange.

Threaded or socket weld connections shall be protected with screwed or snap on type, securely held plastic protectors. Cast iron plugs are not acceptable for protection unless part of the permanent assembly.

Butt-weld connections shall be protected by wooden disks that cover the entire weld end area, and shall be secured by metal straps and fasteners.

Covers, straps or fasteners shall not be welded to equipment.

Equipment shall be adequately supported for shipment. All loose parts shall be crated or boxed for shipment and appropriately identified. Where shipment is braced internally, it shall be marked conspicuously, "*Remove internal braces before testing and operating*".

All large and heavy shipping units shall have suitable skids for moving. Crating shall also be adequate for lifting with slings. If location of slings is critical, these locations shall be marked accordingly.

As the shipment may be left in open storage at the designated place, the Supplier shall ensure that the delivered items have appropriate protection from water and other elements.

All delicate electrical and mechanical parts susceptible to damage from moisture shall be packed in hermetically sealed container or other approved containers within their packing cases, with all machined surfaces coated with a rust preventive compound. All sealed packages shall include bags of silica or equally moisture absorbing chemical. When electric space heaters are provided for that purpose, these should be wired to the outside of the equipment so that energization immediately upon receipt is possible without disassembly of crates, etc. This also requires that no combustible material be left inside the equipment.

All equipment belonging to the same system/skid shall be properly marked and packed in the same crate as much as practicable. The Supplier shall not mix equipment and parts of one system with another to avoid confusion during assembly.

Valves, including its bolts, nuts, and washers, shall be segregately packed and properly marked according to plant system, size, and number of pieces.

All temperature gauges, pressure gauges, switches, transmitters, and other instruments shall be properly marked and carefully packed so as not to break the associated glass and undue damage to the threaded portion.

All spare parts shall be packed in a sealed container including special and standard tools in their separate sealed toolboxes.

All packages, crate boxes, drums, bags, bundles, or other containers or any loose pieces shall carry the following identification marks on the two (2) sides in black with a stencil proof ink or paint by means of block letters not less than 30 mm high, i.e.



NATIONAL POWER CORPORATION

CONTRACT NO.	:	_____
ITEM NO.	:	_____
PORT OF DISCHARGE	:	_____
DESCRIPTION	:	_____
OF CONTENT	:	_____
NET WEIGHT	:	_____ kgs.
GROSS WEIGHT	:	_____ kgs.
DIMENSION	:	_____ m ³
CRATE NO.	:	_____

All packages shall be forwarded with a copy of packing list placed inside the package and another copy thereof contained in a waterproof envelope placed outside the package. The packing list shall give all information on the package such as package no., packing appearance, net weight, gross weight, dimension, measurement, and description of the equipment including storage and handling instructions with descriptions for periodic inspection and/or storage maintenance to ascertain that no deterioration will occur during storage.

Prior to shipment, the Supplier shall furnish NPC advance copies of all packing lists and other pertinent documents.

The Supplier shall employ methods that will warrant safe delivery of equipment to its ultimate destination, with careful consideration given to the type of commodity, method of transportation, destination, storage time, and storage facilities at point of destination.

GW-13.2 Shipment/Transport

The Supplier shall be responsible for the sea and land transportation of the equipment, materials and supplies required under this Specification and shall ensure that they are safely and timely delivered to the specified site. Supplier shall be deemed to have visited the plant site and other areas on the route of delivery, including port facilities, inter-island shipping facilities, island transport, access roads, bridges, railways and to have acquainted

themselves with all factors that will affect the cost of shipping and freight to Site.

Any damages to the roads, bridges, railways, ports, etc. arising out of neglect of Supplier shall be the responsibility of the Supplier. Likewise, any additional claim attributable to Supplier's lack of knowledge or understanding on existing conditions of the site shall not be given due credence.

The Supplier shall ship the materials and equipment on clear commercial bill of lading and the cost of all freight, insurance, shipping, handling and road transport charges shall be included in the Bid Price.

Upon arrival of equipment and materials at site, NPC and the Supplier or their authorized representatives, shall jointly verify the plant equipment to be stored at site following the steps below:

- a) Inspection and verification of the packing list;
- b) Visual inspection of the condition of the packing and its surfaces; and
- c) Partial opening of the crates and plastic sheet protection of the plant auxiliary equipment and DG sets to verify the content and its physical condition and to check pilferage or damage during shipment and storage.

A record shall be prepared carefully noting all eventual shortages, defects or damages, signed by the Supplier and concurred by NPC. All shortages and damages noted shall be immediately replaced by the Supplier at his own cost and shall ensure the timely delivery of replacement without affecting the agreed overall project implementation schedule.

The Supplier shall keep a proper store ledger carefully noting all movements of materials within the project site. NPC has the right of access to the ledger, which shall be kept by the Supplier on site at all times.

Shipment of equipment and materials to be supplied by the Supplier should be through carriers of Philippine registry. However, goods may be shipped by a carrier which is not a Philippine registry provided that a certification of its non-availability is issued by the nearest port authority within ten (10) calendar days from the date the goods are ready for shipment.

GW-13.3 Storage

The Supplier shall be responsible for securing all his supplied equipment at a place designated by NPC until the completion of the erection/installation and test. Any loss and/or damage of said equipment at said storage area shall be the responsibility of the Supplier.

If the equipment and materials to be supplied by the Supplier will not be immediately required for installation at the specified site/s, the materials and equipment shall be carefully stored and maintained at such place and in such a manner as NPC may direct until such time as they are ready for installation/erection.

If the Supplier desires to use any storage area other than those designated by NPC, he may do so at his own expense and subject to the approval of NPC.

Any part or auxiliary equipment which are exposed to the open and need to be protected from rain, dust or other elements that may result to damage and deterioration of said equipment, the Supplier shall provide with temporary tarpaulin or equivalent type of cover until they have been installed in their respective areas.

The Supplier shall treat the wooden equipment crates/packages and the soil under the equipment and immediate surroundings to make it impervious and toxic to subterranean termites, often referred to as white ants or "anay" by application of soil poison solutions. Materials to be used shall be a solution commonly used by licensed companies or entities engaged in pest control or pest eradication. Banned solutions must never be applied. Applications of the solution shall be in accordance with the manufacturer's recommendation.

GW-14.0 CLEAN UP

When the Works are completed and before the issuance of the Certificate of Completion is made, the Supplier shall remove from the Site, without expense to NPC, all temporary structures, all materials and rubbish of every sort, shall fill and dress all holes and cavities made for his convenience, and shall leave the whole area in good order and condition, all as required and directed by NPC.

GW-15.0 CERTIFICATE OF COMPLETION AND ACCEPTANCE

When all the works and services have been satisfactorily completed as required in the Contract, the Supplier may give notice to this effect to NPC. The notice shall be the basis for the issuance of Certificate of Completion in respect of the works within fifteen (15) days of receipt of such notice.

After the lapse of the warranty period, provided that there are no defects found and/or pending repair works (including completion of the required Supplier's Service Personnel Services specified in Clause GW-16.0 (Guarantee) as certified by the Plant Manager), NPC shall issue the Certificate of Final Acceptance.

GW-16.0 GUARANTEE

The Supplier shall guarantee that upon receipt of NPC's Notice of Request, he will promptly repair, and/or replace, at his own expense, equipment and machineries, against defect in design, workmanship and materials and shall include labor, parts and travel time for necessary repairs at the plant site effective from date of issuance of Certificate of Completion for a period of twelve (12) months.

However, if any DG sets or plant system/s has been put into commercial operation even before the issuance of the Certificate of Completion, the warranty period of the particular DG sets or plant system/s shall commence on the first day of the commercial operation. Commercial operation shall mean when generated loads are already exported to the grid/consumers following the successful performance/reliability tests. Accordingly, a Certificate shall be issued by the implementing group and/or plant head stating that the Warranty Period has started for the particular DG sets or plant system/s with the date stipulated thereon.

The Supplier shall also provide the services of the equipment Manufacturer/Supplier or his authorized local representative (a service technician who has complete knowledge of proper operation and maintenance of the DG sets) for a period of not less two (2) days in two (2) separate visits which will coincide on the first two (2) scheduled periods of preventive maintenance (every 250 hours or per manufacturer's recommended hours) of at least one DG set during the warranty period at no cost to NPC to perform the following, but not limited to:

- a) Checking/inspection of installed equipment;
- b) Conduct evaluation and assessment of operating parameters;
- c) Make necessary adjustment on instruments and controls;
- d) Perform/supervise necessary cleaning, repair, trouble shooting, parts replacement; and
- e) Provide training and/or informative instructions similar to items "a)" to "d)" above to NPC Plant Operation and Maintenance Personnel. Such training/instructions shall be conducted (Hands on) in such a way that NPC Plant O & M Personnel would be able to perform reliably and satisfactorily on similar DG sets supplied under this contract.

This shall include any maintenance/repair services rendered upon request of NPC in the event of any abnormality occurs within the warranty period. For minor repairs/replacements/adjustments as determined by the Supplier, plant maintenance personnel who had undergone training conducted by the Supplier may perform the necessary repairs/replacements/adjustments, if authorized by the Supplier through any means of available communications, provided that such repair shall not relieve the Supplier of its obligation under the contract if such repair is not done properly.

The guarantee period of twelve (12) months shall be exclusive of any downtime attributable to the Supplier. In case of DG sets downtime occurs during the warranty period due to fault of the Supplier, the downtime hours shall be added to the 1-year warranty period which shall start upon receipt by the Supplier of NPC's Notice of Request for Supplier's Repair Services. Hence, the warranty period is extended with the equivalent downtime attributable to the Supplier.

Provided further that the release of the warranty bond/security is without prejudice to terms provided by Clause GW-15 and shall be done after the warranty period plus downtime attributable to Supplier, if any as certified by the concerned end-user.

Accordingly, the warranty bond shall be extended.

In the event that undue delay is being caused by the Supplier for failing to attend the requested maintenance/repair services within ten (10) calendar days, NPC reserves the right to attend/complete the maintenance/repair services at the risk and cost of the Supplier. The decision of NPC in this regard shall be final. Accordingly, a penalty shall be charged to the Supplier as follows:

Penalty = Prevailing electricity rate in pesos per kW-day x DG set rated capacity x number of shutdown days counted from 11th day of Supplier's acknowledgement to NPC's request without action.

The Supplier guarantees that when the equipment and/or material are placed in operation and/or use, it will perform in the manner as set forth in the Contract.

GW-17.0 MEASUREMENT OF PAYMENT

Measurement for payment for all works shall be based on the bid price of each item as shown in the respective Schedule of Requirements. The cost shall cover all works required and described in the pertinent provisions of the specifications and for the satisfactory completion of each work.

Failure of the Supplier to submit the approved "As-Built" Drawings and "Operation and Maintenance" Manuals to NPC on the respective dates specified in Clauses GW-6.3.7 and GW-6.3.8, NPC shall withhold Five percent (5%) of contract amount from payments due to the Supplier.

PART I – TECHNICAL SPECIFICATIONS

AW – ARCHITECTURAL WORKS

SECTION VI – TECHNICAL SPECIFICATIONS**AW – ARCHITECTURAL WORKS****TABLE OF CONTENTS**

<u>CLAUSE NO.</u>	<u>TITLE</u>	<u>PAGE NO.</u>
AW-1.0	GENERAL ARCHITECTURAL REQUIREMENTS	1
AW-1.1	General	1
AW-1.2	Submission of Samples	1
AW-1.3	Substitution of Materials	1
AW-1.4	Certification of Materials	2
AW-1.5	Other works which even if not specifically mentioned in the Section and Schedule of Requirements shall be included:	2
AW-1.6	Measurement and Payment.....	3
AW-2.0	PREFABRICATED CONTAINER HOUSE	4
AW-2.1	General	4
AW-2.2	Work Scope.....	4
AW-2.3	Design Criteria for Prefabricated Container House	5
AW-2.4	Measurement and Payment.....	5
AW-3.0	PLUMBING FIXTURES AND FITTINGS	6
AW-3.1	General	6
AW-3.2	Make	6
AW-3.3	Trade Marks	6
AW-3.4	Fixtures	6
AW-3.5	Installation	6
AW-3.6	Toilet Accessories	7
AW-3.7	Measurement and Payment.....	7
AW-4.0	CONCRETE MASONRY WORKS.....	8
AW-4.1	General	8
AW-4.2	Materials.....	8
AW-4.3	Installation	9
AW-4.4	Concrete Lintel	9
AW-4.5	Testing of CHB	9
AW-4.6	Measurement and Payment.....	10
AW-5.0	PLASTERED PLAIN CEMENT FINISH.....	11
AW-5.1	General	11
AW-5.2	Materials.....	11
AW-5.3	Application.....	11
AW-5.4	Measurement and Payment.....	12
AW-6.0	PAINTING AND VARNISHING	13
AW-6.1	General	13
AW-6.2	Inspection of Surfaces	13
AW-6.3	Materials.....	13
AW-6.4	Colors and Samples	15
AW-6.5	Workmanship	15



AW-6.6	Protection	15
AW-6.7	Paint Application.....	16
AW-6.8	Painting Systems.....	18
AW-6.9	Measurement and Payment.....	20
AW-7.0	CONCRETE FLOOR HARDENER.....	21
AW-7.1	General	21
AW-7.2	Materials.....	21
AW-7.3	Measurement and Payment.....	21
AW-8.0	PLYWOOD CEILING BOARDS	22
AW-8.1	General	22
AW-8.2	Materials.....	22
AW-8.3	Sample.....	22
AW-8.4	Wood Framing.....	22
AW-8.5	Miscellaneous.....	22
AW-8.6	Construction	22
AW-8.7	Protection	22
AW-8.8	Measurement and Payment.....	23
AW- 9.0	ROOFING AND SIDING SHEETS.....	24
AW- 9.1	General	24
AW- 9.2	Materials.....	24
AW- 9.3	Workmanship	24
AW- 9.4	Measurement and Payment.....	24
AW-10.0	DOWNSPOUTS AND ROOF DRAINS	25
AW-10.1	Scope of Works	25
AW-10.2	Measurement and Payment.....	25
AW-11.0	SOIL TREATMENT	26
AW-11.1	General	26
AW-11.2	Material	26
AW-11.3	Application.....	26
AW-11.4	Measurement and Payment.....	26



SECTION VI - TECHNICAL SPECIFICATIONS

AW-1.0 GENERAL ARCHITECTURAL REQUIREMENTS

AW-1.1 General

The work to be done under this section shall include the furnishing of all labor, materials, equipment, tools, storage and stockyards of the pertinent materials and structural components and other incidentals for all architectural works enumerated hereunder, as shown on the accompanying drawings or as otherwise directed.

The work shall be performed and completed with high quality workmanship, in accordance with generally accepted modern practice in carpentry fenestrations, tinsmithing, plumbing, painting, landscaping and masonry work, etc. notwithstanding any omission from these Specifications or drawings.

Materials and structural parts that the Contractor shall supply and install, and which will be incorporated in the structure shall be new and unused. They shall be suitable for their intended purpose and appropriately matched to each other complying with all applicable regulations, quality and dimensions standards. Defective work is not acceptable.

AW-1.2 Submission of Samples

At least one (1) month before the start of any installation or application of materials, the Contractor shall submit samples of materials for all sections for evaluation and approval. No work shall be done until after samples are approved by the NPC Representative in writing. All work must strictly conform to approved samples as to quality, texture, color and finish.

Failure of the Contractor to comply with the preceding stipulation shall not entitle them of any extension of time nor any claim whatsoever for any delay in the work after rectification due to disapproval of work.

To avoid unnecessary delay, it is suggested that the orders and/or purchase of imported or local materials shall be made within sufficient period in order that adequate supply is available at any time when needed.

AW-1.3 Substitution of Materials

The Contractor shall submit a written request for substitution of materials in lieu of those specified when deemed very necessary and urgent. Such request shall indicate the reasons for substitution. No substitute material shall be used without written authorization from the NPC Representative.

The Contractor shall submit written request for substitution at least one (1) month before such materials are actually needed. Such request shall be accompanied by samples to be substituted and corresponding certification.



No price increase will be allowed for a better kind of material.

AW-1.4 Certification of Materials

The Contractor shall submit to the NPC Representative signed certificates from manufacturer or sole distributor of equipment and materials to be furnished and installed by the Contractor, certifying as to the kind, quality, rated capacity, quantity, performance and other descriptions of the equipment and materials delivered under a receipt number and date. No equipment or materials shall be erected, installed or applied such as electrical fixtures and accessories, concrete reinforcing steel, cement, G.I. and C.I. pipes, valves and fittings, plumbing and sanitary fixtures, building materials and finishes, paint and waterproofing, etc., without the required certificates.

AW-1.5 Other works which even if not specifically mentioned in the Section and Schedule of Requirements shall be included:

- The measurements for the execution and payment of the Works, including provisions of the measuring equipment and the engagement of labor
- Connecting up of water, gas and electricity from the mains of the site indicated by the NPC Representative to the points of use
- Provision of small equipment and tools
- Safeguarding the Works against surface water, which shall normally be reckoned with, and its possible necessary removal
- Protecting the Works from heat, wind and rain
- Protection and safety measures required
- Protecting the executed works and the items handed over the execution of same from damage and theft up to the time of acceptance
- Supplying of the operational materials
- Supplying of consumable stores
- Supplying of fitting dowels
- Supplying of simple type pipe covering, e.g., in the shape of pipe sheathings with corrugated cardboard and the like
- Supplying and fitting of pipe fastening elements, e.g., pipe clips, hangers, etc.
- Installing and dismantling as well as providing all framework and scaffolds
- Making blackouts on concrete
- Chemical preservation of timber
- Instructing the operating and maintenance personnel

NOTE: The above provisions are general for all types of buildings. The Contractor shall be guided accordingly by the applicable provisions in the specifications and what is shown in the drawings for each type.



AW-1.6 Measurement and Payment

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for various items of Architectural Works. Payment will be made at the corresponding pertinent pay items in the Schedule of Requirements. Payment shall constitute full compensation for all labor, materials, equipment, tools and incidentals necessary for the completion of each work.



AW-2.0 PREFABRICATED CONTAINER HOUSE**AW-2.1 General**

The specification covers the features and technical requirements for the supply, delivery and erection/installation of one (1) unit, 20ft. Prefabricated Container House. Other parts and accessories which are not specifically mentioned herein but are necessary for the proper assembly and erection of the staff house shall be included to be furnished.

All materials to be used and incorporated into the staff house shall be new and unused. They shall be suitable for the intended purpose and shall comply with all applicable regulations, quality, and standards.

The Supplier shall accept full responsibility for his work including design, performance qualifications, specifications, documentation, reports, fabrication, assembly, corrosion protection, shop testing, preparation for shipment, field testing, warranty provisions and compliance with the applicable codes and standards and the requirements of this Specification.

AW-2.2 Work Scope

The works and services to be performed by the successful bidder shall cover the supply, delivery, and complete erection/installation of one (1) unit, 20ft. Prefabricated Container House which shall essentially consist of but not limited to the following:

1. Moving-in including furnishing, installation, construction, operation and maintenance of general construction facilities.
2. Clearing and grading of the project site and disposal of all excess materials to designated areas.
3. Construction of reinforced concrete foundation including all required structural excavation, backfill and proper disposal of all excess excavated materials as per detailed drawings.
4. Supply and installation of one (1) unit twenty (20) feet Prefabricated Container House with the following specifications and fixtures:

Dimensions	6.0 meters length by 3.0 meters width by 2.7m height
Container Frame	Square tubing, 4 mm base metal thickness, pre-painted.
Wall Panels	50mm Polystyrene insulation with double-sided 0.45mm pre-painted GI sheet



Roof Panels	50mm Glasswool insulation with pre-painted GI sheet roof and interior ceiling
Flooring	MGO board with linoleum tiles
Windows (4 sets - 1.0m x 1.0m)	Aluminum sliding windows
Door (1 set - 0.80m x 2.1m)	Steel Door
Toilet & Bath (Control Room) (1 set - 1.20m x 1.20m)	Complete with fixtures & fittings, including ceramic floor and wall tiles, 0.60m x 2.1m PVC door, 0.50m x 0.50m aluminum awning window and plumbing

5. Application of touch up paint for scratch during installation.

6. Removal/clearing of all debris and waste/excess materials prior to demobilization.

AW-2.3 Design Criteria for Prefabricated Container House

The prefabricated container house shall be designed for the erection on the concrete foundation. All materials under these specifications shall be designed, constructed and erected in accordance with the requirement of the specification and codes of AISC, ASTM and other such regular published and accepted codes except were modified or supplemented by these specifications.

Wind load

The wind load shall be based on the latest edition of NSCP.

AW-2.4 Measurement and Payment

Measurement and payment for prefabricated container house will be based on the corresponding contract unit price (set) under the architectural work's Schedule of Requirements.

Payment shall be made at the contract unit price, which payment shall cover costs of furnishing all materials and labor including equipment and tools required to complete the work and all associated costs for site grading, foundation/ slab construction including transport to site.



AW-3.0 PLUMBING FIXTURES AND FITTINGS**AW-3.1 General**

The work covered by this section of the Specifications consists in furnishing all plant, labor, equipment and tools, articles, appliances and materials and in performing all operations in connections with the installation of all plumbing fixtures, fittings and accessories, complete, in strict accord with this section of the Specifications or indicated on the drawings, are included in this work.

AW-3.2 Make

The model numbers herein given intended to illustrate the quality and design of fixtures that will be required. American standard fixtures specified herein and any substitution made to any item of fixtures specified must first be approved by the NPC Representative.

AW-3.3 Trade Marks

All plumbing fixtures and fittings must bear the trademarks of the manufacturer.

Maintenance Manual shall be submitted including complete instructions for replacing valve washers and strainers and give manufacturer's recommendations as to cleaning finish fixture surfaces.

Submit samples of valves, faucets, trims, and others for approval of the NPC Representative.

AW-3.4 Fixtures

Water Closet – as shown in the drawings or as specified in the Schedule of Requirements

- a) Bibbs - Nickel Plated Copper or Brass Alloy
- b) Floor Drain - Stainless or Brass Alloy
- c) Clean-outs - Brass alloy

AW-3.5 Installation

Plumbing fixtures shall be installed free and open in a manner to afford access for cleaning. All brackets, cleat, plates, and anchors required to support the fixtures shall be furnished in a rigid manner. Water closets shall be sat on Boll-Wax.

Installed plumbing fixtures shall be kept clean and in working order for adequate protection so as not be used by anybody until issuance of Certificate of Completion.



All fixtures shall be provided with individual control stop so that each fixture may be separately controlled without affecting any other fixture.

All flush valves shall be equipped with vacuum breaking devices.

AW-3.6 Toilet Accessories

- a) Soap Holders – colored, vitreous China to match fixtures quality, brand and wainscoting color.
- b) Tissue Paper Holder - colored, to follow Water Closet brand and quality. Provide and fit, ready for use, on the most convenient side of the wall inside each water closet compartment, 750mm (30") above the finish floor.
- c) Liquid Soap Dispenser

AW-3.7 Measurement and Payment

Measurement and payment for **Plumbing Fixtures** will be based on the number of sets/pieces installed and accepted by the NPC Representative.

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for plumbing fixtures. Payment will be made at the corresponding pertinent pay item under architectural works in the Schedule of Requirements. Payment shall constitute full compensation for all labor, materials, equipment, tools and incidentals necessary for the completion of this work.



AW-4.0 CONCRETE MASONRY WORKS**AW-4.1 General**

The work to be done under this section shall include the furnishing of all labor, materials, equipment, tools and other incidentals to complete the work.

Concrete masonry units of the type and thickness indicated shall be provided and shall be properly coordinated with the work of other trades. The source of supply for material which will affect the appearance of the finished work shall not be changed after the work has started.

Masonry units shall be handled with care to prevent chipping and breakage. Storage piles shall be so located as to avoid being damaged by construction operations and traffic. Cement and lime shall be stored off the ground under watertight cover until ready for use. Damaged materials shall be rejected.

AW-4.2 Materials

Concrete Hollow Blocks shall be of standard manufacture, machine-vibrated, fine and even textured and well-defined edges.

Unless otherwise shown on the drawings, concrete hollow blocks to be used shall conform to the requirements of ASTM Specification C-129 Minimum Compressive Strength of not less than 4.48MPa average of the fine specimens.

Mortar Proportions:

Cement mortar for laying concrete hollow blocks shall consist of one (1) part Portland cement, one-fourth (1/4) part lime and three (3) parts sand. Only sufficient water to make a workable mix will be permitted.

- a) Masonry grout for filling cells of concrete blocks shall consist of one (1) Portland cement, one-fourth (1/4) part lime, three (3) parts sand to which three (3) pea gravel is added by volume. Mortar materials shall be accurately measured by volume and thoroughly mixed until evenly distributed throughout the batch mechanical mix. The actual mixing time shall not be less than two minutes.
- b) Intersecting hollow blocks walls and partitions shall be bonded by overlapping units on alternative course or by the use of 6.3mm (1/4") diameter ties at 610mm (24") O. C. every second course (maximum) anchored in filled cells.

Concrete lintel beams shall extend 305mm (12") beyond both sides of the opening and reinforced with four 12.7mm (1/2") bars placed over and below window openings.

- a) Concrete studs, reinforced with one 12.7mm (1/2") diameter bar, shall be placed at both sides of all window and door openings.



- b) All horizontal reinforcement shall be tied to vertical reinforcement.
 - c) Reinforcement shall be as specified in Section "Structural Steel".
- Cement shall be Portland cement of approved brand conforming to ASTM Specifications C150, Type I or Type IP.
- a) Lime shall be made with pulverized and quicklime or with hydrated lime.
 - b) Sand shall be clean, washed and free from deleterious substances.
 - c) Water for mixing shall be clean and potable.

AW-4.3 Installation

Laying of all masonry units shall be plumbed, leveled and accurately spaced. All units shall be wetted before laying. The block should be laid on full mortar bedding and in such a way that no cracks are formed between the blocks and the mortar at the time the blocks are placed. All joints should be filled with mortar at the time it is laid. Any horizontal and vertical CHB wall reinforcements shall be anchored to concrete works by means of 10mm (3/8") by 609mm (24") long dowels. Embedding of anchor bolts, expansion shields, conduits, etc. shall be done as the erection progresses.

Cutting and patching of masonry required to accommodate the work of other trades shall be performed by masonry mechanics.

Finishing of all hollow block wall surfaces to be applied with cement plaster will be cleaned and evenly wet slashed with a wash of neat cement and sand followed by 1:2 cement mortar mix 10mm (3/8") thick which shall be applied with a wooden float.

AW-4.4 Concrete Lintel

Unless otherwise indicated, provide concrete lintels over all openings in concrete unit masonry walls. Lintels shall be cast-in-place and reinforced with longitudinal bars at the bottom, and of sizes as indicated on the plans. Concrete works shall conform to Concrete Works of these Specifications.

AW-4.5 Testing of CHB

Test samples from every 500 units shall be taken at random from the CHB to be used before installation. The testing shall be performed by a laboratory approved by the NPC Representative and the cost thereof shall be charged to the account of the Contractor. Concrete hollow blocks represented by such samples, failing to meet the requirements under the latest edition ASTM 6129 shall be rejected.



AW-4.6 Measurement and Payment

Measurement and payment for **Concrete Hollow Blocks** including its reinforcing bars will be based on the area in place and accepted by the NPC Representative.

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for concrete masonry works. Payment will be made at the corresponding pertinent pay item under architectural works in the Schedule of Requirements. Payment shall constitute full compensation for all labor, materials, equipment, tools and incidentals necessary for the completion of this work.



AW-5.0 PLASTERED PLAIN CEMENT FINISH**AW-5.1 General**

The work to be done under this section includes furnishing of all labor, materials, equipment and other facilities and the satisfactory performance of all work necessary to complete all cement plaster finish.

Plaster mixture is applied in layers to masonry and reinforced concrete, surface to interior or exterior walls and ceilings.

AW-5.2 Materials

- a) Portland cement conforming to the latest edition of ASTM Standards C-150.

Lime - Slaked quicklime or hydrated lime to make lime putty.

Sand - Natural sand, white or light grey, washed and cleaned, strong and free from injurious amount of dust and flaky particles.

Water - Clean and fresh contains no salt, potable and free from sulfur oil and other impurities that may cause discoloration of the finish.

- b) Accessories for plaster work, includes nails, picture, moulds, casings, window stools, bases, etc.

AW-5.3 Application

The total thickness of masonry and plaster shall be 15mm (5/8"). For a three-coat plastering, the scratch coat and brown coat shall be at least 6.3mm (1/4") thick and the hard finish 3.2mm (1/8") thick with a minimum thickness of 1.6mm (1/16") at any point. For a two-coat work the base shall be 12.7mm (1/2") thick and the hard finish the same as for a three-coat work.

The lath for plastering shall be leveled, plumb and well secured to the backing material. The leveling elements installed would include grounds and screeds. For walls, a screed shall be installed at the base of the wall with its top about 102mm (4") above finish floor. The screed is run horizontally, leveled and set at the exact thickness of finished plaster. Around all openings and the intersection with the ceiling grounds are installed.

All anchorage for cabinets, furniture, stair, handrails, electrical outlets, etc., should be installed before plastering is started.

All internal corners should be reinforced by lapping wire lath.

Mixture for various coats should be checked to see that proportions are correct.

Manufacturer's directions for applying the various types of plaster should be followed scrupulously. The NPC Representative should check whether they conform to end use of the plaster.



AW-5.4 Measurement and Payment

The measurement for payment for all **Plaster Plain Cement Finish** will be based on the area applied and accepted by the NPC Representative.

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for plain cement finish. Payment will be made at the corresponding pertinent pay item under architectural works in the Schedule of Requirements. Payment shall constitute full compensation for all labor, materials, equipment, tools and incidentals necessary for the completion of this work.



AW-6.0 PAINTING AND VARNISHING**AW-6.1 General**

The work to be executed under this section shall include the furnishing of all materials, labor, tools and ladders, scaffolding and other facilities necessary for the satisfactory performance of all work necessary to complete all painting and finishing of all surfaces throughout the interior and exterior of the building, except as otherwise specified.

The Contractors, providing the labor, materials or both for this project are specifically referred to the General Contract plans, to the General Conditions of the specifications, to all the Sections of the Specifications and to the various other sub-contract documents which may affect the completion of any sub-contract work. In the absence of a complete agreement between sub-contractors, supply dealers or others affected by the construction of this project, the General Contractor shall be held responsible for the co-ordination of all the work.

The Contractor shall examine all sections of this specification and perform all paintings called for therein.

All woodwork in ceiling, partitions, handrails, cabinet work, grill work, mouldings and others as specified by the NPC Representative shall be painted/varnished.

AW-6.2 Inspection of Surfaces

Before starting the work, the Contractor shall inspect all surfaces to be painted. If the surfaces cannot be put in proper condition to receive paint by customary cleaning methods or sanding or sparkling, the Contractor shall notify the NPC Representative in writing. The NPC Representative will cause these defects to be reminded. The commencing of the work by the Contractor indicates his acceptance of the surfaces to be painted and assumes responsibility for the rectification of any unsatisfactory finishing, resulting from his negligence.

AW-6.3 Materials

All paint materials shall meet the requirements of the Philippine National Standard Specifications for Paintings.

Paints shall be brought to the Site in tightly closable, convenient, original containers, if nothing to the contrary is stipulated in the Specifications. The containers shall be marked in a durable manner with the following particulars:

- Maker
- Paint and relevant thinner
- Gross and net weights
- Date of supply by the maker's factory



The openings of the containers shall leave enough room for a stirring appliance.

All containers shall be kept tightly closed until the contents are to be used. Immediately prior to use of the contents and before pouring into smaller containers for working purposes, any skin shall be removed and the contents stirred thoroughly, if necessary, with a stirring appliance.

Paints, thinners and filling cements which are not required for immediate use shall be protected against the action of frost and heat.

Only thinners supplied by the makers of the paint or those described by them as suitable shall be use for adjusting paints to working consistency. The instructions of the maker shall be followed in this respect.

Paint and filling cements shall be used in accordance with the maker's instructions.

The Contractor shall obtain from the manufacturer and shall submit to the NPC Representative a paint manufacturer's guarantee for the quality of each painting material and that each coat of paint is compatible with previous and subsequent coats.

Paints which do not have to be prepared by mixing several constituents just prior to use shall be brought to the Site in such a state of readiness that they need only be adjusted to brushing or spraying consistency to meet the relevant working conditions (e.g., temperature), by adding the particular thinners in accordance with the maker's instructions.

With the exceptions of ready-mixed materials in original containers, all mixing shall be done at the job site. No materials are to be reduced or changed except as specified by the Manufacturer of said materials.

The quality of the paints shall be such that they form no solid sediment and at most a slight skin in unopened original containers within 6 months - calculated from the marker's delivery date. A paint which has formed a solid sediment or more than just a slight skin in the unopened original containers by the time of use or which cannot be processed satisfactorily shall not be used. A sediment shall be regarded as solid if it cannot be dispelled quickly and completely by stirring.

The use of white zinc (lithophones) will not be allowed.

A place will be designated by the NPC Representative for the storage of paint materials and tools. Whenever it may be necessary to change the location of this storage place, the Contractor shall promptly move to the newly designated place. The storage space floor shall be adequately protected from damage and from paint. Paint shall be covered at all times, safeguards taken to prevent fire.



AW-6.4 Colors and Samples

All colors shall be subjected to the approval of the NPC Representative. Tinting of matching colors shall be done under the supervision of the NPC Representative. In all cases, a sample shall be applied on the job and the

NPC Representative must give his approval before work is commenced. If required, three panels, 200 mm x 250 mm (8" x 10") of each color and finish shall be prepared in advance, with the NPC Representative. "Of color selected" shall be understood as all coats specified herein.

AW-6.5 Workmanship

All work shall be done by skilled mechanics with high quality workmanship. All paints shall be evenly applied so as to be free from sags, runs, crawls or other defects. All painting materials shall meet the requirements of stress and shall be in accordance with the relevant standards. All coatings shall be of proper consistency and well brushed out so as to show the minimum of brush marks, except varnish and enamel which shall be uniformly flowed on. All brushes shall be clean and in good condition, with heavy brushes preferred. Light brushes shall not be permitted.

Paint shall be thoroughly stirred so as to keep the pigment evenly in suspension when paint is being applied.

No painting shall be done under conditions that are unsuitable for the production of good results. No oil painting shall be done in damp weather.

Application of succeeding coats shall strictly follow the over-coating times specified by the paint manufacturer. If no specific data are available, all coats shall be thoroughly dry before painting shall be applied. At least twenty-four (24) hours shall be allowed between coats. Exterior painting under damp/wet conditions is not allowed.

Painting coat as specified are intended to cover the surfaces perfectly, if surfaces are not fully covered, further coat shall be applied to attain the desired evenness of the paint application.

All parts of moldings and ornament shall be left clean and true to details. All finish shall be uniform as to sheen, color and texture, except when glazing is required.

AW-6.6 Protection

The Contractor shall protect the work of all other trades against damage or injury by his employees, or by his materials, tools or utensils used in connection with this contract. Any damage done by him shall be repaired at his own expense, without additional compensation beyond the contract price.



The Contractor shall note that some damage to paintwork during shipment, storage, and building-in and particularly during grouting of the steel lining is unavoidable and the application of all protective treatment shall be programmed accordingly. Care shall be taken to remove salt crystal liable to become deposited during the sea transport and/or storage at seaport by thorough washing with clean fresh water. Before any coat of paint is applied, the surface shall be prepared as hereunder described, so that it is clean and free from all deleterious matter and completely dry.

The Contractor shall be responsible for the complete shop and field coats. Shop coats shall be checked for good quality and where necessary, before proceeding with the painting or coating operations at Site, the Contractor shall clean and repair, including smooth trowel, all shop coats which are defective or damaged.

Protect all parts of the building from paint drops by using clean drop cloths and remove all paint inadvertently placed or dropped on exposed surfaces without damage to same. Close various spaces while painting and exclude dust until finish is dry.

Plumbing systems shall not be used to wash paint brushes or containers.

Temporary or permanent welding shall not be permitted on areas where the welding will damage paint or other protective coatings, unless the areas of coatings which would be damaged thereby are accessible for repairing and inspection. Materials which have been painted shall be handled with care and protected as necessary to preserve the coating in good conditions.

AW-6.7 Paint Application

Materials, which are subject to working instructions, shall be treated according to these instructions, unless stipulated differently by the relevant paint manufacturer:

Paint, gloss and coating may be worked manually or by machines, unless a particular execution has been stipulated in the Specifications.

Paint, gloss and coat shall be bond firmly and be of even surface without scars and strips.

The surface shall be smooth, if not otherwise stipulated in the Specifications, such as finely or coarsely granulated.

Any paint, gloss or coating shall be applied without filling to create a uniform surface or, when gloss is being applied, a flowing surface with the required materials according to instruction manuals, of white or light shade, unless otherwise stated in the Specifications.

Top finish shall be high gloss, unless otherwise stated in the Specifications.

If flat levels are to be formed, the prime coated surfaces shall be completely being covered with suitable undercoat filler ribbed and smoothed.



Primer protective coating shall be applied on woodwork according to manufacturer's instruction. If several coats are requested, the preceding coat shall need to be dried before applying the subsequent one. This does not apply for wet-on-wet techniques.

Drying periods prescribed by the manufacturer shall be observed, for open surfaces, as well as for edges or irregular surfaces. All edges at doors, windows, skirting, sockets, etc., shall be of sharp and straight line.

New concrete and masonry surfaces must be thoroughly naturalized either by brush or spray with a solution of 2 kg. of zinc sulfate to each gallon of water.

Surfaces so treated shall be tested to ascertain that alkalinity is removed; otherwise a second treatment with the same solution shall be applied. Within 24 hours after drying, all crystals on the surface must be brushed off applying the prime coat.

Metal works shall be kept clean and free from corrosion following installation. Abraded surfaces shall be retouched prior to finish painting, using the same type of paint as prime coat. Galvanized metals shall be weathered or pickled with the approved metal primer in accordance with printed instruction of the manufacturer.

Where components parts of steel or aluminum alloys meet, joints shall be sealed so that no moisture can penetrate between the contact surfaces.

Rivet and bolt heads, protruding corners, sharp section edges and places of difficult access shall be pre-treated.

The paint shall be applied in coats which are as uniform as possible.

The first priming coat shall be applied by brush. Further coats shall be applied by brush if nothing to the contrary is stipulated in the Specifications. Smaller and specially shaped brushes shall be used for rivet and bolt heads, protruding corners, sharp section edges and places of difficult access.

When applying paints by spray-gun, the object to be sprayed shall not be contaminated by water or oil in the compressed air.

In paint systems involving coats, the various coats of paints shall be distinguishable from each other by their shade.

All coats of paint shall be applied only to clean, dry and non-greasy surfaces. In multi-coat paint systems, the coat last applied shall always be sufficient dry, free from any superficial moisture and from dust and dirt before applying the next text coat; only when using the moist oil type of paints may it be necessary for the previous coat to be hard dry.

The Contractor shall inform the NPC Representative in good time before starting to apply the next coat so that the NPC Representative shall have the opportunity of approving the previous coat.



Painting work shall not be carried out at a temperature below +5 °C and above 50 °C. In addition, painting work shall not be carried out on surface affected by the action of rain, fog and moisture or water of condensation; work started on such surfaces may not be continued until the surfaces to be painted are completely dry.

AW-6.8 Painting Systems

All surfaces which are required by the Finish Schedules or specifications to be painted, or otherwise finished, shall be given coats of paints or varnish as specified herein. Individual directions printed on the label of the approved paint and varnish shall be strictly followed. Paint thinner or linseed oil of the same brand as the paint to be thinned shall be used.

All materials, supplies and articles furnished shall be the standard products of superior quality. All constituent materials shall conform to the applicable provisions of the latest edition of ASTM Specifications.

The following list indicates painting materials of special compositions considered suitable for various parts of the works.

Concrete and Plastered Surface

Any concrete, cement plaster exposed to high humidity 3 coats of a highly weather-resistant synthetic resin-based paint. The first coat shall contain from 5% to 20% thinner as the surface requires.

All concrete (walls, foundations, etc.) backfilled with soil or submerged.

- 1 coat of coal-tar epoxy.
- 2 coats of a mineral-filled water-resistant coat-tar epoxy.

Concrete, cement plaster, etc. exposed to oil, surface shall be dry, if possible sandblasted, clean and slightly roughened.

- 1 coat with a plastic-modified hydraulic mortar.
- 2 coats of an oil-resistant synthetic resin-based paint.

Concrete exposed to Mechanical and Chemical attack.

- 1 coat of colorless 2- pack epoxy-based paint; this shall contain from 10% to 20% thinner as the surface requires.
- 2 coats of 2-pack epoxy-based paint.

Concrete flooring exposed to mechanical wear and oil.

- 3 coats of chlorinated rubber-based paint. The first coat shall contain 15% thinner.

Internal concrete, plastered walls exposed to abrasion.

- 3 coats of an oil-free, synthetic resin-based, dust-binding paint.



Concrete flooring subject to minor mechanical wall.

- 2 coats of an oil-free, synthetic resin-based, dust-binding paint.
- Internal plastered ceilings and walls.

- 2 coats of a polyvinyl-acetate dispersion type, non-chalking paint. First coat shall contain up to 30% thinner of clean, fresh water as the surface requires.

Wooden Surfaces

a) Exterior Parts – N/A

b) Surface shall be smoothed down with adhesive; if machine sanding is involved, a sanding is involved, a sanding sealer to bind the fibres shall be applied; the surface shall also be dry and free from dust.

- 1 coat of fungicide and bactericide ingredients after first coat.
- 2 coats of synthetic resin-based lacquer with white active pigments.

c) Interior Parts - Application of varnish on wooden interior walls, partitions, T&G ceiling panelling and closets/cabinets.

All materials, supplies and articles furnished shall be the standard products of a known manufacturer approved by the NPC Representative.

- 1) First Coat. Fill open grained wood with natural wood paste fillers, as is, or mixed with oil-wood stain to obtain desired shade. Apply along the grain within 30 minutes. Let dry overnight and sand lightly.
- 2) Second Coat. Apply any one (1) of the colors of oil-wood stain: oak, walnut, marble, and mahogany. Dry overnight and sand lightly.
- 3) Third Coat. Spray required coats of lacquer sanding sealer. Let dry for 30 minutes and sand to smooth.
- 4) Choice of any of the following topcoats:
 - Clear flat lacquer - for standard flat effect.
 - Clear dead flat lacquer - for complete flat lacquer.
 - Super dead flat lacquer - for complete flat lacquer.
 - Clear gloss lacquer - for standard gloss effect.
 - Water white gloss lacquer - for brilliant crystal-clear effect.
 - Versatile spar varnish - for glossy thick coating also applicable for exterior wood surfaces.



When spraying under high humid conditions, add up to ten per cent (10%) by volume of lacquer thinner retarder to prevent blushing of lacquer products.

Steel Surfaces

Details are given General Technical Requirements.

AW-6.9 Measurement and Payment

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for painting. Payment will be made at the corresponding pertinent pay item under architectural works in the Schedule of Requirements. Payment shall constitute full compensation for all labor, materials, equipment, tools and incidentals necessary for the completion of this work.



AW-7.0 CONCRETE FLOOR HARDENER**AW-7.1 General**

The work under this section shall be undertaken by skilled tradesmen experienced with this kind of work. The work to be done shall consist of furnishing all labor, materials and provision of tools and equipment necessary to complete the application of Floor Hardener.

AW-7.2 Materials

Floor hardener shall be non-metallic a mixture of especially graded mineral aggregates crushed and sieved to produce sharp granules. It should be extremely hard and must be highly resistant to abrasion, impact, chemical and acid, attack and will not oxidize under any circumstances. It should be non-metallic and must be a mixture of graded Silicon Carbide and Aluminum Oxide Aggregates.

AW-7.3 Measurement and Payment

Measurement and payment for **Concrete Floor Hardener** will be based on the area placed and accepted by the NPC Representative.

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for concrete floor hardener. Payment will be made at the corresponding pertinent pay items under Architectural Works in the Schedule of Requirements.

Payment shall constitute full compensation for all labor, materials, equipment, tools and incidentals necessary for the completion of this work.



AW-8.0 PLYWOOD CEILING BOARDS**AW-8.1 General**

Consist of furnishing of all labor, materials and other facilities for the satisfactory of all work necessary to complete the marine plywood ceiling.

AW-8.2 Materials

Thickness of plywood boards shall be as indicated on the drawings, marine, rotary cut, tanguile or dao. Sheets shall be nailed to ceiling nailers/joists at 150mm (6") on center.

AW-8.3 Sample

Samples must be submitted to the Contracting Officer for approval as to quality.

AW-8.4 Wood Framing

Framing shall be 50mm x 76mm (2" x 3") tanguile ceiling joists at 1200mm O.C.B.W. and 50mm x 50mm (2" x 2") nailing strip at 400mm o.c.b.w. or as indicated on the drawings.

AW-8.5 Miscellaneous

Fastener shall be smooth shank, zinc - coated, common wire nails of local manufacturer.

Glue shall be resorcinol formaldehyde synthetic resin.

Putty shall be of the color to match wood finish where exposed and shall be subject to approval of the Contracting Officer.

AW-8.6 Construction

All rough carpentry work, ground centering, blocking, etc., shall be in accordance with detailed drawings or recognized carpentry standards.

The Contractor shall rigidly construct all wood framing true to lines, levels and dimensions. Nails and other anchorage shall be in accordance with good practice.

Miter external molded members and cope internal corners.

No hammer mark or any other unsightly marks shall be made on any exposed wood face.

All lumbers that will come in contact with concrete and masonry shall be coated with asphalt.

AW-8.7 Protection

The Contractor shall be held accountable from the damaged materials caused by negligence mishandling.



AW-8.8 Measurement and Payment

Measurement for payment for **Plywood Ceiling Boards** will be based on the area installed and accepted by the NPC Representative.

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for plywood ceiling works. Payment will be made at the corresponding pertinent pay item under architectural works in the Schedule of Requirements. Payment shall constitute full compensation for all labor, materials, equipment, tools and incidentals necessary for the completion of this work.

Payment shall constitute full compensation for all labor, materials, equipment, tools and incidentals necessary for the completion of the work.



AW- 9.0 ROOFING AND SIDING SHEETS**AW- 9.1 General**

The Contractor shall furnish all labor, materials, and operations including tools, other implements and accessories for the complete installation of roofing sheets wherever indicated in the drawings.

Installation shall be performed by skilled workmen in accordance with the construction and shop drawings and the manufacturer's standard.

Shop drawings and manufacturer's catalogue showing product standards and technical data will be provided by the Contractor to the NPC Representative for approval.

AW- 9.2 Materials

Material for roofing shall be UPR-250 pre-insulated composite roofing panel (25mm thick) or approved equal. Effective width is 1m and with base metal of 0.60mm thick for Top Metal Skin and 0.40mm thick for Bottom Metal Skin. Bended sheets such as flat barge caps, flashings, ridge rolls, capping, moldings and gutter must be 0.6mm thick.

AW- 9.3 Workmanship

Installation of the roofing shall be done by the manufacturer or his authorized installer in strict accordance with the specification of the manufacturer.

AW- 9.4 Measurement and Payment

Measurement and payment for **Roofing and Siding Sheet** will be based on the projected area inspected and accepted by the NPC Representative. No measurement & payment will be made on hidden areas covered by side & end overlaps, the cost for these being included in the projected area.

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for roofing and siding sheet. Payment will be made at the corresponding pertinent pay item under architectural works in the Schedule of Requirements. Payment shall constitute full compensation for all labor, materials, equipment, tools and incidentals necessary for the completion of this work.



AW-10.0 DOWNSPOUTS AND ROOF DRAINS**AW-10.1 Scope of Works****a) Downspouts**

Downspouts shall be 150 mm diameter unplasticised PVC, or as indicated in the drawings complete with fittings and accessories down to the catch basin and water storage tank.

b) Roof Drain

Roof drain shall be of high grade, strong, stainless. Casting shall be free from blowholes, porosity hard spots, excessive shrinkage, cracks, or other injurious defects shall be smooth and well cleaned both inside and outside and all fin sand roughness removed. Roof drains shall conform to the diameter of downspouts. Roof drains shall be provided at the upper end of all downspouts.

AW-10.2 Measurement and Payment**a) Downspouts**

Measurement for payment will be based on the length installed and accepted.

b) Roof Drains

Measurement for payment for Roof Drain will be based on the number of sets installed and accepted.

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for downspout and roof drains. Payment will be made at the corresponding pertinent pay item under architectural works in the Schedule of Requirements. Payment shall constitute full compensation for all labor, materials, equipment, tools and incidentals necessary for the completion of this work.



AW-11.0 SOIL TREATMENT**AW-11.1 General**

The work to be done under this Section shall include all labor, materials, tools and equipment necessary for soil treatment.

The Contractor shall treat the soil under the building and immediate surroundings to make it impervious and toxic to subterranean termites, often referred to as white ants or “anay” by application of soil poison solutions.

AW-11.2 Material

Material to be used shall be a solution commonly used by licensed companies or entities engaged in pest control or pest eradication. Banned solutions must not be applied.

AW-11.3 Application

The application of solutions follows the sequence of construction and the following are the order treatment:

- a) Thoroughly saturate every linear meter of excavation for footings and other cement work.
- b) After grading and leveling the soil in the ground and layers of gravel laid preparatory to the pouring of concrete, flood or soak every square floor area.
- c) As soon as the building is constructed, just prior to the landscaping of the lawn and garden, saturate every linear meter perimeter of the building, about three (3) meters wide, with the termite proofing solution.
- d) Treat earth fills thoroughly as they may carry termite colonies. As soon as the fill is packed and leveled, saturate every one square meter area with 4 liters of the termite-proofing solution.

An ordinary watering can (sprinkling can) can be used to saturate or saturate areas with the termite-proofing solution. However, for convenience and thorough and faster application, use a power sprayer with 3 to 5 gallons per minute capacity.

AW-11.4 Measurement and Payment

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for soil treatment. Payment will be made at the corresponding pertinent pay item under architectural works in the Schedule of Requirements. Payment shall constitute full compensation for all labor, materials, equipment, tools and incidentals necessary for the completion of this work.



PART I – TECHNICAL SPECIFICATIONS

CW – CIVIL WORKS

SECTION VI – TECHNICAL SPECIFICATIONS**CW – CIVIL WORKS****TABLE OF CONTENTS**

<u>CLAUSE NO.</u>	<u>TITLE</u>	<u>PAGE NO.</u>
CW-1.0	GENERAL CONSTRUCTION FACILITIES	1
CW-1.1	SCOPE	1
CW-1.2	MOVING-IN	1
CW-1.3	SUPPLIER'S CAMP FACILITIES	1
CW-1.4	WATER SUPPLY	1
CW-1.5	SEWERAGE DISPOSAL AND SANITATION	2
CW-1.6	FIRE PROTECTION	2
CW-1.7	CONSTRUCTION POWER.....	2
CW-1.8	CAMP SECURITY	2
CW-1.9	CONSTRUCTION MATERIAL STORAGE	2
CW-1.10	REMOVAL OF CAMP AND CONSTRUCTION FACILITIES	3
CW-1.11	MEASUREMENT AND PAYMENT	3
CW-2.0	CARE OF WATER DURING CONSTRUCTION	4
CW-2.1	SCOPE	4
CW-2.2	DRAINAGE AND DEWATERING.....	4
CW-2.3	MEASUREMENT AND PAYMENT.....	4
CW-3.0	ENVIRONMENTAL REQUIREMENTS FOR CIVIL WORKS.....	5
CW-3.1	SCOPE	5
CW-3.2	GENERAL CONDITIONS	5
CW-3.3	MEASUREMENT AND PAYMENT.....	6
CW-4.0	SITE GRADING	7
CW-4.1	SCOPE	7
CW-4.2	CLEARING, GRUBBING AND MISCELLANEOUS WORK.....	7
CW-4.2.1	CLEARING AND GRUBBING.....	7
CW-4.2.2	MISCELLANEOUS WORKS	7
CW-4.3	GRADING.....	7
CW-4.3.1	GENERAL	7
CW-4.3.2	CLASSIFICATION OF MATERIALS	7

SECTION III – TECHNICAL SPECIFICATIONS

LuzP22Z1435Se

CW-4.3.3 STRIPPING	8
CW-4.3.4 EXCAVATION AND FILL	8
CW-4.3.5 SLIDES	9
CW-4.3.6 SLIP-OUTS.....	9
CW-4.4 DISPOSAL.....	9
CW-4.5 SOURCES OF FILL MATERIALS.....	9
CW-4.6 ENVIRONMENTAL REQUIREMENTS.....	9
CW-4.7 MEASUREMENT AND PAYMENT.....	10
CW-4.7.1 CLEARING AND GRUBBING.....	10
CW-4.7.2 MISCELLANEOUS WORKS	10
CW-4.7.3 STRIPPING	10
CW-4.7.4 GRADING EXCAVATION.....	10
CW-4.7.5 GRADING FILL.....	10
 CW-5.0 STRUCTURAL EXCAVATION, FILL AND BACKFILL	11
CW-5.1 SCOPE	11
CW-5.2 MATERIALS	11
CW-5.2.1 STRUCTURAL EXCAVATION.....	11
CW-5.2.2 STRUCTURAL FILL.....	11
CW-5.2.3 SPECIAL FOUNDATION, IF ANY	12
CW-5.2.4 STRUCTURAL BACKFILL	12
CW-5.3 CONSTRUCTION.....	12
CW-5.3.1 EXCAVATION	12
CW-5.3.2 STRUCTURAL FOUNDATION FILL.....	13
CW-5.3.3 SPECIAL FOUNDATIONS.....	14
CW-5.3.4 BACKFILL	14
CW-5.4 MEASUREMENT AND PAYMENT.....	14
CW-5.4.1 STRUCTURAL EXCAVATION.....	14
CW-5.4.2 STRUCTURAL FOUNDATION FILL.....	15
CW-5.4.3 SPECIAL FOUNDATIONS.....	15
CW-5.4.4 STRUCTURAL BACKFILL	15
CW-5.4.5 TRENCH EXCAVATION AND BACKFILL FOR SEWERAGE, DRAINAGE AND WATER SUPPLY PIPES AND CABLE TRENCH.....	16
 CW-6.0 CONCRETE	16
CW-6.1 SCOPE	16
CW-6.2 CLASS OF CONCRETE.....	16
CW-6.3 MATERIALS	16
CW-6.3.1 CEMENT	16

CW-6.3.2 REINFORCING STEEL	16
CW-6.3.3 WATER.....	17
CW-6.3.4 AGGREGATES	17
CW-6.3.5 FORMWORK	17
CW-6.4 STORAGE OF MATERIALS	17
CW-6.4.1 CEMENT AND AGGREGATES	17
CW-6.4.2 REINFORCING STEEL	18
CW-6.5 CONCRETING	18
CW-6.5.1 GENERAL	18
CW-6.5.2 FORMWORK CONSTRUCTION.....	18
CW-6.5.3 PLACING REINFORCEMENT	19
CW-6.5.4 MIXING CONCRETE	19
CW-6.5.5 PLACING CONCRETE	20
CW-6.5.6 FINISHING CONCRETE	20
CW-6.5.7 REMOVAL OF FORMS	20
CW-6.5.8 CURING AND PROTECTION	21
CW-6.5.9 SAMPLING AND TESTING OF CONCRETE	21
CW-6.5.10 TOLERANCES AND REPAIR FOR CONCRETE CONSTRUCTION	22
CW-6.5.11 SECOND STAGE CONCRETE.....	22
CW-6.6 MEASUREMENT AND PAYMENT.....	22
 CW-7.0 REINFORCING STEEL	 23
CW-7.1 DESCRIPTION.....	23
CW-7.2 MATERIAL REQUIREMENT	23
CW-7.2.1 BAR REINFORCEMENT	23
CW-7.2.2 SAMPLING	23
CW-7.3 CONSTRUCTION REQUIREMENT	23
CW-7.3.1 ORDER LIST FOR BENT BARS.....	23
CW-7.3.2 FABRICATION	24
CW-7.3.3 PROTECTION OF MATERIAL	24
CW-7.3.4 PLACING AND FASTENING REINFORCEMENT & MISCELLANEOUS MATERIAL	24
CW-7.3.5 SPLICING.....	26
CW-7.4 MEASUREMENT AND PAYMENT.....	27
 CW-8.0 STRUCTURAL STEEL.....	 28
CW-8.1 GENERAL	28
CW-8.1.1 SUBMITTALS.....	28
CW-8.1.2 DELIVERY AND STORAGE.....	28

CW-8.2	MATERIALS	29
CW-8.2.1	STEEL	29
CW-8.2.2	BOLTS, NUTS AND WASHERS:.....	29
CW-8.2.3	ACCESSORIES:.....	29
CW-8.3	EXECUTION.....	30
CW-8.3.1	FABRICATION	30
CW-8.3.2	WELDING OF STRUCTURAL STEEL WORK:.....	30
CW-8.3.3	SHOP PAINTING	30
CW-8.3.4	ERECTION	31
CW-8.3.5	TESTS AND INSPECTIONS	31
CW-8.4	MEASUREMENT AND PAYMENT.....	32
CW-9.0	REINFORCED CONCRETE FOUNDATION AND ASSOCIATED STRUCTURES FOR EQUIPMENT AND OTHER COMPONENT (DESIGNED/CONSTRUCTED BY SUPPLIER)	32
CW-9.1	SCOPE	32
CW-9.2	DESIGN AND CONSTRUCTION	32
CW-9.3	MEASUREMENT AND PAYMENT.....	33
CW-10.0	DRAINAGE SYSTEM AND APPURTENANT STRUCTURES	34
CW-10.1	SCOPE	34
CW-10.2	MATERIALS	34
CW-10.2.1	NON-REINFORCED CONCRETE DRAINAGE PIPES	34
CW-10.2.2	REINFORCED CONCRETE DRAINAGE PIPES	34
CW-10.2.3	PVC PIPES	34
CW-10.2.4	CONCRETE COVERED RECTANGULAR DITCH.....	34
CW-10.2.5	BEDDING MATERIAL	35
CW-10.3	CONSTRUCTION	35
CW-10.3.1	TRENCH EXCAVATION AND BACKFILL	35
CW-10.3.2	CONCRETE CANAL.....	35
CW-10.3.3	APPURTENANT STRUCTURES	35
CW-10.4	PIPE INSTALLATION.....	36
CW-10.4.1	GENERAL	36
CW-10.4.2	NON-REINFORCED AND REINFORCED CONCRETE DRAINAGE PIPES.....	36
CW-10.5	MEASUREMENT AND PAYMENT.....	37
CW-10.5.1	REINFORCED CONCRETE CANAL.....	37
CW-10.5.2	CONCRETE DRAINAGE PIPES AND UPVC PIPES.....	37
CW-10.5.3	APPURTENANT STRUCTURES	37
CW-10.5.4	BEDDING	37

CW-11.0 SECLUSION FENCE.....	38
CW-11.1 SCOPE	38
CW-11.2 MATERIALS	38
CW-11.2.1 CEMENT AND REINFORCING STEEL	38
CW-11.2.2 HEAVY GALVANIZED CYCLONE WIRE	38
CW-11.2.3 FINE/COARSE AGGREGATES AND WATER.....	38
CW-11.2.4 G.I. PIPES	39
CW-11.2.5 STRUCTURAL STEEL	39
CW-11.2.6 CONCRETE HOLLOW BLOCKS (CHB).....	39
CW-11.3 CONSTRUCTION	39
CW-11.4 MEASUREMENT AND PAYMENT.....	39
CW-11.4.1 SECLUSION FENCE INCLUDING VEHICULAR AND PEDESTRIAN GATE.....	39
 CW-12.0 STONE MASONRY / GROUTED ROCKWALL (NOT USED).....	 40
CW-12.1 SCOPE	40
CW-12.2 MATERIALS	40
CW-12.2.1 Boulders.....	40
CW-12.2.2 Mortar for Masonry Works	40
CW-12.3 MEASUREMENT FOR PAYMENT.....	42
 CW-13.0 PERIMETER FENCE AND VEHICULAR/PEDESTRIAN GATE	 42
CW-13.1 SCOPE	42
CW-13.2 MATERIALS	42
CW-13.2.1 Cement and Reinforcing Steel	42
CW-13.2.2 Concrete Hollow Blocks (CHB).....	42
CW-13.2.3 Fine and Coarse Aggregates and Water	43
CW-13.2.4 Galvanized Barbed Wire	43
CW-13.2.5 Structural Steel (Vehicular/Pedestrian Gate).....	43
CW-13.3 CONSTRUCTION	43
CW-13.4 MEASUREMENT AND PAYMENT.....	44
CW-13.4.1 Perimeter Fence	44
CW-13.4.2 Vehicular/Pedestrian Gate.....	44
 CW-14.0 GRAVEL SURFACING.....	 45
CW-14.1 SCOPE	45
CW-14.2 MATERIALS AND WORKMANSHIP	45
CW-14.3 MEASUREMENT AND PAYMENT.....	45
 CW-15.0 STEEL POLE WITH CROSS-ARMS AND BRACES.....	 46
CW-15.1 DESCRIPTION	46

SECTION III – TECHNICAL SPECIFICATIONS

LuzP22Z1435Se

CW-15.2	POLE REQUIREMENTS	46
CW-15.3	POLE ERECTION	46
CW-15.4	MEASUREMENT AND PAYMENT	47
CW-16.0	GROUTING	48
CW-16.1	SCOPE	48
CW-16.2	PHYSICAL PROPERTIES	48
CW-16.3	SUBMITTALS	48
CW-16.4	MEASUREMENT AND PAYMENT	48
CW-17.0	PVC WATERSTOP	49
CW-17.1	SCOPE	49
CW-17.2	PHYSICAL PROPERTIES	49
CW-17.3	SUBMITTALS	49
CW-17.4	MEASUREMENT AND PAYMENT	49

TECHNICAL SPECIFICATIONS**CW – CIVIL WORKS****CW-1.0 GENERAL CONSTRUCTION FACILITIES****CW-1.1 Scope**

This section covers the construction and/or maintenance of access roads, drainage system and other appurtenant structures, moving-in of the Supplier's construction equipment, setting up of the Supplier's camp and the disposition of the Supplier's various facilities at the end of the Contract.

CW-1.2 Moving-in

The Supplier shall bring to the site all his necessary construction equipment and plant and install all stationary construction equipment and plant at location and in the manner approved by the NPC. The Supplier shall submit sufficient detailed plans showing the proposed location of such stationary equipment and plant and other pertinent data. No installation of such stationary equipment shall be undertaken unless the corresponding plans have been approved by the NPC.

CW-1.3 SUPPLIER's Camp Facilities

The Supplier shall provide and grade his camp site, construct his camp, employee housing, warehouse, machine and repair shops, fuel storage tanks and provide such related facilities and sanitary conveniences that the Supplier deems necessary for maintaining health, peace and order in the camp and work areas. The areas that may be used by the Supplier within the plant site shall be designated by the NPC.

The Supplier shall provide, maintain and operate, under competent direction, such camps and facilities as are necessary for the housing, feeding and accommodation of his employees.

CW-1.4 Water Supply

The Supplier shall, at his own expense, be responsible for the supply, installation, operation and maintenance of a safe and adequate supply of drinking and domestic water. Whenever there is a possibility of contamination of the water supply for drinking and domestic purposes, chlorination or some other approved methods of sterilization shall be carried out. The installation and maintenance of these services shall be subject to the approval of the NPC.

CW-1.5 Sewerage Disposal and Sanitation

The Supplier shall, at his own expense, be responsible for the installation operation and maintenance of an adequate sewerage disposal and sanitation system and shall provide adequate toilet and wash-up facilities for his employees at his camp and in the areas where work is being carried out.

The Supplier shall execute the work with due regard to adequate sanitary provisions and applicable codes and shall take all necessary steps to prevent the pollution of water in any spring, river, or other sources of water supply. All toilets or wash-up facilities shall be subject to the prior and continuing approval of the NPC.

CW-1.6 Fire Protection

The Supplier shall observe all necessary precautions against fire, shall provide and maintain at his own expense, portable fire-fighting equipment he may deem necessary, and shall comply with all applicable laws of the Philippines relating thereto.

In the event of an uncontrollable fire occurring in the area of the Supplier's operation, the Supplier shall have to extinguish the fire immediately at his own expense, to the full extent of the manpower and equipment employed under the contract at the time of the fire.

The Supplier shall indemnify NPC against all liabilities, claims, damages and/or lawsuits arising thereto.

CW-1.7 Construction Power

The Supplier shall be responsible for providing his own electric power supply required for construction and erection/installation. If power is available from NPC and should the Supplier elect to utilize the NPC's power supply, he shall make an arrangement with NPC concerned group as to the billing rates and other requirements needed for direct connection to NPC.

CW-1.8 Camp Security

The Supplier shall provide his own security force to the extent that he deems necessary for maintaining peace and order in the camp and work areas and to safeguard materials and equipment. Nothing under the provisions of this paragraph shall relieve the Supplier from full responsibility for the maintenance of peace and order and protection of life and property in all areas where he operates.

CW-1.9 Construction Material Storage

The Supplier is required to put up warehouse(s) with capacities sufficient to store the construction materials required in the work. The warehouse(s) shall be specifically for this contract, notwithstanding his other facilities in the site that may serve the purpose.

CW-1.10 Removal of Camp and Construction Facilities

After the completion of the work covered by the contract and prior to acceptance of the completed work, the entire camp facilities of the Supplier, including its water supply system, electric distribution system, quarters, warehouses, shops, dining halls, commissaries, temporary shed and other facilities therein shall be removed by the Supplier. The site shall be cleared and cleaned as directed by the NPC.

CW-1.11 Measurement and Payment

No separate measurement and payment will be made for the Supplier's Construction Facilities. The cost of furnishing, constructing, maintaining, operating and removing of temporary drainage structures, pumping system and other dewatering devices necessary to keep construction operations free from water, shall be included in the various pay items in the Schedule of Requirements for structures where such care of water is required.

CW-2.0 CARE OF WATER DURING CONSTRUCTION**CW-2.1 Scope**

In accordance with the specifications contained in this section or otherwise directed, the Supplier shall construct and maintain all necessary temporary drainage ditches and other temporary protective works and he shall also furnish, install, maintain and operate necessary pumping equipment and other devices to protect construction operations free from water coming from any source, including rain.

CW-2.2 Drainage and Dewatering

The Supplier shall be responsible for dewatering foundation areas so that work can be carried out on a suitably dry condition. The Supplier shall construct drainage ditches, holes, culverts, furnish, maintain and operate at his own expense all necessary pumps and other dewatering devices to keep all work areas free from water.

After the work is completed and before it is accepted by the NPC, the Supplier shall remove all pumping equipment and shall remove, fill or plug all temporary drainage structures as directed, all at his expense.

CW-2.3 Measurement and Payment

No separate measurement and payment will be made for the Supplier's compliance to the foregoing. The entire cost thereof shall be included in the various pay items in the Schedule of Requirements.

CW-3.0 ENVIRONMENTAL REQUIREMENTS FOR CIVIL WORKS**CW-3.1 Scope**

This section pertains to the environmental and safety provisions, requirements and conditions that shall govern during the execution of all civil works under this project.

CW-3.2 General Conditions

The Supplier shall ensure compliance with the applicable environmental and safety regulations, as well as ECC conditions, during installation/construction of this project through the implementation of measures that include, but not limited to, the following:

- a) Designate a Safety Officer and a Pollution Control Officer who shall respectively handle all safety and environmental concerns of the project.
- b) Prepare and submit Construction Safety and Health Plan (CSHP).
- c) Properly manage debris and various waste generated during installation/construction, such as the following:
 - Dispose of demolition and construction debris in a designated or NPC approved disposal area(s);
 - Stockpile (and cover if possible) or haul to the designated and/or pre-developed dump sites (spoil disposal areas) that shall be provided with suitable drainage – equipped with sediment traps, stripped top soil, spoils from quarry/borrow sites and excavated materials;
 - Segregate solid wastes, such as empty cement sacks, scraps of tin or wood, used wires and other domestic garbage, for recycling or storage in NPC-approved temporary storage areas and further disposal to LGU-designated disposal sites.
 - Properly handle, store and dispose-off, through DENR-accredited transporter/treater, hazardous wastes i.e. used oils, paints, thinner, etc.
- d) Limit construction activities that generate excessive noise to daytime works only to prevent nuisance to nearby residents during rest hours.
- e) As far as practicable, undertake site stripping, grading and excavations during dry weather.
- f) Construction/Installation shall be carried-out in a manner where landslides and erosions are minimized.

- g) Avoid unnecessary opening/clearing of areas outside construction sites or destruction of vegetative cover, especially cutting of existing trees; and to re-vegetate disturbed areas.
- h) Implement biological control measures such as maintenance of vegetation buffers (i.e. sodding of grass, planting of creeping vines, herbs, shrubs and trees) to shield streams/rivers from sedimentation; planting of vegetative cover over erodible surfaces; and planting of exposed sloping areas with shallow-rooted species like grasses, herbs or creepers.
- i) Locate fill slopes and spoil heaps away from drainage routes and properly remove/dispose the same as soon as practicable.
- j) Preserve or replace, if practicable, natural drainage patterns (when disturbed by civil works) with appropriate drainage channels.
- k) Convey oil-contaminated wastewater from workshops, garages, or gas filling stations through an oil trap (i.e. improvised oil-water separator) prior to discharge.
- l) Spray water, wherever and whenever necessary, to minimize dust generation.
- m) Provide PPEs and other safety provisions required by DOLE, for its project/site works.
- n) Take all necessary steps to prevent the pollution of groundwater and/or water bodies in the vicinity of the project site.

CW-3.3 Measurement and Payment

No separate measurement and payment will be made for the Supplier's compliance to the foregoing. The entire cost thereof shall be included in the various pay items in the Schedule of Requirements.

CW-4.0 SITE GRADING**CW-4.1 Scope**

In accordance with the specifications contained herein and in conformance with the lines, slopes, grades and extent shown on the plans or otherwise directed by the NPC, the Supplier shall furnish all equipment, labor and materials and shall perform the required grading work.

CW-4.2 Clearing, Grubbing and Miscellaneous Work**CW-4.2.1 Clearing and Grubbing**

The Supplier shall perform clearing and grubbing on the project site. The site shall be cleared and grubbed of all trees and brush except particular trees, which may be retained by the NPC for preservation. Particular trees to be left in place shall be protected from scarring and/or other injuries during clearing and grubbing work and other construction operations.

All stumps, roots and brush shall be removed to a depth of thirty (30) cm below original ground surface and disposed of in a place designated by the NPC. Downed timber, which may be ordered saved by the NPC for future use, shall be cut into logs as directed and neatly piled in a place designated by the NPC, otherwise they shall be disposed of same as above.

CW-4.2.2 Miscellaneous Works

Where shown on the drawings or if not shown but directed by the NPC, the Supplier shall perform miscellaneous work like demolition, removal, chipping, replacement or transfer of existing structures and other miscellaneous work. All demolished structures shall be disposed of as directed by NPC.

CW-4.3 Grading**CW-4.3.1 General**

The word "grading" as defined herein means bringing to required grades all areas in accordance with the lines, slopes, elevations and grades shown on the drawings or as directed by the NPC.

CW-4.3.2 Classification of Materials

All materials in grading work shall be unclassified regardless of the nature of materials encountered during grading excavation and of materials used in grading fill. It is on the basis of unclassified material that Supplier shall determine his unit bid price for grading excavation and grading fill.

CW-4.3.3 Stripping

Fill areas to be brought to grade shall first be stripped of their top soil as directed but in no case less than twenty (20) centimeters in depth and disposed of properly in spoil areas designated by the NPC. Only materials from grading excavation and intended to be used for filling or backfilling purposes shall be stripped of top soil in the same manner as above.

CW-4.3.4 Excavation and Fill

Areas required to be brought to grade shall be excavated or filled as the case may be. Grading work shall be carried out in such a manner that the free drainage is maintained at all times and nowhere shall pondage be found in any part of the work.

The NPC may require the modification of slopes and grades according to the conditions actually encountered during excavation, but such change or modification shall not be construed to mean by the Supplier as a basis for additional compensation over and above the contract unit prices.

Any over-excavation performed by the Supplier for any purpose or reason, except as may be ordered by the NPC, shall be at the Supplier's expense and any excess of excavation shall be refilled, where required, with approved materials that shall be furnished, placed and properly compacted at the expense of the Supplier.

Unsuitable materials, as determined by the NPC, which may be encountered below established grade, shall be removed to a depth as directed and accordingly replaced with suitable materials approved by the NPC. The removal and proper disposal of such unsuitable materials shall be paid for at the contract unit price for the item, Grading Excavation, and payment for placing and compacting suitable material be made at the contract unit price for the item, Grading Fill, in the Schedule of Requirements.

Fill work shall not be started until the area has been inspected and approved by the NPC after stripping. Grading fill shall be spread and compacted in layers of 15 cm. loose volume and compacted with approved roller weighing not less than 10 tons. Each layer shall be moistened or dried as directed for maximum compaction. No succeeding layer shall be placed thereon unless the preceding layer has been tested for compaction and approved by the NPC.

In the event that construction of concrete footing or other concrete foundations is on fill, the fill shall be compacted efficiently and thoroughly so that when the fill is tested for compaction at the required foundation elevation for the structure, the required bearing capacity is attained but in no case less than 144KPa. In no case shall filling and compaction work to be done without the presence of NPC's inspectors. The Supplier shall be held liable for any structural instability or damage that might result in consequence to non-compliance of this requirement. The Supplier shall institute corrective measures to bring the foundation base to a condition or state that will conform to the required bearing

capacity; and also to repair and make good any damage on the structure to the satisfaction and at no cost to NPC.

CW-4.3.5 Slides

In the event that slides occur along excavated slopes during grading operations or after completion of grading but prior to acceptance of the work, the Supplier shall remove and dispose the slide materials and also to trim the slopes as directed to leave the slopes in a safe and neat condition all at no additional cost to NPC, unless occurrence of such slides is occasioned by causes beyond control of the Supplier. In such event, payment for the satisfactory removal and proper disposal of slide material and finishing and rounding of slopes will be paid for at the equivalent of thirty percent (30%) of the contract unit price per cubic meter for the item Grading Excavation.

CW-4.3.6 Slip-Outs

In the event of slip-outs in any part of the grading fill prior to final acceptance of the work, the Supplier shall rebuild such portion of the fill. In the case it is determined that the slip-outs was caused through the fault of the Supplier, the rebuilding of the fill shall be performed by the Supplier at no extra cost to NPC; otherwise, the reconstruction of the fill will be paid for thirty percent (30%) of the contract unit for the item, Grading Fill.

CW-4.4 Disposal

All excess materials from grading work (including excess materials in structural excavation and miscellaneous work) shall be disposed of by the Supplier. The acquisition of the right-of-way for the area of disposal including the access thereto, permits, and other requirements, shall be the responsibility of the Supplier at no cost to NPC. The Supplier shall be held solely liable for any claim by third parties that may arise from improper transport and disposal of excess materials. The cost of acquisition of the above-mentioned right-of-way shall be included in the unit bid price for excavation.

CW-4.5 Sources of Fill Materials

When suitable materials from grading excavation are deficient to meet the quantity required for grading fill, additional fill materials shall be obtained from other sources proposed by the Supplier and approved by the NPC. Cost of excavating, hauling, placing and compacting additional materials from borrow sources shall be included in the unit price bid for the item, Grading Fill. Acquisition of right-of-way to these sources shall be the responsibility and account of the Supplier.

CW-4.6 Environmental Requirements

All construction activities to be performed by the Supplier shall be in accordance with the restrictions stated in the approved Environmental Clearance Certificate (ECC) and the conditions set forth in Clause 3.0 – Environmental Requirements for Civil Works.

CW-4.7 Measurement and Payment**CW-4.7.1 Clearing and Grubbing**

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for Clearing and Grubbing. Corresponding cost hereof shall be included in the unit bid price of relevant item(s) in the Schedule of Requirements.

CW-4.7.2 Miscellaneous Works

Measurement for payment for miscellaneous work such as demolition, restoration, etc., shall be made on a lot basis unless otherwise specified in the Schedule of Requirements. Payment will be made at the contract unit price for the various pay items under Miscellaneous Works, which payment shall cover all cost for furnishing labor, equipment and incidentals necessary for demolition and restoration, disposal, and other related works required to complete the item.

CW-4.7.3 Stripping

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for Stripping. Corresponding cost hereof shall be included in the unit bid price of relevant item(s) in the Schedule of Requirements.

CW-4.7.4 Grading Excavation

Measurement for payment for Grading Excavation shall be based on the number of cubic meters excavated and properly disposed. Volume shall be computed by the average end area method which shall be the volume between the original ground (as determined by survey to be made by representatives of both NPC and the Supplier) and graded surface on the drawings or as established by NPC. To this volume shall be added, for purpose of payment, all authorized excavations below grade.

Payment will be made at the contract unit price for the item Grading Excavation in the Schedule of Requirements, which payment shall constitute full compensation for furnishing of all labor, construction equipment and incidentals necessary excavate, dispose and other related work required to complete the work item.

CW-4.7.5 Grading Fill

Measurement for payment for Grading Fill shall be based on the number of cubic meters of the materials placed, graded, compacted and accepted. Volume shall be computed by the average end area method which shall be the volume between the ground surface after stripping and the finished grade surfaces on the drawings or as established by NPC.

Payment will be made at the contract unit price for the item Grading Fill in the Schedule of Requirements, which payment shall constitute full compensation for furnishing of all materials, labor, construction equipment and incidentals necessary to complete the work item.

CW-5.0 STRUCTURAL EXCAVATION, FILL AND BACKFILL

CW-5.1 Scope

In accordance with the specifications contained herein and as shown on the drawings and otherwise directed, the Supplier shall perform all the required structural excavation, fill and backfill for the entire project, including the proper disposal of excess excavated materials.

CW-5.2 Materials

CW-5.2.1 Structural Excavation

No classification will be made on the materials excavated. The Supplier shall determine his/her unit bid price for structural excavation based on unclassified material regardless of the nature of the materials actually encountered and excavated.

CW-5.2.2 Structural Fill

a. Sand and Gravel Fill

The material shall be of the same classification as the sand and gravel base consisting of river sand and gravel as approved by the NPC. The composite material shall be free from vegetable matter and lumps or balls of clay, and shall be uniformly graded from coarse to fine in accordance with the grading requirements shown below:

<u>Sieve Designation (Square Mesh Sieves)</u>	<u>Percentage by Weight Passing</u>
50.0 mm (2")	100
25.4 mm (1")	55-85
9.5 mm (3/8")	35-60
4.76 mm (No. 4)	25-50
2.08 mm (No. 10)	20-40
0.42 mm (No. 40)	8-20
0.074 mm (No. 200)	2-8

b. Structural Earth Fill

Structural earth fill shall consist of filling with suitable materials obtained from grading excavation or from borrow areas approved by the NPC.

CW-5.2.3 Special Foundation, if any

The NPC shall have the option to use one or both of the following materials for special foundations, whether or not shown on the drawings:

a. Lean Concrete

The strength of lean concrete shall be 13.79MPa or as designated by the NPC.

b. Selected Materials

Selected materials shall consist of compactable material which, when compacted, shall attain the required bearing capacity. The material could be a combination of earth and rock particles not greater than 8 cm including sandy clay, gravelly clay, or shale, all approved by the NPC.

Bed materials for water pipes and/or drainage culverts shall use sand fills.

CW-5.2.4 Structural Backfill

Backfill for Structures Other Than Pipes – Material for backfill shall consist of compactable and approved material taken from grading and structural excavations. Any additional material needed shall be obtained from borrow areas proposed by the Supplier and approved by the NPC.

Backfill for Sewerage and Drainage Pipes – The layer of backfill materials immediately above, up to 60 cm. from the top of pipe, and on the sides of the pipe shall consist of selected material consisting of clay soil and/or other fine materials that are free from stone particles, roots, debris. The upper layer shall consist of compactable materials taken from pipe trench and other structural excavation.

Backfill for Water Supply Pipes – Backfill for water supply pipes shall consist of compactable materials taken from trench excavation and approved by the NPC.

CW-5.3 Construction**CW-5.3.1 Excavation**

a. General

The Supplier shall notify the NPC sufficiently in advance before the beginning of any excavation so that a joint survey for baseline data and cross-sectional measurements can be undertaken on the undisturbed/natural ground surface. All excavation shall be carried out according to the lines, slopes and grades shown on the drawings. In case an increase or decrease in quantities occur as a result of changes made by the NPC to such lines, slopes, and grades, the provisions on Variation Orders under the General Conditions of Contract (GCC) shall apply.

After each excavation is completed or where replacement of unsuitable material below required foundation grade has been undertaken, the Supplier shall notify the NPC so that proper inspection and confirmatory test on the bearing capacity of the foundation material can be made. In no case that concrete, sewer, drainage or water supply pipe can be placed unless a written approval has been issued by the NPC.

Over-excavation performed by the Supplier due to his carelessness shall be filled and properly compacted with the suitable material approved by NPC, at no additional cost to NPC.

b. Structural Excavation, Structure Other Than Pipes

The Supplier shall excavate the foundations to the specified side slopes and depths shown on the drawings, after which the NPC will conduct tests on the underlying material below foundation grade to determine the actual bearing capacity at such depth. If the required bearing capacity is not attained, the NPC shall instruct the Supplier to excavate further down until, in the opinion of the NPC, the bearing capacity is adequate to sustain the applied load on the foundation.

Compliance to such instruction shall not entitle the Supplier for additional compensation over and above the unit prices for excavation regardless of the nature of material excavated. For purposes of measurement, the applicable paylines for the excavation under this condition or situation shall be as shown on the drawings that show the paylines for excavation and special foundation materials.

c. Drainage and Sewerage Pipes and Cable Trench

The width of trench excavation for drainage and sewerage pipes and cable trench shall be as indicated on the drawings. All trench bottoms shall be excavated to the foundation grade indicated, regardless of the foundation material classification.

d. Water Supply Pipes

Trenches for main or feeder lines shall be excavated to the depth of no less than 0.25 meter on open ground and 0.60 meter under roadways and parking areas, both depths measured from the finished grade surface.

Service pipes shall be buried to a depth of at least 0.15 meter below grade line.

CW-5.3.2 Structural Foundation Fill

No fill materials shall be placed in any part of the fill foundation unless the foundations have been inspected and approved by the NPC. Fill materials shall be placed and spread in layer covering the entire length and breadth of the section under construction, each layer not to exceed 15 cm. in loose volume thickness and compacted thoroughly to the desired compaction as determined

by the NPC. No succeeding layer shall be placed until the previous layer has been tested and approved, as to compaction, by the NPC.

CW-5.3.3 Special Foundations

If unsuitable material is encountered or if the foundation material is unsuitable such that the required bearing capacity of the foundation cannot be attained at the required elevation, further excavation shall be performed by the Supplier as stated in CW-5.3.1b.

Excavated materials below foundation grade shall be replaced at the direction of the NPC, either by lean concrete or by selected materials as mentioned in CW-5.2.3.

Selected materials shall be placed in 15-cm layers and compacted until the required bearing capacity is attained.

CW-5.3.4 Backfill

1. Structures, Other Than Pipes

Excavated areas around structures for backfilling shall be backfilled with approved materials in horizontal layers, each not exceeding 15cm. (6") in loose volume thickness. Each layer shall either be moistened or dried as directed and thoroughly tamped with tampers having no less than 160 cm² of tamping area and weighing not less than 20 kg. The last layer shall be neatly brought up to the level of the adjoining finished grade surface.

In no case shall backfill be placed around concrete structures until after fourteen (14) days from placement of the concrete.

2. Drainage and Sewerage Pipes

After the pipes have been installed and grouted joints sufficiently cured, but in no case less than seven (7) days allowed for curing as specified in NSCP and the whole pipeline inspected, backfill materials specified herein shall be placed in layers as directed, each layer either dried or moistened as directed and thoroughly tamped. The backfill shall be brought up evenly on both sides of the pipe up to the top of the pipe and finally up to the finished grade surface.

3. Water Supply Pipes

After the pipeline has been installed and tested it shall be backfilled in layers as directed and compacted to the satisfaction of the NPC.

CW-5.4 Measurement and Payment

CW-5.4.1 Structural Excavation

Measurement for payment for structural excavation performed by the Supplier for structures (except drainage, sewerage and water supply pipes, and appurtenances of which cost of excavation and backfill is included in the cost

of installed pipe and constructed appurtenances) will be based on the number of cubic meters of materials excavated.

For purpose of payment, all authorized excavation below foundation grade (like in the case of unsuitable materials encountered) shall be included in the measurement.

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for Structural Excavation. Corresponding cost hereof shall be included in the unit bid price of relevant item(s) in the Schedule of Requirements which payment shall constitute full compensation for furnishing all labor and equipment necessary for excavation work and proper disposal of excess material excavated.

CW-5.4.2 Structural Foundation Fill

Measurement for payment for Structural Foundation Fill will be based on the number of cubic meters of fill materials placed within the neat lines as shown on the drawings.

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for structural foundation fill. Payment will be made at the corresponding pertinent pay items with Sand and Gravel Fill/Base shown in the Schedule of Requirements, which payment shall constitute full compensation for furnishing, placing and compacting fill materials; labor which include spreading, compacting, etc., equipment and other incidentals necessary to complete the item.

CW-5.4.3 Special Foundations

Measurement for payment for lean concrete and/or selected materials placed within the pay lines for excavation will be based on the number of cubic meters in-place and accepted.

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for special foundations. Payment will be made at the various pertinent pay items shown in the Schedule of Requirements, which payment shall cover all costs for furnishing all labor, materials, equipment and tools necessary to complete the item.

CW-5.4.4 Structural Backfill

Measurement for payment for Structural Backfill (except backfill for drainage and sewerage pipes, appurtenances and other structures of which cost of backfill is included in the cost of installed pipes and appurtenances) will be based on the number of cubic meters of approved materials, backfilled, satisfactorily compacted and accepted. Any backfill material placed outside the pay lines for excavation to replace slides or over-excavation will not be paid.

Unless otherwise specified in the Schedule of Requirements, no separate payment will be made for Structural Backfill. Corresponding cost hereof shall

be included in the unit bid price of relevant item(s) in the Schedule of Requirements which payment shall constitute full compensation for furnishing all labor, materials and equipment necessary for backfilling work.

CW-5.4.5 Trench Excavation and Backfill for Sewerage, Drainage and Water Supply Pipes and Cable Trench

No separate measurement and payment will be made for trench excavation and backfill for all sewerage, drainage and water supply pipes. Payment for trench excavation and backfill for pipes shall be included in the payment pertaining to pipes as shown in the Schedule of Requirements.

CW-6.0 CONCRETE

CW-6.1 Scope

In accordance with the specifications contained in this section, the Supplier shall furnish all materials, labor, equipment and tools and perform all concreting works in accordance with the drawings, or as otherwise directed.

CW-6.2 Class of Concrete

Class of concrete or strength shall be as indicated on the drawings, which shall conform to the minimum requirement for compressive strength indicated on the provision of NSCP for Concrete and, in no case, shall not be less than 20.7 MPa.

CW-6.3 Materials

CW-6.3.1 Cement

Cement for concrete works shall be furnished by the Supplier and shall conform to the requirements of the latest edition of the Standard Specifications for Portland Cement (ASTMC150).

Unless otherwise specified, cement shall be ordinary Portland Cement. Type I or Type 1P for general construction which concrete is not in contact with soils or ground water and Type II for concrete in contact with soil or ground water.

Changing of brand or type of cement within the same structure will not be permitted unless with prior permission and approval obtained from the NPC.

CW-6.3.2 Reinforcing Steel

The Supplier shall furnish all reinforcing steel of the sizes shown on the drawings and in accordance with the herein specifications for reinforcing steel.

CW-6.3.3 Water

Water for use in concrete shall be subject to the approval of the NPC. It shall not be salty and shall be reasonably clear and free from oil, acid, injurious alkali or vegetable matter.

CW-6.3.4 Aggregates

All coarse and fine aggregates shall consist of hard, tough, durable and clean, uncoated particles. All foreign materials and dust shall be removed by processing. Aggregates shall generally be rounded and reasonably free from thin, flat and elongated particles in all sizes and well graded from coarse to fine.

CW-6.3.5 Formwork

Timber, lumber and plywood to be used for falsework and formwork shall be sound and shall comply with the requirements of this specifications. Use forms where a smooth form finish is required. Lumber shall be square-edged or tongue-and-groove boards, free of raised grain, knotholes and the other surfaces defects. Steel when used shall conform to the requirements of the ASTM A36. Steel form surfaces shall not contain irregularities, dents, or sags.

Forms shall be wood, plywood, or steel. Wood forms for surfaces exposed to view in the finished structure and requiring a smooth form finish, shall be plywood. For unexposed surfaces, undressed square-edge lumber may be used. Forms for surfaces requiring special finishes shall be plywood, or shall be lined with plywood, a non-absorptive, hard-pressed fiberboard, absorptive-type lining or other suitable material. Plywood, other than for lining, shall be concrete-form plywood free of raised grain, torn surfaces, worn edges, patches, or other surface defects, which would impair the texture of the concrete surface. Surfaces of steel forms shall be free from irregularities, dents, and sags.

CW-6.4 Storage of Materials**CW-6.4.1 Cement and Aggregates**

All cement shall be stored, immediately upon delivery at the Site, in weatherproof building that will protect the cement from dampness. The floor shall be adequately raised from the ground and in buildings placed in the locations approved by NPC. Provisions for storage shall be ample, and the shipments of cement as received shall be separately stored in such a manner that allows the earliest deliveries to be used first and to provide easy access for identification and inspection of each shipment. Storage buildings shall have capacity for storage of sufficient quantity of cement to allow sampling at least twelve (12) days before the cement is to be used. Bulk cement, if used, shall be transferred to elevated air tight and weatherproof bins. Stored cement shall meet the test requirements at any time after storage when NPC orders retest. At the time of use, all cement shall be free flowing and free of lumps.

Handling and storing of concrete aggregates shall be such that segregation or inclusion of foreign materials is sufficiently prevented. NPC may require that aggregates be stored on separate platforms at satisfactory locations.

In order to secure greater uniformity of concrete mix, NPC may require that the coarse aggregate be separated into two or more sizes. Different sizes of aggregates shall be stored in separate bins or in separate stockpiles and relatively away from each other to prevent the material at the edges of the piles from intermixing.

CW-6.4.2 Reinforcing Steel

Reinforcing steel shall be stored in accordance with the specifications for reinforcing steel.

CW-6.5 Concreting

CW-6.5.1 General

The written approval of the NPC shall be secured prior to any concreting work. All concrete shall be poured on dry and cleaned surfaces.

CW-6.5.2 Formwork Construction

Forms shall be installed mortar and watertight, true to the dimensions, lines and grades of the structure and with the sufficient strength, rigidity, shape and surface smoothness as to leave the finished works true to the dimensions shown on the drawings or required by NPC and with the surface finish as specified.

The inside surfaces of forms shall be cleaned of all dirt, mortar and foreign material. Forms, which will subsequently be removed, shall be thoroughly coated with a release agent or coating prior to its use. The release agent shall be commercial quality form oil or other approved coating which will permit the ready release of the forms and will not discolor the concrete.

Formwork for concrete placed underwater shall be watertight.

Forms shall be constructed so that the form surface of the concrete does not undulate excessively in any direction. Undulations exceeding either 2 mm or 1/270 of the center distance between studs, joints, form stiffeners, form fasteners, or wales will be considered to be excessive. Should any form of the forming system, even though previously approved for the use, produce a concrete surface with excessive undulations, its use shall be discontinued until modifications, satisfactory to NPC's Representative, have been made.

Portions of concrete structures with surface undulations in excess of the limits herein stated may be rejected by the NPC.

Form fasteners consisting of bolts, clamps or other devices shall be used as necessary to prevent spreading of the forms during concrete placement. The

use of ties consisting of twisted wire loops to hold the forms in position will not be permitted.

All formworks shall be provided with adequate clean-out openings to permit inspection and easy cleaning after all reinforcement has been placed. Where forms for continuous surfaces are placed in successive units, the forms shall be fitted over the completed surface to obtain accurate alignment of the surface and to prevent leakage of mortar. Panel forms shall be constructed so that they can be removed without damaging the concrete. All exposed joints, edges, and external corners shall be chamfered a minimum of 20 mm unless specified otherwise herein. Forms for heavy girders and similar members shall be constructed with a proper camber.

Coating: Before placing the concrete, the contact surface of forms shall be coated with a non-staining mineral oil or suitable non-staining form coating compound or shall be given two coats of nitrocellulose lacquer, except as specified otherwise. Mineral oil shall not be used on forms for surfaces, which are to be painted. For surfaces not exposed to view in the finished structure, sheathing may be wetted thoroughly with clean water. All excess coating shall be removed by wiping with cloths. Reused forms shall have the contact surfaces cleaned thoroughly. Those that have been coated shall be given an additional application of the coating. Plaster waste molds shall be layered with two coats of the thin shellac or lacquer and coated with soft or thinned non-staining grease.

Tolerance and Variations: The Supplier shall set and maintain concrete forms to ensure that, after removal of the forms and prior to patching and finishing, no portion of the concrete work will exceed any of the tolerances specified. Variations in floor levels shall be measured before removal of supporting shores. The Supplier shall make the necessary corrective measures for the variations resulting from deflection, or when the latter affects concrete quality or curing. The tolerances specified shall not exceed by any portion of the concrete surfaces; the specified variation for one element of the structure shall be considered unacceptable when it permits another element of the structure to exceed its allowable variations. Except as otherwise specified herein, tolerances shall conform to ACI 347.

CW-6.5.3 Placing Reinforcement

Reinforcing steel and embedded items shall be properly and securely installed prior to the placing of concrete.

In no case shall concreting start without prior inspection and approval by the NPC of the placed reinforcement and other embedded items.

CW-6.5.4 Mixing Concrete

Mixing of concrete shall conform to the requirements of ACI Code for Concrete Construction.

CW-6.5.5 Placing Concrete

Concrete shall be conveyed from mixers to the forms or to the place of deposit as rapidly as possible and by methods that will prevent segregation or loss of ingredients. There shall be no vertical drop greater than 1.5 meters except where suitable equipment like metal pipe or tremie is used. The pipe or tremie shall be kept full of concrete and its end shall be kept buried in the newly placed concrete. Chutes through which concrete is delivered to the structure in a thin, continuously exposed flow will not be permitted except for very limited or isolated sections of the work.

Earth surfaces, upon which concrete shall be placed, shall be cleaned, dry and thoroughly compacted before placing the concrete.

Rock surface, upon which concrete shall be placed, shall be thoroughly cleaned of loose or semi-detached or unsound rock particles. Before placing concrete, all surfaces shall be wetted thoroughly to keep them in a completely moist condition, after which leveling mortar of the same cement ratio as the concrete mix complete contact between concrete and the leveled surface.

CW-6.5.6 Finishing Concrete

After the concrete has been deposited, distributed and vibrated, the concrete shall be struck off and screened by mechanical means approved by the NPC. The finishing machine shall be of the screening and troweling type designed and operated both to strike off and to consolidate. Hand finishing may be employed when suitable finishing machines are not available. Finishing of concrete shall be done, as directed, to the satisfaction of the NPC.

All finished surfaces shall be tested with 3 meters straight edge and any variation of the surface from the desired crown or cross section shall be properly corrected.

CW-6.5.7 Removal of Forms

Formwork shall not be removed without the permission of NPC; where such permission, however, shall not relieve the Supplier of its responsibility for the safety of the work. Blocks and bracing shall be removed at the time the forms are removed and in no case shall any portion of the wood forms be left in the concrete.

Falsework removal for continuous structures shall be as directed by NPC but in which case shall be temporarily supported such that the structure is gradually subjected to its working stresses. False work shall not be released in any span until the strength specified hereunder is attained.

When concrete strength tests are to be used as basis for the removal of forms and supports, the compressive strength of concrete must meet the following minimum requirements:

	Min. Time	Min.% Strength
Centering under girders and beams	14 days	80%
Sides of beams and all vertical surfaces	1 day	70%
Floor Slabs	14 days	80%

The site shall be cleared of all debris and refuse resulting from work.

CW-6.5.8 Curing and Protection

Concrete shall be cured for a period of not less than fourteen (14) consecutive days by keeping the surfaces of concrete continuously (not periodically) wet. Where tongue and groove forms were used and left in place of curing, they shall be kept wet at all times prevent opening at the joints and drying out of the concrete.

CW-6.5.9 Sampling and Testing of Concrete

The Supplier shall furnish all materials, either separately or mixed, as required by NPC. Selection of materials and the making of test specimens shall be made under the supervision of NPC and delivered to NPC laboratory or any NPC-accredited testing agency at the Supplier's expense.

The expense of making and curing all concrete specimens including the materials comprising the concrete specimens shall be borne by the Supplier. The cost of shipping and testing the concrete shall likewise be at the expense of the Supplier.

No concreting work on the project will be permitted to be done until NPC signifies in writing that, following the performance of the necessary tests, he gives his approval to the use of all materials involve in making the concrete.

As work progresses, test cylinders shall be fabricated from the concrete samples and tested in accordance with ASTM C31 and ASTM C39. At least one set of four (4) cylinders shall be made from each 10 cu.m of the concrete placed of each class. Also at least one set shall be made per day for each class of concrete placed each day.

Two (2) cylinders shall be tested at 28 days for specification compliance and one shall be tested at 7 and 14 days respectively for information. The acceptance test result shall be the average of the strength of the two cylinders tested at 28 days.

The compressive strength of the concrete shall be deemed acceptable if the average of any consecutive strength tests equals or exceeds the specified design strength (f_c'), provided no individual test falls below the f_c' by more than 3.50 MPa(500 psi) if f_c' is equal or less than 5,000psi (35Mpa); or by more than 0.10 f_c' , if f_c' is more than 5,000 psi (35Mpa).

Concrete deemed to be not acceptable using the above criteria maybe rejected unless the Supplier can provide evidence, by means of core tests, that the quality of concrete represented by the failed test result is acceptable in place.

Three (3) cores shall be taken in accordance with ASTM C42 and soaked for 24 hours prior to testing. Concrete in the area represented by the cores will be deemed acceptable if the average strength of the cores is equal to at least 85% of and no single core is less than 75% of the specified strength.

CW-6.5.10 Tolerances and Repair for Concrete Construction

Concrete structures shall be constructed to the lines shown on the drawings or where so required to suit actual field requirements. Any structure that does not conform to such lines shall be repaired or removed and made anew by the Supplier at no additional cost to the Corporation.

Repairs shall be made at surface imperfections due to faulty placing of concrete and cuts on the structures due to the removal of excess concrete on the lines shown on the drawings. Such repairs shall be made immediately after early stripping of the forms, after the imperfections have been identified and the methods of repair appropriately established.

CW-6.5.11 Second Stage Concrete

The second stage of concrete finishing shall be done only after the final installation of all pertinent equipment, anchorages, pipings, conduits and other embedded items as may be required for all electromechanical works.

CW-6.6 Measurement and Payment

Measurement for payment for Concrete (except concrete which shall be measured for separate payment) will be based on the volume of concrete placed and accepted within the neat lines of the structure as shown on the drawings or in accordance with the manner of measurement set forth in the various sections of the Technical Provisions. No deduction will be made for rounded or beveled edges or space occupied by the metal items 10 sq. cm. or less in cross section, embedded in concrete.

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for Concrete. Corresponding cost hereof shall be included in the unit bid price of relevant item(s) in the Schedule of Requirements which payment shall cover all costs for furnishing all labor, materials, including equipment and tools required for concreting work. Payment shall also include non-shrink cementitious grout and epoxy grout inside foundation block out and above engine base plate and care of water.

CW-7.0 REINFORCING STEEL**CW-7.1 Description**

This work shall consist of furnishing, fabricating, and placing of steel reinforcement of the type, size, shape and grade required in accordance with these specifications and in conformity with the requirements shown on the Drawings or as directed by the NPC.

CW-7.2 Material Requirement

All material shall conform to the requirements hereinafter given. Certified test reports (mill test or other) shall be submitted to the NPC for all reinforcement steel used. These tests shall show the results of all chemical and physical tests made.

CW-7.2.1 Bar Reinforcement

Reinforcement bars for concrete shall be hot-rolled, weld able, deformed billet-steel bars conforming to the requirements specified in ASTM A615 and PNS 49 unless shown on the Drawings or as required by the NPC. The use of the cold twisted bars is not permitted. Bar reinforcement shall be shipped in standard bundles, tagged and marked in accordance with the Code of Standard Practice of the Concrete Reinforcement Steel Institute.

CW-7.2.2 Sampling

The NPC's Representative will sample reinforcement bars at the source of supply or at the point of distribution, and the Supplier shall notify the NPC in sufficient time in advance to permit sampling and testing before shipment is made. Three (3) samples from each size shall be taken at random representing five (5) tons or fraction thereof of each size.

CW-7.3 Construction Requirement**CW-7.3.1 Order List for Bent Bars**

Before materials are ordered, the Supplier shall furnish all order lists and bending diagrams for the approval of the NPC. The approval of order lists and bending diagrams by the NPC shall in no way relieve the Supplier of responsibility for the correctness of such lists and such lists and diagrams. Any expenses incident to the revisions of materials furnished in accordance with such lists and diagrams to make them comply with the drawings shall be borne by the Supplier.

Shop Drawings for Reinforcing Steel (ACI 315): Indicate bending diagrams, assembly diagrams, splicing and laps of bars, shapes, dimensions and details of bar reinforcing, accessories and concrete cover. Do not scale dimensions from structural drawings to determine lengths of reinforcing steel.

CW-7.3.2 Fabrication

Bent bar reinforcement shall be cold bent as shown on the drawings or as required by the NPC. Bars shall be bent around circular pin having the following diameters (D) in relation to the diameter of the bar (d):

Bars 6mm Φ to 20mm Φ inclusive	D=6d
Bars 25mm Φ and 28mm Φ	D=8d
Bars 32mm Φ and greater	D=10d

Bends and hooks in stirrups and lateral ties may be bent to the diameter of the principal bar enclosed therein.

CW-7.3.3 Protection of Material

Steel reinforcement shall be protected at all times from injury. When placed in the work, it shall be free from dirt, detrimental scale, paint, oil or other foreign matter. However, when steel has on its surface easily removable and detrimental rust, loose scale or dust, it shall be cleaned by a satisfactory method, approved by the NPC.

Store reinforcement of the different sizes in racks raised above the ground with accurate identification. Protect reinforcing steel from contaminants such as grease, oil and dirt.

CW-7.3.4 Placing and Fastening Reinforcement & Miscellaneous Material

All reinforcement bars, stirrups, hanger bars, wire fabric, spirals and other reinforcing materials shall be provided as indicated in the drawing or required by the specification, together with all necessary wire ties, chairs, screws, supports, and other devices necessary to install and secure the reinforcement properly. All reinforcement, when placed, shall be free from rust, scale, oil, grease, clay, and other coatings, and foreign substances that would reduce or destroy the bond. Rusting of reinforcement shall not reduce the effective cross sectional area of the reinforcement to the extent that the strength is reduced beyond specified values. Heavy, thick rust or loose, flaky rust shall be removed by rubbing with burlap or other approved method, prior to placing. Reinforcement that has bends not shown on the project drawings or on approved shop drawings, or is reduced in section by rusting such that its weight is not within permissible ASTM tolerances, shall not be used. All reinforcement shall be supported and wired together to prevent displacement by construction loads or by the placing of concrete. Unless directed otherwise by the NPC, reinforcement shall not be bent after being partially embedded in hardened concrete. Detailing of reinforcing shall conform to ACI 315. Where cover over reinforcing steel is not specified or indicated, it shall be in accordance with ACI 318.

All steel reinforcement shall be accurately placed in position shown on the drawings or as required by the NPC and firmly held there during the placing and setting of the concrete. Bars shall be tied at all intersections except where spacing is less than 30 mm in each direction, when alternate intersections shall be tied. Ties shall fasten on the inside.

Distance from the forms shall be maintained by means of stays, blocks, hangers or other approved supports. Blocks for holding reinforcement from contact with the forms shall be pre-cast mortar blocks of approved shape and dimensions or approved chairs. Layers of bars shall, be separated by pre-cast mortar blocks or by other equally suitable devices. The use of pebbles, pieces of broken stone or brick, metal pipe and wooden blocks or metal chairs shall not be permitted. Unless otherwise shown on the Drawings or required by the NPC, the minimum distance between bars shall be 40mm. Reinforcement in any member shall be placed and then inspected and approved by the NPC before the placing of concrete commences. Bundled bars shall be tied together at not more than 1.80 meters intervals.

Reinforcement shall be placed accurately and secured. It shall be supported by suitable chairs and spaces or by metal hangers. On the ground, and where otherwise subject to corrosion, concrete or other suitable non-corrodible material shall be used for supporting reinforcement. Where the concrete surface will be exposed to the weather in the finished structure or where rust would impair the appearance or finish of the structure, all reinforcement supports, within specified concrete cover, shall be galvanized or made of a suitable non-corrodible material.

All placement or movement of reinforcing steel after placement, to positions other than indicated or specified, shall be subject to the approval of the NPC.

Concrete protection for reinforcement shall be as indicated, or if not indicated, in accordance with ACI 318.

The minimum concrete cover for reinforcement specified in the bid documents shall takes precedence over all permissible reinforcement placement variations; nothing in the variations listed below is to be constructed as permitting violation or compromise thereof:

- | | |
|--|------------------|
| a. Height of bottom bars | ±6mm above form |
| b. Lengthwise positioning | ±50mm of bars |
| c. Spacing bars in walls and solid slabs | ±25mm |
| d. Spacing bars in beams and footings | ±6mm |
| e. Height of top bars | ±6mm |
| f. Stirrup spacing: | |
| (1) For any one stirrup | ±25mm |
| (2) For over-all group | ±25mm of stirrup |

Anchors and bolts; including but not limited to those for the machine and equipment bases: frames or edgings, hangers and inserts, door bucks, pipe supports, pipe sleeves, pipe passing through walls, metal ties, conduits, flashing reflects, drains and all other materials in connection with the concrete construction shall, where practicable be placed and secured in position when the concrete is placed. Anchor bolts for machines shall be set to templates, shall be plumbed carefully and checked for location and elevation with an instrument, and shall be held in position rigidly to prevent displacement while concrete is being placed.

CW-7.3.5 Splicing

Splicing of reinforcement shall be in accordance with ACI 318, except as indicated otherwise or modified herein. Where splices in addition to those indicated on the drawings are necessary, they shall be approved by the NPC prior to their use. Splices shall not be made in beams, girders, and slabs at points of maximum stress. Butt Splicing shall preferably be used over lapping for bar sizes larger than 32 mm Φ . Splices to be welded shall conform to AWS D1.4; certification of weld ability of the reinforcement by the manufacturer, shall be submitted to the NPC. If the Supplier elects to use butt splicing of reinforcing, he shall submit complete details of the process to be used by the NPC. If the butt splices are used the Supplier shall ensure that the splice meets the requirements specified herein by performing at least three splices which shall be submitted for tests to a testing laboratory that has been approved for such testing by the NPC. The cost of these shall be borne by the Supplier.

All reinforcement shall be furnished in the full lengths indicated on the Drawings. Splicing of bars, except where shown on the Drawings will not be permitted without the written approval of the NPC. When allowed, splices shall be staggered as far as possible and with a minimum separation of not less than 40 bar diameters. Not more than one-third of the bars may be spliced in the same cross section, except where shown on the Drawings.

Unless otherwise shown on the Drawings, bars shall be lapped a minimum distance of:

<u>Splice Type</u>	<u>Grade 40 Min.Lap</u>	<u>But Not Less Than</u>
Tension	24d	300mm
Compression	20d	300mm

Where d is the diameter of the bar. In lapped splices, the bars shall be placed in contact and wired together. Lapped splices will not be permitted at locations where the concrete section is insufficient to provide a minimum clear distance of one and one-third the maximum size of coarse aggregate between the splice and the nearest adjacent bar. Welding of reinforcing steel shall only be done if detailed on the Drawings or if authorized by the NPC in writing. Spiral reinforcement shall be spliced by lapping at least one and half (1 1/2) turns or by butt-welding unless otherwise shown on the drawings.

CW-7.4 Measurement and Payment

The quantity to be paid for shall be the calculated theoretical number of kilograms of reinforcement steel bars as determined from the net length of the steel shown on the drawings, incorporated in the concrete and accepted.

The weight of deformed bars will be computed from the theoretical weight of the same nominal size as shown in the following tabulation:

<u>Designation</u>	<u>Size (mm)</u>	<u>Weight (kg/m)</u>
#2	6	0.222
#3	10	0.616
#4	12	0.888
#5	16	1.579
#6	20	2.468
#8	25	3.854
#9	28	4.833
#10	32	6.313
#11	36	7.991

Clips, ties, separators and other and related materials used for positioning and fastening the reinforcement in place as required by the NPC shall not be included in the weight-calculated payment under this item. If bars are substituted upon the Supplier's request and as a result, more steel is used than specified – only the amount specified shall be included.

When laps are made for splices, other than those shown on the drawings or required by the NPC and for the convenience of the Supplier, the extra steel shall not be measured nor paid for.

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for the accepted quantity of Reinforcing Steel. Corresponding cost hereof shall be included in the unit bid price of relevant item(s) in the Schedule of Requirements which payment shall be made in full compensation for furnishing materials, labor, equipment and incidentals necessary to complete this item.

CW-8.0 STRUCTURAL STEEL**CW-8.1 General**

This section covers the fabrication, erection, and shop painting of structural steel in accordance with the AISC "Manual of Steel Construction" referred to herein. In the AISC "Manual of Steel Construction" referred to herein, the Specification for Design, Fabrication, and Erection of Structural Steel for Buildings," and "Structural Joints using A307 or A325 Bolts" shall be considered a part thereto.

CW-8.1.1 Submittals

Shop Drawings of all structural steel in five (5) copies for approval prior to fabrication of structural steel with complete information necessary for the fabrication and erection of the component parts of the structure including the location, type and size of all bolts and welds, member sizes and lengths, camber & connector details, blocks, copes, and cuts. Include all welds by standard welding symbols.

Erection Plan consists of descriptive data to illustrate the structure steel erection procedure including the sequence of erection and temporary shoring and bracing, and written description of the detailed sequence of all welding, including each welding procedure to be performed.

Certificates of Conformance for the following:

- Bolts, Nuts and Washers
- Welding Electrodes and Rods
- Paint
- Steel
- Certified Test Reports

Chemical Analysis and Tensile Strength Test of structural steel in accordance to ASTM A36.

For bolts and nuts, the Supplier shall also submit chemical analysis, including tensile strength and hardness tests as required by ASTM A307.

CW-8.1.2 Delivery and Storage

All materials shall be handled, shipped and stored in a manner that will prevent distortion or other damages. Materials shall be stored in a clean and properly drained location and out of contact with the ground. Damaged materials shall be replaced or, when permitted by NPC, may be repaired in an approved manner at no additional cost to NPC.

CW-8.2 Materials

All the materials shall be of the best quality of their kind, well graded and within the allowable distortions. They shall be free from flakes, corrosion, scale of fragments that could reduce the resistance and durability or injure the external appearance.

Except as modified herein, blast clean surfaces in accordance with SSPC SP6. Wash clean surfaces that become contaminated with rust, dirt, oil, grease or other contaminants with solvents until thoroughly clean. Ensure that steel to be embedded in concrete and surfaces when assembled, are free from rust, grease, dirt and other foreign matter.

CW-8.2.1 Steel

Materials shall conform to the respective specifications specified herein. Materials not otherwise specified herein shall conform to the AISC "Manual of Steel Construction".

Structural Steel:	ASTM A36
Steel Pipe:	ASTM A53, Type E or S, Grade B, ASTM A501
Steel W-Shape Piles (Soldier Piles):	ASTM A328

CW-8.2.2 Bolts, Nuts and Washers:

All bolts, nuts and washers shall be of hot-dip galvanized steel, in accordance with the following:

Bolts:	ASTM A307, Grade A or ASTM A36 for Anchor Bolts; ASTM A325 for Fastening Bolts
Nuts:	ASTM A563, Grade A, heavy hex style, except nuts less than 38mm may be provided in hex style
Washers:	ANSI B18.22.1, Type B

CW-8.2.3 Accessories:

Welding electrodes and steel structural members shall use:

Rods	E60XX electrodes
Non-shrink Grout	ASTM C827, non-metallic

CW-8.3 Execution**CW-8.3.1 Fabrication**

Structural steel fabrication shall be in accordance with the applicable provisions of the Specification for the Design, Fabrication, and Erection of Structural Steel for Buildings as set forth in the AISC "Manual of Steel Construction".

CW-8.3.2 Welding of Structural Steel Work:

All welding works shall be as indicated in the drawings and shall conform to AWS D1.1 - 77 "Structural Welding Code". Unless specified on the drawings, fillet welds shall be a minimum of 5 mm (3/16") and welding electrodes shall be with a tensile strength of 485 MPa.

All welding works shall be executed by the AWS D1.1 qualified welders, welding operators and trackers, whose workmanship shall be subject to the approval of NPC.

CW-8.3.3 Shop Painting

Except as otherwise specified, shop prime surfaces of all structural steel, except steel to be embedded in concrete or mortar. Surfaces to be welded shall not be coated within 12 mm from the specified top of the weld prior to welding. Insure that the surfaces are thoroughly dry and clean when the paint is applied. Do not paint on wet weather except under cover. Do not apply paint to steel, which is at a temperature that will cause blistering or porosity, or will otherwise be detrimental to the life of the paint. Apply paint with high quality workmanship, and coat all joints and crevices thoroughly. Prior to assembly, paint all surfaces that will be concealed or inaccessible after assembly.

Shop prime coat surfaces as soon as possible after cleaning. Apply one coat of inorganic zinc to a minimum dry film thickness of 100 microns.

- **Field painting:** When the erection work is complete, the heads of field bolts, all welds and any surface from which the shop coat of paint has become worn off or has otherwise become defective, shall be cleaned and thoroughly covered with one coat of shop coat paint. When the paint applied for touching up bolt heads and abraded surfaces has become thoroughly dry, apply two field coats of marine epoxy paint subject to the approval of NPC.

- **Marking:** Prior to erection, members shall be provided with a painted erection mark. In addition, connecting parts assembled in the shop for remaining holes in field connections shall be matched marked with scratch and notch marks. Do not locate erection markings on areas to be welded. Do not locate erection markings in areas that will decrease member strength or cause stress concentrations.

CW-8.3.4 Erection

Except as modified herein, erect steel in accordance with the AISC "Manual of Steel Construction". Where parts cannot be assembled or fitted properly as a result of errors in fabrication or of deformation due to handling or transportation, report such condition immediately to the NPC's Representative and obtain approval there from for the methods of correction for straightening, including members of steel conforming to ASTM A514.

Drain Steel work properly; fill pockets in structures exposed to the weather with an approved waterproof material.

Provide safety belts and lines for workmen aloft on high structures unless safe working platforms or safety nets are provided.

When calibrated wrenches are used for tightening bolts, calibrate them at least one each working day using not less than three typical bolts of each diameter. Do not use impact torque wrenches to tighten anchor bolts set in concrete.

Connections: Connections shall be executed as shown on drawing. In case, connections are not detailed, it shall be designed in accordance with AISC "Manual of Steel Construction". Build connections into the existing work. Punch, sub-punch and ream, or drill bolt holes.

Tolerances: Structural steel shall be furnished and installed to the lines and levels as shown on the drawings.

Any structure that does not conform shall be repaired, removed and/or erected anew by the Supplier at no additional cost to NPC.

Tolerances on structural steel shall be in accordance with the "Code of Standard Practice" of the AISC "Manual of Steel Construction".

CW-8.3.5 Tests and Inspections

Visual Inspection of Welding: After the welding is completed, hand or power wires brush welds, thoroughly clean them before the inspector makes the check inspection. Inspect welds with magnifiers under strong, adequate light for surface cracking, porosity, and slag inclusions; excessive roughness; unfilled craters; gas pockets; undercuts; overlaps; size and insufficient throat and concavity. Inspect the preparation of groove welds for adequate throat opening and for snug positioning of backup bars.

Non-Destructive Testing¹: In accordance with AWS D1.1 Twenty-five percent (25%) of the total number of joints, as selected by the NPC, shall be tested. If more than 20 percent of welds contain defects identified by testing, then all welds shall be tested by radiographic or ultrasonic testing, and to be approved by the NPC. When all welds made are required to be tested, magnetic particle

¹ Not applicable on non-critical structures/joints and as directed/required by NPC Design Engineer.

testing shall be used only in areas inaccessible to either radiographic or ultrasonic testing. Retest defective areas after repair.

CW-8.4 Measurement and Payment

Measurement for payment for structural steel shall be based on the total number of kilograms of structural steel placed and accepted and shall constitute full compensation for furnishing all labor, materials and equipment necessary to complete the item.

Unless otherwise specified in the Schedule of Requirements, no separate Measurement and Payment will be made for the item Structural Steel in the Schedule of Requirements.

CW-9.0 REINFORCED CONCRETE FOUNDATION AND ASSOCIATED STRUCTURES FOR EQUIPMENT AND OTHER COMPONENT (DESIGNED/CONSTRUCTED BY SUPPLIER)

CW-9.1 Scope

In accordance with the specification contained in this section, the Supplier shall design and furnish all materials, labor, equipment and tools to construct all reinforced concreting and relevant works based on the approved drawings or as directed by NPC.

CW-9.2 Design and Construction

The design and construction of reinforced concrete foundations and other elements for equipment and related component to be furnished by the Supplier shall be the responsibility of the Supplier. Reinforced concrete foundations shall be designed based on the actual weights, dimensions and relevant design parameters of the equipment and structures subject to NPC's evaluation and approval. No foundation and structural elements shall be constructed unless its design is duly approved in writing by NPC.

The minimum design parameters to be considered by the Supplier are as follows:

1. Compressive strength of concrete shall be 20.7 MPa at 28 days
2. Reinforcing steel shall conform to Philippine National Standards grade DSB 275
3. Compacted sand and gravel bedding shall be 150 mm thick
4. Soil bearing capacity shall be subject to the Supplier's determination and verification at the site
5. Wind velocity shall be based on the latest edition of NSCP.
6. Concrete pad or pedestal shall extend 150 mm beyond the equipment skid/base on all sides or at least 50 mm beyond the base plate of equipment supports
7. Top of foundations/pedestals shall be 300 mm above the finished ground elevation

8. Anchor bolt materials shall be A307 with nuts and washers. Sizes and number of anchor bolts shall be designed to safely withstand all forces acting on the equipment/structures. Anchor bolts and other embedded items shall be properly and securely installed prior to the placing/pouring of concrete.

All works and materials shall be constructed, installed and/or erected to conform with the relevant sections of this Specifications and in accordance with the generally accepted engineering techniques and methodologies.

CW-9.3 Measurement and Payment

Unless otherwise indicated in the Schedule of Requirements, no separate measurement and payment will be made for the design and construction of reinforced concrete foundation and/or other structural elements of the equipment and their related components. The entire cost of furnishing of all materials, labor, equipment and tools for the entire works shall be included in the supply and installation of associated mechanical and/or electrical equipment/works where they are required.

CW-10.0 DRAINAGE SYSTEM AND APPURTENANT STRUCTURES**CW-10.1 Scope**

In accordance with the specifications contained herein, the Supplier shall furnish all materials, labor, equipment and tools, perform all required excavation and backfill, install all pipes and construct canals and ditches, as the case may be, where indicated on the drawings or where directed conforming with the lines and grades as established in the field by the NPC. The Supplier shall also construct or install, where required, appurtenant structures like street inlet, street inlet-catch basin combination, manhole, catch basin for downspouts, drainage outlets, etc. as well as joints and connections as may be required to complete the system.

CW-10.2 Materials**CW-10.2.1 Non-Reinforced Concrete Drainage Pipes**

Non-reinforced concrete drainage pipes shall meet the requirements of ASTM C14.

One pipe length shall be taken at random representing a group of fifty (50) pipes or fraction thereof of the same size and shall be submitted for test. Any group represented by corresponding test specimens that do not meet the strength and other test requirements shall not be used in the work.

CW-10.2.2 Reinforced Concrete Drainage Pipes

Reinforced concrete drainage pipes shall meet the design and test requirements for Class II Reinforced Concrete Pipes in accordance with ASTM C76 and ASTM C497.

One (1) pipe length shall be taken at random representing a group of fifty (50) pipes or fraction thereof of the same size and shall be submitted for test. Any group represented by corresponding test specimens that do not meet the strength and other requirements shall not be used in the work.

CW-10.2.3 PVC Pipes

Polyvinyl Chloride (PVC) Pipes shall be unplasticized conforming to ISO4435 or equivalent. Details/scheme of perforation shall be as indicated in the bid drawing or as directed by NPC.

CW-10.2.4 Concrete Covered Rectangular Ditch

Cement, reinforcing steel, aggregate and water to be used for the construction of concrete covered rectangular ditch and open rectangular canal shall conform to the requirements set forth in Section CW-6.0 – Concrete. Foundation base material for concrete canal shall be sand and gravel as described in Section CW-5.0.

CW-10.2.5 Bedding Material**A. For Stable Soil and Rock Foundation**

Bedding material for sewerage and drainage pipes in stable soil and rock foundation, as determined by NPC, shall consist of sand or natural sandy soil in which all the materials passes a 9.5 mm (3/8") sieve but not more than 10% passes a 0.074 mm (No. 200) sieve.

B. For Unstable Foundation

Bedding for sewerage and drainage pipes in soft and unstable foundation as determined by the NPC, shall consist of 13.79MPa concrete cradle in conformity with the dimensions shown on the drawings, or as determined by the NPC.

C. Foundation under Roadways and Parking Areas

Bedding for sewerage and drainage pipes crossing under roadways and parking areas with pipe cover (excluding concrete or asphalt pavement) of 60.9 cm (2 ft.) or less shall consist of 13.79MPa concrete cradle in conformity with the dimensions shown on the drawings, or as determined by the NPC.

CW-10.3 Construction**CW-10.3.1 Trench Excavation and Backfill**

Trench excavation and backfill work shall be done in accordance with the pertinent provisions of Section CW-5.0.

CW-10.3.2 Concrete Canal

Concrete canal, open or covered, shall be constructed in accordance with the lines and grades shown on the drawings. Class of concrete shall be as indicated on the drawings or directed by the NPC.

CW-10.3.3 Appurtenant Structures

Appurtenant structures like street inlet, street inlet-catch basin combination, manhole, catch basin for downspouts, catch basin for intersecting perforated PVC pipes, septic tank, drain pit, drainage outlets, etc. shall be constructed at locations indicated on the plans or at the other convenient locations designated by the NPC. All appurtenant structures shall be of 20.7 MPa concrete unless otherwise shown on the drawings.

CW-10.4 Pipe Installation**CW-10.4.1 General**

Before any drain pipe is installed, the sand or concrete bedding shall have been prepared and approved in accordance with the grade, shape, and dimensions shown on the drawings, or as directed by the NPC. No pipe over 45.7 cm (18") in diameter shall be laid on concrete bedding until seven (7) days have been elapsed after placing the concrete bedding. Pipes under 45.7 cm (18") in diameter may be laid after five (5) days elapsed after placing the concrete bedding.

All drain pipes shall be laid carefully, hubs upgraded, ends fully and closely jointed, and true to the lines and grades given. Succeeding pipe shall be jointed to the previously laid pipe, correct in alignment and grade. Any pipe, which has been damaged during installation or before acceptance of the work, shall be replaced and laid by the Supplier at his expense.

CW-10.4.2 Non-Reinforced and Reinforced Concrete Drainage Pipes

Whenever possible, concrete pipes shall be handled and installed with the aid of mechanical equipment and not just rolled or pushed into the trench from the bank. For small pipes, rope slings may be placed at both ends of the pipes and the rope slowly paved out until the pipe rests on the trench bed. proper and careful handling and laying should be observed at all times to prevent unnecessary structural damage to the pipe, especially at the pipe ends.

For pipes on sand bedding, before joining the next pipe length to the last pipe already laid, the bottom of the trench shall be excavated to the shape, size and location of the collar below the joint. The next pipe section shall then be securely attached to the previously laid pipe seeing to it the correct alignment and grade is always attained. Same procedures shall be observed for the remaining pipes.

All pipe joints shall be filled with stiff mortar composed of one (1) part cement and two (2) parts clean sand and enough water. The inside part of the joint shall be plastered properly to bring the inside surfaces of jointed pipe ends flush even. Sufficient mortar shall be placed on the outside surface of joint to form a bead around the joint. Plastering work shall be as directed and approved by the NPC. After initial set, the mortar on the outside surface shall be protected from air and sunlight with a cover thoroughly wetted earth or burlap. Curing of the joint shall be done for a period of at least seven (7) days within which no backfill shall be placed on the installed pipeline.

CW-10.5 Measurement and Payment**CW-10.5.1 Reinforced Concrete Canal**

Measurement for payment for reinforced concrete canal, open or covered, and other channels will be based on the number of linear meters of canal constructed and accepted.

Payment will be made at the corresponding contract unit price for each type, open or covered, per linear meter shown in the Schedule of Requirements. Payment shall constitute full compensation for furnishing all labor, materials, equipment and tools necessary for the construction of the concrete canal including attendant excavation, bedding and backfilling.

CW-10.5.2 Concrete Drainage Pipes and uPVC Pipes

Non-reinforced and reinforced concrete drain pipes, and uPVC pipes in place and accepted will be measured by the linear meter along the centerline of the pipeline.

The quantities measured as provided above, completely installed and accepted, will be paid at the contract unit price for each size and kind of pipe shown in the Schedule of Requirements. Payment shall constitute full compensation for furnishing all labor, material, equipment and tools for fabricating, hauling, installing and jointing of pipes. Payment shall also include the cost of attendant excavation, bedding and backfilling.

CW-10.5.3 Appurtenant Structures

Measurement for payment of appurtenant structures like street inlet, street inlet-catch basin combination, manhole, catch basin for downspouts, septic tank, drain pit, drainage outlets, etc. will be based on the number of structures constructed/installed and accepted.

The Supplier will be paid at the contract unit price for the pertinent item for each appurtenant structure shown in the Schedule of Requirements. Such payment shall cover all costs for furnishing all equipment, labor, materials and tools necessary to complete the construction of the aforementioned appurtenant structures. Payment also includes the cost of attendant excavation and backfill, furnishing, scheduling, cutting, bending and placing of reinforcing steel.

CW-10.5.4 Bedding

Unless otherwise specified in the Schedule of Requirements, no separate measurement and payment will be made for Bedding. Corresponding cost hereof shall be included in the unit bid price of relevant item(s) in the Schedule of Requirements which payment shall constitute full compensation for furnishing all labor, materials, equipment and tools necessary to complete the items.

CW-11.0 SECLUSION FENCE**CW-11.1 Scope**

In accordance with the specifications contained herein, the Supplier shall furnish all labor, materials, equipment and tools and shall construct the seclusion fence including vehicular and pedestrian gate to the length or extent shown on the drawings or as established in the field.

CW-11.2 Materials**CW-11.2.1 Cement and Reinforcing Steel**

Cement and Reinforcing steel shall conform to the requirements set forth in the Section CW-6.0 – Concrete. Class of concrete shall be 20.7MPa or as shown on the drawings.

CW-11.2.2 Heavy Galvanized Cyclone Wire

The material shall be made from steel wire helically wound and interwoven in such a manner as to provide a continuous mesh without knots or ties except in the form of knuckling or of twisting and barbing the ends of the wires to form the selvage of the fabric. The base metal shall be steel of such quality and purity that, when drawn to the size of wire specified and coated with zinc either before or after fabrication, the finished fencing shall be of uniform quality and have the properties and characteristics conforming to ASTM Designation A392. Fabric that is zinc coated after weaving and produced in accordance with this specification shall be hot-dip galvanized. Fabric that is zinc coated before weaving may be either electrolytically or hot-dip galvanized.

At the option of NPC, Heavy Galvanized Cyclone wire delivered to the site shall be tested. One roll from every fifty (50) rolls or fraction thereof shall be taken at random as a sample for test purposes, except in no case shall less than two (2) samples be tested. To determine compliance with the requirements of this specification, the test specimens for each of the test specified shall be taken from the outside end of the sample rolls representing the lot. If any specimen tested fails to meet the requirements of this specification, the roll represented by the specimen shall be rejected and two (2) additional rolls shall be tested, both of which shall meet the requirements in every respect, otherwise the lot represented by the sample may be rejected.

CW-11.2.3 Fine/Coarse Aggregates and Water

Fine and coarse aggregates and water shall conform to the requirements stated in Section CW-6.0 – Concrete.

CW-11.2.4 G.I. Pipes

Galvanized iron pipes for the seclusion fence and gates shall conform to ASTM A120.

CW-11.2.5 Structural Steel

All structural steel (rolled shapes and plates) for the fabrication of the vehicular and pedestrian gates, unless otherwise specified on the drawings, shall conform to ASTM A36.

CW-11.2.6 CONCRETE HOLLOW BLOCKS (CHB)

Concrete hollow blocks shall be 150 mm x 200 mm x 400 mm (6"x 8"x 16") non-load bearing with a compressive strength of 3.10MPa. CHB units shall be free of chips, splits or other defects, which in the opinion of the NPC, might impair their strength and durability. At the option of the NPC, CHB units delivered to the site shall be tested to check on their specified strength. One specimen taken at random representing 500 units shall be tested. Sampling shall be done by the NPC. The group represented by a specimen that fails the compression test shall not be used in the work.

CW-11.3 Construction

- a) Excavation, backfilling and concreting work shall be in accordance with the applicable provisions of Section CW-5.0 – Structural Excavation, Fill and Backfill and Section CW-6.0 – Concrete.
- b) Fabrication and installation of the heavy galvanized cyclone wire seclusion fence and gate shall be in accordance with the drawings or as directed by the NPC.
- c) All welding work shall conform to the Specification for Welded Highway and Railway Bridges of the American Welding Society (AWS).

CW-11.4 Measurement and Payment**CW-11.4.1 Seclusion Fence Including Vehicular and Pedestrian Gate**

Measurement for payment shall be based on the number of linear meters of seclusion fence including vehicular and pedestrian gate constructed and accepted.

Payment shall be made at the corresponding contract unit price for seclusion fence, shown on the Schedule of Requirements, which payment shall include the cost of furnishing all labor, materials, equipment and tools necessary for the construction of seclusion fence including reinforced concrete posts, CHB wall and footing, excavation and backfill.

CW-12.0 STONE MASONRY / GROUTED ROCKWALL (NOT USED)**CW-12.1 Scope**

The work covers all works in connection with slope protection works or as directed by NPC. The works shall consist of construction of stone masonry walls or grouted riprap as shown in the drawings and as required by NPC.

CW-12.2 Materials**CW-12.2.1 Boulders**

Boulders shall consist of hard, durable and selected stones, free from seams, weathered parts, dirt or any other injurious material that may prevent the proper adhesion of the mortar. Minimum size shall be 10 centimeters in diameter or 0.00055 cubic meters. Stones placed beside the boulders shall be equal or less than the size in volume with the exception that smaller rocks may be used for pinning and for filling the interstices or voids between them.

The stones shall be roughly squared where required. All shaping or dressing of stone shall be done before the stone is laid.

CW-12.2.2 Mortar for Masonry Works**A. Scope**

This part deals with the proportioning, mixing and transportation of the mortars to be used for the grouted rockwall and other relevant stone masonry works.

B. Materials

- 1) Portland Cement – Portland cement shall be furnished by the Supplier and provisions set forth in CW-6.0 (Concrete) shall govern.
- 2) Sand - Coarse and fine sand shall consist of hard, tough, durable, uncoated particles acceptable to NPC. All foreign materials and dust shall be removed by processing.
- 3) Water – Water for mortar shall be free from oil, acid, alkali, vegetable matter or other deleterious substances and shall be reasonably clear and clean.

C. Proportioning

The mortars shall be proportioned by volume as specified in the following table:

Class of Mortar	Portland Cement	Hydrated Lime	Sand
A	1 part	-	2 parts
B	1 part	-	3 parts
C	1 part	½ part	3 parts
D	1 part	1 ½ part	3 parts

The method of measuring materials for the mortar shall be such that the specified proportions of the mortar materials can be controlled and accurately maintained during the progress of the work.

The quantity of water shall be the necessary one to obtain a satisfactory workability for the specific use of each mortar.

D. Mixing

The mortar shall be mixed for a minimum of 2 minutes in a mechanically operated drum type mixer or equivalent mixer approved by NPC.

The mixer shall be rotated at the speed recommended by the manufacturers and the total quantity of materials mixed in any batch shall not exceed the rated capacity of the mixer.

The gauged amount of water shall be gradually introduced into the mixer, partly before the loading of the dry materials and partly immediately after the loading of the same has been completed.

The entire content of the drum shall be discharged before a new cycle of batching is started, and at all times, the inside of the drum shall be kept free from build-up of materials. The mixer drum shall be thoroughly cleared-out prior to change of mix or on cessation of mixing.

Hand-mixing for small batches is permissible provided that the mortar is mixed up to the degree obtained with the mechanically operated mixer. If hand mixing of the mortar is permitted by NPC, the fine aggregates and cement shall be mixed dry in a tight box until the mixture assumes a uniform color, after which, water shall be added as the mixing continues.

E. Placing

Stones shall be thoroughly wetted before placing, and shall be laid by hand in full mortar beds, in courses approximately horizontal both in longitudinal and transverse directions. Stones will not be considered to be properly bedded until mortar exudes from the underside of the bedded stones. No voids in any part of the rip-rap will be permitted.

F. Transportation

The equipment and the tools for transportation and for placing batched mortar shall ensure that contamination or loss of ingredients do not take place.

Mortar shall be stirred or worked at frequent intervals to prevent separation. Any mortar that is not placed within thirty minutes after the first water has been added to the batch shall be wasted. Except for necessary tempering on the mortar board, the retempering of the mortar shall not be permitted.

G. Payment

No separate payment shall be made for mortar, which shall be included in the stipulated price fully grouted riprap or stone masonry works.

CW-12.3 Measurement for Payment

Measurement for payment of the fully grouted rockwall and/or stone masonry shall be based on the actual volume placed and accepted. Opening of less than 10 percent for each cross-sectional area shall not be deducted.

Unless otherwise indicated in the Schedule of Requirements, no separate measurement and payment will be made for grouted rockwall. Payment hereof will be made at the corresponding pertinent pay items in the Schedule of Requirements per cubic meter, which shall constitute full compensation for the furnishing of all materials, labor and equipment necessary for the rip-rapping/stone masonry works.

CW-13.0 PERIMETER FENCE AND VEHICULAR/PEDESTRIAN GATE**CW-13.1 Scope**

In accordance with the specifications contained herein, the Supplier shall furnish all labor, materials, equipment and tools for the construction of perimeter fence to the length or extent shown on the drawing or as established in the field.

CW-13.2 Materials**CW-13.2.1 Cement and Reinforcing Steel**

Cement and reinforcing steel shall conform to the requirements set forth in Section CW-6.0 – Concrete. Class of concrete shall be 20.7MPa or as shown on the drawings.

CW-13.2.2 Concrete Hollow Blocks (CHB)

Concrete hollow blocks shall be 150 mm x 200 mm x 400 mm (6"x 8"x 16") non-load bearing with a compressive strength of 3.10MPa. CHB units shall be free of chips, splits or other defects, which in the opinion of the NPC, might impair their strength and durability. At the option of the NPC, CHB units delivered to the site shall be tested to check on their specified strength. One specimen taken at random representing 500 units shall be tested. Sampling shall be done by the NPC. The group represented by a specimen that fails the compression test shall not be used in the work.

CW-13.2.3 Fine and Coarse Aggregates and Water

Fine and coarse aggregates and water shall conform to the requirements stated in CW-6.0 – Concrete.

CW-13.2.4 Galvanized Barbed Wire

Barbed wire shall consist of three (3) strands of 2.7mmØ heavy galvanized wire with 2.2mmØ four-point barbs. It shall be of the coating class as specified in the drawings.

Individual wire specimen shall stand being bent cold through 180° without fracture on the wire and without flaking off of the zinc coating.

CW-13.2.5 Structural Steel (Vehicular/Pedestrian Gate)

Fabrication and installation of vehicular and pedestrian gates shall conform to the requirements of the drawings or as directed by the NPC.

Steel square bars shall be used as the main frame of the gate. The other lower sizes as shown/indicated in the bid drawings shall be as the secondary frames of the gate.

All tubular steel for Pedestrian and Vehicular gate including railings/grills shall be hot-dipped galvanized.

CW-13.3 Construction

- a. Excavation, backfilling and concreting work shall be in accordance with the applicable provisions of Section CW-5.0 – Structural Excavation, Fill and Backfill and Section CW-6.0 – Concrete, respectively.

- b. CHB Construction

Laying – All masonry units shall be plumbed, leveled and accurately spaced. All units shall be wetted before laying. The block should be laid on full mortar bedding and in such a way that no cracks are formed between the blocks and the mortar at the time it is laid. Any horizontal and vertical CHB wall reinforcements shall be anchored to concrete works by means of 10 mm (3/8") round by 609 mm (24") long dowels. Embedding of anchor bolts, expansion shields, conduits, etc. shall be done as the erection progresses.

Cutting and Patching – Cutting and patching of masonry required to accommodate the work of other trades shall be performed by masonry mechanics.

Finishing – All hollow block wall surfaces to be applied with cement plaster will be cleaned, evenly wet slushed with a wash of neat cement and sand followed by 1:2 cement mortar mix 10 mm (3/8") thick which shall be applied with a wooden float.

c. Mortar Proportions

- 1) Cement mortar for laying concrete hollow blocks shall consist of one (1) part Portland cement, one-fourth (1/4) part lime and three (3) part sand. Only sufficient water to make a workable mix will be permitted.
- 2) All horizontal reinforcement shall be tied to vertical reinforcement.

d. Fabrication and installation of vehicular and pedestrian gates shall conform to the requirements of the drawings or as directed by the NPC.**e. All welding work shall conform to the Specifications for Welded Highway and Railway Bridges of the American Welding Society (AWS).**

Galvanized surfaces to be painted, in addition to being cleaned with mineral spirits or other solvents, will require surface treatment to which paint will adhere. The galvanized surfaces, therefore, shall be coated with a solution of 7.5 grams of copper sulfate to a liter of water, allowing the coating to remain on the surface of at least twelve (12) hours, and dusting off with stiff brushes.

Surfaces to be painted shall be clean, dry, smooth and free from dust, rust, grease or oil. Sufficient time shall be allowed between coats of paints to insure complete drying but in no case less than 24 hours. No painting shall take place during the presence of rain, fog, dew or where the surfaces may otherwise be damp. All work shall be done with high quality workmanship, leaving finished surfaces free from runs and sags.

CW-13.4 Measurement and Payment**CW-13.4.1 Perimeter Fence**

Measurement for payment for perimeter fence will be based on the number of linear meters of fence constructed and accepted or as indicated in the Schedule of Requirements.

CW-13.4.2 Vehicular/Pedestrian Gate

Unless otherwise indicated in the Schedule of Requirements, no separate measurement and payment will be made for the fabrication and installation of vehicular and/or pedestrian gates. All costs hereof shall be included in the payment for perimeter or seclusion fences, as applicable, or as indicated in the Schedule of Requirements.

CW-14.0 GRAVEL SURFACING**CW-14.1 SCOPE**

The Contractor shall furnish gravel surfacing in areas as required in the drawings or as directed by the NPC. The Contractor shall furnish all materials, labor, equipment and other necessary accessories so as to complete the work satisfactorily.

CW-14.2 MATERIALS AND WORKMANSHIP

All gravel surfacing as shown in the drawing shall consist of a base layer and finish layer. Material for base layer shall be natural or crushed stone of a clean, hard and durable quality. Before placing of the base course, the surface of the subgrade shall be cleaned of all objectionable substances and properly shaped and drained. The material for base layer shall not be more than 5 cm. in size, and placed and spread on the prepared subgrade to a thickness of 7.5 cm. Spread materials shall be compacted by means of rammer, tapping machine or approved equal equipment. The material for finish layer shall not be more than 2.5 cm. in size, and placed, spread, and compacted satisfactorily.

CW-14.3 MEASUREMENT AND PAYMENT

Measurement and payment will be based on the number of cubic meters of materials placed and compacted according to the drawings or as directed by NPC. Payment will be made at the contract unit price for the item Gravel Surfacing in the Schedule of Requirements. The unit price shall include all cost of subgrade preparation, materials, hauling, compacting equipment need to complete the item.

CW-15.0 STEEL POLE WITH CROSS-ARMS AND BRACES**CW-15.1 Description**

This specification covers the technical and associated requirements for the supply and erection of steel pole complete with cross arms and braces.

CW-15.2 Pole Requirements

The poles shall be manufactured and supplied with the required holes, rigging accessories, insulator attachment plates, lugs for bolted steps, guying attachments, ground clamps complete with bolts, nuts, washers and miscellaneous fittings, whenever necessary, and shall have the following properties of steel poles:

Description	40' (12.20 m)	35' (10.65 m)	30' (9.15 m)	25' (7.62 m)
Steel Material	ASTM A572	ASTM A572	ASTM A572	ASTM A572
Tip Diameter	200 mm	200 mm	200 mm	150 mm
Butt Diameter	320 mm	300 mm	260 mm	240 mm
Thickness	4 mm	4 mm	4 mm	4 mm
Shape	Octagonal	Octagonal	Octagonal	Octagonal
Minimum Yield Strength	345 MPa	345 MPa	345 MPa	345 MPa

The tip and butt shall be covered with plate similar to body thickness. Cross arm and brace members, if required in the Bid Drawings, shall be of the same material as pole body and shall conform to NPC's general arrangement drawings. The strength of the attachment of cross arms to the body shall be sufficient to develop the full capability of the cross arm.

Hole location and diameters for steel poles and cross-arms/braces shall be referred to electrical drawings.

All structural steel, bolts, nuts and washers shall be hot-dip galvanized after fabrication in accordance with ASTM A123 with minimum zinc thickness of 85 microns. Exposed welds shall be mechanically cleaned.

CW-15.3 Pole Erection

The Supplier shall use standard and accepted practice and method of erecting the poles depending on their location. The Supplier shall excavate holes for poles setting to a depth indicated below:

Depth of Pole Setting					
Length of Poles		In Earth		In Rock	
Meter	Feet	Meter	Feet	Meter	Feet
12.20	40	1.80	5.9	1.22	4.0
10.67	35	1.65	5.4	1.22	4.0
9.15	30	1.52	5.0	1.22	4.0
7.62	25	1.40	4.6	1.22	4.0

All holes shall be dug in the correct locations and shall be large enough to provide for the use of tamping bars all around the poles to the full depth of the holes.

All poles shall be set truly vertical and exact in alignment. After the poles have been set and aligned properly, the holes shall be backfilled with materials consisting of 20% sand AND 80% gravel. The gravel and sand material shall be filled around the holes and compacted thoroughly at 30 cm (12 inches) layer by tamping tools before placing the next 30 cm layer of gravel and sand, until the backfill material reaches the ground surface level. Materials from the excavated holes shall be placed and tamped around the poles to a height of 30 cm. (12 inches) above ground line and shall be spread sloping radially outward until it intersects with the ground surface.

The cross-arms and hardwares shall be assembled and installed properly in accordance with the drawings. All nuts and locknuts shall be adequately tightened.

Braces such as flat and x-braces, shall be attached where required. The braces shall be attached by the Supplier in accordance with the drawings. All nuts shall be tightened adequately.

CW-15.4 Measurement and Payment

Measurement for payment for steel pole shall be based on the total quantity of steel pole supplied, erected and accepted by NPC.

Measurement for payment for cross-arms and braces shall be on lot basis of cross-arms and braces supplied, installed to the respective poles and accepted by NPC.

Payment will be made at the contract unit price for the items, Steel Pole and; Steel Cross-arms and Braces in the Schedule of Requirements, which payment shall constitute full compensation for furnishing of all materials, labor and hardwares and accessories necessary to complete the items.

CW-16.0 GROUTING**CW-16.1 SCOPE**

This specification covers the requirements for the furnishing and installation of 2 component concrete epoxy grout unless shown otherwise on the design drawings.

CW-16.2 PHYSICAL PROPERTIES

The cured product shall have the following properties:

Tensile Strength = 27.65 MPa (4000 psi) min.

Compressive Strength = 63.60 MPa (9200 psi)

CW-16.3 SUBMITTALS

The Contractor shall submit copies of brochures/specifications for NPC's approval.

CW-16.4 MEASUREMENT AND PAYMENT

Unless otherwise specified in the Schedule of Requirements, no separate payment will be made for Grouting. Corresponding cost hereof shall be included in the unit bid price of relevant item(s) in the Schedule of Requirements which payment shall constitute full compensation for furnishing all labor, materials and equipment necessary to complete the items.

CW-17.0 PVC WATERSTOP**CW-17.1 SCOPE**

This specification covers the requirements for the furnishing and installation of PVC Waterstop as shown on the design drawings.

CW-17.2 PHYSICAL PROPERTIES

The PVC Waterstop shall have the following properties:

Tensile Strength = 13.82 MPa (2000 psi) min.

Tear Resistance = 115.87 N/mm (300 lb/in)

CW-17.3 SUBMITTALS

The Contractor shall submit copies of brochures/specifications for NPC's approval.

CW-17.4 MEASUREMENT AND PAYMENT

Unless otherwise specified in the Schedule of Requirements, no separate payment will be made for PVC Waterstop. Corresponding cost hereof shall be included in the unit bid price of relevant item(s) in the Schedule of Requirements which payment shall constitute full compensation for furnishing all labor, materials and equipment necessary to complete the items.

PART I – TECHNICAL SPECIFICATIONS

MW – MECHANICAL WORKS

PART I – TECHNICAL SPECIFICATIONS**MW – MECHANICAL WORKS****TABLE OF CONTENTS**

<u>CLAUSE NO.</u>	<u>TITLE</u>	<u>PAGE NO.</u>
MW-1.0	GENERAL.....	1
MW-2.0	SCOPE OF WORK.....	1
MW-3.0	GENERAL MECHANICAL WORKS REQUIREMENTS	2
MW-3.1	General	2
MW-3.2	Equipment Foundation.....	2
MW-3.3	Piping System	3
	MW-3.3.1 General.....	3
	MW-3.3.2 Pipe and Fittings.....	5
	MW-3.3.3 Piping Accessories.....	6
	MW-3.3.4 Drains and Vents.....	6
	MW-3.3.5 Pipe Supports.....	7
	MW-3.3.6 Welding.....	8
MW-3.4	Valves and Accessories.....	9
MW-3.5	Bolts, Screws, Nuts and etc.....	11
MW-3.6	Drives and Gears.....	11
MW-4.0	DIESEL GENERATING (DG) SETS.....	12
MW-4.1	General	12
MW-4.2	Diesel Engine	15
	MW-4.2.1 General.....	15
	MW-4.2.2 Crankcase and Cylinder Block.....	15
	MW-4.2.3 Cylinder Liners.....	15
	MW-4.2.4 Cylinder Head and Valve.....	16
	MW-4.2.5 Piston and Connecting Rods.....	16
	MW-4.2.6 Fuel Injection.....	16
	MW-4.2.7 Crankshaft and Camshaft.....	17
	MW-4.2.8 Fuel System.....	17
	MW-4.2.9 Lubricating Oil System.....	18
	MW-4.2.10 Cooling System.....	19
	MW-4.2.11 Intake Air and Exhaust System.....	19
	MW-4.2.12 Starting System.....	20
MW-4.3	Governing system.....	21
MW-4.4	Control and Instrumentation	22
MW-4.5	Engine Protection Device	24
MW-4.6	GENERATOR	24
MW-4.7	SOUND ATTENUATED/WEATHERPROOF ENCLOSURE.....	25
MW-4.8	Spare Parts and Tools.....	26
MW-4.9	Test, Commissioning and Training	27

MW-5.0	FUEL OIL STORAGE AND TRANSFER SYSTEM	28
MW-5.1	Scope of Work.....	28
MW-5.2	Diesel Fuel Oil Storage Tank.....	29
	MW-5.2.1 General.....	29
	MW-5.2.2 Scope of Work.....	29
	MW-5.2.3 Materials.....	30
	MW-5.2.4 Design and Construction.....	30
	MW-5.2.4.1 Shell.....	31
	MW-5.2.4.2 Bottom.....	31
	MW-5.2.4.3 Roof.....	32
	MW-5.2.4.4 Shell Attachments and Tank Appurtenances.....	32
	MW-5.2.4.5 Erection.....	35
	MW-5.2.4.6 Test and Inspection.....	36
	MW-5.2.4.7 Tank Calibration.....	39
	MW-5.2.4.8 Painting Requirements.....	39
	MW-5.2.4.9 Submittals.....	40
MW-5.3	Fuel Day Tank.....	41
MW-5.4	Fuel Transfer Pump.....	42
	MW-5.4.1 General.....	42
	MW-5.4.2 Scope of Works.....	42
	MW-5.4.3 Design and Construction.....	42
	MW-5.4.4 Spare Parts.....	43
	MW-5.4.5 Submittal.....	44
	MW-5.4.6 Pump Testing.....	44
	MW-5.4.7 Painting.....	44
MW-5.5	Piping, Valves, Fittings and Accessories	44
	MW-5.5.1 Scope of Work.....	44
	MW-5.5.2 Piping.....	45
	MW-5.5.3 Valves.....	46
	MW-5.5.4 Strainers.....	46
	MW-5.5.5 Pressure Gauges.....	46
	MW-5.5.6 Flow Meters.....	46
	MW-5.5.7 Testing	47
	MW-5.5.8 Painting	47
MW-6.0	DOMESTIC WATER SUPPLY SYSTEM	48
MW-6.1	General	48
MW-6.2	Drilling, Developing and Testing of Well	48
	MW-6.2.1 General.....	48
	MW-6.2.2 Drilling.....	48
	MW-6.2.3 Well Completion and Development.....	49
	MW-6.2.4 Submittal.....	49
MW-6.3	Pump.....	49
MW-6.4	Water Storage Tank	50
MW-6.5	Piping, Valves and Fittings	50
MW-6.6	Testing	50
	MW-6.6.1 Pumps.....	50
	MW-6.6.2 Water Storage Tank.....	50
	MW-6.6.3 Domestic Water Supply Piping System.....	51
MW-6.7	Disinfecting of Water Storage Tank and Domestic Water Piping System....	51

MW-7.0	FIRE FIGHTING SYSTEM.....	52
MW-7.1	Scope of Work.....	52
MW-7.2	Fire Extinguisher.....	52
MW-7.3	Submittal	53
MW-8.0	AIRCONDITIONING AND VENTILATION SYSTEM	53
MW-8.1	General	53
MW-8.2	Design Conditions	53
MW-8.3	Schedule of Equipment.....	54
MW-8.4	Air Conditioning System	54
	MW-8.4.1 Scope of Work.....	54
	MW-8.4.2 Window Type Air-conditioning.....	55
MW-8.5	Ventilation Unit	55
	MW-8.5.1 Scope of Work.....	55
	MW-8.5.2 Wall-Mounted Exhaust Fan.....	55
MW-8.6	Installation and Painting.....	56
MW-8.7	Spare Parts	56
MW-8.8	Acceptance Test.....	56
MW-8.9	Submittal	56
MW-9.0	MISCELLANEOUS EQUIPMENT AND MATERIALS	56
MW-9.1	Scope of Work.....	56
MW-10.0	GUARANTEE.....	57
MW-10.0	MEASUREMENT OF PAYMENT	58

MW - MECHANICAL WORKS

MW-1.0 GENERAL

The Work to be done under this section shall include the furnishing of all labor, materials, equipment, tools and other incidentals for all mechanical works enumerated hereunder or as shown on the accompanying drawings and installation manuals or as otherwise directed by NPC for the **Supply, Delivery, Installation, Test, and Commissioning of 2 x 150 kW Modular Diesel Generating Sets, Associated Electrical Equipment & Balance of Plant for the Electrification of New Area in Jintotolo Is., Balud, Masbate.**

All equipment and materials to be supplied by the Supplier shall be new and unused, of current manufacture, and of the highest grade and the best of their respective kinds, and free from defects and imperfections. They shall be suitable for their intended purpose and shall comply with all applicable regulations, quality, and dimension standards.

The work shall be performed and completed with high quality workmanship in accordance with generally accepted modern practice in the design, supply, delivery, installation, test and commissioning of mechanical equipment and associated works for the safe and reliable operation of the **two (2) Units of Modular DG Sets and Auxiliaries.**

The Supplier shall strictly observe the requirements specified in this Specific Technical Specifications (Mechanical Works) in conjunction with the General Technical Specifications (General Works). The Specific Technical Specifications shall take precedence over the General Technical Specifications in case of any inconsistency.

MW-2.0 SCOPE OF WORK

The scope of work shall cover mainly of, but not limited to the supply, delivery, installation, test and commissioning of two (2) Units (Prime Rated Power) Modular DG Sets complete with auxiliary equipment and devices, control/monitoring and protection system, including other works and services specified in Clause GW-2.0 of the General Works specifications.

The Works shall include the preparation of design, technical specifications and data, detailed drawings and construction of foundations for all the supplied equipment, and all other essential information of the equipment to be supplied under this contract.

The Supplier shall supply all anchor/machine bolts, special tools and accessories required for mounting/installation of the generating set/s including structural steel supports and appurtenances for auxiliary equipment.

MW-3.0 GENERAL MECHANICAL WORKS REQUIREMENTS**MW-3.1 General**

This specification covers the general requirements for design, supply and installation of mechanical equipment and associated works including other equipment not described herein shall be in conjunction with the requirements described in the relevant sections of this specification and accompanying drawings.

All mechanical equipment and related steel structures shall be furnished and installed in accordance with the general requirements of this specification, unless otherwise specified in the relevant sections of this specification. The specific work to be done shall be as described in the relevant sections of this specification and/or shown on accompanying drawings.

All mechanical equipment, materials, piping, valves, instruments and associated steel supports which the Supplier shall supply and install and which thereafter will be incorporated in the plant shall be new and unused. They shall be suitable for their intended purpose and appropriately matched to other items complying with all applicable regulations; quality and dimension standards

The Supplier shall provide the services of a qualified erection engineer who shall be responsible for the supervision of the erection, installation and test of all equipment and materials supplied by the Supplier.

The work shall be performed and completed in accordance with generally accepted modern practice in the fabrication, assembly, installation and test of all equipment and materials supplied by the Supplier, notwithstanding any omission from these Specifications or drawings.

Defect and damages to the equipment resulting from faulty installation works shall be repaired and/or replaced by the Supplier at no cost to the NPC.

MW-3.2 Equipment Foundation

All equipment and associated structures to be supplied by the Supplier under this contract shall be provided with concrete foundation and to be installed in accordance with the manufacturer's recommendations and applicable codes and standards. The Supplier shall prepare the design and drawings of concrete foundations and associated structures for all his supplied equipment to conform with the requirements of the relevant Civil Works specifications, unless otherwise specified or shown on the drawings. All drawings and calculations as required, shall be subject to NPC for review and approval prior to construction and erection.

The Supplier shall be responsible for the correct positioning and leveling of the equipment and auxiliaries, and any checking made by the NPC during the course of the work shall not relieve the Supplier from his

responsibility. During installation works, electro-mechanical equipment shall be carefully lifted or glided on the foundation by using only approved methods and equipment, and in a manner that will prevent damage to the equipment and foundation. The equipment shall be positioned on a location as shown on the drawings and shall be leveled and checked true to grade and alignment before final grouting. The Supplier shall strictly adhere to the installation procedures/manuals provided by Manufacturers of the equipment.

Prior to equipment mounting and grouting, the surface area and blackouts of concrete foundation shall be cleaned of all dirt by any approved means. Chipping of concrete surface to the required thickness shall be done by any approved methods without damaging the concrete structure as a whole.

The pouring of concrete to secure in place any equipment on its concrete foundation shall not be made until the NPC has verified the correct location of the foundation. Should incorrect positioning be ascertained after the concrete pouring, the Supplier shall make the correction at his own expense.

The concrete foundation surfaces shall be free of any loose materials, oil, water or any other contaminants that would prevent the grout from bonding. The concrete shall be chipped to expose a minimum aggregate so as to remove all laitance and provide a rough surface for bonding. The exposed surface shall be blown with compressed air free of oil to remove dust.

MW-3.3 Piping System

MW-3.3.1 General

The piping system shall be furnished to provide a complete and acceptable installation necessary for the safe and efficient operation of each system and equipment. All required piping shall be furnished complete with flanges, joints, gaskets, packing, drains, vents, insulation if required, hangers, guides, and all auxiliary steel and anchors required to complete the various piping systems.

The Supplier shall submit for NPC's review and approval detailed drawings covering the arrangement, actual layout, route and interface connections. Any required modification from the approved drawings or specification to suit actual site conditions, shall be permitted only with prior consent of NPC. Such modifications shall be reflected/incorporated in the as-built drawings which shall be submitted by the Supplier for NPC review and final approval.

Piping shall be properly arranged such that it will result in neat appearance and convenient to operate and maintain. Items requiring periodic attention shall be readily accessible from floors or platforms. Pipe shall neither obstruct passageways of any kind nor interfere with access to other valves or equipment.

The Supplier shall install the piping system in a thorough manner and with good workmanship, in accordance with the construction drawings and specifications or as directed by NPC.

All pipes, fittings, valves and appurtenances shall be free from dirt or other foreign matters before laying. In the installation of the pipes, care shall be taken to prevent the pipes from becoming clogged during the progress of the work; should any pipe become either partially or wholly clogged before final acceptance of the work, it shall be cleaned out by the Supplier in a manner satisfactory to NPC or shall be replaced by and at the expense of the Supplier. Open ends shall be temporarily plugged, otherwise, suitably closed when necessary. Special care shall be taken in carrying out the installation of joints, branches, valves and other fittings.

Pipe sleeves shall be provided for pipe and tubing which penetrates platforms, floors, roofs and partitions. Proper flashing shall be provided to ensure tightness and water-proofing, where required.

Piping installation shall be sloped to prevent trapping of air bubbles. Where required, suitable venting system with valve shall be provided.

Where pipeline are laid underground, the trench shall be provided with a cushion pad of at least 150 mm sand and sandy soil bedding materials prior to pipe laying, unless otherwise shown on the drawings.

All pipeline excavation shall be backfilled up to the level of the finished grade surface in layers of 150 mm and thoroughly compacted, unless otherwise shown on the drawing. Backfill materials shall be compactable soil taken from trench excavation and approved by NPC. Trench excavation, backfilling, concrete works and construction of valve manhole shall be done in accordance with the pertinent provisions of the relevant Civil Works Specifications.

Pipes to be placed underground shall not be covered prior to the approval of NPC. Underground pipes shall be embedded as shown on the drawings.

Steel piping to be installed underground shall generally be applied with tape wrapping with minimum finished thickness of 1 mm and applied spirally with overlap of 50% in all parts of the pipe and fittings or asphalt jute of 6 mm thickness, unless otherwise specified. Bitumen-based primer shall be applied to pipe before applying the tape. The tape wrapping brochures shall be submitted for NPC approval prior to procurement and application. The wrapping shall extend for 300 mm beyond the buried portion.

All pipes that cross roadways or concrete pavement shall be provided with pipe sleeve of steel material or reinforced concrete pipe to protect the pipe from various load imposed by passing vehicles, unless otherwise shown on the drawing. The pipe sleeves shall extend 600 mm beyond shoulder of each pavement side.

After considering site conditions, and in case execution cannot be done according to the piping route in the design drawings, on-site changes may be acceptable subject to the approval of NPC.

Flexible joints as well as vibration isolation joints shall be installed as near as possible to equipment and devices and shall not be forced to expand, extend and compressed. In case flexible joints are long and sagging due to own weight, it shall be suspended or supported.

Pipe fittings and unions for screwed piping are to be installed in such a way as to be easily accessible for repair and maintenance.

For water piping, after installation, pipe insides shall be washed thoroughly using high pressure cleaning pump. Water for washing must be clean enough not to damage the equipment.

For oil pipes, after installation, pipe insides shall be thoroughly blown with compressed air to remove all dirt, rust and the likes. If necessary, pipes insides shall be soaked thoroughly using acid solution to remove all dirt, rust and the likes. All equipment shall be disconnected from the pipes to be washed to avoid damage to the units. Acid solution shall be disposed in a manner that will not pose hazard to the environment. Thoroughly flush the pipe insides with a clean water to wash away all acid solutions and let dry before re-connecting the pipes.

All existing facilities, if applicable, which are affected and damaged during the installation of piping shall be replaced and/or restored to its original appearance by the Supplier at its own expense.

The Supplier shall strictly observe the safety requirements/regulations of existing plants during the performance of the work.

MW-3.3.2 Pipe and Fittings

All piping works shall be coordinated with other works at site and with existing installation so that interference between piping and other structural features will be avoided. In case interference occurs, NPC will decide which work is to be relocated.

Unless otherwise specified, all pipes to be used shall generally conform to ASTM A 53, Grade B, seamless with a minimum wall thickness equivalent to Schedule 40.

All steel piping, 65 mm and above, shall be butt-welded or flanged. All piping, 50 mm and under, shall be joined by socket welded or screwed where specified or other approved joint specifications.

Pipe fittings for 65 mm pipes and above shall be seamless, butt weld, minimum of Schedule 40 conforming to ASTM A 234 Gr. WPB with dimensions to ANSI B16.9. Fittings for 50 mm pipes and below shall be forged, socket weld or threaded (minimum of 3000 lb and 2000 lb rating, respectively) and conforming to ASTM 105 with dimensions to ANSI B16.11.

Malleable iron, galvanized screwed fittings conforming to ANSI B16.3 (Malleable iron threaded fittings, Class 150) may be used for Potable Water System.

Gaskets shall be selected based on the nature of the fluid or its temperature to be handled. Gasket materials shall not contain asbestos in any form.

Flanged bolts shall be hexagonal head machine bolts conforming to ASTM A 307 Gr. B with dimensions in accordance with ANSI B18.2.1 and complete with heavy semi-finished head nuts conforming to ASTM A 194, Gr. 2H and ANSI B18.2.2.

Equipment and auxiliaries shall be furnished with all required bolts, screws, anchor bolts with sleeves, nuts, washers, locking devices, washers, gaskets, and other accessories to complete the piping system.

Generally, all gaskets, bolts, nuts and washers to be used in the various piping systems shall be new and free from defects and imperfections. Materials to be used shall be suitable for the liquid to be handled.

Threads shall be metric. Where required they shall be adequately treated against corrosion before dispatch from the works. All threads shall be greased carefully during installation except where otherwise specified. Split pins or other approved locking devices generally shall be provided for nuts which may become loose due to vibration, etc.

Any such rivets, bolts, screws, gaskets, etc., which are considered surplus, but not more than 10% of the permanent installation, after the installation of the equipment has been completed shall become spare parts and shall be wrapped, marked and handed over to NPC.

MW-3.3.3 Piping Accessories

Strainers shall be of simplex type with body stainless steel material and flanged ends. Body drain and vent connections shall be included. Drain plugs shall be threaded. Screen elements shall be of stainless steel construction with minimum 60-mesh size or shown on the drawings. Magnets shall be included to trap small iron and steel particles for use in fuel oil lines.

Pressure gauges for fuel oil system shall be provided with dampener. Each pressure gauge shall be provided with isolation valve. Pressure gauge shall be of bourdon tube type with solid front case, and minimum size of dial gauge shall be of 100mm Ø.

MW-3.3.4 Drains and Vents

Not all piping system vents and drains may be shown on the piping drawings. The Supplier shall provide and install vent and drain connections at all high and low points, respectively, and as required for suitable operation.

Where practicable, all pipelines shall be sloped in the direction of flow and shall be adequately trapped at low points and vented at high points in the pipe runs.

The minimum valve size for vents and drains shall be 15 mm nominal diameter. In general, the piping for drain and vents shall be the same material as the main lines.

All piping shall be arranged to permit complete drainage when a particular unit or system is shutdown for maintenance.

All vent lines which are normally operated shall be terminated at least 3 m or higher above the highest service platform.

All drain lines which run to waste shall be routed to a suitable drain trench, floor drain or sewer.

MW-3.3.5 Pipe Supports

Pipe supports shall be fabricated and installed as required by the piping system configuration. If pipe supports required are not shown on the accompanying drawings the Supplier shall provide detailed drawings and submit to NPC for review and approval.

Pipe supports shall be fabricated and assembled to permit the free movement of piping caused by thermal expansion and contraction. The design of elements for supporting or restraining piping systems, or components thereof, shall be based on all the concurrently acting loads transmitted into the supporting elements. Where resonance with imposed vibration and shocks occur during operation, suitable dampers, restraints, anchors, etc., shall be added to remove these effects. Pipe supports shall be spaced as far apart as economically possible, with due consideration to assure that the sag of the pipe between supports is within limits that will permit drainage and also avoid excessive bending stresses from concentrated loads.

All piping shall be installed with supporting devices selected and located to insure that the finished system will provide uniform continuous slope for draining, that expansion will be so directed as to minimize stresses in the piping material, and that all elements will be suitably and substantially supported, guided and anchored. Supports at floor or wall sleeves will not be permitted.

Riser pipes shall be individually supported. To reduce riser loads, the riser supports may be supplemented by the nearest support on a horizontal pipe. The horizontal length of pipe between the nearest support and risers shall not be longer than the length of the riser supplemented by the nearest support. Bends shall have the supports no further away from the riser than the radius. Where two rods are used in a solid rod riser hanger, each rod shall be capable of taking the entire load.

Piping systems, where flexibility is not required, shall be supported by rigid hangers. It shall be designed and fabricated so that they will not become disengaged by pipe movement.

Hanger rods shall be provided with suitable sockets or eyes to permit lateral piping movement without imposing a bending moment on the hanger rod. The eyes in the rods shall be welded shut. Safe loads for hanger rods shall be calculated on the root area of the threads. In no case shall hanger rods of less than 10 mm diameter be used for support of piping 50 mm and smaller or less than 15 mm diameter rod for supporting pipe 65 mm and larger.

When the pipe is covered with insulation and is to rest on the support, protection saddles shall be used whenever possible. Protection saddles shall be welded to the piping to prevent slipping and/or falling. The saddle material shall be the same as the pipe material, however, alloy saddles shall not be welded to alloy piping in the field. On lines of 50 mm diameter and below where service temperatures are 100 °C and under, the pipe shall slide or rest directly on the support and shall be left bare of insulation at such locations.

The location and provision of temporary supports required during hydrostatic testing shall be the responsibility of the Supplier.

Temporary construction supports shall not be welded to the pipe except with approval of NPC and shall be attached in a manner that will not damage the pipe. These supports shall be completely removed upon completion of construction.

Equipment connections shall not be used to support piping either for temporary or permanent support.

MW-3.3.6 Welding

All welding shall be performed by welders and procedures qualified in accordance with the requirements of ANSI Code B31.1 "Power Piping" or, where applicable, ASME Boiler and Pressure Vessel Code, Section IX.

All welding shall penetrate to the full depth of the pipe. The slag shall be cleaned from each weld bead and any defects be removed before the next bead is applied. The completed weld shall be cleaned of slag and spatter metal on all surfaces.

Welding, preheat and post-weld heat treatment for piping shall be in accordance with the requirements of ANSI B31.1 or where applicable, the ASME Boiler and Pressure Vessel Code.

All welding, except for small pipe, shall be performed by the electric-arc method and where practical, with process controlled automatic machines. All pipe weld joints for piping 50 mm and smaller shall be socket weld, unless otherwise approved by NPC.

Where weld metal is deposited in successive layers, each layer shall be thoroughly peened before the next layer is applied.

Particular care shall be taken in aligning and separating the edges of the members to be joined by butt welding so that complete penetration and fusion at the bottom of the joint will be ensured. Pipe and tubing shall be accurately cut to measurements shown on the drawings by proper means such as machining, grinding or by thermal cutting. Burrs shall be removed by reaming.

Welding fittings shall be of the same material and wall thickness as the pipe to which they are attached. Where there is a difference in wall thickness, the component shall have a gradual transition in accordance with the applicable standard.

Nozzles or branch pipes shall be carefully shaped and welded to the header or run pipe in such a manner that the nozzle, the branch pipe, or any weld material shall not extend into the run pipe to cause obstruction of flow.

All surfaces for welding shall be clean and free from paint, oil, rust, scale and other materials detrimental to welding.

All filler materials including consumable insert materials and shield gases shall comply with requirements of the Applicable Codes and Standards. All welding rods shall be stored in accordance with the Supplier's instructions. The electrodes for arc-welding shall be classified on the basis of mechanical properties of the as-welded deposited weld-metal, type of covering, hydrogen absorption, welding position of the electrodes and type of current.

Steel piping shall be fusion welded using manual, automatic and semi-automatic welding processes whereby the arc and the deposited weld are protected from atmospheric conditions during welding. Pipes shall be properly aligned using line-up clamps or alignment jigs prior to butt welding.

MW-3.4 Valves and Accessories

All valves and accessories to be supplied under this contract shall generally conform with the requirements in this specification. All valves supplied by NPC shall be installed in accordance with the requirements specified herein.

The Supplier shall select valves, valve drives and accessories which are suitable for the operating conditions of the systems in which they are to be used, and shall be responsible for the pressure and temperature ratings of the selected components. The selected components shall meet the requirements of trouble free and safe operation under maximum load, part load and transient conditions.

Generally, all valves shall be leak-proof in either flow direction (except for non-return valves) when the nominal pressure is applied.

Valves, valve drives and accessories which are of similar make, size and type shall be interchangeable with one another. The Supplier shall standardize the types and the sizes of the valves as far as possible, in order to facilitate maintenance and limit the stock of spare parts. The manufacturer of valves shall be well known.

All regularly operated isolation valves and control valves shall be accessible from a permanent floor or access platform.

All valve bodies shall be of the same nominal size as the adjacent piping, unless otherwise specified. The internal diameter of valve ends adjacent to the pipe work shall be the same as the internal diameter of the connecting pipe.

All valves shall be located and designed so that the maintenance and change of valve internals is possible without removing the valve casing from the pipe.

The stems of all valves for outdoor service shall have weatherproof protection covers of approved construction.

Valves other than outside screw and yoke type, in size larger than 50 mm are to be provided with gate position indicators. Valves shall close clockwise.

The drive units of motor-driven valves shall also be provided with handwheels for manual operation. The handwheel shall be operable under all conditions and shall be independent of the motor drive. It shall not be rigidly coupled to the motor drive and shall not compulsory turn when the motor is energized.

All valves 65mm and larger shall have a body and bonnet material of at least cast iron. Cast steel material shall be used for high pressure or temperature applications. Stem, seat ring & seat, wedge or disc shall be made of bronze, for high pressure or temperature applications stainless steel shall be used. Valves 50mm and below shall be made of bronze unless otherwise other materials are approved by NPC.

Gate or globe valves shall generally be used for isolation in the piping system. Ball valves or butterfly valves may be used if specified or shown on the drawings.

All gate and globe valves, 65mm and over shall be of OS & Y rising stem, solid wedge type disc for gate valves and plug type disc for globe valves, bolted, bonnet, bolted gland and have flanged ends with the following materials of components:

- | | | | |
|----|------------------|---|------------------------|
| a) | Body & bonnet | - | Cast iron |
| b) | Stem | - | Bronze or brass |
| c) | Seat ring & seat | - | Bronze or bronze faced |
| d) | Wedge or disc | - | Bronze or bronze faced |

Gate and globe valves, 50mm and smaller shall be made of bronze or stainless steel, rising stem, union bonnet, inside screw, solid wedge or plug type disc, with screwed or flanged ends. Valves installed in valve boxes shall have flanged ends for easy replacement or if valves with screwed ends are used, appropriate unions shall be installed.

Valves of all sizes shall have a rating of not less than Class 150.

Garden hose connection valves or hose bibs shall be of bronze material, 20 mm size and outfitted with male thread hose connections.

MW-3.5 Bolts, Screws, Nuts and etc.

All bolts, screws, anchor bolts, with sleeves, nuts, washers, locking devices, etc., required for all equipment and accessories to be supplied under this Contract shall be furnished.

Threads shall be metric. Where required they shall be adequately treated against corrosion before dispatch from the works. All threads shall be greased carefully during installation except where otherwise specified.

Split pins or other approved locking devices generally shall be provided for nuts which may become loose due to vibration, etc.

All bolts, nuts, screws and other devices used to fix, clamp or adjust any parts which are exposed to water or high humidity, or subjected to frequent adjustment or frequent removal shall be of corrosion resistant steel or bronze or hot-dipped galvanized. All other bolts and pins shall be of carbon steel.

When in position, all bolts or screwed rods shall project through the corresponding nuts, but this projection shall not exceed three threads, unless more length is required for adjustment.

MW-3.6 Drives and Gears

All moving parts of machinery including shafts, couplings, collars, projecting key heads, gear wheels, rope/belt-drives shall be completely guarded to provide full protection. All set screws on revolving shafts shall be countersunk or suitably protected. The guards shall be of approved design and shall be fitted, where necessary, with inspection doors/openings. All guards shall be arranged so that they can be removed without disturbing the parts of the gears and equipment which they protect.

Where practicable gear wheels shall be forced fit on the shaft and in addition, shall be keyed adequately to prevent any relative motion between the wheel and shaft. Where gears and couplings are secured in position by means of keys, they shall be accessible for tightening or removal. All keyways shall be machine cut. Couplings and collars shall be the shrouded or protected-type, free from projections of any kind.

All bearings shall be mounted in dustproof housings. Base of bearing supports shall be machined and shall rest on machined-surfaces.

MW-4.0 DIESEL GENERATING (DG) SETS**MW-4.1 General**

The DG Sets shall be designed and manufactured for maximum safety and reliability in accordance with **ISO 9001** quality specifications.

The DG Sets shall have the following characteristics at Specified Reference Site Conditions:

a.	Prime Rated Power Output, kW	150
b.	Nominal Voltage, V	480
c.	Power Factor	0.8
d.	Frequency, hz	60
e.	Number of Phases, Ø	3
f.	Rated Speed, RPM	1800
g.	Fuel Consumption @ 100% Load (guaranteed), li/kW-hr (max.)	0.30

Specified Reference Site Conditions

- Total Barometric Pressure : 100 kPa
- Air Temperature : 40 °C
- Charge Air Coolant Temperature : 40 °C
- Relative Humidity : 80%

For different test conditions, the measured prime power output and fuel consumption of the DG Sets shall be adjusted to Specified Reference Site Conditions using the adjustment formulas in ISO 3046/1 or other applicable standards.

Prime Power Output shall mean the power delivered and measured at the generator terminal under Specified Reference Site Conditions.

Each DG Set shall be capable of producing the Prime Power Output under the most adverse combination of ambient tropical temperature, pressure and humidity as specified in Clause GW-3.0 of the General Works specifications. In addition, the units shall be able to operate with ten (10) percent overload for a period of one (1) hour every twelve (12) hours operation.

Each DG Set shall also comply with the Emission Standards of the Philippine Clean Air Act as specified in Clause GW-3.4 of the General Works specification.

The engine shall be capable of starting from "Cold" condition and operating at specified period (Supplier to specify) under load without available external AC power for motor driven auxiliaries, except starting DC power.

The Diesel engine-generator sets shall be of the same Brand/Model to allow interchangeability and easy procurement of spare parts.

Each diesel engine shall be directly coupled to the generator and shall be designed for installation within an enclosure which is weatherproof and sound attenuated to conform with the requirements of Clause GW-3.3 of the General Works specification and Clause MW-6.0 of this specification.

Each unit shall be complete with all auxiliary equipment required to operate the unit including generator control and protection panel (GCPP). The GCPP shall be supplied separate from the unit which will be installed inside the control room and shall be in accordance with the requirements specified in the relevant Electrical Works specifications and as shown on the bid drawings. Push buttons for start/stop, emergency stop including selective monitoring/metering instruments shall also be provided at the local control panel mounted on the engine skid per manufacturer's standard, except otherwise specified. Monitoring/metering devices on the local panel mounted on the engine skid shall have simultaneous reading with those on the GCPP during operation.

All associated electrical control equipment required for operation of the unit as specified in the relevant technical specifications shall be furnished by the Supplier and ready for installation and wired in the unit's GCPP.

All auxiliary equipment shall be mounted within the confines of the common steel base or within the sound attenuated and weatherproof enclosure, except as otherwise specified. Auxiliary pumps required for the operation of the DG set shall be engine-driven except otherwise specified. All interconnecting piping and wiring for equipment mounted on the steel base or within the enclosure shall be supplied and shop-installed.

The DG set shall be mounted on a common heavy fabricated steel skid type base frame complete with anti-vibration mounting pads ensuring complete vibration isolation of the rotating assemblies and shipped to the plant site in a weather/soundproof enclosure.

Each DG set shall be provided with fully weatherproof and sound proof enclosure incorporating preferably an internally mounted exhaust silencers (residential type or approved equivalent meeting the specified maximum sound level @ 1 meter) and shall be of extremely rugged construction in order to withstand rough handling during transport and installation.

Provisions for Crane and Forklift unloading of the complete DG set shall be engineered, designed, and manufactured as a heavy duty, welded steel construction with four point lifting provisions and forklift pockets as used on heavy duty construction installations. Details of construction and manufacturer's certification of the lifting provision shall be included in the drawings to be submitted during project implementation.

The Supplier shall be responsible for the design and construction of equipment foundations for the modular generating sets and associated auxiliary equipment to ensure proper mounting/anchoring of the units, including necessary site grading and development of the location area, subject to the approval of NPC. The Supplier shall supply all

anchor/machine bolts, special tools and accessories required for mounting/installation of the generating set/s including structural steel supports and appurtenances for auxiliary equipment. The engine foundation shall be designed such that waste oil water can be collected and to be discharged/interconnected to the nearest existing oil water separator.

All piping systems that are an integral part of the unit shall be included in the scope of supply of the Supplier including connection bolts, nuts and gaskets for equipment, valves and other devices with flanged end connections. Unless otherwise specified or approved, all pipes to be used shall generally conform to ASTM A 53, Grade B, seamless with a minimum wall thickness equivalent to Schedule 40.

All piping shall be butt-welded or flanged. Pipe fittings for 65 mm pipes and above shall be seamless, butt weld, minimum of Schedule 40 conforming to ASTM A 234 Gr. WPB with dimensions to ANSI B16.9.

Flanged joints, when required for removal of the equipment, shall be in accordance with ANSI B16.5.

All integral piping 50 mm \varnothing and below shall be socket-welded in accordance with ANSI B16.11, except otherwise approved. All fittings 50 mm \varnothing and below shall be 2000 lbs. minimum and in accordance with ANSI B16.11.

All oil piping, fittings, and valves shall be shop-fitted, chemically cleaned, and oiled.

Gaskets shall be selected based on the nature of the fluid or its temperature to be handled. Gasket materials shall not contain asbestos in any form.

Flanged bolts shall be hexagonal head machine bolts conforming to ASTM A 307 Gr. B with dimensions in accordance with ANSI B18.2.1 and complete with heavy semi-finished head nuts conforming to ASTM A 194, Gr. 2H and ANSI B18.2.2.

Equipment and auxiliaries shall be furnished with all required bolts, screws, anchor bolts with sleeves, nuts, washers, locking devices, washers, gaskets, and other accessories to complete the piping system.

Generally, all gaskets, bolts, nuts and washers to be used in the various piping systems shall be new and free from defects and imperfections. Materials to be used shall be suitable for the liquid to be handled.

All valves shall be designed, fabricated, and tested in accordance with ANSI B31.1 and shall conform to the pressure and temperature ratings of ANSI B16.34 based on the conditions specified in Clause GW-3.0, Design and Duty Conditions of the General Work specifications.

All DG Set skid-mounted piping that requires outside connection such as or fuel, water, exhaust and lubricating oil systems shall be provided with flexible joints and/or expansion bellows and matching flange including bolts and nuts, as applicable.

The relative experience of the Manufacturer of DG set shall comply with the following:

- a) The Manufacturer/Assembler should have been in the business of manufacturing the equipment for not less than five (5) years; and
- b) The Manufacturer of diesel engine should be in the business of manufacturing the equipment for not less than ten (10) years.

NOTE: Experience less than what is required will be ground for rejection of equipment being offered.

MW-4.2 Diesel Engine

MW-4.2.1 General

Each diesel engine shall be of heavy duty compression ignition type, water-cooled, pressure-lubricated, four-stroke cycle, In-line type multi-cylinder arrangement, trunk piston design equipped with exhaust gas turbocharger and charge air cooler, electronic governor, direct fuel injection, capable of operating the type of fuel oil specified in this specification without entailing frequent maintenance and replacement of engine components other than the scheduled maintenance at fixed interval.

The engine shall be operated at a rated speed of 1800 rpm using Distillate Fuel No. 2 under the site conditions specified in Clause GW-3.0 of the General Works specification. However, for the purpose of determining the guaranteed prime power output and guaranteed fuel consumption of the DG set, the Specified Reference Site Conditions described in Clause MW-4.1 shall be used.

MW-4.2.2 Crankcase and Cylinder Block

The crankcase and cylinder block or blocks shall be of high tensile strength cast iron and stressed relieved prior to any machining works. The block shall be of ample strength and stiffness, and be of proven design. The crankcase block shall incorporate mounting feet for bolting down the engine. Removable side covers for inspection purposes and relief valves incorporating flame traps to guard against damage or injury from crankcase explosions shall be included.

MW-4.2.3 Cylinder Liners

The cylinder liners shall be renewable wet type honed to minimize piston ring wear, fitted into the cylinder block with suitable seals and with the head in position, locked firmly in position.

MW-4.2.4 Cylinder Head and Valve

The cylinder heads shall be of cast construction, suitably cored for water cooling passages and included preferable two inlet and two exhaust valves per cylinder as applicable. Means shall be provided to prevent the valve from dropping far enough to cause damage and double springs shall be provided. The valve seats shall be renewable. The valves and seats particularly on the exhaust shall be of materials such as stellite to be able to resist the severe duty.

Preference will be given to engines with individual heads for each cylinder and where the manifolds are left in unit with the removal of one or more heads.

Allow for the fitting of maximum cylinder pressure indicator for checking of compression and maximum firing pressures of each cylinder. A lever or handwheel, which decompresses all cylinders simultaneously, shall be provided. Tappet covers shall be separately removable for setting clearances.

MW-4.2.5 Piston and Connecting Rods

The pistons shall be designed to withstand the temperatures and pressures encountered and machined to produce the correct shape under normal operation and incorporate a proven combination of compression, oil control and scraper rings. The rings shall be treated by chromium plating or otherwise for long life. The gudgeon pin shall be hardened and ground and positively restrained within the piston boss.

The connecting rods shall be of high tensile strength forged steel construction and incorporate a removable end cap which shall be interlocked and/or dowelled to the rod. The piston and connecting rod shall be removable either through the cylinder bore or through crankcase doors.

Lubricated oil shall be conveyed to the gudgeon pin by drilling the connecting rod or spraying oil into the underside of the piston.

MW-4.2.6 Fuel Injection

Fuel injection system shall be of well-proven design, self-compensating for wear, and for varying fuel viscosity. The fuel pumps shall be designed and positioned so that their performance is unaffected by the engine heat. The engine and fuel system shall be suitable for a wide range of fuels. Individual injectors are to be fitted for each cylinder head with identical high pressure seamless steel pipes from injection pump/s to its appropriate injector.

Damping shall be provided in the fuel supply manifold to the injection pumps to avoid the possibility of high pressures being set up in this manifold due to surging.

The fuel pumps are to be controlled by electronic type governing system. Suitable drip trays and drain pipes are to be provided to avoid contamination of the lubricating oil. Drain pipes shall be provided from these trays to collecting tank. Fuel leak-off pipes from the injectors shall be taken to the fuel day tank.

MW-4.2.7 Crankshaft and Camshaft

Each crankshaft and camshaft shall be of single high tensile strength alloy steel forging with hardened and ground bearing surfaces. Unless other approved provisions are made, the crankshaft shall be drilled to provide lubrication for the connecting rod bearings and incorporate balance weights. The shaft diameters shall be sufficient for several regrinds. The camshafts shall be gear-driven. The cam followers shall be of the roller type.

MW-4.2.8 Fuel System

The basic specification for the diesel fuel oil to be used by the diesel engine units shall be as specified in Clause GW-3.5 of the General Works specifications.

Although the specified fuel specification is the base specification that will be used for Performance Test, NPC prefers that the engine be able to run on a wide range of fuels.

Bidders shall state the range of fuel specifications for satisfactory operation of the engine.

A fuel system shall be furnished to regulate fuel flow to maintain constant rated engine speed regardless of load variations.

The fuel system shall include separate elevated fuel day tank, electronic engine governor, direct fuel injection, fuel metering equipment, primary filter/strainer, secondary filter/strainer as required per manufacturer's standard, necessary valves, relief valve, pressure gauges and fuel cut-off valves.

Primary fuel filter shall be of type to remove both solid and liquid impurities with replaceable element to protect the injection system. Secondary fuel filters shall be of replaceable canister type filters.

Simplex strainer with minimum 60 mesh size and stainless steel filter element shall be provided.

Each DG set shall be provided with separate fuel day tank of 900 liters minimum capacity complete with accessories, associated structural supports, isolation valves, 50 liters per minute @ 10 meters discharge head cast iron double acting rotary hand pump with flexible hose of appropriate materials and size, instruments and other accessories as shown on the bid drawings. The fuel day tank shall be provided with high and low level alarm contacts for annunciation in the generator control and protection panel.

The fuel oil day tank shall be a shop-fabricated, all welded construction, rectangular or any approved shape and shall be designed and constructed in accordance with the requirements of applicable standards complete with manholes; inlet and outlet nozzles; and nozzles for vent, overflow, drain, sounding, level gauge and switches. Included in the supply of the day tank are its structural steel supports with sufficient height as required by the diesel engine operating system or as recommended by the engine manufacturer and complete with mounting/anchor bolts. The structural steel supports shall be pre-fabricated ready for assembly at site. The tank material shall be of carbon steel conforming to ASTM A36 or approved equal with minimum shell thickness of 5 mm. Nozzles shall be fitted with flanges, raised face conforming to ANSI B16.5. The tank shall be provided with an interior and exterior coating. The supply shall include all the necessary materials for fixing and installation.

MW-4.2.9 Lubricating Oil System

The lubricating system shall be of forced-feed type to supply oil under pressure to all working points such as main bearings, crank pins bearings, piston, piston rings and pins, camshaft drive and other moving parts.

The lubrication system shall incorporate full flow oil filtration thermostatic valve, pressure and temperature indicators, system pressure regulator, oil cooler, gear-driven pressure oil pump, oil sump and may include a gear-driven scavenge oil pump.

Oil Pressure switches shall be provided to prevent the engine from increasing speed above idle if the oil pressure is below normal and closes down the engine if satisfactory pressure is not achieved within a given period.

On start-up, adequate lubricating oil shall be supplied to the engine and turbo/supercharger bearings. If required, a DC motor-driven pre-lube oil pump shall be provided. The DC motor shall be fed from the 24 volt DC system to be supplied by the Supplier.

Each DG set shall be provided with free jet centrifuge type lube oil purifier. The lube oil purifier shall have adequate capacity to allow the proper treatment of lube oil circuit.

The Supplier shall provide NPC after award of Contract the recommended grade of lubricating oil and the names of at least three (3) suitable manufacturers and their trade name. Prior to delivery, the lubrication piping system of the unit shall be cleaned with flushing oil and the first fill of lubrication oil and lubricants to be used during the Testing and Commissioning shall be included in the supply.

MW-4.2.10 Cooling System

The cooling system shall be of sufficient capacity to provide engine jacket water, lubricating oil and charge air cooling when the unit is delivering full-rated load under the specified conditions.

The system shall comprise all necessary valves, integral pipe works on the engine, lubricating oil and charge air coolers, radiator, cooling water pump, expansion tanks as applicable, thermostatic valves and instruments such as thermometers, pressure gauges and switches, water level detectors and other necessary protection devices.

The cooling water pump shall be engine mounted gear driven of sufficient capacity to provide engine jacket water cooling, lubricating oil and charge air cooling when the unit is delivering full-rated load under the specified conditions.

The radiator shall be designed to permit easy maintenance and cleaning of the interior and preferably vertically mounted. Radiator shall be of industrial finned tube type for closed circuit cooling system. It shall be equipped with an engine driven blower type fan complete with fan guard and the fan belts shall have a tension adjustment and belt guard. The radiator fan shall have sufficient capacity to maintain the desired cooling requirements of the diesel engine. Ball tap valve of bronze material shall be provided to interconnect/feed fresh water into the cooling water system or expansion tanks, if applicable.

Fan blades shall be of aluminum alloy material or approved equivalent. The assembled motor shall be certified as having been statically and dynamically balanced and having been non-destructively tested by x-ray or other approved method.

The framework of the radiator and other steel parts except machined surfaces shall conform to ASTM A36, hot-dipped galvanized, with a minimum application rate of 600 g/m². Bolts and nuts used for the structural parts shall also be hot-dipped galvanized. A flexible connecting section shall be provided between the radiator and discharge louver frame.

MW-4.2.11 Intake Air and Exhaust System

Intake air filter and exhaust silencer shall be adequately sized to prevent excessive pressure drop.

Heavy duty dry type intake air filter shall be provided to protect the engine from dust and solid particles. Filter shall preferably be mounted on the engine and provided with service indicator to show that the filters need to be cleaned.

The exhaust system shall be constructed of corrosion and heat resisting material conforming to ASTM A 106 or approved high grade material suitable for the exhaust temperature of the unit. Exhaust system shall include residential type silencer, stainless steel expansion bellows, tail

end pipe terminating in a horizontal plane and cut at a 45° angle or per manufacturer's installation standard, and necessary bracing needed for mounting to prevent transmission of engine vibration to the enclosing structure. Exhaust pipe/silencer installed within the enclosure shall be thermally insulated. Exhaust silencer shall preferably be installed inside the enclosure, except otherwise installed per manufacturer's standard/recommendation and approved by NPC.

Exhaust gas pipe shall be provided with flanged connection and mounting supports, and all the required connection bolts, nuts, washers and gaskets.

For modular DG set installed at available space within the existing powerhouse, extension of exhaust pipe complete with expansion joints, spring hangers, pipe supports and associated structures, pipe fittings and accessories, and pipe insulation for pipe inside the powerhouse shall be provided by the Supplier.

A suitable size of turbochargers for ample supercharging shall be provided complete with axial turbine wheel, centrifugal compressor, gas inlet casing, air filtration and lubricating system.

MW-4.2.12 Starting System

Each DG set shall be capable of being started, synchronized to the system and loaded to the full rating of the unit without dependence upon the AC auxiliary power supplies.

Electric starting system shall operate on a 12V or 24V electrical circuits per manufacturer's standard, energized by storage batteries. Circuit ground shall be negative.

Electric cranking motors shall be heavy-duty, with capacity to crank the engine at sufficient speed to start when conditioned to, and in an ambient temperature of 40°C, in conjunction with the specified range of fuel and lubricants. The drive mechanism for engaging the starting motor with the engine flywheel shall be inherently designed to operate and release without the application of heat. Starting system including battery shall be adequate to crank the engine for a minimum of three (3) cranking periods without overheating. Each cranking period shall consist of 30 seconds of constant cranking followed by a 2-minute rest. To protect the engine and electric cranking motors, Over Crank and Failure to Crank relays shall be provided to prevent excessive cranking period and cranking stress, respectively.

Storage battery shall be lead acid type or approved equivalent complete with battery tray and intercell connectors. The battery capacity shall be compatible with the cranking duty described in the preceding paragraph, in an ambient temperature of 40°C. Battery tray shall be constructed of fiberglass or approved corrosion resistant material and so treated as to be resistant to deterioration by battery electrolyte. Construction shall be such that any spillage or boil-over of battery electrolyte shall be contained within the tray to prevent a direct path to enclosure floor.

Battery charger shall be adequate to recharge the fully-depleted battery as required and shall automatically control the rate of charge, providing a high charge rate to a depleted battery and reducing to a trickle-charge rate when the battery charger indicate charging rate. Charging rate shall be adjustable. Battery charger shall be solid-state full wave rectifier type rated 480V or 230V and 60 hz. The nominal output voltage shall be determined by the Manufacturer. The charger and battery shall be mounted and wired within the enclosure of the generating set.

MW-4.3 Governing system

The engine speed shall be controlled by an electronic governor capable of isochronous or droop type speed regulation and 115 percent overspeed shutdown. The governing system shall be able to maintain engine speed within 4% of rated speed from no load to full load generator output. The control shall be capable of switching between isochronous or droop speed regulation remotely. The frequency at any constant load, including no load or idling during start-up, shall remain within a steady state band width of rated frequency. The engine governor shall be provided with a generator loading control unit.

The Governing system shall have at least the following response characteristics or better:

Load Variations at rated speed	Maximum change of speed as a percentage of rated speed	Maximum recovery time to within steady state tolerance (seconds)
a) On full load rejection	Temporary change 15% Permanent change Dependent on droop Setting	15 -
b) On a change of load, both on and off, by any step of 25% of the rated load	Temporary change 4% Permanent change Dependent on droop Setting	5 -

The steady load speed band shall not exceed 1% of the rated speed. The speed droop shall be adjustable from 1 to 8 percent.

The governing system shall allow safe manual, local, and/or remote control of the no-load, non-synchronized running speed of the engine from 90% to 110% of nominal speed to allow synchronizing of the generator.

Microprocessor based modular DG set control and governing system shall be supplied with portable programmers and driver software necessary to operate the units satisfactorily in isochronous or in parallel operation.

MW-4.4 Control and Instrumentation

The controls and monitoring of the generating set shall generally be performed remotely from the generator control and protection panel (GCPP) to be installed inside the control room, but selective monitoring/metering with start, stop and emergency stop push buttons shall also be provided in the local panel mounted on the engine skid or at appropriate location within the modular generating set. These selective monitoring/metering instruments shall have simultaneous reading with those on the GCPP during operation. The GCPP shall conform to the requirements specified in the pertinent Electrical Works Specifications.

The DG set's control system shall be designed for remote start-up and speed control including automatic and manual control. It shall be equipped with all necessary instrumentation to provide adequate monitoring of the unit under all operating conditions including "standby". The GCPP shall conform to the requirements specified in the relevant Electrical Single Line Diagram.

The DG sets shall also be tripped manually from the control room or from the engine in case of emergency.

Instrumentation selected shall be suitable for the application per Manufacturer's standard subject to approval by NPC including those specified in the relevant sections of these specifications. Process fluid corrosion effects, pressure surge and ambient temperature ranges shall be considered in material and housing selection so as to provide safe design margin.

The unit shall be capable of being started, synchronized to the system and loaded to the full rating without dependence upon the AC auxiliary power supplies. The unit shall be capable of accepting load within specified time after receiving a start signal. After the unit has been running for specified time at full load it may be assumed the AC power supplies will be again available.

The unit shall accept the load applied to it up to the overload rating and shall automatically control the voltage and frequency during loading and unloading.

The locally mounted control panel shall be fitted with a lockable safety glass viewing window for easy monitoring or operation. The control panel and cable terminal shall be side-mounted or at location per manufacturer's standard and shall accept a complete range of factory designed and installed attachments. Emergency stop button shall be provided and mounted on the enclosure exterior.

The lockable safety glass viewing window located at the DG Set enclosure shall be provided with the following monitoring indicators/control points but not limited to:

- a) RPM meter
- b) Hours Run Counter

- c) Oil Pressure Gauge
- d) Oil Temperature Gauge
- e) Cooling water Temperature Gauge
- f) Start/Stop Pushbuttons
- g) Emergency Stop Pushbutton

The g DG Set's GCPP (floor-mounted pedestal type to be installed in the control room) shall be of manufacturer's standard design and shall contain the monitoring/control points and other measuring/supervisory/electrical instruments as specified in the pertinent Electrical Technical Specifications which shall include but not limited to the following:

- a) RPM Meter
- b) Hours Run Counter
- c) Oil Pressure Gauge
- d) Oil Temperature Gauge
- e) Cooling Water Temperature Gauge
- f) Number of Starts
- g) Battery Voltage
- h) Ready to Start Light
- i) Remote Control Position Indicating Light
- j) Generator Breaker Position, close and open

Included in the DG Set's control and protection panel are the following Human Machine Interface Indicators such as:

- a) Manual Start/Stop
- b) Auto/Remote Start
- c) Test Run-Auto
- d) Emergency Stop Button
- e) Alpha/Numeric Screen
- f) Discrete Status Indicators
- g) Fault Reset
- h) Local/ Remote Selector Switch

Alarm devices shall be provided for all abnormal conditions that may endanger the unit or prevent its starting or running satisfactorily as specified in Part II – Technical Data Sheets and relevant Clauses of the Electrical Works specifications.

The GCPP shall also be provided with annunciating window complete with acknowledge and test lamp push buttons and an audible device located on top of the panel. It shall be of modular design, microprocessor-based designed for operation on a DC supply.

The alarm points shall include but not limited to the following:

- a) Engine overspeed
- b) Lube oil pressure low
- c) Lube oil temperature high
- d) Cooling water high temperature
- e) Exhaust gas temperature high
- f) High and low battery Voltage
- g) High and low fuel level

- h) Failure to Crank Shutdown
- i) Over Crank (failure to start)
- j) Electrical alarms as required in the pertinent Electrical Works Specifications
- k) Other Miscellaneous alarms as required for safe and reliable operation of the plant
- l) Control Switch for Engine Start, Stop and Emergency including its auxiliary/associated equipment

MW-4.5 Engine Protection Device

Sufficient protection devices shall be provided for each DG set to shut down the engine and simultaneously trip the generator circuit breaker in the event of overspeed, high cooling water temperature, low oil pressure and other manufacturer's specified mechanical and electrical type of faults. The cut-out devices shall incorporate indicating instruments with cut-out contacts adjustable over the whole range of the instruments. The Supplier shall submit annunciation data indicating the measurement and source for all conditions which will initiate protective unit alarm or shutdown.

An overspeed shutdown device, operating independently of the governing system, shall be provided. This device shall operate in either the manual or automatic mode of operation of the DG set.

The following accessories, as a minimum, shall be provided to safeguard the engine from being damaged by dangerous operation thereof:

- a) A mechanical operated type overspeed trip device to cut-off the fuel oil supply to the engine not more than thirteen percent (13%) above the rated engine speed;
- b) A signal generator type electrical overspeed trip relay operated at an adequate speed not more than fifteen percent (15%) above the rated speed;
- c) An emergency shutdown trip solenoid;
- d) A device to shut down the engine in the event of excessive low lubricating oil pressure, excessive rise in the engine cooling water or lubricating oil temperatures; and
- e) Other items in accordance with the Manufacturer's standard.

MW-4.6 Generator

The generator shall be close-coupled to the engine through an SAE flange arrangement for perfect alignment and is self-exciting. Output voltage is controlled by automatic voltage regulator. The generator and exciter shall conform with the requirements specified in the relevant Electrical Works Specifications.

MW-4.7 Sound Attenuated/Weatherproof Enclosure

Each DG set shall be fully enclosed in a sound attenuated and weatherproof enclosure designed to provide a sound pressure level of not more than 85 dBA at 1-meter distance measured at any point of the unit.

The enclosure shall be designed to withstand wind velocity of not less than 156 MPH (250 KPH) or as specified in the latest edition of National Structural Code of the Philippines and accurately dimensioned in compliance with the National Electrical Code (NEC), the National Fire Protection Association (NFPA) for clearance of all specified items included therein, and all applicable fire codes for a structure and application of this type. They shall be designed on modular principles with many interchangeable components permitting on site repair.

The enclosure shall have elegant appearance that includes acoustic baffles for the air inlet and outlet, walls with sandwich mineral wool attenuation of reliable quality made of galvanized steel material conforming to ASTM A-36 and painted finish. It shall be coated in accordance with manufacturer's standard.

The design and construction shall be modular with side panels, doors, louvers and for all component parts to have minimum thickness of 2mm (gauge 14). The roof of the enclosure shall meet or exceed the minimum gauge requirements specified but, in addition, shall be strengthened in such a manner as to support the largest commercially available exhaust silencer recommended by the Manufacturer for this application.

Wide opening access doors for easy maintenance of all main components shall be provided. The joints of the enclosure shall be of bolted or screwed design to allow easy disassembly and assembly during major maintenance of the DG set and its auxiliaries. All access doors shall be fully lockable to prevent unauthorized access.

All components of the enclosure shall be assembled utilizing stainless steel bolts, nuts and washers, hinges and locks. Watertight neoprene flat washers shall be used on all roof bolts.

The enclosure shall incorporate internally mounted exhaust residential silencers with mounting brackets and are of extremely rugged construction in order to withstand rough handling and installation. Tail pipe extension shall be provided, terminating in a horizontal plane and cut at a 45° angle or other means per recommendation of the manufacturer to prevent the entrance of water. Stainless steel, seamless flexible exhaust pipe and necessary bolts, flanges and gaskets to match the engine and exhaust silencer shall be provided.

The DG Set-mounted control panel shall be fitted with safety glass viewing window for easy monitoring of operation and located in a lockable access door. The monitoring/control points shall be as specified in Clause MW-4.4 of this specification. The control panel and cable terminal shall be side or front-mounted and shall accept a complete range of factory

designed and installed attachments. Emergency stop button shall be provided and mounted on the enclosure exterior.

The enclosure shall be provided with necessary louvers designed to meet engine air requirements and proper ventilation. All louvers with bird screen shall be designed to prevent the entrance of driving rainwater but shall have sufficient free area to allow for 120% of the total DG Set air requirements or per manufacturer's standard. To guarantee that the enclosure is free from any leak and can prevent entrance of rain water, Rain Test shall be conducted.

All necessary fittings, hoses, shut-off valves, etc., shall be provided to facilitate fuel oil/lube oil filling, lube oil and water drain at the exterior of the enclosure. Engine crankcase breather pipes shall terminate at the exterior of the enclosure directly under the radiator air discharge louver.

The base of the enclosure shall be designed and manufactured as a heavy duty, formed steel construction with four (4) point lifting provision to support the calculated weight. Details of the base construction shall be included with the drawings to be submitted.

Auxiliary interface box shall also be provided which houses the electrical/instrument connection terminals for interfacing to the control panel external to the DG set.

The enclosure shall contain the battery racks, battery cables, battery charger and 12-volt or 24-volt battery capable of delivering at least 3 cold-cranking. The battery rack shall be welded to the sub-base with hold down bolts with cross over strap.

MW-4.8 Spare Parts and Tools

Spare Parts and Tools for the generating sets and its auxiliaries shall be supplied by the Supplier in accordance with the requirements specified in Clause GW-12.0 of the General Works Specification.

The lists of Spares and Tools in a form to be filled up by the Supplier as specified in Part II - Technical Data Sheets, are preliminary and subject to changes to conform with the final design and model/brand of the proposed equipment (per manufacturer's standard).

The Bidder shall indicate "N/A" to the respective items in the said lists if found not applicable to the brand/model of the proposed equipment. However, NPC reserves the right to request the Supplier to provide the same or its equivalent if it is determined to be "required or necessary" during the evaluation, checking and review/approval of the final lists to be submitted by the Supplier during the Contract Stage at no cost to NPC.

Spare parts shall be provided to ensure reliable operation of the supplied equipment for one (1) year and shall include spares that will be used during the Pre-commissioning/Commissioning Test.

The Spare Parts List to be submitted with the Bid shall be in a form specified in Clause GW-12.1 – General Works Specifications or in Part II – Technical Data Sheets.

The spare parts listed in the forms attached in Part II – Technical Data Sheets are minimum requirements which the Supplier shall include in the spare parts list that contain the recommended spare parts for one (1) year operation.

The standard and recommended tools for normal/overhaul maintenance of the generating sets and associated auxiliary equipment shall be supplied for the plant in accordance with the Manufacturer's standard practice including those specified/listed in the forms attached in Part II – Technical Data Sheets.

The Supplier shall submit a detailed Tools list with the Bid in a form specified in the Bid form and the corresponding brochures/catalogues of the respective tools for approval of NPC prior to delivery at the Plant Site.

The Supplier shall include a Portable Computer with the latest pre-installed windows operating system compatible with manufacturer's software needed in programming the genset control setting (with licensed CD-ROM drive dongles of genset control system) and electronic/digital governing system including other digital components that require exclusive programs from the Manufacturer with free update throughout the operating life of the generating sets.

All tools shall be handed over to NPC in perfect condition at the time of taking over.

MW-4.9 Test, Commissioning and Training

All tests and inspections (shop test, site test and commissioning) shall be carried out in accordance with the requirements specified in Clause GW-9.0, Inspection and Tests of the General Works Specifications, relevant sections of the specific technical specifications (Civil, Mechanical & Electrical Works specifications) and respective test procedures duly approved by NPC.

When the generating sets are ready for commercial service, reliability test shall also be conducted continuously without major failure for a period of twenty-four (24) hours or at any programmed/scheduled operating hours available at the plant site which the generating sets and all its associated auxiliaries are required to operate under the normal working conditions of the power plant.

Prior to the tests, the Supplier shall submit five (5) copies of test procedures for NPC's review/approval for all equipment covered by the Contract at least forty-five (45) calendar days prior to the conduct of actual test. No tests shall be conducted unless relevant test procedures are submitted and approved by NPC.

The Supplier/Manufacturer shall conduct training at the Plant Site all NPC's operators who will be assigned to operate and maintain the plant which shall consist of not less than four (4) NPC Operators. The training program shall be conducted by expert/s who are knowledgeable and trained by the genset manufacturer or his authorized representative/s as specified in Clause GW-10.0 of the General Works specifications.

MW-5.0 FUEL OIL STORAGE AND TRANSFER SYSTEM

This section provides the essential information for the fuel oil storage and transfer system equipment and accessories to be supplied, installed and tested by the Supplier. The system shall comprise of fuel oil storage tank, fuel oil day tank, transfer pump, piping system and its associated accessories to complete the system requirements of the new plant.

MW-5.1 Scope of Work

The work shall include the supply, installation and test of all the equipment specified below and other accessories even though not specifically mentioned in this specification or shown on the drawing but are necessary to obtain a complete set for the safe and reliable operation of the system as a whole.

- a) One (1) unit of diesel oil storage tank, 10 m³ nominal capacity, cylindrical and vertical, complete with level indicator, vertical ladder, handrailings, manhole, tank nozzles, associated valves, fuel oil sounding tape and painting works including calibration, testing (weld inspection/liquid penetrant) and other accessories shown on the bid drawings or specified in this section;
- b) One (1) set of fuel oil unloading pump, 10 m³/hr capacity, 30m head, gear type, complete with local control box, isolation & check valves, pressure gauges at pump inlet and outlet, strainers, flowmeter, spare parts, anchor bolts and its concrete foundation;
- c) Two (2) sets of 1.0 m³ fuel oil day tanks complete with manhole, inlet/outlet and vent nozzles, overflow, drain and level gauge/switch, and structural supports;
- d) One (1) lot fuel oil piping system complete with valves, strainers, pipe and fittings, gaskets, flanges, bolts and nuts, pipe supports and other required accessories to complete the piping systems for the fuel oil unloading, transfer of fuel oil from storage tank to day tanks, day tanks to and from diesel gensets, fuel oil storage tank's overflow and drain to oil water separator, waste water/oil from powerhouse drain pit to oil water separator including necessary excavation, backfilling and asphalt jute application to embedded pipes.

MW-5.2 Diesel Fuel Oil Storage Tank**MW-5.2.1 General**

The design, fabrication, erection and testing of storage tank shall conform to the requirements specified in this general specifications, applicable codes & standards and as shown on the accompanying drawings.

Upon completion of erection and testing, tank shall be shot blasted internally and externally and painted with approved quality paint to withstand the anticipated service conditions.

Storage tank shall be provided with necessary nozzles for connections to all pipeworks as shown on the drawings which include tapping points for instrumentation, manholes, vents, drains and other appurtenances such as access vertical ladders, hand railings, and etc.

The tank shall be provided with two hinged and jointed manhole doors secured by bolts and winged nuts.

Prior to the purchase of materials, fabrication and erection/installation of the fuel oil storage tank, the Contractor shall submit for approval by NPC, brochures for tank materials including necessary details as required.

MW-5.2.2 Scope of Work

The work to be done under this section shall comprise all labor, tools, supply of appurtenant materials and other incidentals for all works enumerated hereunder in accordance with the Specifications contained herein and as shown in the drawings or otherwise directed by NPC.

The Contractor shall submit detailed drawings as required for NPC's approval prior to construction of the fuel oil storage tank.

The scope of the work shall consist of but not limited to the following:

- a) Design, fabrication, delivery, installation/erection and testing of one (1) set of diesel oil storage tank with a nominal capacity of 10 cu. m., nominal diameter of 2.5m and height of 3m;
- b) Fabrication/installation of vertical ladders, railings, manholes, roof vents, intake and discharge nozzles, air-foam chamber nozzles, drain and overflow nozzles with pipe to drain pit, sounding gauge hatch, heat detector nozzle, nozzles for level gauge and other accessories shown on the bid drawings or specified herein;
- c) Three (3) sets of 65 mm Ø Gate Valves for tank inlet, outlet and spare nozzles, one (1) set of 50 mm Ø gate valve for drain line and one (1) set of 150 mm Ø butterfly valve for tank farm drain to oil water separator;
- d) Tank Calibration;

- e) Testing (liquid penetrant),
- f) Sandblasting and painting; and
- g) One (1) unit of 10 m long fuel oil sounding tape.

MW-5.2.3 Materials

All materials used for the storage tank shall be new and unused and of the best grade and quality for the purpose. All manufactured items shall be standard commercial products of reputable manufacturers and in case where the materials shown in the drawing are not covered by the standards or specifications, the Contractor shall furnish high quality materials which are acceptable to the applicable Specifications and provisions of ASTM A-36 and AISC Standard Specifications or equivalent approved by NPC.

All materials used for pipes and fittings shall be carbon steel, schedule 40, seamless, conforming to ASTM A53 Grade B. Valves shall be cast or forged carbon steel body materials, flanged ends, with rising stem and generally be of gate valve type for size 65 mm and above in diameter, unless otherwise specified. Valves 50 mm Ø and below shall be of all bronze material.

Plates shall be shaped at shop and edges be sheared, machined or chipped to suit the curvature of the tank and shall be marked before shipment to site.

Certified mill test reports, covering all steel plate and structural shapes to be used in the work and as required by the governing codes and standards shall be furnished by the Contractor for NPC's record. Copies of each mill test report shall be submitted to the NPC prior to fabrication of materials covered.

MW-5.2.4 Design and Construction

The fuel oil storage tank shall be of all welded construction designed, fabricated, constructed and erected in accordance with the requirement of API Standard 650 including Appendix E and shall be supplied complete with manholes, nozzles, level gauge, ladders, railings and pipe connections.

The tank shall be vertical, cylindrical and with self-supporting conical roof.

The tank shall be designed for erection on a concrete ringwall type foundation conforming to API standard requirements. The foundations shall be in accordance with the requirements shown on the relevant Civil Work drawings.

The fuel oil tank sounding tape body/frame shall be of aluminum alloy with stainless steel tape and brass dropper. Brochures/catalogues shall be submitted by the Contractor for NPC's review and approval prior to procurement.

The fuel storage tank shall be designed and constructed with the following criteria:

MW-5.2.4.1 Shell

The tanks shell plates shall be constructed of not less than the following thickness (corrosion allowance included) conforming to ASTM A-36 material:

First course to top course : 5 mm

The tanks shell shall be designed to have all courses truly vertical.

Shell vertical joints shall be by butt weld with complete penetration and fusion as attained by double welding or by other means which obtain the same quality of deposited weld metal on the inside and the outside weld surface. Vertical joints in adjacent shell courses shall not be in alignment, but shall be offset from each other a minimum distance of five (5) times the thickness of the thicker course at the offset point.

Shell horizontal joints shall be by butt weld with complete penetration and fusion. Abutting shell plates shall have a common vertical centerline.

Top angles of A 36 material shall be attached to the shell either by butt joint which shall be of complete penetration and fusion or an alternative joint as shown on the drawing. Angle size shall not be less than 50mm x 50mm x 5mm (2" x 2" x 3/16") and the outstanding leg extends outside the tank.

Shell plates shall be of standard size conforming to 1,220mm (4') wide, 2,440 mm (8') long and edges shall be properly squared and/or prepared for butt welding. Minimum thickness shall be 5mm or as shown on drawings.

Shell plates of standard size conforming to 1,830mm (6') wide, 6,100mm (20') long may be used if transportation to the plant site is possible. Accordingly, detailed drawings showing arrangements of plates for shell, roof and bottom shall be submitted by the Contractor for NPC's review and approval.

MW-5.2.4.2 Bottom

Bottom plates shall have a minimum thickness of 8.0mm (5/16") (allowance for corrosion included), with standard plate size similar to the shell plates and conforming to A36 material. The plates shall be joined by lap welding, arranged as shown in the bid drawings. Three (3) plate laps in tank bottoms shall not be closer than 300mm (12") from each other and also from the tank shell.

The bottom plates under the bottom shell ring shall have the outer ends of the joints fitted and lap-welded to form a smooth bearing for the shell plates.

Where butt-welded bottom plates are employed, the edges shall be prepared with either square or V-grooves. The butt welds shall be made by applying a backing strip 3mm (1/8") thick or heavier by tack welding to the underside of the plate. The bottom plates shall have a minimum slope of 1:100mm.

The attachment between the bottom edge of the lowest course shell plate and the bottom plates shall be a continuous fillet weld laid on each side of the shell plate.

MW-5.2.4.3 Roof

The roof shall be self-supporting cone type provided by rafters as shown on the drawings. The roof shall be constructed in accordance with the latest edition of API 650, Standard for Construction of Welded Steel Tanks.

The self-supporting cone type roof shall have 15 degrees slope from the horizontal as shown on the drawings. All roofs and supporting structures shall be designed to support dead load, plus a uniform live load of not less than 1.0 kPa (20 lbs/sq.ft.) of projected area. Roof plates shall have a minimum nominal thickness of 5mm (3/16") and its material shall be ASTM A36.

The roof plates shall be welded to each other on top side with a continuous full-fillet weld on all seams and shall not be attached to the supporting members. The roof plate circumference shall be attached to the top angle (not less than 50mm x 50mm x 5mm) of the tank with a continuous fillet weld on the top side only. Rafters supported on shell by means of rafter lugs are welded to the tank shell and connected to the center collar plate as shown on the drawings. Where other construction is employed, detailed drawings shall be submitted by the Contractor for NPC's review and approval.

MW-5.2.4.4 Shell Attachments and Tank Appurtenances

The tanks shall be provided with the following tank appurtenances generally arranged in accordance with the bid drawings:

- a) Vertical Ladders and Handrailings
- b) Roof manhole
- c) Shell manhole
- d) Shell outlet nozzle
- e) Shell inlet nozzle
- f) Water draw off sump nozzle & piping
- g) Roof vent
- h) Overflow nozzle & piping
- i) Level gauge nozzles
- j) Air-foam nozzle (Spare Nozzle)
- k) Grounding pads
- m) Nameplate
- n) Sounding Tape

Vertical Ladders and Handrailings

The Tank shall be provided with vertical ladders.

Guardrailings along the circumference of the roof shall be provided. Height of top railing above floor shall be 1000mm. Toeboard of 75mm height x 6mm thickness shall also be provided with midrail located approximately one-half the distance from top of floor to top of railing. Maximum distance between railing posts shall be 2400mm (96") or as shown on the drawings.

Vertical ladder shall be 450 mm wide with 20 mm round bar ladder rungs spaced at 300 mm center to center.

All parts shall be made of A36 except otherwise specified and hot dipped galvanized. Details of construction shall be as shown on the drawings.

Manholes and Nozzles

Manholes and nozzles shall be provided and constructed in accordance with API 650 and/or shown on the drawings. Reinforcing plates for these openings shall be made of one piece only. The minimum cross-section area of the reinforcement shall not be less than the product of the vertical diameter of the hole in the shell and gross plate thickness used. The necks, reinforcing plates and shell-plate openings which have either sheared or oxygen-cut surfaces shall have such surfaces uniformed and smoothen, with corners rounded, except where such surfaces are fully covered by attachment welds.

The tank atmospheric vent shall be fitted with a stainless filter of a replaceable type. Vent shall conform to the requirements of API Standard 2000.

Manholes and nozzles attached or fitted on the tank shall be of carbon steel, Schedule 40, seamless pipe conforming to ASTM A53 Grade B. Manholes may be fabricated using carbon steel plate of approved material subject however to radiographic test (RT) after fabrication.

Manholes on tanks shall be furnished with hinged cover as shown on the drawings. Design of hinged components other than those shown on the drawings may be used provided that detailed drawings shall be submitted by the Contractor for NPC's review and approval.

Grounding Pads & Rod

The tank shall be provided with minimum of two (2) grounding pads equally spaced around the exterior of the tank for grounding protection. Grounding pads shall be type 304 stainless steel or approved equivalent and shall be welded to the tank. Pads shall be at least 65mm by 75mm by 6mm thick and shall be drilled and tapped to the full thickness of the pad for hex head cap screws. Screw hole spacing and location shall

match that of NEMA Standard hole terminals or as shown on the drawings.

Grounding rods to be used shall be of copper 20mm Ø and 3m long with connecting copper wire between grounding pad and rod or as required.

Nameplate

Nameplate shall be provided and securely fixed to the tank at location which are readily visible. The main inscriptions on the nameplate shall include Tank Tag Number or SPIN (FO01TNK), Manufacturer/fabricator, Design Code, Nominal Capacity, Nominal Diameter, Nominal Height, Date of Manufacture and etc.

In addition to the nameplate, the lettering "NPC" and the NPC Logo shall be painted on one side of the outside wall surfaces of the fuel oil storage tank facing the national road or main highway. The exact location of which shall be as directed by NPC. Each letter shall have at least a height of 0.6 m and approximately 0.45 m. width, or as otherwise directed by NPC. The color of the letters shall be luminous black. The color of NPC logo shall conform to its standard color.

Holding Down Bolts

Holding down bolts shall be provided to protect the tank from skidding or overturning due to wind load or earthquake load. Number and size of bolts shall be provided as shown on drawings and equally spaced high strength bolts conforming to ASTM A 307.

Piping, Valves and Fittings

Interconnecting piping to be installed shall be as shown on the drawings. Piping and fittings shall be of carbon steel, Schedule 40, seamless pipe conforming to ASTM A53 Grade B.

Inlet, outlet, water draw-off nozzles including spare nozzle shall be supplied with valves of sizes preferably similar to the nozzles unless otherwise specified or shown on the drawings. Valves 65 mm and above shall be of rising stem, cast iron body, and with flange ends. Valves 50 mm and under shall be of bronze or stainless steel material with rising stem, flanged or screwed ends. Gate valves shall generally be used, except for 150 mm Ø valve installed on waste oil drain to oil water separator, which is butterfly valve.

Gauges and Instrumentation

The tank shall be outfitted with all the proper instrumentation and/or gauge necessary for the accurate monitoring and control of the Diesel Fuel Oil.

The tank shall be provided with a ground receding level gauge. The level gauge shall be completed with welded hollow shell float, guide wires, tape, sheave elbows, tape conduit (pipe), support brackets, gauge head

and level switches. The level gauge shall be constructed of the following materials:

- a) Gauge head - Aluminum
- b) Sheave elbows - Aluminum
- c) Sheaves - Stainless steel
- d) Float - Stainless steel
- e) Guide & gauge wires - Stainless steel
- f) Guide wires anchor - Stainless steel
- g) Support brackets - Carbon steel
- h) Gauge wire conduit pipe - ASTM 53 galvanized

The level gauge shall be so located that tank liquid level can be accurately indicated to a height equal to the straight side height of the tank.

All connection lugs or openings in the tank required for gauge equipment installation shall be furnished.

A calibration scale shall be printed on the tank and shall be large enough so it can easily be visible preferably from the powerhouse.

Wires and cables to be used and installed aboveground shall be enclosed in a rigid steel conduit (galvanized) except those laid on cable trays. Cables installed underground shall likewise be enclosed and pipe sleeve are coated with bituminous paint.

Sounding Tape

The Contractor shall include the supply of one (1) set of Fuel Oil Tank Sounding Tape which is 10 meter long. Tape body/frame shall be of aluminum alloy with stainless steel tape and brass dropper. Brochures/catalogues shall be submitted by the Contractor for NPC's review and approval prior to procurement.

MW-5.2.4.5 Erection

The Contractor shall furnish all labor, tools, welding equipment and cables, falsework, scaffolding and other equipment necessary for the erection of the tanks complete and ready for use. Lifting lugs attached to the tank for erection purposes shall be removed by the Contractor and any noticeable projection of weld metal shall be chipped-off.

Shell plates shall be shaped to suit the curvature of the tank at the shop prior to shipment to the project site.

Tank shell seams shall be so positioned that they do not pass through vessel connections. Inside seam shall be ground smooth for application of the internal's protective coating.

The tanks and their structural components shall be welded by shielded metal-arc, the gas metal-arc, the flux-cored-arc, the electroslag or the electrogas process using suitable equipment. Welding may be performed manually, automatically or semi-automatically according to procedures described in ASME Section IX. Welding shall be performed in a manner to ensure complete fusion with the base metal. No welding of any kind shall be performed when the surfaces to be welded are wet, dirty nor during high winds unless the welder and the work are properly shielded. Each layer of weld metal or multi-layer shall be cleaned of slag and other deposits before applying the next layer.

The edges of all welds shall merge with the surface of the plate without a sharp angle. The maximum acceptable undercut shall be 0.4mm (1/64") of the base metal for vertical butt joints and 0.79mm (1/32") in depth for horizontal butt joints.

Tack weld, a weld made to hold parts of a weldment in proper alignment until final welds are made, shall not be considered as having any strength value in the finished structure.

The minimum size of fillet weld shall be as follows: plates 5mm (3/16") thick, not less than one-third the thickness of the thinner plate at the joint, with minimum of 5mm (3/16"). Single welded lap joints are permissible only on bottom plates and roof plates. Lap-welded joints, as tack-welded, shall be lapped not less than five (5) times the nominal thickness of the thinner joints, the lap need not exceed 50.8mm (2") and 25.4mm (1") for single welded lap joints. The reinforcement thickness of the welds on all butt joints on each side of the plate shall not exceed 2.4mm (3/32") and 3.2mm (1/8") for vertical and horizontal joints respectively. The reinforcement need not be removed except that it exceeds the maximum acceptable thickness. During the welding operation, plates shall be held close contact at all lap joints. Tack welds used in the assembly of vertical joints of the shell shall be removed when such joints are, welded manually. Tack welds, whether removed or left in place, shall be made using a fillet weld or butt weld procedure. Tack welds to be left in place shall be made by qualified welder and shall be examined visually for defects. Defective tack shall be removed.

Misalignment in completed vertical joints shall not exceed 10% of the plate thickness or 1.6mm (1/16"), whichever is larger. The upper plates in completed horizontal butt joints shall not project beyond the face of the lower plate at any point by more than 20% of the upper plate thickness, with a maximum projection of 3.2mm (1/8"), except that a projection of 1.6mm (1/16") is acceptable for upper plates less than 7.9mm (5/16") thick.

MW-5.2.4.6 Test and Inspection

Test and inspection of all materials and equipment shall be performed in accordance with the requirements of all applicable codes and standards, unless otherwise stated in this specification.

The Contractor shall establish test procedure in accordance with the requirements of this specification which will be used as guide in the performance of field test and inspection for all works furnished. The test procedure shall be submitted to NPC for review and approval.

Upon completion of works, the Contractor shall conduct and perform test and inspection for the system's equipment furnished which will be in accordance with the approved test procedure. The tests shall be performed in the presence of NPC representative. Prior to start of tests, the Contractor shall notify NPC of the date when such tests are to be performed.

Any defect found during the tests shall be rectified by the Contractor in the same manner described herein.

Weld Inspection

a) Butt Welds

Complete penetration and fusion is required for welds joining shell plates to shell plates. Inspection for quality of welds shall be made by liquid penetrant examination. Where visual inspection by NPC inspector indicates unsatisfactory welds, acceptance or rejection shall be based on the results of the penetrant examination.

b) Fillet Welds

Fillet welds are welds of approximately triangular section joining two (2) surfaces approximately at right angle to each other as in lap joint, tee joint or corner joint.

Inspection of fillet welds shall be made by visual examination. Where visual inspection by the NPC inspector indicates unsatisfactory welds, acceptance or rejection shall be based on sectioning such areas by chipping with a mechanical round-nosed chipping tool.

c) Cost

All costs for making radiographs and any necessary repairs shall be borne by the Contractor.

Methods of Inspecting Joints

Liquid penetrant examination is required for shell butt welds, annular plate butt welds and flush-type connection with butt welds. Inspection by liquid penetrant examination shall not be required for roof plate or bottom plate welds nor for welds joining roof plates to the top angle, top angle to shell plate, shell plates to bottom plates or appurtenances to tanks.

The method of liquid penetrant examination shall be in accordance with Section V, of ASME Code and applicable editions/addenda. The examination shall be performed in accordance with a written procedure prepared by the Manufacturer in compliance with the applicable requirements of Section V of the ASME Code.

All materials to be used shall be of a recognized commercial quality per manufacturer's recommendation.

Liquid Penetrant Examination shall be properly recorded and documented and submitted to NPC including rejectable indications and its location and extent.

Tank Testing

a) Testing Tank Bottom Welds

Upon completion of welding the tank bottom, all joints shall be tested by vacuum using a soap film solution.

b) Testing Tank Shell

Upon completion of the entire tank and the performance of weld inspection specified in Section MW-5.2.4.6, the tank shell shall be tested by one of the following:

- b.1 If water is available, the tank shall be filled with water and inspected frequently during the filling operation. Filling of water shall be 50mm (2") above the top leg of the top angle.
- b.2 If water is not sufficient to fill the tank, the test shall be made by one of the following:
 - b.2.1 Painting all joints on the inside with a highly penetrating oil and carefully examining the outside of the joint for leakage.
 - b.2.2 Applying vacuum to either side of the joints or applying internal air pressure as specified in Item c) of this Section and carefully examining the joints for leak.

c) Testing Tank Roof

Upon completion, the tank roof shall be tested by applying internal air pressure or external vacuum to the seams with a soap film solution. The internal pressure shall not exceed the weight of the roof plates.

Repairs**a) Repair of Welds**

All defects found shall be called to the attention of the NPC inspector and his approval shall be obtained before they are repaired. Pinhole leaks or porosity in tank bottom joints may be repaired by applying an additional weld bead over the defective area. Other defects or cracks in tank bottom joint or leaks in shell joints or in the shell-to-bottom joints shall be required by chipping or melting out the defects from one or both sides of the joint, as required, and rewelding. Only sufficient cutting out the defective joints is required as is necessary to correct the defects. Isolated pinhole leaks in roof joints may be caulked mechanically. Considerable porosity in the roof joints or of cracking shall be added with bead of weld metal laid over the affected portion. Mechanical caulking is not permitted for any other repairs. Repairs of defect discovered after the tank has been subjected to hydrostatic test shall be made with the water level at least 300 mm (1') below the point being repaired or with the tank empty if repair is on or near the tank bottom.

All repaired welds shall be checked by repeating the original inspection procedure and by repeating one of the testing methods.

MW-5.2.4.7 Tank Calibration

The tank shall be calibrated for accurate measurement of Diesel Fuel Oil. Five (5) copies of calibration table shall be furnished to NPC. Prior to the conduct of the calibration process, the Contractor shall submit in five (5) copies of Tank Calibration Methodology for NPC review and approval.

MW-5.2.4.8 Painting Requirements**General**

The tanks and other surfaces shall be painted in accordance with first class standard practices suitable for the purpose.

All paints and shop primer to be used shall be of standard types of a well-known manufacturer subject to the approval of NPC.

Surface Preparation

Prior to painting, all weld spatter, mill scale, burrs, rust, loose particles, and flux shall be removed. Grinding and deburring shall be performed with a wheel that will assure a clearly cut surface.

Blast cleaning with iron-free sand or grit shall be used. The grit shall be new and unused. Surface preparation of external surface of tank that will be carried-out at the site shall be done by power tool cleaning to avoid scattering of abrasives caused by blast cleaning.

All cleaned surfaces shall be primed within six (6) hours or before any rust bloom forms on the blasted surface.

Painting Application

Application of painting shall be in accordance with the Manufacturer's recommendations and standard practices. No painting shall be applied on wet or damp surfaces.

The tank external surfaces, appurtenances and other surfaces shall be painted to conform with the following:

- | | | | |
|----|--|---|-------------------------------------|
| a) | Primer Coat
(75 microns DFT) | : | Zinc rich epoxy polyamide
primer |
| b) | Intermediate Coat
(100 microns DFT) | : | Epoxy polyamide |
| c) | Final Coat
(50 microns DFT) | : | Polyurethane enamel |

The tank inside surfaces including structural shall be painted to conform with the following:

- | | | | |
|----|--|---|--|
| a) | Primer Coat
(50 microns DFT) | : | Zinc rich epoxy polyamide
primer |
| b) | Intermediate Coat
(100 microns DFT) | : | Polyamide amine cured epoxy
coating |
| c) | Final Coat
(100 microns DFT) | : | Polyamide amine cured epoxy
coating |

The underside of the tank bottom shall be coated with coal tar epoxy, 400 microns DFT.

The Contractor shall provide test instruments used for testing dry film thickness.

Should the measured dry film thickness result to less than the specified one, the Contractor shall apply additional paint to the coat inspected or shall increase the thickness of succeeding coat, as applicable, to conform with the specified total dry film thickness.

Final color of paint on external surfaces of the tank shall be silver or as directed by NPC. Final color of associated piping and equipment shall be similar to the existing facilities unless otherwise directed by NPC.

MW-5.2.4.9 Submittals

Prior to the purchase of materials, fabrication and erection/installation of the fuel oil storage tank, the Contractor shall submit for review and/or approval by NPC, construction drawings of the tank concrete foundation and detailed drawings as required.

Certified mill test reports, covering all steel plate, structural shapes and piping/nozzles to be used in the work and as required by the governing codes and standards shall be furnished for the NPC's review and record. Copies of each mill test report shall be submitted to NPC prior to fabrication of materials covered under this work.

Prior to the conduct of tank test, inspection and test procedures shall be submitted for NPC's review and approval. Test report shall be submitted in five (5) copies fifteen (15) days after the conduct of test.

MW-5.3 Fuel Day Tank

The fuel oil day tank shall have a minimum capacity of 900 liters and shall be shop-fabricated, all welded construction, rectangular shape and shall be designed and constructed in accordance with the requirements of applicable standards complete with manholes, inlet and outlet nozzles, nozzles for vent, overflow, drain and level gauge/switches. Included in the supply of fuel oil day tank are its structural steel supports with sufficient height as required by the diesel engine fuel system or as recommended by the engine manufacturer. The tank material shall be of carbon steel conforming to ASTM A36 or approved equal with minimum shell thickness of 5 mm. Nozzles shall be fitted with flanges, raised face conforming to ANSI B16.5. The supply shall include all the necessary materials for fixing and installation.

The tank shall be provided with an interior and exterior coating. For internal surfaces, three (3) coats of paint having a phenolic-base or equivalent shall be applied. As minimum, first coat shall be applied with 80 microns DFT of zinc rich polyamide epoxy primer. Second and final coat shall be applied with 100 microns DFT for each coat. External surfaces shall be painted with 80 microns DFT of zinc rich polyamide epoxy primer on first coat. On second coat, 160 microns DFT of intermediate chlorinated rubber shall be applied and 80 microns DFT chlorinated rubber topcoat as final coat. Refer to relevant Civil Works specifications and drawings for details of concrete foundation and supporting steel structures.

Inspection of welds shall be made by visual examination. Where visual inspection by the NPC inspector indicates unsatisfactory welds, acceptance or rejection shall be based on sectioning such areas by chipping with a mechanical round-nosed chipping tool.

Tank tightness shall be tested by filling the tank with water and inspected frequently during the filling operation. Filling of water shall be up to the point above the overflow nozzle. Traces of leakages shall be determined for at least one (1) day while the tank is filled with water.

MW-5.4 Fuel Transfer Pump**MW-5.4.1 General**

The fuel transfer pump shall be used for unloading diesel oil from a tanker or 210-liter drum or transferring diesel oil from the fuel oil storage tank to the diesel engine day tanks.

The plant shall be provided with one (1) set of Fuel Oil Transfer Pump with capacity of not less than 10 m³/hr at a discharge head of 30m complete with accessories necessary for the safe and reliable operation of the pump including spare parts as recommended by the manufacturer for one (1) year operation.

The pump shall be installed inside the pump house/pump shade complete with concrete foundation, anchor bolts and electrical amenities and shall conform to the requirements of relevant Civil and Electrical Works Specifications and drawings.

MW-5.4.2 Scope of Works

One (1) set of Fuel Oil Transfer Pump, with capacity not less than 10 m³/hr at a discharge head of 30m, shall be supplied, installed and tested at plant site to unload or transfer diesel fuel oil including its concrete foundation, anchor bolts, pump house and spare parts for one (1) year operation.

The works shall include the supply and installation of associated valves, strainers, gauges, power cables, controls and other accessories necessary for the safe and reliable operation of the fuel oil transfer pump, but not limited to those shown on the attached drawings.

MW-5.4.3 Design and Construction

Pump shall be horizontal gear type with a capacity of not less than 10 m³/hr at a discharge head of 30m. Pump casing shall be made of cast iron material capable of withstanding a hydrostatic pressure of 150% of the maximum pumping pressure under which the pumps could operate at design speed.

The fuel oil transfer pump shall conform, as minimum, to the following requirements:

- | | | | |
|----|---------|---|----------------------------|
| a) | Casing | : | Cast Iron |
| b) | Gear | : | Ductile Iron |
| c) | Shaft | : | High Strength Carbon Steel |
| d) | Bushing | : | Bronze (Graphited) |

Gland shall be made of cast iron stuff with graphite gland packing. Oil pan shall be provided at the gland section to catch possible oil leaks.

Pump shall be equipped with adjustable safety valve or relief valve to protect the unit from overpressure. Safety valve box and cover shall be made of cast iron.

Lifting lugs and eyes and other special tackle shall be provided as necessary to permit easy handling of the pump and its components.

The pump shall be driven by a direct-coupled motor mounted on a common metal base ready for installation on concrete foundation. Concrete foundation and anchor bolts shall be included in the scope of work and shall conform to the requirements of relevant Civil Works Specifications.

Pump motor shall be selected so that the pump brake HP requirement throughout the entire capacity range shall be within the nameplate rating of the motor. Motors shall be capable of operating continuously at rated output within $\pm 5\%$ of rated frequency and at any voltage within $\pm 10\%$ of rated value.

Pump motor shall generally be of the squirrel cage rotor induction type and shall comply with ANSI Standards plus amendments. Standard frame sizes should be used.

Pump Motor shall be of the totally enclosed guarded fan cooled type, suitable for outdoor installation, designed either continuous or intermittent operation and direct on line starting. Motors shall conform to the requirements specified in the electrical Works specifications.

The pumps to be supplied shall be operated at 230V, 1-phase, 60 cycles. Pumps shall be operated only from the local panel located in the pump house.

Local panel shall be provided with start and stop push buttons with indicating lights. Start and Stop status for each pump shall be monitored in the Control Room Panel.

The technical requirements of the associated valves, flowmeter, strainers, gauges, testing and spare parts shall conform to the requirements specified in this section.

All cables and conduits of appropriate size required for the connection of the motor to the existing station panelboard shall be provided by the Contractor.

MW-5.4.4 Spare Parts

The Contractor shall supply the manufacturer's recommended spare parts for one (1) year operation for each pump to be supplied which shall include the following as minimum:

- a) One (1) set of bearings for pump and motor; and

- b) One (1) set of bushings, wearing rings, packing and gaskets for the pump.

MW-5.4.5 Submittal

The Contractor shall submit for NPC evaluation and approval for the following:

- a) Pumps Catalogues or brochures, outline drawings and single line diagram including the pump's concrete foundation;
- b) Test procedures prior to test; and
- c) Test and inspection reports

MW-5.4.6 Pump Testing

The pump and motor shall be subjected to factory tests to determine its conformance with the design and operating characteristics and shall be performed in accordance with the approved test procedures and applicable codes and standards which shall include the following:

- a) Pressure hydrostatic proof of the spiral case to 1.5 times the maximum pressure for 30 minutes;
- b) Report of the characteristic curve such as Height vs. Flow, Power absorbed against Flow, Efficiency against Flow;
- c) Test of uninterrupted operation to full flow and maximum height of each pump motor set for one (1) hour; and
- d) Test of uninterrupted operation without load for each pump motor set for one (1) hour.

MW-5.4.7 Painting

Pumps, associated valves and other accessories are generally delivered with final paint applied at the manufacturer's shop per manufacturer's standard. Any part of the final paint that will be damaged during transport and installation shall be re-painted or touched-up after installation and testing.

MW-5.5 Piping, Valves, Fittings and Accessories

MW-5.5.1 Scope of Work

The Supplier shall supply, install and test a complete Fuel Oil Transfer and Waste Oil/Water Piping System including pipe supports, fittings, necessary accessories, all required excavation and backfill of pipe trenches, painting and other necessary accessories as required and shown on the attached drawings.

The F. O. Transfer piping system shall consist of piping interconnections for a flexible hose at fuel rotary hand pump inlet, and from fuel oil day tanks to respective diesel engines.

Waste Oil/Water shall consist of piping interconnections from drain pits in the Generating sets' area to the oil-water separator as shown on the relevant works drawings.

MW-5.5.2 Piping

Fuel oil piping shall be constructed from ASTM A53 Gr. B, seamless pipe, schedule 40. All piping 65mm and larger shall be constructed with flanged joints or butt-welded joints and fittings. Piping 50mm and below shall be constructed with flanged joints or socket welded joints and fittings or otherwise permitted or approved by NPC.

Fuel oil piping in the fuel oil day tanks' area shall generally be installed above ground. All other fuel oil piping shall be installed either above ground or underground or as directed by NPC. Fuel piping installed underground shall generally be applied with tape wrapping of minimum finished thickness of 1 mm and applied spirally with overlap of 50% in all parts of the pipe and fittings or other corrosion protection method as approved by NPC. The tape wrapping brochures shall be submitted for NPC approval prior to procurement and application. The wrapping shall extend for 300 mm beyond the buried portion.

Waste oil/water piping shall be constructed of Unplasticized Polyvinyl Chloride (uPVC) pipe, schedule 80 or class 150, conforming to ASTM D-1784 or approved equivalent.

Unplasticized PVC pipe connection joints 80 mm (3") Ø and above shall be joined by rubber ring or solvent cement type connection in conformance with manufacturer's recommendation. Smaller sizes shall be of solvent cement type connection. Flanged connections shall be used for connecting to flanged surfaces or to flanged-ends valve and shall be of the same material with the connected pipe with a rating of class 150 or ANSI 150.

The waste oil/water piping system shall generally be laid underground. All trenches shall be provided with a cushion pad of at least 100mm sand and sandy soil bedding materials. All pipeline excavations shall be backfilled up to the level of the finished grade surface in layers of 150 and each layer shall be thoroughly compacted. Backfill materials shall be compatible soil taken from trench excavation and approved by NPC.

All pipes that crosses roadways shall be provided with pipe sleeve made of steel material or RCP pipe to protect the pipe from various loads imposed by vehicles and shall extend 600mm beyond shoulder of each pavement side. Embedded pipes in open areas shall be laid not less than 300mm from the ground surface to the bottom of pipe.

PVC pipe installed aboveground or with associated isolation valve shall be properly supported to avoid pipe sagging. Pipe covering made of steel or metal shall be provided in case there is high risk of damaging the pipe during normal operation and maintenance.

All trench excavation and backfill works shall be done in accordance with pertinent provisions specified in the Civil Works Specifications.

MW-5.5.3 Valves

All gate or globe valves to be supplied shall be of the outside screw and yoke design or with rising stems. Valves body material shall be of cast iron for sizes more than 50mm diameter and cast bronze or stainless steel for 50mm and smaller. All valves shall have flanged ends with a rating of not less than 150 lb. The use of screwed ends may be applied to 50 mm diameter subject to the approval of NPC. Check valves shall be of swing type.

MW-5.5.4 Strainers

Strainers shall be of basket type with cast iron body and flanged ends or as specified in the relevant specifications. Body drain and vent connections shall be included. Drain plugs shall be threaded. Screen elements shall be of stainless steel construction with minimum 32-mesh size or as shown on the drawings. Magnets shall be included to trap small iron and steel particles for use in fuel oil lines.

Cast iron Y-strainers with 60 mesh size (or mesh size as recommended by the flowmeter manufacturer) shall also be provided upstream of each flow meter installed between the genset and day tank. The filter element shall be of stainless steel fitted with magnet and with screwed ends

MW-5.5.5 Pressure Gauges

Pressure gauges for fuel oil system shall be provided with dampener. Each pressure gauge shall be provided with isolation valve. Pressure gauge shall be of bourdon tube type with solid front case, and minimum size of dial gauge shall be of 100mm Ø.

MW-5.5.6 Flow Meters

Flow meters shall be provided for fuel oil system as shown on the drawings. One (1) flow meter shall be provided downstream of the fuel transfer/unloading pump.

Accuracy of flow meters shall be $\pm 0.5\%$ of total flow with 0.03% repeatability. Flowmeters shall be of LCD display capable of monitoring the total/accumulated flow, resettable total flow and instantaneous flow rate. Simplex strainer with minimum 60 mesh size and stainless steel filter element shall be provided. The flowmeter shall be made of aluminum or approved equivalent with flanged ends and shall utilize an internal battery that can last up to at least 5 years. The flowmeter shall be

equipped with pulse generator or 4-20mA current output and ready for interconnections in future telemetry project.

MW-5.5.7 Testing

The assembled piping and valves shall be hydrostatically tested at 1.5 times the design pressure for a minimum of 30 minutes. During the test, valves shall be opened and closed. Any leakage or any defect disclosed by the tests shall be corrected and repaired by the Contractor at his own expense to the satisfaction of NPC.

The assembled fuel oil piping system may be tested using a compressed air at a pressure of 1.25 times the operating pressure of the system and maintaining it for a minimum of 10 minutes, subject to the approval of NPC. Examination for leakage detected by soap bubble or equivalent method shall be made of all joints and connections. The piping system shall show no evidence of leaking.

During initial pipe filling and trial operation of the fuel oil piping system, piping fittings and joints shall be visually inspected against leak.

There shall be no leakage whatsoever from the pipes, fittings and connections for each section tested while the system is under test pressure for the period of not less than thirty (30) minutes or the total time to inspect all portions of the waterline under test, whichever is longer. During the test, valves shall be opened and closed. Any leakage or any defect disclosed by the tests prior to the acceptance shall be corrected and repaired by the Contractor at his own expense to the satisfaction of NPC.

Before any test is made, the Contractor shall notify NPC in advance so that such test may be witnessed. All expenses that may be incurred during the tests shall be borne by the Contractor.

MW-5.5.8 Painting

All steel piping installed outdoors and indoors shall be prime coated with 80 microns DFT zinc rich epoxy paint and 80 microns DFT of chlorinated rubber for each intermediate and topcoat.

All steel pipes laid underground shall be applied with two (2) coats of coal tar epoxy polyamide of 170 microns DFT each coat and finally wrapped with 6mm thickness asphalt jute.

Painting for waste oil/water uPVC piping is not required unless otherwise directed by NPC.

Final color for Fuel Oil piping and associated valves installed above ground shall conform to Munsell No. 7.5R 3/12.

MW-6.0 DOMESTIC WATER SUPPLY SYSTEM**MW-6.1 General**

This section provides the essential information for the design, supply, installation, construction, test and commissioning of the complete Domestic Water Supply System to provide the water requirement of the plant including the required excavation and backfilling of pipe trenches.

The work shall include, but not limited to the following:

- a) One (1) lot of Drilling, Casing Installation, Well Development, Well Disinfection;
- b) One (1) set of Shallow Well Hand Pump complete with controls, instrumentation and necessary accessories;
- c) One (1) lot of Elevated Water Storage Tank complete with accessories; and
- d) One (1) lot of Piping, Valves, and Fittings including the required excavation and backfill.

MW-6.2 Drilling, Developing and Testing of Well**MW-6.2.1 General**

The Supplier shall furnish labor, materials, and equipment and perform all operations in connection with the drilling, placing of casing, development and disinfection of the well which shall be drilled to an appropriate size and depth.

Depth of well shall be approximately 15 m or at a water level suitable for drinking purposes. The Supplier shall be responsible for the geological study/ground water as to where the well will be drilled taking into consideration the location of the Elevated Water Storage Tank shown on the drawing.

The Contractor shall secure a Drilling Permit from National Water Resources Board (NWRB) and submit copy to NPC, together with the well-drilling data. A duly registered well driller shall undertake the drilling pursuant to the Amended IRR of PD 1067 (Water Code of the Philippines).

MW-6.2.2 Drilling

Drilling of the well shall be done by an appropriate method most suited to the conditions of the well site to be drilled. When necessary, temporary casing shall be used in sections in the hole through over burden or unstable materials to prevent casing-in of the well.

MW-6.2.3 Well Completion and Development

The Supplier shall develop the well by an appropriate method most suited for the conditions of the well site and placing ready for installation of the jetmatic hand pump.

The Supplier shall undertake all operations pertaining to completion and development of the well which shall consist of installation of casing, installing well screen in a sand and gravel formation, developing toe water bearing, surging and back washing.

All permanent casing materials shall be new. The well casing to be installed shall be 50mm Ø GI steel pipe, while the pump's suction pipe is 32mm Ø steel pipe conforming to ASTM A 53 seamless hot dip galvanized, schedule 40 pipe. Opening of the well screens shall have dimension to avoid the sediments to pass into the well and shall be designated to prevent clogging and shall be free from jogged edges, irregularities, etc. that will accelerate clogging or corrosion.

After the completion of well construction, the well shall be thoroughly cleaned of all foreign substances including tools, timbers, rope, debris of any kind, cement, oil, grease and scum. The casing pipe shall be thoroughly sabbed using alkalis, if necessary, to remove oil and grease.

Sterilization of the well is done by pouring a solution of 0.46 kg (1 pound) of calcium hypochlorite in 38 liters (10 gals) of water.

MW-6.2.4 Submittal

The Supplier shall submit to NPC the complete installation details prior to start of works and the complete well-drawdown test results upon completion of the drilling.

MW-6.3 Pump

The scope of work shall cover the supply, delivery, installation at the well platform and test of one (1) unit of shallow well hand pump complete with brass foot valve, stainless steel screen with 5mm Ø slots, associated valves, flanges, bolts, nuts and other accessories necessary for the safe and reliable operation of the domestic water supply system.

The shallow well hand pump shall have a minimum discharge capacity of 0.455 m³/h (2 gpm) and capable of lifting water at a minimum depth of 7.6 m. The hand pump shall be reciprocating type and made of cast iron.

The pump shall be complete with necessary fittings and accessories to provide the safe and reliable operation of the pumping system.

The following documents shall be submitted by the Supplier for NPC's review and approval.

- a) Technical data, specifications and catalogues;

- b) Outline, assembly and installation drawings showing all the dimensions; and
- c) Operation and maintenance manuals.

MW-6.4 Water Storage Tank

The Supplier shall supply, deliver, install and test one (1) set of water storage tank. The water storage tank shall have a minimum capacity of 600 liters and shall be of polyethylene type. The water storage tank shall be complete with manhole, inlet and outlet nozzles with valves, overflow pipe, strainer, drain nozzle with valve, level switch nozzle with plug (for future use), pipe supports, access ladder and supporting steel structures.

Tank foundation and supporting steel structures shall be in accordance with requirements of relevant Civil Works specifications and drawings.

MW-6.5 Piping, Valves and Fittings

Domestic water supply and distribution piping shall be constructed from Unplasticized Polyvinyl Chloride (uPVC) pipe, schedule 80 or class 150, conforming to ASTM D-1784 or approved equivalent.

Gate valves, shall be made of bronze or stainless steel, rising stem, union bonnet, inside screw, solid wedge or plug type disc, with screwed or flanged ends. Check valves shall be of swing type, cast bronze and with screwed ends.

Valves of all sizes shall have a rating of not less Class 150.

Garden hose connection valves or hose bibbs shall be of bronze material, 20mm size and outfitted with male thread hose connections.

MW-6.6 Testing

After installation of the equipment, the Supplier shall perform necessary tests at site to determine its compliance with the requirements of the specifications. All costs for testing shall be borne by the Supplier.

MW-6.6.1 Pumps

The pump shall be subjected to site tests to determine its conformance with the design and operating characteristics and shall be performed in accordance with the approved test procedures and applicable codes and standards.

MW-6.6.2 Water Storage Tank

Upon completion of the tank, it shall be filled with water at a proper pressure to fill the tank to the maximum water level. The water shall remain in the tank for at least twenty-four (24) hours after which observations for leaks and other defects shall be made.

All defects shall be corrected by the Supplier to the satisfaction of NPC before final acceptance of the work is made. Any leakage that is disclosed in the test shall be repaired by the Supplier.

All equipment and appurtenances necessary to carry out the tests and any repair, if required, shall be borne by the Supplier.

MW-6.6.3 Domestic Water Supply Piping System

The piping system shall be hydrostatically tested at a pressure of 1.5 times the operating pressure of the system.

Tests may be applied to sections or the entire system. The test shall be made between valves and sections of not more than 305m (1000 ft) in accordance with the American Water Works Association (AWWA). There shall be no leakage whatsoever from the pipes, fittings and connections for each section tested while the system is under the test pressure for the period of not less than thirty (30) minutes of the total time to inspect all portions of the waterline under test, whichever is longer. During the test, valves shall be opened and closed. Any leakage or any defect disclosed by the tests prior to the acceptance shall be corrected and repaired by the Supplier at his own expense to the satisfaction of NPC.

Before any test is made, the Supplier shall notify NPC in advance so that such test may be witnessed. All expenses that may be incurred during the tests shall be borne by the Supplier.

MW-6.7 Disinfecting of Water Storage Tank and Domestic Water Piping System

The water storage tank and domestic water piping system shall be disinfected after testing and before being put into use. Before disinfections, the tank and piping should be drained, flushed, re-drained and refilled. In refilling, care must be taken to avoid entraining or entrapping air in the tank. The Supplier may use any of the methods of disinfections as recommended by the American Water Works Association (AWWA) or any of the following kinds of treatment:

- a) Chlorine Gas-Water Mixture;
- b) Calcium-Hypochlorite or equal; or
- c) Dry Calcium Hypochlorite or Chlorinated Lime and Water Mixture.

Retention period shall be at least 24 hours and shall produce not less than 10 ppm at extreme end of the lines at the end of the retention period. After flushing, residual chlorine must be reduced to less than 1 ppm.











MW-7.0 FIRE FIGHTING SYSTEM

This section provides the essential information for the design, manufacture, fabrication, supply, installation, delivery to site and test of the specified Fire Fighting System.

All equipment and materials necessary for the complete installation shall be furnished complete, even though not necessarily mentioned in this specification but are necessary for the safe and reliable operation of the Fire Fighting System.

All the fire fighting equipment shall be supplied by the Contractor complete with their corresponding technical brochures written in English that would aid in the installation, operation and maintenance of the equipment.

Fire extinguishers shall be designed, installed and tested in accordance with International Organization for Standardization (ISO) norms and/or internationally accepted standards and/or listings or certifications based on Section 10.5.3.2 of the Revised Implementing Rules and Regulation (RIRR) of RA 9514 – The Fire Code of the Philippines, such as:

CERTIFYING BODY	CERTIFICATION/ COMPLIANCE MARKINGS
National Fire Protection Association (NFPA)	
Underwriters Laboratories (UL)	
Factory Mutual (FM)	
American National Standards Institute (ANSI/UL 8)	
Loss prevention Certification Board (LPC or LPCB)	
European Committee for Standardization (CE marked or EN 1866-1:2007)	
Australia Standards Association (ASA or AS2444)	
Japan Industrial Standard Committee (JIS or JISC)	
Korea Fire Industry Technology Institute (KFI)	
British Standards Institution (Kitemark EN3 or BS EN3)	

The fire extinguishers shall be check-weighed at interval of six (6) months from the date of delivery for a period of one (1) year and if found to be undercharged (unless used by an NPC personnel) shall be filled and recharged by the Contractor at no expense to NPC.

Painting of Fire Fighting Equipment and applicable piping shall be in accordance with Manufacturer's standard or as directed by NPC. Equipment with final painting have already been applied at the shop but have been damaged during transport and/or installation works, shall require touch-up painting.

The Contractor shall design, furnish, install and test all the equipment specified below.

MW-7.1 Scope of Work

The Supplier shall supply the specified number of Underwriter Laboratories/Factory Mutual Approved Portable Type Fire Extinguishers complete and ready for operation and shall be installed at their corresponding place of use as specified in the particular specifications and as shown on the drawings.

- a) Three (3) units of Portable Type Fire Extinguisher, Clean Agent (HCFC or Halotron I Type), 7.1 kg. (15.5 lbs), wall-hung type, multi-shots, non-expiry and shall be in certified/ approved by the certifying body specified in Section VI, Part I, MW-7.0; and
- b) One (1) unit of Foam (AFFF/F3) wheeled type fire extinguisher complete with self-contained cylinder mounted on a frame with handle, floorstand and steel wheels, 125 L (33 gallons) capacity complete with associated valves, dial gauge indicator, nitrogen expellant tank for unit pressurization, appropriate size of discharge hose of 15 m long fitted with couplings and foam nozzle assembly and shall be in certified/ approved by the certifying body specified in Section VI, Part I, MW-7.0.

MW-7.2 Fire Extinguisher

Fire extinguishers shall be Underwriter Laboratories and/or Factory Mutual approved and of rechargeable cylinder with five (5) years guarantee against leak. Each fire extinguisher cylinder shall be complete with release valve, dial gauge indicator, appropriate length of hose with nozzle and locking pin.

The 7.1 kg (15.5 lbs.) minimum capacity wall-hung type fire extinguishers shall be complete with carrying handle and wall-mounting bracket.

Portable fire extinguishers shall be suitable for the protection against class ABC fires using Clean Agent (HydroChloroFluoroCarbon or Halotron I Type) that is environmentally safe and leaves no residue.

The Foam (AFFF/F3) wheeled type fire extinguisher unit shall consist of a completely self-contained cylinder mounted on a frame with handle, floorstand and steel wheels, 125 L (33 gallons) capacity complete with associated valves, dial gauge indicator, nitrogen expellant tank for unit pressurization, appropriate size of discharge hose of 15 m long fitted complete with couplings and foam nozzle assembly, shall be in certified/ approved by the certifying body specified in MW-7.0.

The fire extinguishers shall be check-weighed at interval of six (6) months from the date of delivery for a period of one (1) year and if found to be undercharged (unless used by an NPC personnel) shall be filled and recharged by the Contractor at no expense to NPC.

MW-7.3 Submittal

The Supplier shall submit the technical specifications/data and brochures/catalogs of the fire extinguishers for the approval of NPC prior to purchase.

MW-8.0 AIRCONDITIONING AND VENTILATION SYSTEM

MW-8.1 General

This section provides the general technical requirements and other essential information for the Air Conditioning and Ventilation System equipment to be supplied, installed and tested by the Supplier.

The Air Conditioning and Ventilation Systems shall be provided in the containerized/pre-fabricated control house which houses the generator control and protection panels (GCPP), associated electrical equipment and devices. The Supplier shall be responsible for determining the respective sizes/ratings of the Air Conditioning and Ventilations system in consideration to the various electrical equipment and devices installed in the control house and subject to review and approval of NPC.

All air-conditioning equipment and Ventilation System shall preferably have one Brand name and shall be the standard product of a reputable A/C manufacturer. In case other brand of A/C and Ventilation equipment are to be used to meet with the specific requirements in the bid document, catalogues and other supporting documents shall be submitted for NPC's review and approval.

Power supply for the ventilation and air-conditioning equipment shall be 220V, single phase, 60 hz.

Refrigerant to be used shall be environmental friendly.

All necessary transformers and electrical materials shall be included in the Supplier's supply if power ratings provided are other than the one's specified above.

MW-8.2 Design Conditions**a) Outdoor Conditions:**

Dry Bulb Temperature	:	35°C
Wet Bulb Temperature	:	27°C
Relative Humidity	:	80% to 100%

b) Indoor Conditions (for air-conditioned areas):

Dry Bulb Temperature	:	24°C ± 3°C
Relative Humidity	:	50% ± 5%

c) Area to be air-conditioned shall be:

- c.1 Control Room (as indicated in the Schedule of Equipment and as shown in the Bid Drawings)

d) Area to be ventilated shall be:

- d.1 Comfort Room (Containerized Control Room) - 10 air changes per hour

MW-8.3 Schedule of Equipment**1. Air-Conditioning Unit**

Location	Quantity	Cooling Load	Type
1) Control Room	One (1) unit	16,000 kJ/hr	Window/ Inverter Type, Wall Mounted
2) Bunkhouse	One (1) unit	8,500 kJ/hr	

2. Ventilation Unit

Location	Quantity	Rating	Type
1) Control Room & Bunkhouse's CR	Two (2) units	100 m ³ /hr	Wall Mounted Exhaust Fan

MW-8.4 Air Conditioning System**MW-8.4.1 Scope of Work**

The Work called for in this specification includes the design, furnishing, delivering, installing, testing and commissioning of window/inverter type air conditioners to provide a fully ventilated and air conditioned rooms. The work shall include other accessories even though not specifically mentioned in this specification but are necessary to obtain a complete set for the safe and reliable operation of the system as a whole.

All installation works shall include provision of opening for the air conditioning unit/s including its mounting brackets.

All electrical materials such as circuit breakers, automatic controls, including all power and control wires, supervision, electrical outlets, fittings and conduits for interlocking the operation of the indoor units and outdoor units shall be included and provided by the Supplier including complete system of automatic temperature controls.

The type and quantity of air conditioning equipment to be supplied shall be as specified in Clause 8.3 (Schedule of Equipment) or shown on the drawings.

The air conditioning unit to be supplied and installed shall have the following features/accessories but not limited to:

- With Remote Controller and Holder
- With automatic and manual swing louver control
- With control switch
- Cool Mode
- Fan Mode
- Automatic Mode

MW-8.4.2 Window Type Air-conditioning

The Window Type Air Conditioning Unit to be supplied and installed for the control room/house is as specified in the schedule of equipment or shown on the drawings.

The unit shall be wall mounted, inverter type room air conditioner and shall be provided with a room thermostat and sensing element which detect changes in room temperature and adjust it to desired cooling by automatic actuation of the compressor. Compressor shall be provided with thermal overload device that automatically shuts off the compressor during overheating.

Fan motor shall be permanently lubricated. The unit shall operate on a 230 V AC, single phase and 60 Hz power supply.

Mounting brackets which are properly fixed on the wall shall be provided to support the suspended portion of the air conditioner unit. Weather seals shall be provided on the area between the air conditioner and wall opening.

The work shall also include the provision of wall opening for installation of the window type air conditioning units.

MW-8.5 Ventilation Unit**MW-8.5.1 Scope of Work**

The Supplier shall furnish, deliver, install and test the ventilation system equipment complete with all the necessary appurtenances for its efficient operation. The scope of supply shall include all mounting supports and fixing materials required to complete the installation and ready for operation.

MW-8.5.2 Wall-Mounted Exhaust Fan

Thru-the-wall propeller fan shall be provided at the Toilet.

The exhaust fan shall be installed/mounted on the wall and shall directly discharge exhaust air outside. It shall be of the direct-driven type and corrosion resistant. The fan shall be provided with an automatic shutter and shall operate on a 220 V, single phase, 60 Hz power supply.

MW-8.6 Installation and Painting

The Air Conditioning Unit/s and Wall Mounted Exhaust Fan shall be installed as indicated in the drawings or as directed by NPC. After installation, all exposed and unfinished surfaces shall be thoroughly cleaned and washed possibly by chemical of all rust, oil and other foreign matters and shall be repainted in accordance with the manufacturer's standard or as approved by NPC.

Likewise, all surfaces and supports shall be thoroughly cleaned of rust, oil and other foreign matters and shall be painted with epoxy primer and two (2) coats of finish paint.

Painted surfaces of all equipment which are damaged during transport and installation shall be repaired or touched-up as necessary to prevent rusting, corrosion, etc. until the final finish painting application is made.

MW-8.7 Spare Parts

The Supplier shall supply the standard spare parts for one (1) year operation or as recommended by the manufacturer. Any replacement spare parts required during the warranty period shall be supplied by the Supplier at no cost to NPC.

MW-8.8 Acceptance Test

Before the Completion of Works, the equipment shall be tested in the presence of NPC to determine whether the requirements of the specifications have been met. Any defects found that are inherent in the equipment shall be remedied at the expense of the Supplier.

MW-8.9 Submittal

The Supplier shall submit the type and model of the air conditioning and ventilation units for the approval of NPC prior to purchase.

MW-9.0 MISCELLANEOUS EQUIPMENT AND MATERIALS**MW-9.1 Scope of Work**

The Supplier shall supply, deliver and install the following equipment, materials and appurtenances which are necessary for the safe and reliable operation of the plant. All equipment and materials to be supplied shall be new and unused. The Supplier shall submit brochures/technical data prior to supply for approval of NPC. The equipment and materials shall be submitted with the Bid in a form specified in the Bid Form.

The materials listed below will be allocated and delivered to the plant site:

- a) Four Wheel Drum Truck (210 liter capacity) - 1 pc.
- b) Clock (10" diameter) - 1 set
- c) Steel Cabinet locker, 90 x 45 x 140 cm galvalum materials - 1 set
- d) Office Table and Chairs (Standard size table, 3 drawers with lock keys and 2 chairs with roller balls) - 1 set
- e) Ear muff, fluid filled high attenuation - 10 sets
- f) Lube Oil requirement (for the next lube oil change) - 80 liters
- g) Flash Light and head light with rechargeable AA battery, halogen bulb, LED light - 1 set
- h) Automatic Rechargeable Emergency Light - 1 set
- i) Electricians First Aid Kit (Plastic case filled specifically to meet the needs of the electricians most common injuries – burns, eye irritations, cuts and insect bites) consists of the ff: - 1 set

Content	Qty.
Adhesive bandages, plastic 1 x 3	16
Burn Ointment 1/8 oz	6
Cold Pack, Instant	4
Eye wash Solution, Eye pads & Strips	7
Tweezers	4

Latex Gloves, Pair	1 box
PVP Iodine Wipes	10
Scissors, 4" blunt	1
Sting Kill Swabs	4
Triangular Bandage	4
First Aide Guide	1

- j) Diesel Fuel including plastic drum - 800 liters
- k) Hard Hat with NPC logo, white color - 5 sets
- l) Plastic table and 4-chair (monoblock) - 1 set

MW-10.0 GUARANTEE

The Supplier shall guarantee that he will repair, and/or replace, at his own expense, the equipment and machineries, against defect, in design, workmanship and materials for a period of one (1) year after the Goods have been installed and commissioned. The Supplier guarantees that when the equipment and/or material are placed in operation and/or use, it will perform in the manner as set forth in the Contract.

MW-10.0 MEASUREMENT OF PAYMENT

Measurement of payment for all Mechanical Works shall be based on the bid price of each item in the Schedule of Requirements (Bid Price Schedule). The cost shall cover all works required and described in the pertinent provisions of the specifications.

Measurement of Payment for the Well Drilling and Development shall be based on per linear meter Bid Price as shown in the Schedule of Requirements (Bid Price Schedule). Payment shall be based on the above work as furnished, delivered, installed, tested and accepted.

PART I – TECHNICAL SPECIFICATIONS

EW – ELECTRICAL WORKS

PART I - TECHNICAL SPECIFICATIONS**SECTION EW - ELECTRICAL WORKS****TABLE OF CONTENTS**

<u>CLAUSE NO.</u>	<u>TITLE</u>	<u>PAGE NO.</u>
EW-1.0	GENERAL.....	1
EW-2.0	SCOPE OF WORK.....	1
EW-3.0	CODES AND STANDARD.....	3
EW-4.0	GENERATOR AND AUXILIARIES.....	5
EW-4.1	AC Generator	5
	EW-4.1.1 General	5
	EW-4.1.2 Design Characteristics	5
EW-4.2	Other Characteristics	5
EW-4.3	Space Heaters.....	6
EW-4.4	Unbalanced Load	6
EW-4.5	Parallel Operation.....	6
EW-4.6	Generator Stator.....	7
	EW-4.6.1 Stator Frame	7
	EW-4.6.2 Stator Core.....	7
	EW-4.6.3 Stator Winding.....	7
EW-4.7	Generator Rotor.....	8
	EW-4.7.1 Rotor Core.....	8
	EW-4.7.2 Rotor Winding	8
EW-4.8	Excitation System	8
	EW-4.8.1 General Description.....	8
	EW-4.8.2 Operating Requirements	8
	EW-4.8.3 Design Consideration for Excitation System	9
EW-4.9	Generator Control and Protection Panel (GCPP).....	9
	EW-4.9.1 Panel Construction	11
	EW-4.9.2 Alarm System.....	11
	EW-4.9.3 Communication Ports	11
	EW-4.9.4 Terminal Blocks.....	12
	EW-4.9.5 Nameplate.....	12
EW-4.10	Generator Circuit Breaker	12
EW-4.11	Equipment Wiring	12
EW-4.12	Equipment Grounding.....	13
EW-4.13	Spares Parts and Tools	13
EW-4.14	Inspection and Testing.....	13
	EW-4.14.1 General	13
	EW-4.14.2 Shop Test.....	13
	EW-4.14.3 Routine Test.....	14
EW-4.15	Data and Information to be Submitted After Award of Contract.....	14
EW-5.0	TRANSFORMERS.....	15
EW-5.1	General.....	15
EW-5.2	Technical Description	16
EW-5.3	Design Requirements	16
	EW-5.3.1 Rating.....	16

	EW-5.3.2	Voltage.....	16
	EW-5.3.3	Frequency.....	16
	EW-5.3.4	Overload Requirement.....	16
	EW-5.3.5	Short Circuit Withstand Capability.....	16
	EW-5.3.6	Transformer Loss Evaluation.....	16
	EW-5.3.7	Impedance and Reactance.....	17
	EW-5.3.8	Audible Sound Level.....	17
	EW-5.3.9	Tolerances.....	17
	EW-5.3.10	Electrical Insulating Oil.....	17
EW-5.4		Design and Construction Features.....	18
	EW-5.4.1	General.....	18
	EW-5.4.2	Cores.....	18
	EW-5.4.3	Windings.....	18
	EW-5.4.4	Bushing.....	19
	EW-5.4.5	Gasket.....	19
	EW-5.4.6	Tank.....	19
	EW-5.4.7	Radiators.....	20
	EW-5.4.8	Hardware.....	20
EW-5.5		Fittings and Accessories.....	20
EW-5.6		Equipment and Marking.....	21
EW-5.7		Standard and Common Tools.....	21
EW-5.8		Tests.....	21
	EW-5.8.1	Routine Test.....	22
	EW-5.8.2	Design Test.....	22
	EW-5.8.3	Miscellaneous Test.....	22
	EW-5.8.4	Site Test.....	22
EW-5.9		Failure to Meet Guarantees.....	22
EW-5.10		Data and Information to be Submitted After Award of Contract.....	23
EW-6.0		SWITCHYARD EQUIPMENT AND APPURTENANCES.....	24
EW-6.1		Automatic Circuit Recloser.....	24
	EW-6.1.1	General.....	24
	EW-6.1.2	Interrupting Medium.....	24
	EW-6.1.3	Insulation Medium.....	24
	EW-6.1.4	Housing Materials.....	24
	EW-6.1.5	Mounting.....	24
	EW-6.1.6	Control Cabinet.....	25
	EW-6.1.7	Earthing.....	25
	EW-6.1.8	Surge Arrester Bracket.....	25
	EW-6.1.9	Marking and Nameplates.....	25
	EW-6.1.10	Operating Mechanism.....	26
	EW-6.1.11	Bushing.....	26
	EW-6.1.12	Current Transformer.....	26
	EW-6.1.13	Auxiliary Supply.....	26
	EW-6.1.14	Control Design Features.....	27
	EW-6.1.15	Sequence of Operation.....	28
	EW-6.1.16	Protection.....	28
	EW-6.1.17	Safety Features.....	29
	EW-6.1.18	Metering.....	29
	EW-6.1.19	Event Recorder/Histogram.....	29
	EW-6.1.20	Spares.....	29
	EW-6.1.21	Other Technical Requirements.....	30

	EW-6.1.22	Test and Inspection.....	30
	EW-6.1.23	Data and Information to be Submitted After Award of Contract	31
EW-6.2		Fuse Disconnect Switch with Lightning Arrester Combination.....	31
	EW-6.2.1	Technical Characteristics and Requirements.....	31
EW-6.3		Kilowatt-Hour Demand Meter.....	33
	EW-6.3.1	Technical Characteristics and Requirements.....	33
EW-6.4		Bus Conductor and Hardware.....	33
	EW-6.4.1	Technical Characteristics and Requirements.....	34
EW-6.5		Maintenance Tools	35
EW-7.0		POWER, CONTROL AND INSTRUMENTATION CABLES.....	35
EW-7.1		Technical Characteristics and Requirements.....	35
	EW-7.1.1	Insulation.....	36
	EW-7.1.2	Jacket.....	36
	EW-7.1.3	Assembly	36
	EW-7.1.4	Application.....	36
EW-8.0		GROUNDING SYSTEM.....	36
EW-8.1		Technical Characteristics and Design Requirements	37
	EW-8.1.1	General	37
EW-8.2		Equipment and Materials Requirements	37
	EW-8.2.1	Grounding Cables	37
	EW-8.2.2	Ground Rods.....	38
	EW-8.2.3	Exothermic Welding Materials	38
	EW-8.2.4	Grounding Hardware	38
	EW-8.2.5	Steel Structure Grounding	38
	EW-8.2.6	Equipment Earthing.....	38
	EW-8.2.7	Powerhouse / Building Earthing.....	39
	EW-8.2.8	Fence Earthing.....	39
	EW-8.2.9	Pipe Earthing.....	39
	EW-8.2.10	Ground Rods.....	40
EW-9.0		LIGHTNING PROTECTION SYSTEM.....	40
EW-9.1		Technical Characteristics and Requirements	40
	EW-9.2.1	Air Terminal and Support.....	40
	EW-9.2.2	Down Conductor	40
EW-10.0		LIGHTING SYSTEM.....	41
EW-10.1		Design Requirements	41
	EW-10.1.1	Technical Characteristics and Requirements.....	41
EW-10.2		Lighting Fixtures, Luminaires and Accessories	42
EW-10.3		Switches and Single-Phase Outlets	44
	EW-10.3.1	General	44
	EW-10.3.2	Switches.....	44
	EW-10.3.3	Single Phase Outlets.....	45
EW-10.4		Outlet Boxes and Pull Boxes	45
	EW-10.4.1	Outlet Boxes.....	45
	EW-10.4.2	Pull Boxes	45
EW-10.5		Lighting and Power Panelboard	45
	EW-10.5.1	Circuit Breaker	45
	EW-10.5.2	Kilowatt-hour Meters	46
	EW-10.5.3	Grounding Electrode	46
	EW-10.5.4	Cables.....	46
	EW-10.5.5	Cable Installation.....	46

SECTION III – TECHNICAL SPECIFICATIONS

LuzP22Z1435Se

	EW-10.5.6	Nameplates.....	47
EW-11.0		CONDUIT SYSTEM.....	47
EW-11.1		Technical Requirements and Characteristics.....	47
EW-12.0		CONTROL, PROTECTION AND MONITORING PANELS OF MOTOR PUMP.....	48
EW-12.1		Technical Requirements and Characteristics.....	49
	EW-12.1.1	Panel Construction.....	49
	EW-12.1.2	Combination Motor Starter and Breaker Unit.....	49
	EW-12.1.2.1	Circuit Breaker	50
	EW-12.1.2.1	Starter Contactors	50
	EW-12.1.2.2	Overload Relays.....	50
	EW-12.1.2.3	Mechanically Operated Auxiliary Contacts (As applicable, to be determined by the Contractor)	51
	EW-12.1.2.4	Remote Control	51
	EW-12.1.2.5	Indicating Lights	51
	EW-12.1.3	Nameplate.....	51
	EW-12.1.4	Equipment Grounding	52
EW-13.0		FACTORY ASSEMBLY AND TESTS.....	52
EW-13.1		General.....	52
EW-13.2		Shop Test.....	52
EW-13.3		Other Requirements	52
EW-14.0		OTHER SITE REQUIREMENTS.....	53
EW-14.1		Job Site Cameras	53
EW-14.2		Technical Characteristics.....	53
EW-15.0		DATA AND DOCUMENTATION REQUIREMENTS.....	54
EW-15.1		Data and Information to be Submitted with the Proposal	54
EW-15.2		Data and Information to be Submitted During Post Qualification.....	55
EW-15.3		Data and Information to be Submitted During Implementation.....	55
EW-16.0		MEASUREMENT OF PAYMENT.....	73

SECTION EW - ELECTRICAL WORKS

EW-1.0 GENERAL

This section covers the technical and associated requirements for the Supply, Delivery, Installation, Test and Commissioning of 2 X 150 kW Modular Diesel Generating Sets, Associated Electrical Equipment and Balance of Plant for the Electrification of New Areas in Jintotolo Is, Balud, Masbate.

It is not NPC's intent to specify all technical requirements nor to set forth those requirements adequately covered by applicable codes and standards. The Supplier shall furnish high quality diesel generating set and its associated electrical equipment meeting the requirements of this specification and industry standards.

All electrical equipment shall be installed in accordance with the relevant sections of this specification. The Supplier shall submit all related drawings and document deemed necessary, prior to the execution of the work, subject to the approval of NPC.

The works shall be performed and completed in a workmanlike manner in accordance with generally accepted modern engineering practice.

EW-2.0 SCOPE OF WORK

The scope of electrical work covers the furnishing of all labor, materials, equipment, tools and other necessary incidentals required for each project site which shall essentially consist of all electrical equipment and materials enumerated herein:

1. Supply, Installation and Test of 2 x 150 kW, 480V, 3-phase, 60Hz AC Generator and associated auxiliary electrical equipment including grounding materials;
2. Supply, Installation and Test of Generator Control and Protection Panel (GCPP) for 2 x 150 kW D/G sets equipped with monitoring, metering, control, protection and synchronizing equipment/devices;
3. Supply of One (1) Spare each of Circuit Breaker, GCPP Module/ Controller, Automatic Voltage Regulator (AVR), and Rotating Diodes for 150 kW D/G Set;
4. Supply, Installation and Test of 2 x 225kVA, 480V/13.8kV, 3-Phase, 60Hz Generator Transformer;
5. Supply, Installation and Test of 20kVA, 7.97kV/240V, 1-Phase, 60 Hz Station Service Transformer;

6. Supply, Installation and Test of 800A, 60 Hz, 15kV, 12kA, Automatic Circuit Recloser;
7. Supply, Installation and Test of 15 kV Fuse Disconnect Switches with Lightning Arrester Combination;
8. Supply, Installation and Test of Kilowatt-hour Demand Meter and associated Instrument Transformers and Accessories;
9. Supply, Installation and Test of Bus Conductor and Line Materials and Hardware;
10. Supply, Laying and Test of Power, Control and Instrumentation Cables including ground conductors and other appurtenances required for the interfacing of supplied equipment;
11. Supply, Installation and Test of Grounding System;
12. Supply, Installation and Test of Lightning Protection System;
13. Supply, Installation and Test of Lighting & Power System and its Accessories;
14. Supply, Installation and Test of Fuel Pump Motor Power Supply including necessary control, monitoring and protective devices;
15. Supply and Installation of Conduit System;
16. Supply and Delivery of Special Tools;
17. Supply, Delivery and Test of two (2) sets of Job Site Cameras to be installed before the start of construction and/or installation of equipment; and
18. All other works and services including those not specifically detailed herein but are required to fully complete the project.

In addition, the following shall be provided by the Supplier:

1. Provision of services of highly qualified and competent engineers for the direct supervision during the test and commissioning of all supplied equipment.
2. Submission of drawings and documents i.e., Equipment Manufacturer's drawings, Operation and Maintenance Manuals, etc.
3. Conduct inspection to verify and assess the extent of the related and incidental works needed to implement the project competently and efficiently.

The Supplier shall bear full responsibility that the equipment has been designed and fabricated in accordance with all codes, standards, and applicable governmental regulations and performs under the conditions and to the standards specified herein.

The equipment to be furnished shall be complete, with all parts in excellent working conditions, of new and high-grade materials and produced with first class workmanship. All materials though not expressly called for in this Specification but are necessary for the complete and proper operation of the diesel generator shall be furnished by the Supplier at no additional cost to NPC.

EW-3.0 CODES AND STANDARD

The equipment furnished shall be in accordance with, but not limited to, the latest issues of the following codes and standards, including all addenda, in effect at time of purchase order unless otherwise stated in this specification:

ANSI/IEEE American National Standards Institute and/or Institute of Electrical & Electronic Engineers

C37.60 Requirements for Overhead, Pad-mounted, Dry Vault and Submersible Automatic Circuit Reclosers and Fault Interrupters for AC Systems

C57.12.20 Standard for Overhead-Type Distribution Transformer 500kVA and Smaller: High Voltage 34500V and Below; Low Voltage, 7970/13800Y V and below

NEMA National Electrical Manufacturers Association

MG 1 Standard for Motors and Generators

WC-5 Thermoplastic-Insulated Wire and Cable for the Transmission and Distribution of Electrical Energy

AB 1 Molded Case Circuit Breaker

ICS2 Industrial Controls and Systems: Controllers, Contactors and Overload Relays rated 600Volts

ICS General Standards for Industrial Control and Systems

MG-1 Motors and Generators

MG-2 Safety Standard for Construction & Guide for Selection, Installation and Use of Electric Motors and Generators

UL Underwriters Laboratories, Inc. (all parts apply)

44 Rubber-Insulated Wires and Cables

83 Thermoplastic Insulated Wires and Cables

508A Industrial Control Equipment

1063 Machine Tool Wire (MTW) for Stranded Conductor Only

IEC	International Electro-Technical Commission
60255	Electrical Relays
60044	Instrument Transformer
60071	Insulation Coordination
60076	Power Transformers, Parts 1-5
60060	High Voltage Test Technique
62271	High Voltage Switchgear and Control Gear
60502	Power cables with extruded insulation and their accessories for rated voltages
60694	Common Specification for High Voltage Switchgear and Control Gear Standards
NFPA	National Fire Protection Association
272	Standard Method of Test for Fire and Smoke Characteristics of Wires and Cables
ASTM	American Society for Testing and Materials
ISO	International Standards Organization
9001	Quality System Model for Quality Assurance in Design/Development, Manufacture and Testing
9002	Quality System Model for Quality Assurance in Production, Installation & Servicing
PEC	Philippine Electrical Code

The latest edition of each standard shall mean the latest edition available at the date of contract signing.

In addition to the above codes and standards mentioned, the Supplier shall comply with all National and local laws, codes, regulations, statutes and ordinances.

Equipment or materials meeting other internationally accepted standards, which ensure an equal or higher quality than the standards mentioned, will also be accepted.

In the event of any apparent conflict among standards, codes or this specification, the Supplier shall refer the conflict to NPC for written resolution before start of fabrication. Final decision regarding the acceptance of proposed standards is the prerogative of NPC.

Standards listed in the equipment specification are used mainly for NPC's references. Other internationally known standards however, shall also apply, provided such standards are equivalent in all respect to the standard prescribed and to the specific requirements described in the individual equipment specification. The Supplier shall submit copies of such standards for NPC's review and approval.

EW-4.0 GENERATOR AND AUXILIARIES**EW-4.1 AC Generator****EW-4.1.1 General**

This specification covers the technical and associated requirements for the supply of diesel generator and associated auxiliary equipment, complete in every respect suitable for safe and satisfactory operation of the equipment.

EW-4.1.2 Design Characteristics

The continuous load capability of the generator shall be the specified nominal rating measured at the terminal. However, the generator shall be designed for continuous operation under normal conditions for 110% of its rated capacity without exceeding temperature rise in accordance with ANSI standard or equivalent applicable standard.

The generating sets shall be designed to meet the local conditions as specified in clause GW-3.0 of the General Works specifications.

The generator design characteristics shall be as follows:

Type	:	Rotating Field Synchronous AC Generator
Rated Continuous Output	:	Refer to Technical Data Sheets
Number of Phase	:	Three (3)
Power Factor	:	0.8 lagging (min.)
Frequency, Hz	:	60
Angular Speed, rpm	:	1800
Voltage, V	:	480
Excitation Class	:	Brushless, Separately Excited, Permanent Magnetic Generator (PMG) or equivalent
Allowable Voltage Variations	:	At rated output, frequency, voltage and power factor, the generator can operate satisfactorily though the terminal voltage at +5.0% of rated value

EW-4.2 Other Characteristics

The three-phase synchronous generator shall be drip-proof, revolving field, self-ventilated, directly connected to the engine and shall conform to applicable standards and additional requirements hereinafter stated. All the generator phase leads, neutral and the terminals for the temperature monitor

shall be brought out to the terminal box mounted solidly on the generator frame.

The generator bearings shall be designed to allow minimal stress induced in the shaft. Generators rated 500kW and below shall have a single or double bearing design. However, generators rated above 500kW shall adopt a double bearing design.

Design shall be such as to protect mechanical, electrical and thermal damage due to vibration, 25% over speed, or voltages and temperature at 10% overload.

EW-4.3 Space Heaters

Space heater shall be installed on the alternator frame to maintain temperature of the alternator above the dew point while not in use. Power supply shall be 120/240VAC single phase and shall be sourced from the plant available power supply. Automatic control and indicating lights for space heater shall be integrated in the generator control and protection panel (GCPP). It shall be furnished complete with all necessary relays and contactors for automatic operation.

The space heater shall automatically turn-on at predetermined time delay when the generator is shutdown to avoid unnecessary operation when the alternator is still hot. Likewise, a relay shall be provided as means to automatically turn-off the space heater operation when the generator starts running.

A manually 2-pole operated circuit breaker shall be provided to open and close both sides of the circuit for maintenance purpose.

EW-4.4 Unbalanced Load

The generator shall be capable of carrying an unbalanced load of 10% continuously without abnormal overheating or causing damage to any parts of the generator. The generator shall be capable of withstanding transient fault conditions which give a rise to a value of I_2^2t not exceeding 30 where:

I_2 is the negative phase sequence per unit current

t is the time in seconds.

EW-4.5 Parallel Operation

The generating set/s to be supplied shall be capable of parallel operation both at regulation and base load with existing and future generator set/s of different make/manufacturers and rating/s.

EW-4.6 Generator Stator**EW-4.6.1 Stator Frame**

The stator frame shall consist of strong housing built by electrical welded steel plates of suitable thickness which have a sufficient degree of sturdiness to prevent the occurrence of undue noise or vibration and shall be explosion proof.

The supply shall include the bedplate, foundation bolts and all other embedded steel parts necessary for erection works.

EW-4.6.2 Stator Core

The stator core shall be constructed from the highest grade silicon steel sheets for the lamination. Special attention shall be paid to the insulation of the lamination and to the finishing of the edges after stamping.

The stator core lamination shall form several segments, separated by vent ducts and each segment shall be perfectly compacted to avoid vibration.

EW-4.6.3 Stator Winding

The stator winding of copper materials shall be formed by coils with Class H insulation. Each coil shall be composed by insulating with thermo setting resin base insulation in order to prevent the mica migration phenomenon. During manufacturing, the coils shall be subjected to special treatment to prevent air intrusion between single conductors and insulating materials.

The part of the coil to be embedded in the slots shall be varnished with semi-conducting varnish, in order to distribute in a uniform manner, the potential gradient and to eliminate the potential difference between the slots wall and the coil surface.

The stator coils shall be adequately clamped with external rings to prevent any deformation or damaged in case of short circuit at the stator terminals. The coil end clamp device and covers shall be designed so as to avoid vibrations and minimize additional losses.

Temperature detectors shall be provided in the stator slots and at the end of the ventilating ducts arranged to receive heat from the hottest spot of the windings with appropriate contacts for monitoring, alarm, detection and protection of the windings provided at the GCPP. At certain pre-set temperature (alarm setting), the temperature detector will trigger an alarm so that an adjustment or action before any insulation damage occurs may be done. The circuit breaker for the alternator will automatically trip in the event that the temperature detectors measure the winding temperature to be above the (shutdown setting) value.

EW-4.7 Generator Rotor**EW-4.7.1 Rotor Core**

The rotor core shall be made of one solid forging with high mechanical strength characteristic and designed to have a large margin between the critical and running speeds (both normal and over speed). The rotor forging shall be fully examined by radiographic and ultrasonic techniques to determine its soundness.

EW-4.7.2 Rotor Winding

The choice of materials for winding and the design, manufacture and fitting of the winding coils shall be such as to prevent and avoid permanent deformation of the winding during service, considering the conditions of operation. The Supplier shall show how their design of the rotor winding accommodates thermal expansion and how damage to insulation is prevented in condition of thermal cycling of the rotor considering the rotational forces involved. The rotor shall be tested at over speed and carefully inspected before assembling into the stator.

EW-4.8 Excitation System**EW-4.8.1 General Description**

The generator shall be equipped with state-of-the-art digital brushless excitation system with high overload and short circuit capability.

The Supplier may offer an alternative excitation system in which according to his experience has superior performance. Technical description pertaining to the alternative system shall be submitted with the proposal.

EW-4.8.2 Operating Requirements

The excitation system shall provide a positive signal to the unit master start-up sequence relay panel. Upon execution of signal automatically or by manual mode, an initial excitation system shall ensure voltage build-up.

During operation on automatic mode voltage control by automatic voltage regulator (AVR), the terminal and the reactive load of the generator shall be kept stable, without hunting, within the specified limits of accuracy at the prevailing set point and shall be self-adjusting, to any point within permissible area of the generator capability diagram during steady state and transient condition.

The terminal voltage of the generator shall be kept within safe limits of the AVR during extra ordinary transient or abnormal operating conditions arising at governor, generator and/or charging of transmission line. These particular conditions shall be guarded by the control. Limiting or protective devices shall be included in the supply.

In automatic operation mode, the generator terminal voltage shall automatically build-up reaching 95% rated speed and capable of synchronization to the grid by synchronizing system.

The AVR shall maintain generator output voltage within $\pm 0.5\%$ for any constant load between no load and full load. The regulator shall be totally solid-state design which includes electronic voltage build-up, volts per Hz regulation, three phase sensing, over-excitation protection, loss of sensing protection, temperature compensation, shall limit voltage overshoot on startup and shall be environmentally sealed.

EW-4.8.3 Design Consideration for Excitation System

The excitation system shall be designed for “manual” and “automatic” voltage control with AVR unit. The equipment shall be mounted in the excitation cubicles. Voltmeter and ammeter shall be provided for generator DC excitation parameters.

All electrical equipment/devices, electronic and control circuits in modular form shall operate satisfactorily within the supply voltage limits and tested according to the required insulation levels.

All components shall be tropicalized and all printed circuit board for electronic circuits shall be sealed with suitable resin resistant for tropical conditions.

EW-4.9 Generator Control and Protection Panel (GCPP)

The Generator Control and Protection Panel to be furnished shall have a Generator Control and Protection Module (GCPM), Selector Switch and the necessary indicating components/accessories for metering and monitoring of the Diesel Generator (D/G) Set/s.

The GCPP to be supplied shall be designed with Generator Circuit Breaker included in the panel. Generator Circuit Breaker mounted on the D/G set container is not acceptable. The GCPP will be installed inside the plant's control room.

The Generator Control and Protection Panel shall be equipped with the following minimum requirements for the operator interface with the diesel engine generator in addition to those specified in the Single Line Diagram.

1. Control and Protection

The GCPM shall be capable of automatic & manual synchronization and parallel operation to existing and future D/G sets. In “Auto Synchronization Mode”, the GCPM shall synchronize the D/G set to the existing D/G sets by automatic closing of the breaker. In “Manual Synchronization Mode”, the operator shall synchronize the D/G set to the existing D/G sets by adjusting the voltage & frequency through the Voltage & Speed Trimmer, and manually closing the breaker by pressing a button in the GCPM.

The GCPM shall also be capable of automatic load sharing to existing and future D/G sets, such as “Fixed / Based Load” and “Power Import / Export” load sharing options.

All interface devices and other accessories necessary for the automatic & manual operation of the system shall be provided by the supplier.

The GCPM shall be capable to trip the generator circuit breaker for electrical and mechanical fault according to calculated tripping parameters. It shall be provided with adequate number of input/output contacts of suitable rating to carry out the prescribed tripping functions, alarm indication, fault recording function and supplementary signaling functions as maybe necessary for the initiation of automatic closing/tripping or switching control.

The protection relays shown on the drawings are the minimum protection required. The Supplier may offer different protection scheme in which based on his experience is suitable for the specified rating of the Diesel Generator set/s subject to NPC’s approval.

b. Selector Switch

For safety and reliable operation of the D/G set, a Local/Remote Selector Switch shall be provided and mounted on the GCPP. In “Local Mode”, operation of the D/G shall be in the Local Control Panel; however, the protection of the D/G through GCPM shall still be active. In “Remote Mode”, the operation of the Diesel Generator shall be on the GCPP through the GCPM.

c. Monitoring and Metering

All indicating instruments shall fulfill the requirements for accuracy class 0.3 except for the frequency meter which shall have ± 0.01 Hz. The panel shall be equipped with the following minimum required metering devices and indicating instruments:

- a. Digital Metering (current, voltage, power (kW, kVAr), energy, frequency, power factor) capable to measure single and three phase parameters through respective control switches;
- b. Event Recorder (to be able to capture the latest events) and Data Logger (all data is stored in non-volatile memory so that information is retained even when power to the unit is lost);
- c. User Programmable Fault Reports; and
- d. Alternator winding temperature monitoring with alarm/shutdown setting.

- e. Other metering and indicating instrument as specified in Mechanical Work Specifications.

All interface devices and other accessories whether or not expressly called for or indicated on the bid drawings but operation of the new diesel generating unit shall be provided by the Supplier. All instruments, scales, relay coils contacts and other features shall be suitable for the apparatus controlled or for the purpose intended.

All DC and AC power supply required for annunciation, control, monitoring and protection of the system shall be integrated in the GCPP. The power and voltage requirements will be determined by the manufacturer in accordance with the ratings and consumption of its equipment/device.

The Supplier may offer a generator control and protection panel with proprietary standard design of the manufacturer containing the required functions suitable to the offered generating sets.

EW-4.9.1 Panel Construction

The panel shall be fabricated from a steel sheet with a minimum thickness of 2.0 mm, the edges shall be formed into a rectangular pattern so that each section is rigid, self-supporting and enclosed. The panel shall be adequately protected and secured.

The panel shall be labeled with ISO symbols and comply with protection rating of IP 65 for outdoor operation and IP 44 for indoor operation. The panel shall also comply with NEMA 12 protection standards.

The panel shall be designed with dimensions not to exceed the size shown on the Bid Drawing.

EW-4.9.2 Alarm System

The Generator Control and Protection Module (GCPM) shall distinguish any abnormal conditions during operation.

An audible alarm and a flashing light shall be installed in the Generator Control and Protection Panel (GCPP) to draw attention for any abnormal conditions during operation.

The GCPM, audible alarm and the flashing light shall be interconnected and shall function simultaneously for any fault alarm.

EW-4.9.3 Communication Ports

Communication Ports exclusively intended for PLC and SCADA system shall be available in the Generator Control and Protection Module (GCPM) and the Local Control Panel (if Electronic Control Module is provided) for control, protection, synchronization, communication, monitoring & metering of existing

and future equipment. The communication between various equipment in the entire power plant shall be MODBUS and Ethernet-based protocol.

EW-4.9.4 Terminal Blocks

Terminal blocks shall be mounted so as to give easy access for external wiring and termination and shall give clear view of the arrangement of the cable tails to allow for future extensions and alterations with an approximately 25% extra terminals per terminal block.

Every terminal point shall have individual and complete identification on the wiring diagram.

EW-4.9.5 Nameplate

The panel shall be provided with adequately sized nameplate made of black surface exposing the white core. In addition, each piece of equipment mounted on or inside the panel shall also be provided with nameplate for easy and convenient identification.

EW-4.10 Generator Circuit Breaker

The generator circuit breaker shall be as stated in the Technical Data Sheets. Circuit breakers with a rating of 800 A and above shall be of the Air Break Type, spring storage device powered by a 125 VDC motor, suitable for hand operation and provided with an appropriate tripping mechanism to be actuated by the protective relays.

Circuit breakers with a rating below 800A shall be of the Molded Case Type, 3-pole with 240 VAC control mechanism and auxiliary switch and 12/24 VDC equipped with electronic shunt trip mechanism. The circuit breaker shall be capable of "switching-in" the generator when synchronizing with one or more units in parallel operation.

Means shall be provided for locally closing and tripping electrically operated breakers without opening the door of the breaker compartment.

Where applicable, circuit breaker derating factors shall be applied to compensate for factors such as ambient temperature, altitude, frequency, duty cycle and enclosure loading.

EW-4.11 Equipment Wiring

Equipment interfaced wiring shall be 600V, stranded copper with thermoplastic insulation and shall comply with the requirements of IPCEA standard. Minimum size shall be 2.0 mm² or larger for control circuit except annunciator wire which shall be 1.2 mm² or larger. The minimum size of current transformer wire shall be 3.5 mm².

All wiring shall be neatly run marked at both ends and securely fixed in such a manner that whenever practicable, wiring can be easily identified and checked against diagram.

The panel shall be provided with earth wiring and connection to create an environment that meets the requirements of electromagnetic compatibility.

EW-4.12 Equipment Grounding

All major equipment such as generator, transformer, generator control and protection panels, and all other metallic parts shall be equipped with at least two (2) terminals or suitable grounding pads of adequate size to accommodate at least two fixing screws for proper connection to the grounding conductors or ground connections to the plant existing grounding system as required.

EW-4.13 Spares Parts and Tools

Spare Parts and Tools for the generating sets and its auxiliaries shall be supplied by the Supplier in accordance with the requirements specified in the General Works Specification and Part II–Technical Data Sheets.

If found not applicable to the proposed equipment model/design, the Supplier shall submit a Manufacturer's certification indicating that the spare parts and standard/special tools listed is not applicable to the equipment being offered.

However, NPC reserves the right to request the Supplier to provide the same or its equivalent if it is determined as deemed necessary during the evaluation, checking and review/approval of the final lists to be submitted by the Supplier during the Contract Stage at no cost to NPC.

EW-4.14 Inspection and Testing

EW-4.14.1 General

The Supplier shall carry out at his own expenses and all tests necessary to ensure the satisfactory design and manufacture of all equipment is in accordance with NFPA 110 to show it is free from defects and will start automatically and could operate efficiently at full load.

The Supplier shall include in his bid the cost of test and commissioning of the diesel generating set. Hence, the Supplier shall bear full responsibility that the equipment has been properly installed, tested and commissioned in accordance with the manufacturer's recommendation, applicable codes and standard required including all applicable government rules, regulations and ordinances.

EW-4.14.2 Shop Test

Routine, design, quality and conformance test and other necessary tests shall be performed in accordance with ANSI Standard or equivalent IEC Standard.

Design tests is required if the equipment is Supplier's new design or previous design with significant design changes. In this case, certified test report of duplicated production type is acceptable.

The Supplier shall make all preparation for tests and provide the required test apparatus and personnel and shall notify NPC in advance of the test schedule.

The test methods, measurements and computation shall be in accordance with the latest applicable requirements of ANSI and IEC standard and shall be submitted for NPC's approval.

EW-4.14.3 Routine Test

The following Routine Test shall be conducted on the alternator at the workshop:

- a. For the generator armature, generator field, excited armature and exciter field:
 1. Measurement of Resistance
 2. Measurement of Insulation Resistance
 3. High Voltage Test
- b. Phase Sequence Test and Voltage Balance Check;
- c. Open Circuit Characteristics with generator line voltage recorded against exciter field current;
- d. Short Circuit Characteristics with generator current recorded against exciter field current;
- e. Voltage Regulation Test to be conducted with AVR in the circuit with reactive loads;

Standard Routine Tests as per relevant ISO standard shall be performed.

EW-4.15 Data and Information to be Submitted After Award of Contract

The following documents (in addition to the documents/drawings specified in Clause GW-6.0 of the General Works specifications) shall be submitted after award of contract for NPC's review and approval prior to procurement and installation of the supplied equipment and materials:

- a. Documentation for Electrical System such as the following:
 1. Single Line Diagram showing the Diesel-Generator Set and related equipment including basic equipment data;
 2. Outline drawings showing all critical dimensions and weights;

3. Schematic and wiring diagram of all power and control circuits for the engine-generator set and auxiliary equipment showing interconnect points and logic diagrams;
 4. Engine-generator Control and Protection panel;
 5. Section and detail drawings of cable terminations and connections.
- b. Brochures/Catalogues of the AC Generator and GCPP;
 - c. Manufacturer's Technical Data Sheets of the AC Generator and GCPP in accordance with EW-15.3;
 - d. Service Manuals and Parts Books
 1. Operating Instructions – with description and illustration of all switchgear control and indicators and engine and generator controls and indicators.
 2. Parts Books – that illustrates and list all assemblies, sub-assemblies and components, except standard fastening hardware (nuts, bolts, washer, etc.)
 3. Preventive Maintenance Instructions – on the complete system that covers the daily, weekly, monthly, bi-annual and annual maintenance requirements.
 4. Routine Test Procedure – for all electronic and electrical circuits and for the main AC generator.
 5. Troubleshooting Chart – covering the complete generator set showing description of trouble, probable cause and suggested remedy.
 - e. Certified Design and Routine Test Results; and
 - f. Field Tests to be performed and Certified Test and Inspection Reports duly signed and witnessed by NPC representative.

EW-5.0 TRANSFORMERS**EW-5.1 General**

This specification covers the technical and associated requirements for the generator step-up transformer and accessories for use in electric generating plants.

EW-5.2 Technical Description

The transformer(s) covered by this specification is (are) for use in an electric generating station. The application details are stated in the Technical Data Sheets.

EW-5.3 Design Requirements**EW-5.3.1 Rating**

Transformer rating, specified in the Technical Data Sheets shall be the basis of the Supplier's guarantee as to performance and temperature rise. The ratings indicated are based on actual load requirements at the service and operating conditions specified herein.

EW-5.3.2 Voltage

The transformer to be supplied shall be designed to withstand the over voltages for the duration of voltage excursions which may be expected as a result of full load rejection of the generator.

EW-5.3.3 Frequency

Frequency for operation shall be 60 Hz.

EW-5.3.4 Overload Requirement

The overload rating and operation shall be in accordance with all cyclic loading duties as specified in IEC 60354. The overload capability of any auxiliary equipment such as bushings, LTC's, CT's, oil expansion tanks, leads, etc. shall not be less than the transformer overload rating. If other considerations will limit the overload capability of the transformer, the Supplier shall specify these limitations in his proposal.

EW-5.3.5 Short Circuit Withstand Capability

The transformer shall withstand the mechanical and thermal stresses produced by external short-circuit currents specified in IEEE Std. 57.12.00 (latest revision).

EW-5.3.6 Transformer Loss Evaluation

Depending on the requirement stated in the Technical Data Sheets, the Supplier is required to fill-in all the information for the transformer losses in the Technical Data Sheets for the generator step-up transformer in order for the NPC to fully determine the most cost effective of the proposed transformer(s) to be supplied considering both cost of losses and first cost.

Failure of the Supplier to completely fill- in all the information needed for proper evaluation by the NPC shall be a ground for rejection of his bid.

The transformer shall be designed for the most economical loss ratio (copper loss/iron loss) for the application as specified in the Technical Data Sheets for the transformer.

EW-5.3.7 Impedance and Reactance

The impedance and reactance shall be stated in the Proposal.

EW-5.3.8 Audible Sound Level

Sound levels decibels (dB) at rated voltage and frequency for liquid immersed generator step-up and station service transformers shall be as below. The average sound level of the transformer shall not exceed these values when measured in accordance with the conditions outlined in the latest ANSI/IEEE C57.12.90 or IEC 60551 for oil-immersed transformers or ANSI/IEEE C57.12.91 or IEC 60726 for dry-type transformers.

Equivalent Two-winding, kVA	Average Sound Level, dB
1-50	48
51-100	51
101-300	55
301-500	56
750	57
1000	58
1500	60
2000	61
2500	62

EW-5.3.9 Tolerances

The transformer shall be designed and manufactured with tolerances in accordance with applicable ANSI/IEC/IEEE standards.

EW-5.3.10 Electrical Insulating Oil

The Supplier shall furnish oil with quality suitable as an insulant and coolant for transformers. The oil shall be new naphthenic based mineral oil meeting the requirements of the latest ASTM D3487 (Standard Specification for Mineral Insulating Oil Used in Electrical Apparatus).

The insulation oil of the transformer must have a Polychlorinated Biphenyl (PCB) concentration of less than (<)2ppm, to be classified as PCB-free. All transformers are required to have PCB analysis of insulating oil conducted by a DENR-Recognized Environmental Laboratories.

A Certification from the Manufacturer that the insulating oil is PCB-free and the Results of Laboratory Analysis indicating the Serial Number of each transformer with corresponding Sample ID shall be submitted to NPC.

EW-5.4 Design and Construction Features**EW-5.4.1 General**

The transformer design, manufacture and assembly shall minimize vibration and shall prevent damage by inherent vibration and stress during operation, transportation and short circuits.

EW-5.4.2 Cores

Cores for the transformers shall be constructed of the highest quality, non-aging high permeability grain oriented silicon steel. The steel shall be in thin laminations, annealed after cutting and rolled to ensure smooth surface at the edges.

The laminations must be free from impurities and must receive stress relief treatment after punching. The laminations shall be accurately flattened, especially at the edges and insulated by suitable procedures with long life heat resistant insulating coat.

Both sides of each sheet shall be insulated with a durable, heat resistant insulation. The cores shall be held firmly by core clamp and brace to ensure adequate mechanical strength to support the winding and to withstand without damage or deformation, the forces, caused by short circuit stresses, transportation or handling to prevent shifting of the core laminations.

The core shall be solidly grounded to the tank and shall be provided with approved lifting devices or lifting lugs at suitable points of the core assembly for core lifting.

EW-5.4.3 Windings

Windings for transformer shall be of the best modern design of conductor having constant cross-section and uniform insulation or graded insulation as required. The coils shall be wound and supported in a manner to provide sufficient oil ducts which will be maintained without constriction.

End coils shall have extra insulation. Coils shall be made up, shaped and braced to provide for expansion and contraction due to temperature changes in order to avoid abrasion of insulation and provide rigidity to resist movement and distortion caused by abnormal operating conditions.

Adequate barriers shall be provided between windings and core and between high and low voltage windings. End coils shall have extra protection against abnormal line disturbances. Permanent current-carrying joint for splices shall be welded or brazed, properly formed and finished, and insulated to conform to the basic insulation.

Winding conductor shall be free from scars, burrs and splinters and shall be uniformly insulated. Permanent current-carrying joint for splices shall be

welded or brazed, properly formed and finished, and insulated to conform to the basic insulation.

The completed assembly of core and coils shall be vacuum dried, immediately impregnated and immersed in dry oil. They shall be adequately braced to withstand ocean shipment, short-circuit forces and earthquakes.

EW-5.4.4 Bushing

All porcelains used in bushing shall be wet process, homogenous, and free from cavities or other flaws. The glazing shall be uniform in color and free from blisters, burrs and other defects. All porcelain parts shall be one piece. The bushings of the same rating shall be interchangeable.

Bushing up to 110 kV BIL shall be porcelain bulk type whereas bushings above 110 kV BIL shall be condenser-type. In the latter case, the bushing shall be provided with capacitance test tap.

Bushings shall have the continuous current-carrying capacity necessary to carry the full 65°C rise current. The bushings shall also be capable of carrying overload currents as required by EW-5.3.4.

The terminal pads shall be of high conductivity bronze or copper and shall be plated with hot flowed electro silver or electro-tin. Whenever a larger terminal pad is required for higher current rating, the mounting holes shall conform to NEMA Standards.

The HV and LV terminations of the generator step-up transformer shall be fitted with suitable insulating shroud. The insulating shrouds shall be manufactured through dip molding process and shall be made from flexible polyvinyl chloride (PVC) material, suitable for low voltage to high voltage applications. The insulating shroud shall be flame retardant, conforming with the UL 94 Standards. They shall be type tested for electric strength in accordance with IEC 60243 - 1 or approved equivalent standards.

EW-5.4.5 Gasket

Gaskets shall be unaffected by hot insulating oil, retain their resiliency during the life of the associated equipment, and be unaffected by weather while maintaining oil and gas tightness. Nitrile rubber gaskets are acceptable. Gaskets of neoprene and/or any kind of impregnated/bonded cork or cork only are not acceptable. Gasket flanges shall have grooves or metal stops to prevent over compression of gaskets. All bolted transformer tank or accessory openings shall be gasketed.

EW-5.4.6 Tank

The transformers shall be housed in a steel tank with all permanent joints molded, backed up by a sturdy steel structure as required to obtain the desired rigidity and strength. The material shall be of high-grade steel plate having good welding qualities. All seams, flanges, lifting and jacking lugs,

braces and other parts attached to the tank shall be welded. No rivets shall be used. The cover shall be bolted type. The tank shall be able to withstand an internal pressure with oil at operating level.

All openings such as joint between the case and cover, bushings insulation mountings, etc., shall have welded on flanges to provide gaskets surfaces and allow for bolt holes. No bolts shall pass to the inside of the case and cover. Flanges shall have gaskets which will remain oil-tight and will not deteriorate under severe conditions. The tank with radiator fitted shall be tested for leaks before painting.

For station service transformer, if to be provided, the transformer tank shall be made of steel. It shall be of sealed-type construction with a steel cover. The tank cover shall be provided with a reusable gasket. The tank cover shall be grounded to the tank body using a copper strap adequately sized for the short-circuit of the transformer. The tank shall be provided with a tank grounding connector located near the base of the tank. The connector shall be eyebolt-type, made from tinned copper alloy material. Standard support lugs shall be provided on the tank wall for securely mounting the transformer on the pole. The type support lug to be provided corresponding to the transformer size shall be as shown in IEEE Std. C57.12.20, latest revision. Lifting lugs shall be permanently attached near the top of the transformer tank to allow for balanced vertical lift. The design of the lifting lugs shall incorporate a safety factor of 5. Lifting facilities for the core-oil assembly shall be provided.

EW-5.4.7 Radiators

Radiators, if to be provided, shall be bolted to the main transformer tank and readily detachable. Isolation valves shall be fitted to the tank to permit radiator removal without draining the main tank. Separate filling plugs, air bleed plugs and drain plugs shall be fitted to each radiator section. Radiators shall be galvanized externally prior to etching and painting. Particular attention shall be given to their internal cleaning and painting to ensure that the radiators arrive in a serviceable condition. All radiators shall be completely sealed with blanking plates and neoprene seals for transport. They shall be thoroughly dried before shipment.

EW-5.4.8 Hardware

All energized hardware, i.e., bolts, nuts and washers shall be made of tinned copper alloy material such as silicon bronze or equivalent. All other hardware shall be hot-dip galvanized.

EW-5.5 Fittings and Accessories

The following transformer accessories shall be included:

1. HV Bushing
2. Oil Level Indicator
3. Oil Sampling Plug

4. Oil Drain Valve
5. Oil Temperature Indicator
6. Pressure Relief Valve
7. Lifting Lugs
8. Anchor Bolts
9. Earthing Terminals
10. HV/LV Insulating shroud

EW-5.6 Equipment and Marking

The transformer shall be provided with a stainless-steel nameplate in accordance with the latest standard of IEC60076-1, fitted in a visible position showing the information indicated below. The entries on the plate shall be indelibly marked.

1. Kind of transformer
2. Number of this standard
3. Manufacturer's name
4. Manufacturer's serial number
5. Year of manufacture
6. Number of phases
7. Rated power (in kVA or MVA)
8. Rated frequency (in Hz)
9. Rated voltages (in V or kV) and tapping range
10. Rated currents (in A or kA)
11. Connection symbol
12. Connection diagram
13. Short circuit impedance (in %Z)
14. Type of cooling (i.e. OA, ONAN, etc.)
15. Insulation voltage (withstand voltages)
16. Insulating liquid
17. Temperature rise (in °C)
18. Total mass, kg
19. Mass of insulating oil

The minimum recommended dielectric strength of oil filling the transformer shall also be engraved on this plate. The rating plate and any other instructions or designations shall be in the English language.

EW-5.7 Standard and Common Tools

The Manufacturer of transformer shall provide standard/common tools for use in the installation of transformer.

EW-5.8 Tests

All tests shall be performed as per latest revision of ANSI C57.12.90 Factory Test shall include, but not limited to the following:

EW-5.8.1 Routine Test

1. Ratio, Polarity and Phase Relation Test
2. No Load Losses and Excitation Current at rated Voltage and Frequency
3. Induced Potential Test (Low-frequency Dielectric Test)
4. Mechanical (Leak Test)

EW-5.8.2 Design Test

1. Winding Resistance Measurement Test
2. Impedance Voltage and Load Loss Measurement
3. Temperature Rise
4. Lightning Impulse
5. Audible Sound Level
6. Mechanical (Lifting & Moving Devices, Pressure Test)

EW-5.8.3 Miscellaneous Test

1. Insulation Power Factor
2. Insulation Resistance
3. Short Circuit Capability

EW-5.8.4 Site Test

The Supplier shall perform all tests specified by the equipment Manufacturer, applicable standards and as necessary to verify the proper operation of the equipment in the presence of NPC representatives.

1. Check level and alignment of the installed transformer;
2. Check tightness of connections and fastenings;
3. Check proper grounding;
4. Check oil level monitors, nameplate, vent plugs;
5. Check wire and cable connections;
6. Check cable glands and entrance; and
7. Check on the proper installation of transformer accessories.
8. Winding resistance
9. Insulation Resistance & Polarity Index/Dielectric Absorption Ratio
10. Transformer Turns Ratio
11. Oil Dielectric Breakdown Voltage Test

EW-5.9 Failure to Meet Guarantees

Depending on the requirement stated in the Technical Data Sheets, the transformer will be tested for compliance with the Manufacturer's guaranteed losses. If the transformer losses, as determined by test, at rated voltage, frequency and 100% rated kVA exceed the guaranteed total losses, the excess in losses shall be evaluated at the following rated cost and the resulting amount shall be deducted from the contract price.

$$S = 2 [(N_{L-L}) (N_{LM} - N_{LG}) + (L_L) (L_{LM} - L_{LG})]$$

Where:

- S = Amount to be deducted from the Contract Price
 N_{L-L} = Cost of No-load losses equivalent to Php 300/Watt
 N_{LM} = Measured no-load losses expressed in Watt
 N_{LG} = Guaranteed no-load losses as stated on the Technical Data Sheets
 L_L = Cost of Load Losses equivalent to Php 250/Watt
 L_{LM} = Measured load losses expressed in Watt
 L_{LG} = Guaranteed load losses as stated on the Technical Data Sheets

When the excess of the total losses reaches five percent (5%), NPC shall have the right to reject the transformer for which such excess is verified during the factory acceptance test.

Successful Bidder shall promptly provide NPC one (1) original and three (3) certified copies of all test data and reports on the transformer.

EW-5.10 Data and Information to be Submitted After Award of Contract

The following documents shall be submitted after award of contract for NPC's review and approval prior to procurement and installation of the supplied equipment and materials:

1. Brochure/Catalogues of the transformer;
2. Manufacturer's Technical Data Sheets of the transformer in accordance with EW-15.3;
3. Outline drawings of transformer and accessories showing the following:
 - a. General Dimensional Drawing
 - b. Sectional Drawing
 - c. Nameplate Drawing
 - d. Marshaling box with connection diagram
4. Description and instructions covering the installation, operation and maintenance of the transformer and accessories;
5. Duly signed Routine Test Results; and
6. Field Test to be Performed and Certified Test and Inspection Reports duly signed and witnessed by NPC representative.

EW-6.0 SWITCHYARD EQUIPMENT AND APPURTENANCES

The switchyard equipment and appurtenances shall be installed as shown on the bid drawing. The equipment shall be securely fastened (as applicable) to the structure to avoid movement during transient fault and manual operation. The required clearance in between equipment during installation shall be observed. All equipment and materials not specifically mentioned herein but are necessary for proper erection, assembly and safe operation of the switchyard shall be identified and furnished by the Supplier at no additional cost to NPC.

EW-6.1 Automatic Circuit Recloser**EW-6.1.1 General**

The Automatic Circuit Recloser shall have rated characteristics as specified in the Technical Data Sheets (Part II of the Technical Specification).

The Automatic Circuit Recloser shall be mechanically and electrically trip free. Any applied close signal, either mechanically or electrically, shall not inhibit the recloser from tripping on the programmed time-current curve.

A manual operating handle shall be provided including an indicator flag for contact position indication.

Close and trip capacitors shall be used to store the necessary energy for operating the recloser. Only the close capacitor energy shall be used for closing while both capacitors are available for opening. Trip energy shall be available following any electrical close.

EW-6.1.2 Interrupting Medium

The interrupting medium shall be vacuum type.

EW-6.1.3 Insulation Medium

Environmentally friendly cycloaliphatic epoxy or equivalent shall be used as dielectric medium. SF6 gas shall not be used.

EW-6.1.4 Housing Materials

The tank shall be manufactured from a hot-dipped galvanized steel, 316 stainless or cast aluminum. Control cubicles shall be manufactured from 316 stainless steel. All support structures and associated bolts and nuts shall be hot dipped galvanized.

EW-6.1.5 Mounting

The Automatic Circuit Recloser shall be suitable for single and double pole/H-frame mounting.

All recloser tanks are to be supplied with standard pole mounting brackets fixed to the rear of the tank. The bracket shall be designed to ensure that the recloser live parts have statutory clearances from the pole and the earthed metal equipment.

The brackets and tank wall are to be of adequate strength to limit distortion, when mounted. Both the top and bottom bracket shall be suitable to carry the total weight of the tank.

A detailed drawing of the Auto-recloser mounting arrangement shall be submitted together with the proposal. The minimum phase-to-earth clearance including clearance to the structure shall be indicated on the drawing.

EW-6.1.6 Control Cabinet

The control cabinet shall be designed for the service condition specified, and fitted with substantial door securing devices.

The control shall be housed in a weatherproof steel cabinet (IP 65) with a pad lockable internally hinged door and shall include a thermostatically controlled heater.

The control cabinet shall be mounted below the tank and shall be connected by a minimum of 20m long multi-core control cable. The multi-core cable shall be ultraviolet stabilized and adequately screened against electrostatic and electromagnetic interference, which can cause malfunctioning of the protection or control equipment. This cable shall connect into both the recloser and the control cabinet by means of plug and socket arrangement.

EW-6.1.7 Earthing

Earthing terminals shall be fitted to equipment. An earthing strap shall be provided between the lid and the tank.

EW-6.1.8 Surge Arrester Bracket

Surge arrester bracket shall be provided for the arrester mounting which will serve as the connection point for the arrester earth. The brackets shall have an unpainted corrosion resistant metal connecting zone which has the capability to conduct surge arrester current.

EW-6.1.9 Marking and Nameplates

Phase identification marking shall be provided on each bushing of the Auto recloser.

A nameplate shall be provided using a non-ferrous material or stainless steel, with the following information:

1. Manufacturer's Name
2. Serial No.
3. Rated Maximum Voltage
4. Rated Continuous Current
5. Rated Interrupting Current
6. Rated Impulse Withstand Voltage

EW-6.1.10 Operating Mechanism

A low voltage system supplied from a battery or voltage transformer may be used to operate a closing mechanism. Tripping energy shall be supplied from a spring mechanism automatically tensioned when the recloser is closed.

Internal batteries used to operate closing mechanism shall not dependent on recloser load current to maintain its state of charge.

The recloser shall incorporate provision to be manually operated using a standard operating stick in the event of failure in the electrical control system.

EW-6.1.11 Bushing

The HV bushing shall be of high quality glazed porcelain, or cycloaliphatic epoxy resin having a creep age length as specified in the Technical Data Sheet.

The Supplier shall provide bird guards for insulation protection between the load side and line side bushings.

EW-6.1.12 Current Transformer

A sensing multi-ratio bushing current transformer for use with the recloser control and protection functions shall be an integral part of the recloser.

They shall be of class and ratio adequate to ensure they do not saturate under fault conditions up to the full rated interrupting current.

Current transformers shall be thermally rated to the recloser current rating regardless of the ratio selected.

EW-6.1.13 Auxiliary Supply

The operating power shall be supplied from an external 240 VAC. A 12Vdc battery with sufficient ampere hour shall be provided for back up control operation in the event of loss of primary supply. The battery shall be capable of operating the control for a minimum of 48 hours. If the primary supply has not been restored within the allowable discharge time of the battery, the control shall automatically shut down. The cable for the external auxiliary supply of approx. 20 m long shall be included in the contract.

EW-6.1.14 Control Design Features

The design of the control shall include the following:

1. Relay Module
2. CPU Module
3. Power Supply Module
4. Communication Interface Module
5. Front Operating & Display Module
6. Ethernet /USB / Wi-Fi / Fiber Optic/RS 232 Communication Module

The panel includes an LCD that shall allow customizable display for viewing operational data of the control. The LCD shall include complete metering information including all current, voltage and power values along with trip values for all profiles. All modules should be replaceable on site without removing the recloser controller unit.

Local Control and Indication

The recloser shall be equipped with the following local operation features through push-buttons operation:

1. Trip (with no reclosing)
2. Close (Single Shot)
3. Auto reclose ON/OFF
4. Local remote operation
5. View trip Sequences and status information

SCADA Operation and Indication

The recloser is required to be controlled and operated using a remote compatible PC with phone modem and applicable software via DNP 3.0 communication protocol.

As a minimum requirement, the following controls and indications shall be provided to the Remote SCADA system using the above protocol:

Control and Indication

1. Tripping and closing
2. Enable and disable automatic sequences (reclosing)
3. Enable and disable protection
4. Change protection setting
5. Reset fault flags and currents
6. Read and display metering data including a summary page
7. Read the operation counter
8. Read the event recorder and display at least 5000 events in time sequence complete with feeder current at the time of the event
9. Display a summary page which shows the number of fault trips since it was last reset
10. Examine recloser/control system malfunction alarms

11. Read all existing recloser settings
12. Switch status (open/close) indications
13. Trip sequences and status information i.e., Protective device and sequence which initiated the trip, date and time, Interrupted current, etc.
14. Buzzer Alarm Trip, Open/Close and Trip Alarm Indications
15. Hotline Tag should be configurable in the control panel for safety and protection of personnel during off-line maintenance work.

EW-6.1.15 Sequence of Operation

In the event of fault on the line controlled by the recloser, the recloser shall automatically open, and after a minimum dead time, it shall automatically reclose and remain closed should the fault along the line is cleared.

In case the fault persists, the recloser shall again disconnect the line being controlled. The recloser shall be capable of not less than three automatic reclose operations at rated short circuit current should the fault persist and then lock out in the open position until reset by hand or remote control.

If the fault is of a transient in nature, the equipment shall remain closed, and the operating mechanism shall automatically reset.

The number of operations to lockout shall be adjustable in any combination of instantaneous and time-delayed trips up to a minimum of four with a minimum dead time of 0.5 seconds for the first operations.

The Automatic Circuit Recloser shall be mechanically and electrically trip free. Any applied close signal, either mechanically or electrically, shall not inhibit the recloser from tripping on the programmed time-current curve.

Close and trip capacitors shall be used to store the necessary energy for operating the recloser. Only the close capacitor energy shall be used for closing while both capacitors are available for opening. Trip energy shall be available following any electrical close operation.

EW-6.1.16 Protection

The Automatic Circuit Recloser to be supplied shall be equipped with but not limited with the following protections:

1. Directional Overcurrent and Earth Fault Protection
2. Instantaneous and AC Time Overcurrent Protection
3. Under/Over Voltage
4. Under/Over Frequency
5. Harmonics Protection
6. Negative Phase Sequence Protection
7. Auto Change Over Protection

All other protections specified in the Technical Data Sheets (TDS).

The controller shall include a sensitive ground/earth fault trip feature that will provide tripping of the recloser after a programmable, definite time for ground currents below normal ground minimum trip levels. The feature shall have a programmable operation to lockout and reclose intervals independent of the ground settings. This feature shall be independently selectable for each protection profile.

A sequence coordination feature shall be included to allow the control to step through selected operation in the operating sequence without tripping.

The control shall include a cold load pick up feature to prevent the control from tripping while energizing non fault system loads.

The Cold Load Pick up feature shall be able to be programmed IN or OUT of service.

EW-6.1.17 Safety Features

The control software shall have a programmable security code to limit access of control programming functions to authorized personnel.

EW-6.1.18 Metering

The control shall provide instantaneous and demand metering with programmable integration intervals for the following minimum functions:

1. Real, Reactive and Apparent Power for each phase and total
2. Power Factor for each phase and total
3. Voltage magnitude for each phase
4. Current Magnitude for each phase and neutral
5. Positive and Negative Sequence Voltages (magnitude and phase)
6. Positive, Negative and Zero Sequence Currents (magnitude and phase)
7. Power Quality Monitoring (TDD up 15th Harmonics, HDD Up to 15th Harmonics, Voltage Sags & Swells,)

EW-6.1.19 Event Recorder/Histogram

Event recorder shall be provided to record and store events in a non-volatile memory. The recorder shall include time and date of event and histogram features displays statistical information including tagged min/max values.

EW-6.1.20 Spares

The Supplier shall furnish a detailed list of required spares for two (2) years operations (if there's any) i.e., protection cards/boards, etc. with equivalent cost.

The list shall include relevant information on the availability and delivery of spare parts.

EW-6.1.21 Other Technical Requirements**Operating and Configuration Editor Software Program**

Laptop and all software and configuration editor software program including licenses shall be supplied and included in the cost of the equipment in the Bid Price Schedule. A set of each type of software including licenses plus instruction manuals shall be provided by the Supplier.

All Recloser shall be properly configured, calibrated, and set at factory prior to delivery based on the desired initial pick up current trip setting requirement of each site at present and/or forecasted load data to be provided by SPUG.

EW-6.1.22 Test and Inspection

The Supplier shall provide a test specification covering all tests on the Supplier's premises, successful completion, as deemed by NPC, of Inspection and Tests on Supplier's premises shall be a prerequisite to shipment of all materials, equipment, software or system(s). Following successful completion of inspection and tests on his premises, the Supplier shall obtain the approval to proceed with the delivery of the equipment, materials, software or system(s) from NPC in accordance with the Technical Specification for the equipment.

Test report on design and routine tests performed in accordance with ANSI/IEEE and/or IEC standard shall be submitted to NPC for evaluation and approval.

All test certificates shall include the manufacturer's serial number.

Type Test

The test to be performed shall be in accordance with the design test set out in Section 6 of ANSI/IEEE C37.60 and Section 5 of ANSI/IEEE C37.63. In addition, the electronic protection /control unit shall have been subject to the relevant impulse, and high frequency noise immunity tests specified in IEC 60255 or equivalent standard.

The recloser complete with control/protection component (including earths) as a composite unit shall have been tested for the rated impulse withstand level and for immunity against the effects of EMI and RFI.

Routine Test

Routine test shall be carried out and shall be in accordance with the production test set out in Section 7 of ANSI/IEEE C37.60.

EW-6.1.23 Data and Information to be Submitted After Award of Contract

The following documents shall be submitted after award of contract for NPC's review and approval prior to procurement and installation of the supplied equipment and materials:

1. Brochure/Catalogues of the Automatic Circuit Recloser;
2. Manufacturer's Technical Data Sheets of the Automatic Circuit Recloser in accordance with EW- ;
3. Outline drawings of Automatic Circuit Recloser and accessories;
4. Schematic and Wiring Diagram;
5. Description and instructions manual covering the installation, operation and maintenance of the transformer and accessories;

The instruction manual to be provided shall include the following:

- A schematic diagram and component layout of all printed circuit boards
 - A detailed list of all component and parts including manufacturers part numbers
 - A detailed description of the circuit operation including block diagrams
 - A comprehensive trouble-shooting guide to assist in fault-finding
6. Duly signed Routine Test Results; and
 7. Field Test to be performed and Certified Test and Inspection Reports duly signed and witnessed by NPC representative.

EW-6.2 Fuse Disconnect Switch with Lightning Arrester Combination

This specification covers the supply and delivery of fuse disconnect switch with lightning arrester combination for use in various diesel power plants.

The materials furnished shall be in accordance with, but not limited to, the latest issues of the Applicable Codes and Standards, including all addenda, in effect at time of purchase order unless otherwise stated herein.

EW-6.2.1 Technical Characteristics and Requirements

The fuse disconnect switch to be supplied shall be suitable for high voltage transformer acting as an overload protector and a device for opening and closing load current. All the metal parts of the fuse disconnect switch shall be free from erosion and rust.

Fuse Cut-Out

Fuse cutouts shall be satisfactory use in a tropical climate with high relative humidity. The cutouts will be mounted by means of steel brackets on steel poles cross arms.

The cutouts are intended for use with button head-type fuse links and must be able to accommodate fuse links meeting the interchangeability requirements of ANSI standard. The cutouts to be supplied shall include the following:

1. Fuse Support Assembly
2. Fuse Holder Assembly
3. Mounting Bracket
4. Lock Washers

Fuse Link

The fuse link to be supplied shall be universal button head with tin fuse element suitable for 15 kV open type distribution cut-out to be used in the overcurrent protection of circuits. It is characterized by perfect time current characteristics, high mechanical strength and reliable arc extinguishing performance, etc. The fuse link shall meet the electrical and mechanical interchangeability requirement in accordance with ANSI standard.

Lightning Arrester

Gapless arresters shall have elements fabricated from non-linear resistance metal oxide materials to perform both the surge discharge and power frequency reseal functions.

Arresters of this type shall be protected in a hermetically sealed wet-process jacket, which shall have a high creep age distance and a high dielectric strength.

The primary terminals shall be suitable for the connection of the type and size of conductors specified in the Technical Data Sheets which can be either copper or aluminum conductors without use of bimetal inserts.

The arrester shall be supplied with a cross-arm mounting bracket that conforms with the requirements of NEMA or with appropriate bracket as a cutout arrester combination on it.

All mounting bolts and conductor connection shall be provided with lock washer. Lock washers shall be fabricated from material that complies with the requirements as per ANSI standard.

All exposed steel or iron part of the arrester shall be hot-dipped galvanized in accordance with ASTM standard.

The Supplier shall submit for approval the brochures and/or catalogues with complete technical specification of the fuse cut out with lightning arrester combination including mounting brackets and accessories.

EW-6.3 Kilowatt-Hour Demand Meter

This specification covers the technical and associated requirements for the kilowatt-hour meter including instrument transformer and accessories required for the electric generating plants.

EW-6.3.1 Technical Characteristics and Requirements

The kilowatt-hour meter shall be furnished and installed by the Supplier as shown on the bid drawings complete with housing and associated metering instruments transformers (current and potential transformers) of appropriate burden and accuracy and other accessories for outdoor metering purposes. It shall be capable to measure the power generated by the plant and feedback power. It shall be designed to operate continuously for the normal life of the meter in an outdoor tropical location exposed to various elements which might affect the meter accuracy and reliability.

The Kilowatt-hour meter shall have the following features:

1. Pilferage proof
2. Tamper Proof
3. Wrong Wiring Alarm
4. Current Flow display
5. Can withstand the temperature of -20°C to +70°C and Humidity of up to 95% non-condensing
6. With back light display
7. With built-in battery for LCD display and back-up battery
8. TOU Programmable Ready
9. Measure display (True RMS voltage, Current, Calendar, Time, etc.)

The kilowatt-hour meter and the required metering instruments shall be pole mounted and to be supplied complete with stainless steel bracket, bolts, etc. required for mounting onto flat-faced pole where pole drilling is permitted.

The Supplier shall submit for approval the brochures and/or catalogues with complete technical specification of the kilowatt-hour meter including instrument transformers and accessories to be supplied prior to delivery at site.

EW-6.4 Bus Conductor and Hardware

This specification covers the technical and associated requirements for stranded aluminum bus conductors and line hardware for use in various diesel power plant switchyards.

All line hardware/materials shall meet the performance requirements application criteria and manufacturing tolerances passed ANSI CB5. 1-1979 -

America National Standard for Galvanized Steel Bolts and nuts for overhead line construction.

EW-6.4.1 Technical Characteristics and Requirements

Describe herein is the general specification of the Bus conductor, line materials and equipment to be supplied for this project.

Stranded Conductor

All wires of the stranded conductor shall be concentrically stranded. The wires in each layer shall be evenly and closely stranded around the underlying wire(s). The tension in individual wires in a layer shall be sufficient to hold each wire firmly in place with only enough strand separation to prevent crowding at the time of stranding and during installation. All steel and aluminum wires shall lie naturally in their position in the stranded conductor and, when the core and/or the aluminum wires are cut, the wire ends shall remain in position or be readily replaced by hand and then remain approximately in position.

The aluminum shall be of the higher purity commercially obtainable which shall not be less than 99.5%. The type of conductor to be supplied shall be stated in the Technical Data Sheets and shall be manufactured according to the applicable ASTM or equivalent IEC standards.

The completed conductor shall be smooth, free from nick, burrs, aluminum or steel particles, dirt and excessive die grease. The conductor shall be absolutely free of copper dust and copper particles.

Clamps

Aluminum strain clamps and suspension clamps for aluminum conductor, if required in the Technical Data Sheets, shall have its clamp bodies and keeper pieces, made of high strength and heat treated cast aluminum alloy. Cotter bolts, U-bolts, nuts, and lock washers shall be hot dip galvanized steel. Cotter pins shall be made of stainless steel. Slip strength of the strain clamp shall be not less than 85% of the rated ultimate strength of the conductor.

Cross Arms

The cross arms to be supplied for this project shall be in accordance to ASCE manual 72 "Design of Steel Transmission Pole Structures". The materials shall meet ASTM A-570 specification (36 KSI min. steel strength) while the galvanizing shall be in accordance with ASTM A-123 specification.

Insulators

Insulators to be utilized in the project shall be in accordance to ANSI Class 55-3 for pin, Class 52-1 for suspension, Class 53-2 and Class 53-4 for spool standard as to material, ultimate tensile strength, leakage, distance, etc.

Line Hardware

Line hardware shall be made either of aluminum alloy, malleable iron or ductile iron with tensile strength in accordance with ANSI standard.

Bolts

All bolts such as carriage, double arming, oval, machine, etc. shall be hot dip galvanized as per ASTM A-153.

EW-6.5 Maintenance Tools

The following lineman's tools shall be provided by the Supplier for the maintenance in the switchyard area:

Item No.	Description	Qty.	Unit
1	Telescopic Hot Stick with Tip Lock Features, Material: Epoxy glass Minimum Length: 35 ft. No. of Sections: 8	1	set
2	Lineman's Rubber Gloves Size: 14" Maximum Usage: 17,000 Volts	2	pairs
3	Lineman's Belt Maximum Length: 42" Minimum Length: 34" D-to-D distance: 56 cm Center Hole: 38"	1	set
4	Positioning Strap, Nylon Maximum Length: 2.0m Minimum Length: 1.3m Adjustable Range: 0.7m	1	set
5	Heavy Duty Hard Hat with strap & NPC (Passed Safety Standard)	3	pcs

EW-7.0 POWER, CONTROL AND INSTRUMENTATION CABLES

This specification covers the technical and associated requirements of power, control and instrumentation cables, and medium voltage power cable for use in switchyards.

All cables shall be designed to withstand the short-circuit condition and voltage drop of 3% (max.).

EW-7.1 Technical Characteristics and Requirements

The cables to be supplied shall have insulation levels able to withstand any voltage surges which are normally expected to occur in the power system in which the cable is to be used, due to switching operations, sudden load variations, faults, etc. The medium voltage XLPE power cable and the 600V

power, control and instrumentation cable to be supplied shall be compliant to ICEA S-66-524 or IEC 60502-2 and UL 83, PNS 35, ICEA S-73-532 specification and requirements of PEC respectively.

The cables shall be selected to withstand without distress any short-circuit currents in the conductor and sheath related to the existing fault levels.

The cables and its accessories shall be manufactured to fulfill the requirements when operating with full load or at any load factor.

EW-7.1.1 Insulation

Insulation shall be of the type specified in the Technical Data Sheets.

EW-7.1.2 Jacket

A tough, ozone, low chlorine, heat, flame and moisture-resistant PVC or Nylon jacket capable of providing protection against sunlight, acids, alkalis and oils shall be furnished for all cables.

EW-7.1.3 Assembly

All multi-conductor cables shall be bundled together with non-hygroscopic fillers to assure a smooth circular assembly. A lapped core binding tape shall be applied over the assembly.

EW-7.1.4 Application

All cables shall be suitable for installation in cable tray, conduit, trench, underground duct in wet and dry locations, and above ground raceway in damp and dry locations.

EW-8.0 GROUNDING SYSTEM

This specification covers the technical and associated requirements for the entire grounding system of the electric generating plants and/or switchyards, required to protect persons and equipment, to reduce electromagnetic interference (EMI) and to allow safe service and maintenance of the installations. The grounding system includes all major and minor equipment such as generator, transformer, generator control and protection panel, ground rods, motors, pumps, etc. and connections.

All materials and parts which are not specifically mentioned herein but are necessary for the safety of operating personnel and safe operation of the plant shall be furnished and determined by the Supplier at no additional cost to NPC.

EW-8.1 Technical Characteristics and Design Requirements**EW-8.1.1 General**

The ruling criteria in the design of the grounding grid shall be the safety of personnel and the proper operation of the electrical equipment during normal operation and during transient disturbances such as short circuits in the electric power system and during lightning discharges.

The Supplier shall carry out earth resistivity measurement for the plant site. Based on the result of this measurement and the system parameter, the appropriate design and the calculation will be determined whether impermissible touch and step voltages occur at any place inside plant area and at any place 10 m. outside of the plant boundary line which may be endangered. These calculations will decide on the provisions for grounding to be made with the relevant part of the civil works related to foundations. If the calculations proved after the application of all engineering possibility that touch and step voltages are still higher than permitted and consequently the Supplier managed to design the earthing and grounding grid in such a way to obtain the lowest touch and step voltage value, all documents including limitation and justification shall be provided to the NPC for approval.

If in case the actual measured resistance of the Supplier-designed and installed ground grid is higher than specified in the Technical Data Sheets, the Supplier shall install, at no extra cost to the NPC, additional grounding rods, mats, grounding electrodes, etc., until the field-measured resistance is equal to or less than the specified value.

The ground grid shall be composed of a system of copper conductors buried approximately 60 cm. beneath the surface of the earth, excluding crushed rock surfacing. Driven ground rods shall be installed at regular intervals and connected to the grounding conductor at grid nodes. A minimum of four (4) of the specified ground rods must be installed (one at each corner of the ground grid). The Supplier shall determine the spacing of ground grid conductors and the total number and location of ground rods and their lengths (single or two or more coupled sections).

EW-8.2 Equipment and Materials Requirements**EW-8.2.1 Grounding Cables**

Grounding cables shall be copper conductor of soft drawn or hard drawn concentric stranding bare copper conductor in accordance with the latest revision of ASTM B3 and manufactured in accordance with ASTM Specification B8 (class B). The copper conductor shall have the characteristics specified in the Technical Data Sheets.

EW-8.2.2 Ground Rods

The ground rod shall be copper-covered steel of circular cross section, with a nominal diameter of 19 mm and a nominal length of 3 meters.

Each ground rod shall have a conical swaged point at one end and shall have a continuous smooth copper covering of at least 0.254 mm thickness molten-welded or copper bonded (electro-deposit) to a steel core. The copper clad or pressed type will not be accepted

EW-8.2.3 Exothermic Welding Materials

The Supplier shall supply exothermic welding materials for cable-to-cable, cable-to-ground rod and cable-to-steel structure grounding connections. The Supplier should submit detailed information describing the proposed process.

EW-8.2.4 Grounding Hardware**Terminal Lugs**

Terminal lugs shall be one hole, socket type, rounded edge lug, cast of high strength corrosion resistant copper alloy. Machine screws, nuts, and washers used with the lugs shall be bronze.

EW-8.2.5 Steel Structure Grounding

All generating plant metal parts such as structures, equipment, cable trays, fence, etc. shall be connected to the ground grid by suitable ground connections.

If there is any possibility for a conductor to fall down on a steel structure, this structure must be connected to the grid with a connection able to sustain the earth fault current.

EW-8.2.6 Equipment Earthing**Transformer Earthing**

The transformer shall be earthed at two points diagonally opposite each other. These connections shall be made from two different points of the earthing grid.

Lightning Arrester

Lightning arresters shall be connected to the earthing grid with 50 mm² tin-annealed copper conductor.

Power Cables

The lead sheath or armor (shield) of the MV power cables, if to be provided, shall be earthed by connecting a flexible braid to the shield. This shall be

done at both ends of each cable. Cable end boxes shall be earthed with copper cable connection on one of the mounting bolts.

Lighting Poles

Poles for lighting shall be connected to the earthing grid with 22mm² tin-annealed copper conductor (one connection for each pole).

Other Metallic Structures

Other types of metal structures within the diesel plant area, not mentioned thereto, shall be connected to the earthing grid.

Major equipment shall be equipped with at least two (2) terminals or suitable grounding pads of adequate size to accommodate at least two fixing screws for proper connection to the earthing system.

EW-8.2.7 Powerhouse / Building Earthing

Generally, each electrical device inside the control building/room must be equipped with an earthing screw of sufficient diameter for connection to the earthing system. The same applies to all metallic parts such as panels, etc. which are effectively connected by earth conductors.

Control panels and desks, switchboards, etc. consisting of several individual sections or compartments shall each be connected to a common tinned copper earth bar unless all panels are solidly welded together, or other approved means are applied ensuring solid earthing connections. In such a case, provisions for earthing must be made at one end at least.

EW-8.2.8 Fence Earthing

Steel fences around the switchyard or station shall be connected to the earthing system at appropriate connection point along the fence and at all corners and gate posts.

EW-8.2.9 Pipe Earthing

All piping shall be earthed at all service points in an approved manner.

The conceptual design of the grounding system based on the specified conditions shall be referred to the bid drawing.

The supply shall include special tools, kits and expandable materials necessary to weld the grid joints and ground rod connections by exothermic process, including reasonable waste to be expected during installations. Standard grounding connectors shall be fixed to metal frames by means of bolted clamps.

EW-8.2.10 Ground Rods

Ground rods shall be driven to a depth such that the top of each rod is at the same elevation as the ground grid and shall be bonded to the ground grid conductors by suitable exothermic connections.

EW-9.0 LIGHTNING PROTECTION SYSTEM

This specification covers the technical and associated requirements for the supply and installation of Lightning Protection System of the plant.

The materials furnished shall be in accordance with, but not limited to, the latest issues of the Applicable Codes and Standards, including all addenda, in effect at time of purchase order unless otherwise stated in this specification.

EW-9.1 Technical Characteristics and Requirements**EW-9.2.1 Air Terminal and Support**

The air termination shall respond dynamically to the appearance of lightning. The materials of the air terminal shall be non-corroding in hostile environment. It shall be located at the highest point of the facility to capture the lightning strike to a preferred point, so that the discharge current can be safely directed via the down conductor to the grounding system.

The air terminal support shall consist of a minimum of 3 meters of galvanized iron piping mast. The conductor shall pass through the center of the mast, with the high voltage termination contained to the upper 1m of the mast. It shall be provided with adequate support to be determined by the Supplier to withstand maximum locally recorded wind velocity in the area. The Supplier shall give technical details of the protection including mounting and installation details for approval.

EW-9.2.2 Down Conductor

The down conductor will provide a low impedance path from the air termination to the ground system so that the lightning current can be safely conducted to earth, without the development of excessively large voltages.

The main copper conductor shall be made of electrical grade copper, with a minimum cross-sectional equivalent to 50mm². The main conductor shall consist of copper strands helically bound by a copper tape conductor designed to evenly distribute the lightning currents concentrically along the conductor length.

In order to reduce the possibility of dangerous sparking (side-flashing), the down conductor route(s) should be as direct as possible with no sharp bends or stress points where the inductance, and hence impedance, is increased under impulse conditions. The down conductor should not be subject to bends of less than 0.5meter radius and shall be secured to the structure by approved metallic fastening at least every 2.0 meters.

EW-10.0 LIGHTING SYSTEM

The lighting system covered by this specification shall include all indoor and outdoor lighting system of an electric generating plants and/or switchyard. Lighting system includes outlets (convenience and power), switches, associated conduits and cables, lighting fixtures (indoor, outdoor and emergency), fittings, distribution panelboards, lighting transformers, contactors, timers, etc.

All materials and parts which are not specifically mentioned herein but are necessary for the proper installation, assembly and safe operation of the lighting system shall be identified by the Supplier and furnished by the Supplier at no cost to the NPC. Any cost involve are deemed to be included in the price for the Lighting System.

EW-10.1 Design Requirements**EW-10.1.1 Technical Characteristics and Requirements****Contamination and Aging Factor**

a. Indoor	:	1.25
b. Outdoor	:	1.67

Illumination Level Requirement, lux

a. Control room	:	400
b. Conference room	:	300
c. Loading Ramp, Staircase	:	100
d. Lavatory, Kitchen	:	100
e. Battery Room	:	200
f. Hallway, Corridor, Foyer	:	50
g. Pump house	:	100
h. Warehouse	:	200
i. Roads	:	50
j. Switchyard area	:	30
k. Guard house	:	100
l. Office	:	500
m. Perimeter fence	:	50
n. Safety lighting	:	10
o. Control building eaves	:	100
p. Control Building Façade Lighting	:	As Recommended by Supplier

Administration Building

a. Engineering/ Technical Room	:	500
b. Administrative Room	:	500
c. Manager's Office	:	400
d. Disbursing Room	:	400
e. Hallway, Corridor, Foyer	:	50
f. Toilet/Utility Rooms	:	100

g. Eaves	:	100
h. Façade Lighting	:	As Recommended by Supplier

Normal lighting/small power outlet and emergency lighting systems shall consist of:

- a. 240VAC, 1-phase, 60Hz, normal station lighting system, including outlets (indoor and outdoor) and emergency lighting system (inside control house only);
- b. Automatic Stand Alone Emergency Lamp (12 VDC), dual lamp, portable type emergency station lighting system for warehouse, door entrances, guardhouse. This emergency lighting system must be switched on automatically in the event of a lighting failure.

The normal station lighting/small power and convenience outlet system, and the automatic stand-alone lamps power shall be supplied from the powerhouse 240 Volt AC lighting and power panelboard.

Circuits shall be separated between normal lighting, emergency lighting, single-phase outlets.

The plant lighting switching shall be designed as follows:

- a. Lighting not normally required during daylight hours shall be controlled by photocells and by separate switches from the station lighting/small power outlet distribution board.
- b. Lighting branch circuits shall be switched locally at each room door or close to the lighting areas.

Replacement of fixture bulbs or tubes shall be possible without disconnecting any part of the power supply and risk of touching live parts of the installation.

EW-10.2 Lighting Fixtures, Luminaires and Accessories

Lighting Fixtures

The Supplier shall submit for approval complete photometry data and type of lighting fixture to be installed together with the shop drawings.

All lighting fixtures when installed shall be free of leaks, warps, dents and other irregularities.

The hangers, cable, supports, channels, frames and brackets of all kinds for safety and proper installation of lighting fixtures shall be furnished and installed by the Supplier at his own expense.

The housing of lighting fixtures shall be fabricated of steel sheet, corrosion resistant, good ventilation and easy installation.

The outdoor lighting fixtures shall be rain and dust proof and shall have a high quality-sealing gasket.

All lighting fixtures, samples and catalogues shall be submitted for NPC's review and approval prior to the order. No lighting fixtures shall be installed without approval of NPC.

Lighting fixtures shall be wired with approved fixture wire, 90°C insulation. Each fixture shall be wired to a single point with an adequate slack for proper connection. All lighting fixtures shall be protected from damage during installation. Any broken lighting fixtures, gloves, receptacles, stems and the like, shall be replaced with new parts, at no cost to NPC.

Lighting Luminaires

1. Surface Mounted Type Luminaires

Light Emitting Diode (LED) tube luminaires shall be quick start, high power factor, easily accessible when the luminaire is mounted in position.

2. Compact Lighting Luminaires

Compact Light Emitting Diode (LED) Luminaires shall be rated 240VAC, 60 Hz operations. Lamp holders shall have a medium screw base and be of porcelain or brass.

When used in damp and wet locations, it shall have an explosion and corrosion proof body and sealed.

3. Automatic Stand-Alone Emergency Lamps

The Supplier shall supply and install the automatic stand-alone emergency lamp of the self-contained battery unit as specified herein.

When the AC main supply is interrupted, the lamps shall be automatically switched ON with a time delay of 1 second to the battery-powered operation. Lamps shall be switched OFF when the batteries are discharged at the low-level voltage (below 7.5V). The charging system of both maximum-constant voltage and constant current shall be able to recharge the completely discharged batteries to their full capacity within 20 hours or less. The charging system shall cut-off automatically and instantaneously upon reaching fully charged state.

Batteries shall be of long life, maintenance free, sealed lead acid type. The batteries shall have sufficient capacity to operate the lamps at full luminous efficiency for up to 3 hours after failure of the main supply.

Rated input voltage of the automatic stand-alone emergency lamps shall be 240 VAC, 1-phase, 60 Hz. Rated Output of the batteries shall be 12 Volt DC.

4. Street/Perimeter Lighting Luminaires

Street/Perimeter Compact LED Lamp shall be used for illuminating roads, parking spaces, perimeter fence area and outdoor equipment areas.

Support for street/perimeter lighting luminaires shall consist of a pole and a bracket arm, giving a mounting height of approximately 6m and the arm shall overhang by 1.8m. Pole and brackets shall be fabricated from galvanized steel or aluminum. Suitably enclosed terminals mounted 600mm above finished ground level shall be provided in each pole, for connection of the luminaires and looping of the power supply cable.

5. Flood Light

Light Emitting Diode (LED) Flood Light shall be forged with high quality aluminum alloy with clear tempered glass and built-in cooling fins.

Under normal supply, the charging system shall ensure and maintain the batteries in a fully charged state ready to supply power and shall be equipped with a reliable protective device to protect the batteries against overload and short circuit.

6. Round Ceiling Luminaire

IP20 Round Ceiling Luminaire, Surface Mounted, 350mm diameter, White Steel Base, White Opal Glass Diffuser and Complete with 2 x 18 Watts, E27 Base, Frosted Finish Compact LED Lamp.

EW-10.3 Switches and Single-Phase Outlets

EW-10.3.1 General

Switches and single phase outlets shall comply with NEMA Standard. The ratings of switches and single phase outlets with one conductor earthed shall be as specific herein. All switches and single phase outlets shall be flush mounted, impact resistant and splash proof type.

EW-10.3.2 Switches

Switches for lighting fixtures shall be of the toggle quiet and flush mounted and fixed to the wall 1.37 m above the finished floor level. The rating of the switches shall be 10A, 240VAC, single-phase.

EW-10.3.3 Single Phase Outlets

All outlets shall be provided with separate earthing pins connected to the yellow/green part in the feeder cable. Outlets with rated voltage not exceeding 250Volts shall be in accordance with PEC for 2-pole three-wire (indoor and outdoor).

EW-10.4 Outlet Boxes and Pull Boxes**EW-10.4.1 Outlet Boxes**

All outlet boxes for concealed work shall be of hot-dipped galvanized steel. Outlet boxes shall be firmly anchored in place and where required provided with fixture supports. The Supplier shall provide special supports for recessed lighting fixtures, etc. Suitable expansion screws shall be used for securing boxes to solid masonry and approved type toggles for securing to hollow masonry units.

All wall boxes on exposed work shall be of aluminum blasted cast iron.

EW-10.4.2 Pull Boxes

Pull boxes shall be installed at all necessary points, to prevent damage to the insulation or other damage that might result from pulling resistance or for other reasons related to improper installation. All pulling boxes shall be made of galvanized sheet steel not less than 2mm. Where pulling boxes are used in connection with exposed conduits, plain covers attached to the pulling box with a suitable number of countersunk flathead machine screws may be used.

EW-10.5 Lighting and Power Panelboard

The Panelboards for Lighting and Power system shall be manufactured to NEMA standards and shall be totally enclosed, recess or surface-mounted.

EW-10.5.1 Circuit Breaker

AC three phase and single phase circuit breakers shall be rated 600V, 60Hz. DC circuit breaker, if to be provided, shall be rated 250VDC.

Circuit breakers shall be quick-make, quick-break with thermal magnetic trip. The circuit breakers shall have interrupting rating of not less than 10,000 RMS Amps.

The circuit breakers shall be installed so as to permit the removal and re-installation or replacement of an individual circuit breaker without requiring the removal of any other circuit breaker or the disconnection of main or branch circuit connectors.

EW-10.5.2 Kilowatt-hour Meters

Kilowatt-hour demand meters shall be transformer-connected, single phase, 2-wire, 240VAC, 60 Hz and shall be of the type specified in the Technical Data Sheets.

EW-10.5.3 Grounding Electrode

Lighting and Power Panelboard shall be effectively grounded. LPP shall be provided with one copper bonded grounding electrode connected through cable conductor with rating equivalent to the ampacity of the panel.

EW-10.5.4 Cables

Cables shall be stranded annealed copper conductor suitable for continuous temperature of 90°C. The minimum size of line conductor to be used shall be 3.5 mm².

Insulation shall be suitable for wet and dry locations, fungi resistant and ultraviolet stable. All cables shall be moisture and heat resistant thermoplastic or cross-linked synthetic polymer unless otherwise specified by NPC.

EW-10.5.5 Cable Installation

The Supplier shall furnish the following miscellaneous materials required for proper cable installation:

- a. Cable ties, clamps and markers.
- b. Connectors, tapes and other splicing and terminating materials.
- c. Fire barriers, duct and conduit sealant, sand and planks.
- d. Pulling lubricants.

The cable entries into buildings, panels and other equipment shall be sealed off by an approved type of sealant suitable for the purpose.

Cables pulled through conduits shall be supported in an approved manner so as to avoid damaged to the insulation. Grease or oily substance shall not be used to facilitate the passage of the cable in conduits.

The pull shall be applied to cables only by means of approved grips and the end portion of the cable, which has been marked or deformed by the grip, shall be cut-off by the Supplier.

All cable runs shall be continuous and all termination shall be at the terminal boards, equipment, etc. No splices are allowed in conduit or cable tray.

Prior to installation of cables, conduits shall be thoroughly cleaned to prevent damage to cables during installation. After cables have been installed, cables shall be tested for continuity and insulation, and shall be tagged with respective cable number.

EW-10.5.6 Nameplates

A unit identification nameplate shall be furnished at the top front of each panelboard. All nameplates shall be black satin finish with white core engraved to show white lettering. Nameplate engraving shall be in accordance with the nameplate designations shown on the accompanying drawings.

EW-11.0 CONDUIT SYSTEM

This specification covers the technical and associated requirements for the supply, laying and installation of conduits as required within the plant complex, including associated fittings, accessories (elbows, tees, steps, crossings etc.), supporting racks and brackets and all hardware.

All materials and parts which are not specifically mentioned herein but are necessary for the proper laying and installation of conduits shall be furnished at no additional cost to NPC.

EW-11.1 Technical Requirements and Characteristics

The conduit system shall conform to the material and fabrication requirements of the specification. All miscellaneous materials required for proper installation shall include but are not limited to, the following:

1. Plug and fillers, coupling and bends;
2. Spacers, inserts and ties for conduits;
3. Conduit splicing solvent and connector material for uPVC conduit, if uPVC conduits are used; and
4. Fire barriers, duct and conduit sealant;

Conduit edges shall be reamed and smoothen to avoid damage to cable outer sheath during cable installation. The conduits shall have the following characteristics:

1. High mechanical strength
2. Corrosion resistant
3. Heat resistant

Conduits

All embedded and concealed in ceiling conduits, boxes and fitting required for the power and control cables including all necessary hardware and accessories such as screws, bolts, concrete inserts, clamps, locknuts, couplings shall be furnished by the Supplier. The required quantities of various items of conduits and associated materials shall be furnished in accordance with the installation requirements.

During installation, due precaution shall be taken to protect the conduit and threads from mechanical injury. The ends of the conduit shall be sealed in an approved manner. Conduit runs shall be sealed by the use of caps and discs

or plugs. The seals shall be maintained, except during inspection and tests, until the conductor is pulled in. Conduit shall be checked to be free from obstructions by pulling a wooden mandrel of appropriate size through the conduit.

Conduits running in floors and terminating at motors or other equipment mounted on concrete bases shall be brought up to the equipment within the concrete bases, wherever possible.

All joints between lengths of conduits and threaded connection to boxes, fittings and equipment enclosures shall be made watertight.

Conduits installed outdoors running underground shall be buried to a minimum of 0.457 m.

Metallic Conduits (If specified)

Rigid metallic conduits shall be hot-dipped galvanized. The inside of the conduit shall have stove enamelled coating to prevent erosion and assure smooth wire pulling.

Metal fittings and cover shall have the same property and finish as that of the metallic conduits.

Rigid metal expansion joints, where required, shall be of standard manufactured product, of watertight construction, equipped with approved means to provide electrical continuity of the conduit runs, zinc-coated, and so designed as to prevent damage to the cables. They shall permit a small amount of transverse movement as well as the longitudinal movement.

Non-Metallic Conduits

Where non-metallic conduits are allowed to be used by NPC, it shall be made of unplasticized polyvinyl chloride (uPVC) smooth walled inside and outside, coloured red-orange, schedule 40.

The uPVC conduits shall be non-corrosive and weatherproof, resistant to the attacks of acids and alkalis and must have a self-extinguishing property, hence shall not support combustion. It shall resist corrosion, rust and scale.

EW-12.0 CONTROL, PROTECTION AND MONITORING PANELS OF MOTOR PUMP

The control, protection and monitoring panels covered by this specification shall primarily be comprised of the combination motor starter with breaker unit, measuring devices, indicating lights and other associated components. The panels, depending on the location where it shall be installed, shall provide one or more of the following functions: control, protection, monitoring and disconnecting means of the FOST Pump Motor to be installed inside the pump house.

EW-12.1 Technical Requirements and Characteristics

The following are the minimum requirements for the operator interface with the Fuel Oil Storage Tank Pump Motor according to location where the panel shall be installed:

1. Pump House: Control Selection (Local/Remote), Motor Control (Start/Stop), Motor Protection (Relays, Contactors and Circuit Breaker) and Motor Status Display (Indicating Lights)
2. Control Room: Motor Control (Start/Stop) and Motor Status Display (Indicating Lights)

The protection relay system shall be designed to bring the unit to automatic opening of breaker for electrical fault according to calculated tripping parameters.

The protection scheme shall be provided with adequate number of input/output contacts of suitable rating to carry out the prescribed tripping functions for the initiation of automatic closing/tripping or switching control.

All DC and AC power supply required for control, monitoring and protection of the system shall be integrated in the panels. The power and voltage requirements will be determined by the manufacturer in accordance with the ratings and consumption of its equipment/device.

The Contractor may offer a motor control, protection and/or monitoring panel with proprietary standard design of the manufacturer containing the required functions suitable to the offered pump motor.

EW-12.1.1 Panel Construction

The panel shall be constructed from a minimum of 2.0 mm thickness steel sheet with edges formed into a rectangular pattern welded steel sheets so that each section is rigid, self-supporting and enclosed. It shall be adequately protected and suitable for indoor and outdoor application and all climate condition.

The panel shall be labeled with ISO symbols and comply with IP 65 for external environmental resistance and IP 44 and NEMA 12 for the resistance of the internal sealed modules.

EW-12.1.2 Combination Motor Starter and Breaker Unit

The combination magnetic full voltage starter unit shall include contactors with manual reset thermal overload relays; and operating coils. The smallest combination starter unit shall be NEMA Type 1 or equivalent to IEC standard.

The combination starter unit shall have a symmetrical interrupting rating which exceeds the available short circuit current not less than 10,000 amperes.

Starter overload relay contacts, contactor operating coils, and starter auxiliary contacts shall be wired to marked unit terminal blocks.

Starters shall reliably operate with 85% of rated bus voltage applied and shall not drop out at voltage lesser than 75 % of rated bus voltage.

Combination starter units furnished shall be full voltage single-speed non-reversing (FVNR) or full voltage single-speed reversing (FVR) as determined by the Contractor and approved by NPC.

EW-12.1.2.1 Circuit Breaker

The combination motor starter unit shall include one miniature circuit breaker or molded case circuit breaker with symmetrical interrupting of at least 10,000 amperes or greater as determined by the Contractor. All breakers shall be manually operated with quick-make, trip-free mechanism of the toggle type.

The breakers shall be equipped with suitable arc quenching devices. Main current carrying contacts shall be silver plated and shall be capable of carrying their rated current without exceeding the Underwriters' Laboratories specified temperature rise. All circuit breakers shall be of the same manufacturer.

EW-12.1.2.1 Starter Contactors

The rated continuous current carrying capacity of each starter contactor to be used shall be as listed in NEMA or IEC Standard. Contactors shall be applied in accordance with their kW rating only. The interrupting capacity of each starter contactor shall be not less than 10 times the rated continuous current carrying capacity.

The electrical life, without maintenance, of each starter contactor to be used shall be not less than 500,000 operations with each opening or closing of the load contacts to constitute one complete operation. The mechanical life of each starter contactor shall be not less than 5,000,000 operations.

Combination starter units which require line voltage to energize the main contactor operating coils or those for which main contactor coil inrush exceeds 600VA shall be equipped with auxiliary contactors (interposing relays) for use in the operating coil circuit.

EW-12.1.2.2 Overload Relays

All starters shall be equipped with overload relays and shall operate within a range of plus or minus 5 percent of the overload relay trip setting. Assemblies which do not meet this requirement both when field tested and when in actual operation shall be replaced by the Contractor.

Alternative proposal shall be considered based on furnishing bimetallic type temperature compensated overload relays or electric alloy type overload relays, provided that such proposals are accompanied by manufacturing

information clearly indicating details of construction and experience records of the overload relay proposed.

EW-12.1.2.3 Mechanically Operated Auxiliary Contacts (As applicable, to be determined by the Contractor)

Each single-speed non-reversing starter shall be furnished with a total of six (6) mechanically operated auxiliary contacts, three (3) normally open and three (3) normally closed, mounted in the main contactor.

If required, each single-speed reversing starter shall be furnished with a total of eight (8) mechanically operated auxiliary contacts, four (4) normally open and four (4) normally closed, mounted on each forward and each reversing main contactor.

If required, each two-speed non-reversing starter shall be furnished with a total of ten (10) mechanically operated auxiliary contacts, three (3) normally open and two (2) normally closed, mounted on each main contactor.

Auxiliary contacts shall be operated by the contactor, not by the operating handle or its mechanism. Contacts shall be wired out to terminal blocks. One (1) NC contact shall be for motor space heater use and shall be rated for 10 amperes or larger.

The use of auxiliary relays to furnish the specified quantities of auxiliary contacts will not be acceptable.

EW-12.1.2.4 Remote Control

Each magnetic starter will be controlled by remote contacts. All necessary internal wiring for this feature shall be furnished and connected to terminal blocks.

EW-12.1.2.5 Indicating Lights

Each reversing starters shall be furnished with two (2) indicating lights on the door to indicate open/close status. Each non-reversing starter shall be furnished with two (2) indicating lights on the door to indicate when the motor is stopped or running.

EW-12.1.3 Nameplate

The panel shall be provided with adequately sized nameplate made of black surface exposing the white core. In addition, each piece of equipment mounted on or inside the panel shall also be provided with nameplate for easy and convenient identification.

EW-12.1.4 Equipment Grounding

The motor control, protection and monitoring panels shall be properly grounded in accordance with the latest electrical and electronics industry standards.

EW-13.0 FACTORY ASSEMBLY AND TESTS**EW-13.1 General**

The Supplier shall carry out at his own expenses all tests necessary to ensure the satisfactory design and manufacture of all equipment is in accordance with relevant ANSI and IEC standard.

All parts shall be properly marked for ease of assembly in the field. Test report on design and routine tests performed in accordance with ANSI or IEC standard shall be submitted to NPC for evaluation and approval.

The test equipment, test method, measurements and computations shall be in accordance with the latest applicable requirements of ANSI and IEC standard.

EW-13.2 Shop Test

Routine, design, quality and conformance test and other necessary tests shall be performed in accordance with ANSI Standard or equivalent IEC Standard. Design tests is required if the equipment is manufacturer's new design or previous design with significant design changes. In this case, certified test report of duplicated production type is acceptable.

The test methods, measurements and computation shall be in accordance with the latest applicable requirements of ANSI and IEC standard and shall be submitted for NPC's approval.

EW-13.3 Other Requirements

The Supplier shall submit the following Factory Test Results:

Generator and Transformer

1. Duly Certified Factory Type Test Results
2. Duly Certified Factory Routine Test Results

Power, Control and Instrumentation Cable

For Power, Control and Instrumentation Cable to be supplied other than those type specified in the PEC, the Supplier shall submit the following:

1. Routine Test Results per IEC or equivalent UL standard
2. Manufacturer's Track Record
3. Brochure with cable ampacity rating including correction factor at 40°C.

EW-14.0 OTHER SITE REQUIREMENTS**EW-14.1 Job Site Cameras**

This specification covers the supply, delivery and installation of job site cameras for the use in the monitoring and documentation of construction of diesel power plants.

The materials furnished shall be in accordance with, but not limited to, the latest issues of the Applicable Codes and Standards, including all addenda, in effect at time of purchase order unless otherwise stated herein.

EW-14.2 Technical Characteristics

The job site cameras to be supplied shall be DC supply operated and battery-operated cameras. It shall be designed to monitor the construction of diesel power plants and access areas for a routine documentation.

At least two (2) sets of job site cameras must be installed first before works shall be done in the sites.

The Supplier shall define the focusing ranges and allowable minimum distance in accordance with the layout at site.

In normal operation, the job site camera provides monitoring of the construction sites. For full coverage of the cameras, the job site cameras shall be installed in an elevated area within the site while is out of reach of the construction equipment. It shall include mounting supports for the ease of the installation.

The job site cameras must have the functionality and adaptability in the construction site. It shall have a 100% reliability without affecting the implementation.

The Supplier shall ensure that the job site cameras they supply, functions correctly and safely. In principle, the installation shall follow that latest modern engineering practice, ensure optimum functionality of supply and ensure the safety of the construction staff.

Job site cameras shall be subject to the approval of NPC.

All job site cameras shall meet the technical requirements specified in the specifications. It shall have a dust proof and weather resistant protective enclosure complying with the technical requirements.

Technical Requirements:

- | | | |
|-------------|---|--------------------------------------|
| a. Type | : | Time-Lapse Camera |
| b. Quantity | : | At least Two (2)
Cameras per Site |

c. Screen	:	Thin-Film-Transistor (TFT) Liquid Crystal Display (LCD)
d. Screen Resolution	:	At least 1.3 Megapixel CMOS
e. View Angle	:	At least 110 degrees
f. Video/Image Resolution	:	1280 x 720
g. Time Lapse Interval	:	15 minutes
h. Battery Type	:	Four (4) Rechargeable AA Size Batteries
i. Additional Battery (Spare)	:	At least Eight (8) Rechargeable AA Size Batteries
j. Battery Charger	:	Included
k. Input Voltage	:	5VDC (Micro USB)
l. Enclosure	:	IP64 compliant
m. Storage Memory	:	SDHC
n. Storage Capacity	:	32 GB
o. Additional Storage (Spare)	:	At least Two (2) 32GB SDHC

When the installation of the job site cameras is completed, the operation and safekeeping shall be turnover to NPC.

EW-15.0 DATA AND DOCUMENTATION REQUIREMENTS

Supplier-furnished data and information shall be guaranteed performance data, predicted performance, interface requirements and construction features of all Supplier's furnished equipment. The accuracy of such information and its compatibility with overall performance requirements specified by NPC are the sole responsibility of the Supplier.

EW-15.1 Data and Information to be Submitted with the Proposal

Supplier shall furnish with his proposal the filled-in Section E-1.0 and E-2.0 of the Technical Data Sheets.

All information submitted would become part of contract data for successful bidder. Any deviation from such data during the implementation stage requires NPC's approval.

EW-15.2 Data and Information to be Submitted During Post Qualification

Supplier shall furnish during the post qualification the filled-in Section E-3.0 to E-12.0 of the Technical Data Sheets.

Filled-out data by the Supplier shall only serve as reference by NPC for the review and approval of brochures/drawings during implementation stage.

EW-15.3 Data and Information to be Submitted During Implementation

The following shall be the full technical data requirement of equipment indicated in Section E-1.0 to E-12.0 of the Technical Data Sheets and EW-13.1 of this specification which shall be submitted by the Supplier together with Manufacturer's brochure/drawings during the Implementation stage.

1.0 AC GENERATOR

Item	Description	NPC Requirements	Supplier's Data
AC Generator			
E-1.1	Manufacturer	By Supplier	
E-1.2	Place of Manufacture	By Supplier	
E-1.3	Generator Model	By Supplier	
E-1.4	Type	Rotating Field Synchronous AC Generator, PMG Type with AVR	
E-1.5	Minimum Rated Power Output at 0.8 Power Factor, kW	150	
E-1.6	Duty/ Operation	Continuous	
E-1.7	Overload Capability	10% of rated power output	
E-1.8	Rated Voltage, V	480	
E-1.9	Frequency, Hz	60	
E-1.10	No. of Phase	3	
E-1.11	Winding Pitch	2/3	
E-1.12	Rated Speed	1800	
E-1.13	Insulation Class	Class H shall be used for both the armature and field windings	
E-1.14	Temperature Rise	Class F at rated load	
E-1.15	Generator Winding Connection	Wye connection with neutral	
E-1.16	Number of Leads	By Supplier	
E-1.17	No. of Pole	By Supplier	
E-1.18	No. of Bearing	By Supplier	

Item	Description	NPC Requirements	Supplier's Data
E-1.19	Allowable Voltage Variations	At the rated kVA, frequency, voltage and power factor, the generator can operate satisfactorily though the terminal voltage may vary at $\pm 5.0\%$ of rated value	
E-1.20	Winding Temperature Detector	To be provided	
E-1.21	Space Heater	To be provided	
E-1.22	Efficiency		
	a. 100% Load	$\geq 85\%$	
	b. 75% Load	Manufacturer's Data	
E-1.23	Guaranteed Losses at 100% rated kVA at 0.8 PF	Manufacturer's Data	
E-1.24	Guaranteed Losses at 75% rated kVA at 0.8 PF	Manufacturer's Data	
E-1.25	Damper Winding	To be provided	
E-1.26	Telephone Interference	THF is better than 2%	
E-1.27	Radio Interference	Equipped with RFI suppression	
E-1.28	Designed to withstand a momentary excess current of 1.5 times of rated current for not less than 2 min.	Yes	
E-1.29	Over speed	1.2 times the rated speed for 2 min.	
E-1.30	Overload Capacity and Duration	10%, for max of 1 hr. in every 12 hrs.	
E-1.31	Cooling System	Totally Enclosed air cooled	
E-1.32	Protection Class	IP 23	
E-1.33	Sustained Short Circuit Capability	Yes	
Excitation System			
E-1.34	Type	Brushless, Separately Excited, Permanent Magnetic Generator (PMG) or equivalent	
Automatic Voltage Regulator (AVR)			
E-1.35	Manufacturer	By Supplier	
E-1.36	Place of Manufacture	By Supplier	
E-1.37	Model	By Supplier	
E-1.38	Type	Digital	
	a. Capable for Parallel Operation	Yes	

SECTION III – TECHNICAL SPECIFICATIONS

LuzP22Z1435Se

Item	Description	NPC Requirements	Supplier's Data
E-1.39	Input Requirements	Manufacturer's Data	
E-1.40	Continuous Output	Manufacturer's Data	
E-1.41	Regulation, %	$\pm 0.5\%$ in steady state with rapid response time	
E-1.42	Response Time, ms	Manufacturer's Data	
Test and Experience Requirements			
E-1.43	Test Requirement		
	a. Routine Test to be Performed	Yes	
	b. Certified Design and Routine Test Reports to be submitted	Yes	

2.0 GENERATOR TRANSFORMER

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
E-2.1	Manufacturer	By Supplier	
E-2.2	Place of Manufacture	By Supplier	
E-2.3	Transformer Model	By Supplier	
E-2.4	Minimum Rated Capacity, kVA	225	
E-2.5	No. of Phase	3	
E-2.6	Rated Voltage		
	a. Primary, kV	0.48	
	b. Secondary, kV	13.8	
E-2.7	Transformer Guaranteed Losses at Rated kVA, Voltage, Frequency and Temperature		
	a. No-Load Losses, Watts	By Supplier	
	b. Load Losses, Watts	By Supplier	
	c. Total Losses (a+b), Watts	By Supplier	
E-2.8	Type of Cooling	ONAN	
E-2.9	Type	Two-winding Transformer	
E-2.10	Class	Outdoor	
E-2.11	Percent Overload%	10	
E-2.12	Type of Overload Capability	In accordance to IEC 60354 normal cyclic loading	
E-2.13	Temperature		
	a. Ambient Temperature	40°C	
	b. Temperature Rise	65 °C	
E-2.14	Neutral	Solidly ground	
E-2.15	Winding Connections		
	a. H-Winding	Wye with Neutral	
	b. X-Winding	Delta	
E-2.16	Insulation Level		
E-2.17	Nominal Voltage Level (kV)		
	a. H-Winding	13.8	
	b. X-Winding	0.48	

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
E-2.18	Highest Voltage Level (kV)		
	a. H-Winding	15	
	b. X-Winding	1.2	
E-2.19	Basic Impulse Level (kV)		
	a. H-Winding	95	
	b. X-Winding	30	
E-2.20	Winding Material	100% Copper	
E-2.21	Vector Group	YNd11	
E-2.22	% Impedance at Rated MVA	Manufacturer's Data	
E-2.23	Average Audio Sound Level not more than, dB when measure in at the factory in accordance with (specify applied standard)	Refer to Table specified under TS-EW-5.3.8 (ANSI/IEEE C57.12.90 or IEC 60076-10)	
E-2.24	Short Circuit Capability	In accordance to ANSI C57.12-2000	
E-2.25	Bushing		
	High Voltage and Neutral Terminal		
	a. Rated Current	To match VA rating plus overload	
	b. Insulation Class	15	
	c. BIL in kV	110	
	d. Standard Used	IEC 60137	
	e. Creepage length, mm	465	
	f. Color	Brown	
E-2.26	Cooling		
	a. Cooling Medium	Air and Oil	
	b. Temperature		
	b.1 Temperature of cooling air, not to exceed	40°C	
	b.2 Average temperature of the cooling air	30°C	
E-2.27	Temperature Indicator		
	a. Supply of dial type winding temperature indicator mounted on the transformer for top oil and hot spot temperature	Yes	
E-2.28	Sudden Pressure Relay	To be provided	
E-2.29	Taps	13.8 kV \pm 2x2.5%	
E-2.30	Transformer Protection	As shown on the Single Line Diagram	
E-2.31	Insulating Oil		
	a. Insulating Oil shall be mineral oil in accordance with ASTM D3487	Yes	
	b. Additional Properties		
	b.1 Min. Flash Point, °C (ASTM D92)	145	
	b.2 Pour point, max °C (not higher than	-40	
	b.3 Kinematic, Viscosity at 40°C	Max 12	
	b.4 Elect. Breakdown limit (IEC 60156)	Min. 30	

SECTION III – TECHNICAL SPECIFICATIONS

LuzP22Z1435Se

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
	c. Polychlorinated Biphenyls (PCBs) free	Yes	
	c.1. Polychlorinated Biphenyls (PCBs) free Certification	To be submitted	
	d. Oil Test Results/Analysis from DENR – accredited testing firm	To be submitted	
E-2.32	Weight of Oil, kg	Manufacturer's Data	
E-2.33	Total Weight, kg	Manufacturer's Data	
E-2.34	Dimension	Manufacturer's Data	
E-2.35	Ground Terminal Connection	Suitable for 100 mm ² copper conductor	
E-2.36	Test Requirements		
	a. Certified Design and Routine Test Reports to be submitted	Yes	
	b. Routine Tests to be Performed	Yes	

3.0 GENERATOR CONTROL AND PROTECTION PANEL

Item	Description	NPC Requirements	Supplier's Data
E-3.1	Manufacturer	By Supplier	
E-3.2	Each GCPP to be supplied shall be equipped with metering, status, alarm and trip indication light, synchronizing devices, protection relays as shown on the bid drawing	Yes	
E-3.3	Class (indoor, outdoor)	Indoor	
E-3.4	Generator Circuit Breaker		
	a. Manufacturer	By Supplier	
	b. Model	By Supplier	
	c. Continuous Current Rating	Refer to Single Line Diagram	
	d. Construction	Molded Case Circuit Breaker	
	e. Type	Compact with Electronic Trip Unit and remote control functions	
	f. Symmetrical Current	Refer to Single Line Diagram	
E-3.5	Enclosure Details		
	a. Protection Class	IP 44	
	b. Metal Steel Sheet Thickness, mm	2	
	c. Cable Entrance	Bottom	

SECTION III – TECHNICAL SPECIFICATIONS

LuzP22Z1435Se

Item	Description	NPC Requirements	Supplier's Data
	d. Dimension (L X W X H), mm	Refer to Bid Drawing	
	e. Weight, kg	Manufacturer's Data	
	f. All materials are non-hygroscopic to prevent fungus growth	Yes	
	g. The GCPP shall be provided w/ nameplate	Yes	
	h. An outline drawing showing details of the GCPP enclosure including its components as shown on the bid drawing shall be furnished by the Supplier for approval of NPC	Yes	
E-3.6	Programmable Logic Controller	Included	
E-3.7	Metering System		
	The metering device to be provided shall consists of the following:	Yes	
	a. Ammeter	Included	
	b. Voltmeter	Included	
	c. Watt-Hour meter	Included	
	d. Power Factor Meter	Included	
	e. Frequency	Included	
	f. kW	Included	
	g. kVAR	Included	
	h. Running Hour meter	Included	
	i. Alternator Winding Temperature	Included	
	j. Other engine metering required as specified in Mechanical Specifications	Included	
E-3.8	Monitoring System		
	a. An Annunciator Window with Common Audio Alarm & Trip indication for:		
	a.1. Monitoring of abnormal conditions during operation of the system including generator & transformer protective devices	Included	

Item	Description	NPC Requirements	Supplier's Data
	a.2. Detection of alternator winding temperature	Included	
	b. Data Logger and Event Recorder	Included	
	c. User Programmable Fault Reports	Included	
	d. PLC Failure, Circuit Breaker Status (On, OFF, Trip), Engine Start/Stop, etc.	Yes	
	e. Other engine monitoring required in M.2k of the MW-TDS shall be included in the GCPP	Yes	
E-3.9	Synchronizing System		
	a. Synchronizing device for Auto and manual synchronization	Yes	
	b. GCPP shall be equipped with protection relays to provide signal and alarm to protect the D/G set from damage during fault	Yes	
E-3.10	The Supplier shall provide all the required Generator Protection devices for the all the D/G set ratings as shown on the Single Line diagram	Yes	
E-3.11	Test Requirement		
	a. Routine Test to be Performed	Yes	
	b. Certified Routine Test Reports to be Submitted	Yes	

4.0 STATION SERVICE TRANSFORMER

Item	Description	NPC Requirements	Supplier's Data
E-4.1	Manufacturer	By Supplier	
E-4.2	Transformer Model	By Supplier	
E-4.3	Minimum Rated Capacity, kVA	20	
E-4.4	No. of Phase	One (1)	
E-4.5	Rated Voltage		
	a. Primary, kV	7.97	
	b. Secondary, kV	0.24	
E-4.6	Type of Cooling	ONAN	

SECTION III – TECHNICAL SPECIFICATIONS

LuzP22Z1435Se

Item	Description	NPC Requirements	Supplier's Data
E-4.7	Type of Oil	Mineral Oil with its electrical & chemical characteristics is compliant with IEC and is Polychlorinated Biphenyls (PCB) free	
E-4.8	Type (specify 3-winding, 2-winding, auto-transformer)	2-winding	
E-4.9	Temperature		
	a. Ambient Temperature	40°C	
	b. Temperature Rise	65 °C	
E-4.10	Insulation Level		
	Nominal Voltage Level (kV)		
	a. H-Winding	7.97	
	b. X-Winding	0.24	
	Basic Impulse Level (kV)		
	a. H-Winding	95	
	b. X-Winding	30	
E-4.11	Polarity	Additive	
E-4.12	Winding Material	100% Copper	
E-4.13	No. of Bushing	One (1)	
E-4.14	Bushing Material	Porcelain	
E-4.15	% Impedance at Rated kVA	2	
E-4.16	Tap Changer	No-Load	
E-4.17	Tap Range	7.97 kV \pm 2 x 2.5%	
E-4.18	Efficiency	97%	
E-4.19	Weight of oil, kg	Manufacturer's Data	
E-4.20	Total Weight, kg	Manufacturer's Data	
E-4.21	Transformer mounting brackets including bolts, nuts, etc.	Included	
E-4.22	Test Requirements		
	a. Routine Test to be performed	Yes	
	b. Certified Routine Test Reports to be submitted	Yes	

5.0 POWER, CONTROL & INSTRUMENTATION CABLE

Item	Description	NPC Requirements	Supplier's Data
15kV Power Cable			
E-5.1	Manufacturer	By Supplier	
E-5.2	Continuous current carrying capacity of conductor at 90°C Operating Temperature	Manufacturer's Data	
E-5.3	Conductor Cross-Section, mm ²	Refer to Single Line Diagram	
E-5.4	Type of cable	Single Core	
E-5.5	Conductor Material	Annealed Copper	
E-5.6	Max. Outside Diameter, mm	Manufacturer's Data	
E-5.7	Conductor Shape	Circular Stranded Wire	
E-5.8	Conductor Material	Annealed Copper	
E-5.9	Insulation		
	a. Material	Cross-linked polyethylene (XLPE)	
	b. Thickness, mm	≥ 4.0	
E-5.10	Outer covering/Jacket		
	a. Material	PVC Sheath Jacketing	
	b. Thickness, mm	Manufacturer's Data	
	c. Termite Protection Required	Yes	
E-5.11	Shielded (yes, no)	Yes	
	a. Type of Shielding	Copper Tape Screen	
E-5.12	Provided with Filler and Binder Tape	Yes	
600V Power, Instrumentation and Control Cable			
E-5.13	Manufacturer	By Supplier	
E-5.14	Type		
	a. Power	THHN/THWN-2	
	b. Control & Instrumentation	Royal Cord	
E-5.15	Continuous current carrying capacity of conductor at 75°C Operating Temperature		
	a. THHN/THWN-2	Refer to Single Line Diagram	
	b. Royal Cord	By Supplier	
E-5.16	Conductor Material	Annealed Copper	
E-5.17	Conductor Shape	Circular Stranded Conductors	

SECTION III – TECHNICAL SPECIFICATIONS

LuzP22Z1435Se

Item	Description	NPC Requirements	Supplier's Data
E-5.18	Type of Insulation	Lead Free, UL-listed PVC	
E-5.19	Outer covering/Jacket	Oil, Chemical and Abrasion Resistant Tough Polyamide (Nylon)	
E-5.20	Meets ASTM, UL 83 & 1063, and PNS 35 Specifications and requirements of PEC	Yes	

6.0 BUS CONDUCTOR AND HARDWARE

Item	Description	NPC Requirements	Supplier's Data
Stranded Conductor Requirements			
E-6.1	Manufacturer	By Supplier	
E-6.2	Type designation	Aluminum Conductor Steel Reinforced (ACSR)	
E-6.3	Code Name	By Supplier	
E-6.4	Conductor size	Refer to Single Line Diagram	
E-6.5	Ampacity, A	Manufacturer's data	
E-6.6	Outer Layers		
	a. Material	Aluminum	
	b. Stranding No.	6	
	c. Calculated Cross-sectional Area, mm ²	Manufacturer's Data	
	d. Coefficient of Elongation (/°C)	Manufacturer's Data	
E-6.7	Core		
	a. Material	Galvanized Steel	
	b. Stranding No.	1	
	c. Calculated Cross-sectional Area, mm ²	Manufacturer's Data	
	d. Coefficient of Elongation (/°C)	Manufacturer's Data	
E-6.8	Conductor Coefficient of Linear Expansion (/°C)	Manufacturer's Data	
Conductor Hardware			
E-6.9	Tension Clamp		
	a. Type	Bolted, U-Bolt	
	b. Material of Body	Aluminum Alloy	
E-6.10	Connectors		
	a. Type	Wedge pressure clamp for stranded conductor connection	

Item	Description	NPC Requirements	Supplier's Data
	b. Angle and T-connectors type	Wedge pressure clamp for stranded conductor connection	

7.0 GROUNDING SYSTEM

Item	Description	NPC Requirements	Supplier's Data
Grounding Grid Design Criteria			
E-7.1	Fault duration, sec.	3	
E-7.2	Total fault level (line to ground), kA	8	
E-7.3	Ground mat design resistance	5 Ohms (max.)	
E-7.4	Grounding connection	Exothermic	
E-7.5	Permissible temperature rise of grid copper conductor, °C	300	
E-7.6	Grid conductor		
	a. Manufacturer	By Supplier	
	b. Minimum Size, mm ²	100	
	c. Material	tin-annealed copper stranded conductor (bare)	
E-7.7	Burial depth of grid conductor below finished grade, m	0.6	
Equipment Grounding			
E-7.8	Bonding Conductor (riser)		
	a. Manufacturer	By Supplier	
	b. Size, mm ²	100, 50 & 22	
	c. Material	Tin-annealed copper stranded conductor with 1.2kV PVC insulation	
E-7.9	Ground Rod		
	a. Manufacturer	By Supplier	
	b. Type	Copper Rod	
	c. Diameter, mm	≥ 19 mm	
	d. Length/section, m	≥ 3 m	

8.0 LIGHTNING PROTECTION SYSTEM

Item	Description	NPC Requirements	Supplier's Data
Lightning Protection			
E-8.1	Manufacturer	By Supplier	
Lightning Rod			
E-8.2	Material	Copper	
E-8.3	Length, mm	2000	
E-8.4	Minimum Diameter, mm	19	
Down Conductor			
E-8.5	Type	Insulated Copper Conductor	
E-8.6	Minimum Cross-Section Area	55 mm ²	
E-8.7	Overall Diameter, mm	Manufacturer's Data	
E-8.8	Insulation Material	PVC	
E-8.9	Weight (kg/meter)	Manufacturer's Data	
Accessories			
E-8.10	Support Pipe, Download Clamp, Terminal Lug, Guy Wire, PVC conduit, etc.	Yes	

9.0 AUTOMATIC CIRCUIT RECLOSER

Item	Description	NPC Requirements	Supplier's Data
E-9.1	Manufacturer	By Supplier	
E-9.2	Place of Manufacture	By Supplier	
E-9.3	Type	Solid Dielectric Vacuum Interrupter	
E-9.4	Phase	3	
E-9.5	Rated Frequency, Hz	60	
E-9.6	Nominal Rated Voltage, kV	13.8	
E-9.7	Maximum Rated Voltage, kV	By Supplier	
E-9.8	Rated Normal Current (Min.)	800	
E-9.9	Rated Symmetrical Interrupting Current at rated Voltage	≥2 kA	
E-9.10	Rated Short Time Current for 3 secs.	≥2 kA	
E-9.11	Rated Making Current (RMS)	≥2 kA	
E-9.12	Rated 1 min. power frequency withstand between phase and earth (min.)	50 kV	
E-9.13	Interrupting Medium	Vacuum	
E-9.14	Insulation Medium	Cycloaliphatic epoxy or equivalent	
E-9.15	Rated Operating Sequence (total number of trips/counts to lock out)	4	

SECTION III – TECHNICAL SPECIFICATIONS

LuzP22Z1435Se

Item	Description	NPC Requirements	Supplier's Data
E-9.16	Current Sensing	By Supplier	
E-9.17	Voltage Sensing	By Supplier	
E-9.18	Mechanical Life – minimum number of close/open operations – without inspection	≥ 30000	
E-9.19	HV Bushing Creepage Distance (min.)	$\geq 465\text{mm}$	
E-9.20	Spare Control Cabinet/Panel to be provided	At least 3	
E-9.21	Min. length of umbilical (multi-core) cable to be provided	At least 20 m	
E-9.22	AC Supply	230 Volts	
E-9.23	DC Supply		
	a. Voltage	By Supplier	
	b. Make of Batteries	By Supplier	
	c. Type	Re-chargeable sealed lead-acid battery	
	d. Capacity	By Supplier	
	e. Battery Operating Time after Loss of AC supply	48 hours	
	f. No. of reclose sequences possible within 48 hours after the loss of ac supply	By Supplier	
E-9.24	Manual "Open-Close" Functionality with Operator Hook Stick	Required	
E-9.25	Controller		
E-9.26	a. Type	Electronic type equipped with advance protection, metering, control and communication in an individual module arranged within the compartment	
	Protection Features		
	a. Directional Overcurrent and Earth Fault Protection	Yes	
	b. Instantaneous/Time Overcurrent	Yes	
	c. Sensitive Earth Fault (Current Setting Range 1 – 80 Ampere)	Yes	
	c. Under and Over Voltage	Yes	
	d. Under and Over Frequency (pick-up setting range of 45 – 65 Hz)	Yes	
	e. Cold Load Pick-up Element	Yes	
	f. Inrush Restraint Element	Yes	
	g. Auto Reclosing Element	Yes	

SECTION III – TECHNICAL SPECIFICATIONS

LuzP22Z1435Se

Item	Description	NPC Requirements	Supplier's Data
	i. Harmonics Protection Element (up to 15th Harmonics)	Yes	
	j. Negative Phase Sequence Element	Yes	
	k. Auto Change Over Protection Scheme	Yes	
	l. Four (4) Independent Protection Groups Each Group must contain independent protection settings for each direction	Yes	
E-9.27	Monitoring/Metering Functions	Yes	
E-9.28	Data Records		
	a. Sequence of Event (Up to 5000 events can be stored)	Yes	
	b. Fault and Disturbance Records	Yes	
	c. Load Profile	Yes	
E-9.29	Communication Interface	RS 232/ RS 485	
E-9.30	No. of trips to lock-out	Up to 4	
E-9.31	Rated Duty Cycle	O-0.1s CO-1s-CO-1s-CO	
E-9.32	Controller Cubicle Degree of protection	IP 65	
E-9.33	Fault Indicator Type FLA3.1 for overhead lines to be integrated with the control cubicle	To be provided	
E-9.34	Buzzer Alarm Trip, Open/Close Alarm Indications	To be provided	
E-9.35	Bird Guard for insulation protection between the load side and line side, Units	6	
E-9.36	Total Weight, kg	By Supplier	
Other Technical Requirements			
E-9.37	Programming (Configuration) and Maintenance Human-Machine Interface equipped w/ Operating and Configuration Editor Software Program to be provided	Yes	
	a. Type	PC Compatible Notebook Computer/ Laptop	
	1. No. of Units to be supplied	1 per unit	
	b. Hardware		
	1. Processor	Latest available model on the time of award	

SECTION III – TECHNICAL SPECIFICATIONS

LuzP22Z1435Se

Item	Description	NPC Requirements	Supplier's Data
	2. Clock Frequency, GHz	2.0 (min)	
	3. RAM Capacity, GB	16	
	4. Hard Disk Capacity, TB	1	
	5. Video Card Capacity	Dedicated 256 Mbytes min.	
	6. Optical Drive	DVD ± RW	
	7. Display	15" LCD Color Monitor	
	8. Audio System	Built-in Stereo Speakers	
	c. Software		
	1. Operating System	Licensed Windows, pre-installed with back-up CDROM bundled with latest version of MS Office and reference manuals	
	2. Communication Stack	OSI-TCP / IP	
	3. Configuration Tools	Provided with back-up copy	
	4. Testing, Maintenance and Diagnostic Software	Provided with back-up copy	
	d. Peripheral Connectivity		
	1. Communication Interface (I/O)	1x9-pin RS232 & 1x25-pin ECP/EPP parallel ports, 1xUSB 3.0 ports, keyboard & Mouse port, VGA port, DP interface, phone line-in, microphone-in ports and DC jack for power adapter	
	e. Keyboard	84/85 key with embedded numeric key pad	
	f. Mouse	Built-in touch pad pointing device	
	g. Power Adaptor	100 - 240V full range 50 – 60Hz	
	h. Battery	Li-ion Battery Pack, At least 4-5hrs rundown battery life with APM	
E-9.38	Operating and Configuration Editor Software Program		
	a. All system software and configuration editor software program including licenses and instruction manuals	To be provided	
E-9.39	Test Requirement		
	a. Design and Routine Tests Reports required	Yes	

10.0 FUSE DISCONNECT SWITCH WITH LIGHTNING ARRESTER COMBINATION

Item	Description	NPC Requirements	Supplier's Data
E-10.1	Manufacturer	By Supplier	
E-10.2	Class (indoor, outdoor)	Outdoor	
E-10.3	Rated voltage, kV	15	
E-10.4	Nominal system voltage, kV	13.8	
E-10.5	Frequency, Hz	60	
E-10.6	BIL, kV	110	
E-10.7	Ampere Frame	100	
E-10.8	Interrupting Capacity, kA	10	
E-10.9	Fuse Link		
	a. Type	Universal button head design	
	b. Current Rating, A	Refer to Single Line Diagram	
E-10.10	Lightning Arrester		
	a. Type	Metal Oxide Varistor (MOV), Gapless	
	b. Rated frequency, Hz	60	
	c. Nominal system voltage, kV	13.8	
	d. Duty cycle voltage (rating), kVrms	12	
	e. Maximum Continuous Operating Voltage (MCOV), for the arresters having the following duty cycle voltage, kVrms	10.2	
	f. Nominal discharge current, kA	10	
	g. Creepage distance, mm	465	
	h. Supporting brackets, bolts, nuts, etc.	Yes	

11.0 KILOWATT-HOUR DEMAND METER

Item	Description	NPC Requirements	Supplier's Data
240V Single Phase Kilowatt-Hour Demand Meter			
E-11.1	Manufacturer	By Supplier	
E-11.2	Accuracy Class	Class 0.5 or Better	
E-11.3	Number of Phase	1	
E-11.4	Wire	2	
E-11.5	Voltage, V	240	
E-11.6	Current Range	Class 200	

Item	Description	NPC Requirements	Supplier's Data
E-11.7	Frequency, Hz	60	
E-11.8	Register Type	LCD	
E-11.9	TOU (Time of Use)	Programmable Ready	
E-11.10	Soft Switches	Available	
E-11.11	LCD Display	Programmable	
E-11.12	Power Consumption	By Supplier	
E-11.13	The Kilowatt-hour meter to be provided is certified and approved by ERC	Yes	
13.8kV Three Phase Kilowatt-Hour Demand Meter			
E-11.14	Manufacturer	By Supplier	
E-11.15	Accuracy Class	Class 0.2 or Better	
E-11.16	Number of Phase	3	
E-11.17	Wire	4	
E-11.18	Voltage, V	120 - 480	
E-11.19	Current Range	Class 20	
E-11.20	Frequency, Hz	60	
E-11.21	Register Type	LCD	
E-11.22	TOU (Time of Use)	Programmable Ready	
E-11.23	Soft Switches	Available	
E-11.24	LCD Display	Programmable	
E-11.25	Power Consumption	Manufacturer's Data	
E-11.26	The Kilowatt-hour meter to be provided is certified and approved by ERC	Yes	
E-11.27	Metering Current Transformer		
	a. Class (indoor, outdoor)	Outdoor	
	b. Insulation type	Full cast epoxy resin	
	c. Secondary rated current for all windings, A	5	
	d. CT ratio	To be based on protection and metering requirements	
	e. Accuracy class	Class 0.2 or Better	
	f. Burden	Manufacturer's Data	
	g. BIL, kV	110	
E-11.28	Metering Voltage Transformer		
	a. Class (indoor, indoor)	Outdoor	
	b. Highest continuous operating voltage of VTs, kV	15	
	c. Nominal voltage of VT, kV	13.2	

Item	Description	NPC Requirements	Supplier's Data
	d. Rated secondary voltage, V	120	
	e. Insulation type	Full cast epoxy resin	
	f. Accuracy class	Class 0.2 or Better	
	g. Burden	Manufacturer's Data	
	h. BIL, kV	110	

12.0 SPARE PARTS AND TOOLS

Item	Description ³	Qty. ¹	Unit Price	Total Price ²
E-12.1	Generator Circuit Breaker for Generator Control & Protection Panel of 150 kW D/G Set	1 Set		
E-12.2	GCPP Module/Controller with installed software for 150 kW D/G Set	1 Set		
E-12.3	Automatic Voltage Regulator (AVR) for 150 kW D/G Set	1 Set		
E-12.4	Rotating/Revolving Diodes for 150kW D/G Set	1 Set		
E-12.5	Telescopic Hot Stick with Tip Lock Features, Material: Epoxy glass Minimum Length: 35 ft. No. of Sections: 8	1 set		
E-12.6	Lineman's Rubber Gloves Size: 14" Maximum Usage: 17,000 Volts	2 pairs		
E-12.7	Lineman's Belt Maximum Length: 42" Minimum Length: 34" D-to-D distance: 56 cm Center Hole: 38"	1 set		
E-12.8	Positioning Strap, Nylon Maximum Length: 2.0m Minimum Length: 1.3m Adjustable Range: 0.7m	1 set		
E-12.9	Heavy Duty Hard Hat with strap & NPC (Passed Safety Standard)	3 pcs		

Note:

1. Minimum requirements but the Supplier may increase the specified quantity if found not sufficient. Additional spares consumed and/or required for any repairs/replacement during the warranty period shall be provided by the Supplier at no cost to NPC.
2. Indicated Price shall be used for reference in future purchase orders.
3. The above list is preliminary which is subject to changes to conform with the final design and model/brand of the proposed equipment (per manufacturer's standard).

13.0 JOB SITE CAMERAS

Item	Description	NPC Requirements	Supplier's Data
E-13.1	Manufacturer	By Supplier	
E-13.2	Type	Time-Lapse Camera	
E-13.3	Quantity	As specified in the SOR/BOQ	
E-13.4	Control Display	Thin-Film-Transistor (TFT) Liquid Crystal Display (LCD)	
E-13.5	Image Sensor Resolution	At least 1.3 Megapixel CMOS	
E-13.6	View Angle	At least 110 degrees viewing angle	
E-13.7	Still Image Resolution	1280 x 720	
E-13.8	Time Lapse Interval	Every 15 minutes/ User-programmable	
E-13.9	Battery Type	Standard AA or AAA Size Alkaline Batteries	
E-13.10	Battery Life	At least 120 days of image recording	
E-13.11	Additional Battery (Spare)	Required	
E-13.12	Enclosure	IP64 compliant	
E-13.13	Storage Memory	SDHC	
E-13.14	Storage Capacity	32GB	
E-13.15	Additional Storage (Spare)	At least Two (2) 32GB SDHC Storage	

EW-16.0 MEASUREMENT OF PAYMENT

Measurement of payment for all electrical works shall be based on the bid price of each item as shown in the Schedule of Requirements – Electrical Works, Section VII of the Tender Documents. The cost of each item shall cover all works required and described in the pertinent provisions of the specifications.



REPUBLIC OF THE PHILIPPINES
NATIONAL POWER CORPORATION
(Pambansang Korporasyon sa Elektrisidad)

TERMS OF REFERENCE

Name of Project: SUPPLY, DELIVERY, INSTALLATION, TEST, AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT & BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREA IN JINTOTOLO IS., BALUD, MASBATE

Project Location: Jintotolo Is., Balud, Masbate

Specification No.: Luzp22Z1435se

Contents : Volume 2 of 2

SECTION IV	-	BID PRICE SCHEDULE
SECTION V	-	BIDDING FORMS
SECTION VI	-	BID DRAWINGS

Design and Development Department



SECTION III TECHNICAL SPECIFICATIONS

PART II – TECHNICAL DATA SHEETS

PART II – TECHNICAL DATA SHEETS**MW – MECHANICAL WORKS****TABLE OF CONTENTS**

SECTION	DESCRIPTION	PAGE
DOCUMENTS TO BE SUBMITTED DURING BID OPENING		
M-1.0	Diesel Generating Set and Associated Equipment Data Summary	III-TDS(MW)-2
M-2.0	Diesel Engine	III-TDS(MW)-3
M-3.0	Fuel Consumption Form for Diesel Generating Set	III-TDS(MW)-3
Annex A.1	Letter of Authorization and Guarantee Statement either from: 1) <i>Original Equipment Manufacturer (OEM)</i> or 2) <i>Licensee /Agreement from OEM as a Licensee</i> or 3) <i>Authorized Distributor/Dealer (accompanied by a Certificate of Authorized Distributorship/Dealership from the OEM/Licensee of the OEM). If from the Licensee, a Certification from the OEM as a Licensee or the Licensee agreement must also be submitted</i> , for the Diesel Generating Sets.	Attachment As Annex A.1
DOCUMENTS TO BE SUBMITTED DURING POST QUALIFICATION BUT NOT LIMITED TO:		
M-4.0	Spare Parts	III-TDS(MW)-5
M-4.1	Spare Parts per Unit of 150 kW DG Set During the Warranty Period	III-TDS(MW)-5
M-4.2	Spare Parts per Total Units of 150 kW DG Sets Supplied and to be Delivered at Jintotolo DPP	III-TDS(MW)-6
M-5.0	Standard/Special Tools	III-TDS(MW)-7
M-5.1	Standard/Special Tools per Total Units of 150 kW DG Set Supplied and Delivered at Jintotolo DPP	III-TDS(MW)-7
M-5.2	Miscellaneous Tools to be Supplied and Delivered at Jintotolo DPP	III-TDS(MW)-8
Annex A.2	"Diesel Generating Set (Engine + AC Generator) Performance Curve" @ Reference Site Conditions (Fuel Rate* vs. Load, "ltrs./kWh vs. Load") with duly signed full name of the representative of the Manufacturer/Assembler/Integrator of the Diesel Generating Set Model/Type being offered	Attachment As Annex A.2
Annex A.3	"Engine Performance Curve" @ Reference Site Conditions (Fuel Cons.* vs. Load, "ltrs./hr vs. Load") with duly signed full name of the representative of the Manufacturer/Assembler/Integrator of the D/G Set and Engine Model/Type being offered.	Attachment As Annex A.3

* Other SI or English Units used for Time, Volume, Power and Energy will be acceptable.

TABLE OF CONTENTS (Cont'd.....)

SECTION	DESCRIPTION	PAGE
DOCUMENTS TO BE SUBMITTED DURING PROJECT IMPLEMENTATION BUT NOT LIMITED TO:		
M-6.0	ISO 9001 Certificate of the Manufacturer/Assembler/Integrator or equivalent for each of the Diesel Generating Set	
M-7.0	Standard Certification of the proposed offered model of Diesel Generating Set from any of the following internationally recognized certifying body/organization: a) Canadian Standard Association (CSA) b) Underwriter's Laboratories (UL) c) Japanese Industrial Standards (JIS) d) European Commission (CE) e) Lloyd's Register (LR) f) Germanischer Lloyd (GL) g) Nippon Kaiji Kyokai (NKK) h) American Bureau of Shipping (ABS)	
M-8.0	Power Derate Curves and Details or Certificate/Statement from Diesel Generating Set's Manufacturer/Assembler/ Integrator that the proposed Diesel Engine-Generator Set have no deration at Reference Site Conditions.	
M-9.0	Manufacturer/Assembler/Integrator's General Data, Catalogue and Brochures of model/type of equipment offered and published as standard products for the Diesel Generating Set which contain the following information: a) Manufacturer/Assembler b) Model/Type c) Prime Rated Power d) Voltage e) Power Factor f) Frequency g) Rated Speed h) Arrangement and Number of Cylinders	
M-10.0	Technical Data for Engine and Auxiliaries (See Attached Forms)	III-TDS(MW)-12
M-11.0	Supplier/Manufacturer/Assembler Drawings, Brochures, Instruction Manuals and other Documents as specified in Clause GW-6.3 and other relevant Clauses of the Technical Specifications	
M-12.0	Fuel Oil Storage and Transfer System	III-TDS(MW)-18
M-13.0	Photos of Nameplates (DG set, Engine and Alternator) – submit 5 months prior to Test & Commissioning	
M-14.0	Serial Nos. of DG set, Engine and Alternator – Submit 5 months prior to Test & Commissioning	

PART II – TECHNICAL DATA SHEETS**MW – MECHANICAL WORKS****DOCUMENTS TO BE SUBMITTED DURING THE BID OPENING**
(Sections M-1.0, M-2.0, M-3.0 and Annex A.1)**NOTES**

1. The Bidder shall complete this technical data sheet and submit the filled-up forms with the technical proposal. The Bidder shall use additional sheets as necessary for any other additional information following the format shown herein or by reproducing the same.
2. The data required are technical features and characteristics of the Equipment to be provided by the bidder. Bidder's proposal shall at least be equal or superior to the requirements specified by NPC.
3. Deviation from the requirements indicated in the technical data sheets M-1.0, M-2.0, M-3.0 and non-submission of the required documents listed as Annex A.1 shall be ground for disqualification.
4. All data and information shall be in English language.

Name of Firm

Name & Signature of Representative

Designation

M-1.0 DIESEL ENGINE-GENERATOR AND ASSOCIATED EQUIPMENT DATA SUMMARY

ITEM	DESCRIPTION	NPC REQUIREMENT	SUPPLIER'S DATA
M-1.1	DG Set (Diesel Engine + AC Generator) – PRIME DUTY *	Designed, manufactured & tested in compliance with the latest version of the standards* listed below, mounted on heavy duty steel baseframe with anti-vibration pads contained in a sound attenuated & weatherproof enclosure	
M-1.1.1	Manufacturer/Assembler/Integrator or of DG Set being offered	By Supplier	
M-1.1.2	Brand Name of DG Set being offered	By Supplier	
M-1.1.3	Model of DG Set being offered	By Supplier	
M-1.1.4	DG Set Manufacturer/Assembler/Integrator Experience, Year	5	
M-1.1.5	DG Set Guaranteed Prime Rated Power at Reference Site Conditions* & 0.8 Power Factor, kW	150 minimum	
M-1.1.6	DG set Guaranteed Fuel Rate at Required 150 kW D/G Prime Power Output & at Reference Site Conditions 100 % Rated Load, li/kW-hr,	0.30 (max)	
M-1.1.7	Voltage, V	480 (± 5%)	
M-1.1.8	Power factor	0.80 (minimum)	
M-1.1.9	Frequency, Hz	60	
M-1.1.10	No. of Phases, Ø	3	
M-1.1.11	Rated Speed, RPM	1800	
M-1.1.12	Governor	electronic	
M-1.1.13	Arrangement & Number of Cylinders	In-line & Multi-cylinder	
M-1.1.14	Maximum Sound Pressure Level @ 1-meter distance, dBA	85	
M-1.1.15	Maximum Permissible NOx, mg/Nm ³	2000 as NO ₂	
M-1.1.16	Maximum Permissible SOx, mg/Nm ³	700 as SO ₂	
M-1.1.17	Maximum Permissible CO, mg/Nm ³	500 as CO	
M-1.1.18	Particulates, mg/Nm ³	200	
M-1.1.19	Factory Acceptance Test	Yes	

- NOTES:**
- * IEC 60034, IEC 60085, IEC60529, ISO 9001 and ISO 3046
 - Guaranteed Fuel Consumption which is more than the specified maximum value will be ground for rejection of the equipment being offered.
 - Experience less than what is required will be ground for rejection of the equipment being offered.

Name of Firm

Name & Signature of Representative

Designation

M-2.0 DIESEL ENGINE

ITEM	DESCRIPTION	NPC REQUIREMENT	SUPPLIER'S DATA
M-2.1	Diesel Engine		
M-2.1.1	a. Manufacturer/Assembler	By Supplier	
	b. Manufacturer's Experience, yr.	10	
M-2.1.2	Place of Manufacture	By Supplier	
M-2.1.3	Model/Type	By Supplier	
M-2.1.4	Engine Prime Rated Brake Power at Reference Site Conditions, kWm or BHP	By Supplier	
M-2.1.5	Number of Cylinders	By Supplier	
M-2.1.5	Bore and Stroke, mm	By Supplier	
M-2.1.5	Piston Displacement, L	By Supplier	
M-2.1.5	Piston Speed, m/s	By Supplier	
M-2.1.5	Engine Mean Effective Pressure, kg/cm ²	By Supplier	
M-2.1.5	Compression Ratio	By Supplier	
M-2.1.5	Overall Dimension of Complete Unit (mxmxm), L x W x H	By Supplier	
M-2.1.5	Maximum Weight of Diesel Engine Generator Set on Skid, kg	By Supplier	
M-2.1.5	Heat Dissipation including (Generating set), kJ/hr	By Supplier	

M-3.0 – FUEL CONSUMPTION FOR DIESEL ENGINE-GENERATOR SETS

A	B**	C	D*	E
D/G Set Guaranteed Prime Rated Power at Reference Site Conditions (Minimum KW)	D/G Set Guaranteed Fuel Rate at Required Prime Rated Power & at Reference Site Conditions (liters/kilowatt-hour)	Cost of Fuel (PhP/ltr)	No. of operating hours per year (hrs)	1-Year Cost of Fuel Consumption, (A x B x C x D) (PhP)
150		66.80	3,427	

NOTES: * For evaluation Purposes: The estimated number of operating hours per year is based on 16 hrs/day operation, 25 days PMS, 10% Outages and assumed 70% Utilization Factor.

** Write the Guaranteed Fuel Rate in three decimal places, i.e. 0.270 L/kW-hr. If Fuel Rate is indicated in more than three decimal places, only the first three decimal numbers will be considered regardless of any number written in the fourth decimal number.

Name of Firm

Name & Signature of Representative

Designation

PART II – TECHNICAL DATA SHEETS**MW – MECHANICAL WORKS****DOCUMENTS TO BE SUBMITTED DURING POST-QUALIFICATION**
(Sections M-4.1 to M-5.2 and Annexes A.2 and A.3)**NOTES**

1. The Bidder shall complete this technical data sheet and submit the filled-up forms during the post-qualification which shall only serve as reference for the review and approval of brochure/drawings during implementation stage. The Bidder shall use additional sheets as necessary for any other additional information following the format shown herein or by reproducing the same.
2. The data required are technical features and characteristics of the Equipment to be provided by the bidder which shall at least be equal or superior to the requirements specified by NPC.
3. The lists of Spares and Tools (Items M-4.1 to M-5.2) are preliminary and subject to changes to conform with the final design and model/brand of the proposed equipment (per manufacturer's standard).

The Bidder shall indicate "N/A" to the respective items in the said lists (Items M-4.1 to M-5.2) if found not applicable to the brand/model of the proposed equipment. However, NPC has the right to ask the Supplier to provide the same or its equivalent if it is determined as "deemed necessary or standard tool/inherent part or optional item" during the implementation of the project, checking and review/approval of the final lists to be submitted by the Supplier during the Contract Stage at no cost to NPC.

4. Non submission of the above documents including documents listed as Annexes A.2 and A.3 shall be a ground for disqualification.

Name of Firm

Name & Signature of Representative

Designation

M-4.0 SPARE PARTS**M-4.1 SPARE PARTS PER UNIT OF 150 KW DG SET DURING THE WARRANTY PERIOD** (Minimum Requirements as Specified in the Technical Specifications and Manufacturer's Standard and Recommended Spare Parts) *

ITEM	DESCRIPTION	PART NO.	MINIMUM QUANTITY**	SUPPLIER'S DATA
M-4.1a	Air Filter Element		6 pcs/size	
M-4.1b	Lube Oil Filter Element		30 pcs/size	
M-4.1c	Fuel Filter Element		15 pcs/size	
M-4.1d	Water Filter Element		6 pcs/size	
M-4.1e	Fan Belt		3 pcs/size	
M-4.1f	Alternator Belt		3 pcs/size	
M-4.1g	Coolant		4 gallons	
M-4.1h	Expected spares to be consumed during the performance test		1 lot	
M-4.1i	Other spare parts recommended by Manufacturer		1 lot	
M-4.1i.1				
M-4.1i.2				
M-4.1i.3				
M-4.1i.4				
M-4.1i.5				
M-4.1i.6				
M-4.1i.7				
M-4.1i.8				
M-4.1i.9				
M-4.1i.10				

NOTES:

* *The above list is preliminary which is subject to changes to conform with the final design and model/brand of the proposed equipment (per manufacturer's standard). NOTE #3 of page III-TDS (MW)-4.*

** *Quantities may be increased depending on manufacturer's required replacement intervals.*

Name of Firm

Name & Signature of Representative

Designation

**M-4.2 SPARE PARTS PER TOTAL UNITS OF 150 KW DG SET
SUPPLIED AND DELIVERED AT JINTOTOLO DPP***

ITEM	DESCRIPTION	PART NO.	MINIMUM QUANTITY**	SUPPLIERS DATA
M-4.2a	Fuel Injector Assembly		2 pcs	
M-4.2b	Top Overhauling Kit		1 set	
M-4.2c	Actuator		1 set	
M-4.2d	Jacket Water Pump Repair Kit		1 set	
M-4.2e	Lube Oil Pump Repair Kit		1 set	
M-4.2f	Fan Adaptor & Accessories including Bearings		2 sets	
M-4.2g	Rocker Gear Cover Gasket		12 pcs	
M-4.2h	Thermostat		1 set	
M-4.2i	Lub Oil Pump Switch		1 set	
M-4.2j	Hot Water Temp. Switch		1 set	
M-4.2k	Turbocharger Repair Kit		1 set	
M-4.2l	Exhaust Manifold Bellow		1 set	
M-4.2m	Magnetic Pick-up		1 pc	
M-4.2n	Other spare parts recommended by Manufacturer		1 Lot	
M-4.2n.1				
M-4.2n.2				
M-4.2n.3				
M-4.2n.4				
M-4.2n.5				

NOTES:

* The a list is preliminary which is subject to changes to conform with the final design and model/brand of the proposed equipment (per manufacturer's standard).
NOTE #3 of page III-TDS(MW)-4.

** Quantities may be increased depending on manufacturer 's required replacement intervals.

Name of Firm

Name & Signature of Representative

Designation

M-5.0 STANDARD/SPECIAL TOOLS/MISCELLANEOUS TOOLS**M-5.1 STANDARD/SPECIAL TOOLS PER TOTAL UNITS OF 150 KW DG SETS SUPPLIED AND DELIVERED AT JINTOTOLO DPP**
(Minimum Requirements as Specified in the Technical Specifications & Manufacturer's Standard/Recommended Tools)⁺

ITEM	DESCRIPTION	NPC REQ'T	SUPPLIERS DATA
M-5.1a	Portable computer (Minimum of Intel I7 Processor, 16GB (1x16GB) DDR4 2666 MHZ, 256 GB PCIe NVMe SSD +1TB SATA 5400RPM 2.5" Inch, 13"-15.6" screen size & with the latest pre-installed windows operating system compatible with manufacturer's/or Supplier's software) needed in programming the DGset control setting (complete with licensed CD-ROM drive dongles of DGset control system) and electronic/digital governing system including other digital components that require exclusive programs from the Manufacturer and/or Supplier with free update throughout the operating life of the DGset	1 set	
M-5.1b	Puller, Cylinder Liner	1 set	
M-5.1c	Puller, Generator Bearing	1 set	
M-5.1d	Puller, Injector Sleeve	1 set	
M-5.1e	Extractor, Valve Seat	1 set	
M-5.1f	Extractor, Piston Ring	1 set	
M-5.1g	Extractor, Valve Guide	1 set	
M-5.1h	Extractor, Valve Spring	1 set	
M-5.1i	Expander, Injector Sleeve	1 set	
M-5.1j	Reamer, Injector Sleeve	1 set	
M-5.1k	Calibrator, Injector (Range 0-600 bars)	1 set	
M-5.1l	Feeler Gauge	1 set	
M-5.1m	Special tools for overhauling and re-assembly of turbocharger	1 set	
M-5.1n	Cleaning nozzle for cleaning of turbocharger	1 set	
M-5.1o	Special tools for maintenance and cleaning of radiators and fans	1 set	
M-5.1p	Mechanical Torque Wrench with click type or dial type torque measurement indicators for cylinder head, main and guide bearing, connecting rod and all engine components utilizing bolt and nut as locking medium	1 set	
M-5.1q	Single and double open-end spanner	1 set	
M-5.1r	Injector timing gauge	1 pc	
M-5.1s	Standard/special tools necessary for overhauling and re-assembly of engine which are not mentioned above	1 set	
M-5.1t	Other tools recommended by the Manufacturer	1 lot	

NOTES: + Minimum requirements but the Supplier shall provide/include in the list all the necessary/standard tools required in the performance of normal maintenance and overhaul. The above list is preliminary which is subject to changes to conform with the final design and model/brand of the proposed equipment (per manufacturer's standard). Refer also to NOTE #3 of page III-TDS(MW)-4.

Name of Firm

Name & Signature of Representative

Designation

NATIONAL POWER CORPORATION



III-TDS(MW)-7

M-5.2 MISCELLANEOUS TOOLS TO BE SUPPLIED AND DELIVERED AT JINTOTOLO DPP +

ITEM	DESCRIPTION	NPC REQUIREMENT	SUPPLIERS DATA
M-5.2a	Hoist, hand chain, 2 tons capacity, 3 meters lift	1 unit	
M-5.2b	Wrench, combination, 13 pcs/set	1 set	
M-5.2c	Wrench, open, 8 pcs/set	1 set	
M-5.2d	Wrench box, 7 pcs/set	1 set	
M-5.2e	Wrench, socket, 17 pcs/set	1 set	
M-5.2f	Wrench, adjustable, chrome vanadium steel, drop forged, fine polished, heavy duty, sizes: 8, 10 & 12"	1 set	
M-5.2g	Wrench, pipe, forge steel, heavy duty, sizes: 12 & 14"	1 set	
M-5.2h	Wrench, torque, 0-500 Nm	1 pc.	
M-5.2i	Plier, combination, sizes: 6, 7 & 8"	1 set	
M-5.2j	Plier, long nose, sizes: 6 & 8"	1 set	
M-5.2k	Screw driver, 6 pcs/set	1 set	
M-5.2l	Vise, size 6" swivel type, pre drilled holes for mounting	1 pc.	
M-5.2m	Caliper, digimatic, measuring range: 0-150mm, accuracy: +/- 0.02mm	1 pc.	
M-5.2n	Micrometer, outside deviation within: +/- 0.01 mm, heavy duty	1 pc.	
M-5.2o	Drill, Electric, 13mm hammer drill, 220 V, 60 Hz, 710 W, 3.2a, reversible, with hammer, lock-on button and kit box	1 pc.	
M-5.2p	Bit, drill, 70 pcs/set, includes 3 position ratcheting hand drive, brad point bits-wood, twist drill bits - metal/wood/plastic/masonry	1 set	
M-5.2q	Grinder, angle, heavy duty, 220 V, 60 Hz, 750 W, 1200 rpm, single phase, variable speed	1 set	
M-5.2r	Tester, Multi, Digital	1 pc.	
M-5.2s	Meter, Clamp, Digital	1 pc.	
M-5.2t	Tester, Megger (0-1000)	1 pc.	
M-5.2u	Allen Wrench	1 set	
M-5.2v	Hammer - ball & claw (2 pcs each type)	1 set	

NOTES: + Minimum requirements but the Supplier shall provide/include in the list all the necessary/standard tools required in the performance of normal maintenance and overhaul. The above list is preliminary which is subject to changes to conform with the final design and model/brand of the proposed equipment (per manufacturer's standard). Refer also to NOTE #3 of page III-TDS (MW)-4.

Name of Firm

Name & Signature of Representative

Designation

**M-5.2 MISCELLANEOUS TOOLS TO BE SUPPLIED AND
DELIVERED AT JINTOTOLO DPP (Cont'd.....)+**

ITEM	DESCRIPTION	NPC REQUIREMENT	SUPPLIERS DATA
M-5.2w	Filter Wrench	1 pc.	
M-5.2x	Tongue & Grove Pliers (10")	1 pc.	
M-5.2y	Precision Screwdrivers (long type)	1 set	
M-5.2z	Grease gun	1 set	
M-5.2aa	Locker Cabinet with 6 compartment with lock keys and ball rollers	1 set	
M-5.2bb	Other tools recommended by the Manufacturer	1 lot	
M-5.2bb.1			
M-5.2 bb.2			
M-5.2 bb.3			
M-5.2 bb.4			
M-5.2 bb.5			
M-5.2cc	Tool box, heavy duty, 535mm x 250mm x 238 mm (or as required to contain all the standard/special and miscellaneous Tools)	1 set	

NOTES: + Minimum requirements but the Supplier shall provide/include in the list all the necessary/standard tools required in the performance of normal maintenance and overhaul. The above list is preliminary which is subject to changes to conform with the final design and model/brand of the proposed equipment (per manufacturer's standard). Refer also to NOTE #3 of page III-TDS (MW)-4.

Name of Firm

Name & Signature of Representative

Designation

PART II – TECHNICAL DATA SHEETS**MW – MECHANICAL WORKS****DOCUMENTS TO BE SUBMITTED DURING THE PROJECT
IMPLEMENTATION****(Sections M-6.0, M-7.0, M-8.0, M-9.0, M-10.0, M-11.0 & 12.0)****NOTES**

1. The Bidder shall complete this technical data sheet/documents and submit the filled-up forms during the project implementation (during contract stage). The Bidder shall use additional sheets as necessary for any other additional information following the format shown herein or by reproducing the same.
2. The data required are technical features and characteristics of the Equipment to be provided by the bidder. Bidder's proposal shall at least be equal or superior to the requirements specified by NPC. The data provided shall be used as basis for evaluation of brochures, drawings and other documents to be submitted for review and approval during the project implementation.
3. All data and information shall be in English language.

DOCUMENTS TO BE SUBMITTED DURING PROJECT IMPLEMENTATION BUT NOT LIMITED TO:		
SECTION	DESCRIPTION	PAGE
M-6.0	ISO 9001 Certificate of the Manufacturer/Assembler/Integrator or equivalent for each of the Diesel Generating Set	
M-7.0	Standard Certification of the proposed offered model Diesel Generating Set from any of the following internationally recognized certifying body/organization: <ol style="list-style-type: none"> Canadian Standard Association (CSA) Underwriter's Laboratories (UL) Japanese Industrial Standards (JIS) European Commission (CE) Lloyd's Register (LR) Germanischer Lloyd (GL) Nippon Kaiji Kyokai (NKK) American Bureau of Shipping (ABS) 	
M-8.0	Power Derate Curves and Details or Certificate/Statement from Diesel Generating Set Manufacturer/Assembler/ Integrator that the proposed Diesel Engine-Generator Set have no deration at Reference Site Conditions.	

Cont'd.....

DOCUMENTS TO BE SUBMITTED DURING PROJECT IMPLEMENTATION BUT NOT LIMITED TO:		
SECTION	DESCRIPTION	PAGE
M-9.0	Manufacturer/Assembler/Integrator's General Data, Catalogue and Brochures of model/type of equipment offered and published as standard products for the Diesel Generating Set which contain the following information: a) Manufacturer/Assembler b) Model/Type c) Prime Rated Power d) Voltage e) Power Factor f) Frequency g) Rated Speed h) Arrangement & Number of Cylinders	
M-10.0	Technical Data for Engine and Auxiliaries	See Attached Forms on page III-TDS(MW)-12
M-11.0	Supplier/Manufacturer/Assembler Drawings, Brochures, Instruction Manuals and other Documents as specified in Clause GW-6.3 and other relevant Clauses of the Technical Specifications	
M-12.0	Fuel Oil Storage Tank	III-TDS(MW)-18

Name of Firm

Name & Signature of Representative

Designation

M-10.0 DIESEL ENGINE

ITEM	DESCRIPTION	NPC REQUIREMENT	SUPPLIER'S DATA
M-10.1	DIESEL ENGINE		
M-10.1.1	Fuel Rate at Required Prime Power Output & Reference Site Conditions for Generating Set Package)		
	75 % Rated Load, Li/kW-hr	By Supplier	
	50 % Rated Load, Li/kW-hr	By Supplier	
	25 % Rated Load, Li/kW-hr	By Supplier	
M-10.1.2	Number of Strokes	4	
M-10.1.3	Rotating Direction (Viewed from Flywheel Side)	By Supplier	
M-10.1.4	Required Time from Starting Signal to Rated Speed, minute	By Supplier	
M-10.1.5	Maximum Time from "Cold Condition" to Rated Speed w/ Load and w/o AC power available for motor-driven auxiliaries, minute	By Supplier	
M-10.1.6	Heaviest part of DG set for maintenance, kg	By Supplier	
M-10.1.7	Idling Speed Recommended, rpm	By Supplier	
M-10.1.8	Duration of Idling (max.), min.	By Supplier	
M-10.1.9	Minimum Load @ Normal Speed, kW	By Supplier	
M-10.1.10	Maximum Load @ Normal Speed, kW	By Supplier	
M-10.1.11	Engine Heat Dissipation, kJ/hr	By Supplier	
M-10.1.12	Engine Mechanical Efficiency, η_m	By Supplier	
M-10.1.13	Numerical Values for Power Adjustment Parameters (Exponents) for high speed per Table 2 of ISO 3046, a, m, n, s	By Supplier	a = m = n = s =
M-10.1.14	Expected Useful Life of Unit @ Prime Rated Power, Yrs	10	

Name of Firm

Name & Signature of Representative

Designation

M-10.0 DIESEL ENGINE (Cont'd.....)

ITEM	DESCRIPTION	NPC REQUIREMENT	SUPPLIER'S DATA
M-10.2 LUBRICATING OIL SYSTEM			
M-10.2.1	Total Lube Oil System Capacity, liters	By Supplier	
M-10.2.2	Lube Oil Consumption of the Engine, g/kwhr	By Supplier	
M-10.2.3	Lube Oil Pump Capacity, m ³ /hr	By Supplier	
M-10.2.4	Lube Oil Filter Mesh, microns	By Supplier	
M-10.2.5	Lube Oil Purifier Type & Capacity	Free jet centrifuge	
M-10.2.6	Lube Oil Priming Pump Capacity, if applicable	By Supplier	
M-10.3 STARTING SYSTEM			
M-10.3.1	Battery Capacity, AH	By Supplier	
M-10.3.2	Starting Voltage, V	24 or 12	
M-10.3.3	Starting Motor Rating, HP	By Supplier	
M-10.3.4	Full Load Cranking Current, A	By Supplier	
M-10.3.5	Battery Charging Type	By Supplier	
M-10.3.6	Battery Charger Charging rate	By Supplier	
M-10.3.7	Time of Cranking, sec	30	
M-10.4 EXHAUST SYSTEM			
M-10.4.1	Exhaust Gas Flow, m ³ /hr	By Supplier	
M-10.4.2	Exhaust Gas Temperature, °C	By Supplier	
M-10.4.3	Maximum Allowable Back Pressure, mmH ₂ O	By Supplier	
M-10.4.4	Exhaust Pipe (nom. Diameter x length x weight), mm x mm x kg	By Supplier	
M-10.4.5	Silencer (nom. Diameter x length x weight), mm x mm x kg	By Supplier	
M-10.4.6	Exhaust Pipe Material, ASTM	A 106 or as required	
M-10.4.7	Silencer Material, ASTM	A 106 or as required	
M-10.4.8	Structural Steel Supports for vertically mounted stack/silencer	By Supplier	

Name of Firm

Name & Signature of Representative

Designation

M-10.0 DIESEL ENGINE (Cont'd.....)

ITEM	DESCRIPTION	NPC REQUIREMENT	SUPPLIER'S DATA
M-10.5	INTAKE AIR SYSTEM		
M-10.5.1	Air Intake Flow (Free Air), m ³ /hr	By Supplier	
M-10.5.2	Air Filter Type	By Supplier	
M-10.5.3	Turbocharger Type (per Manufacturer's standard)	By Supplier	
M-10.5.4	Turbocharger RPM	By Supplier	
M-10.5.5	Charge Air Cooler Type	By Supplier	
M-10.5.6	Total Air Flow Required for Ventilation & Combustion, m ³ /hr	By Supplier	
M-10.6	COOLING SYSTEM (Coolant for initial filling shall be provided By Supplier per engine)		
M-10.6.1	Total Cooling Water Capacity, Liters	By Supplier	
M-10.6.2	Cooling Water Pump Capacity, m ³ /hr	By Supplier	
M-10.6.3	Jacket Water Pump Capacity, m ³ /hr	By Supplier	
M-10.6.4	Radiator Fan Air Flow (Designed for Continuous operation @ specified ambient site conditions), m ³ /hr	By Supplier	
M-10.6.5	Radiated Heat to Ambient, kW/hr	By Supplier	
M-10.6.6	Expansion Tank Capacity and Elevation, if applicable, liters and m.	By Supplier	
M-10.6.7	Radiator Dimensions (l x w x h), m x m x m	By Supplier	
M-10.6.8	Core Material	Aluminum or Copper	

Name of Firm

Name & Signature of Representative

Designation

M-10.0 DIESEL ENGINE (Cont'd.....)

ITEM	DESCRIPTION	NPC REQUIREMENT	SUPPLIER'S DATA
M-10.6.9	Recommended cooling water properties such as ph, hardness, TDS, etc., ASTM		
	PH Value, ppm	By Supplier	
	Total Hardness	By Supplier	
	TDS, ppm	By Supplier	
	Chloride	By Supplier	
	Sulfate, ppm	By Supplier	
	Silica, mg/l	By Supplier	
	Iron, ppm	By Supplier	
	Conductivity, uS/cm	By Supplier	
M-10.7	FUEL SYSTEM		
M-10.7.1	Fuel Feed Pump Capacity, m ³ /hr	By Supplier	
M-10.7.2	Discharge Head of Feed Pump, m	By Supplier	
M-10.7.3	Fuel Filter Type and Mesh, microns	Spin-on with water separator	
M-10.7.4	Injection Nozzle Type	By Supplier	
M-10.7.5	Fuel Day Tank Capacity, m ³	0.9	
M-10.7.6	Fuel Day Tank Type (Elevated)	Rectangular or Approved Shape	
M-10.7.7	Fuel Tank Dimensions (W x L x H), m x m x m	By Supplier	
M-10.7.8	Fuel Tank Plate Material, ASTM	A 36	
M-10.7.9	Fuel Tank Shell Thickness, mm	5	
M-10.7.10	Structural Steel Supports	Included	
M-10.8	ENCLOSURE (Weatherproof & Soundproof)		
M-10.8.1	Manufacturer	By Supplier	
M-10.8.2	Max. Sound Pressure Level @ 1-m distance, dBA	85	
M-10.8.3	Dimensions (L x W x H), m x m x m	By Supplier	

Name of Firm

Name & Signature of Representative

Designation

M-10.0 DIESEL ENGINE (Cont'd...)

ITEM	DESCRIPTION	NPC REQUIREMENT	SUPPLIER'S DATA
M-10.8	ENCLOSURE (Weatherproof & Soundproof) (Cont'd.....)		
M-10.8.4	Enclosure Walls Thickness, mm	2 minimum	
M-10.8.5	Enclosure Roof Thickness, mm	2 minimum	
M-10.8.6	Enclosure Material, ASTM	A 36	
M-10.8.7	Insulation Material	Oil-water resistant and fire retardant insulation and sound attenuating material	
M-10.8.8	Hinges Material	Stainless Steel	
M-10.8.9	Total Weight (DG set, Auxiliaries & Enclosure), kg	By Supplier	
M-10.9	ENGINE METERING AND INDICATION		
M-10.9.1	RPM Meter *, rpm	Included	
M-10.9.2	Hours Run Counter *, hours	Included	
M-10.9.3	Oil Pressure *, kg/cm ²	Included	
M-10.9.4	Oil Temperature *, °C	Included	
M-10.9.5	Cooling Water Temperature *, °C	Included	
M-10.9.6	Cylinders Exhaust Gas Temperature, °C	Optional (Not required for DG set below 1MW)	
M-10.9.7	Battery Voltage, V	Included	
M-10.9.8	Ready to Start	Included	
M-10.9.9	Remote Control Position Indication	Included	
M-10.10	ENGINE PROTECTION AND ALARM		
M-10.10.1	Engine Overspeed	Included	
M-10.10.2	Lube Oil Pressure Low	Included	
M-10.10.3	Lube Oil Temperature High	Included	
M-10.10.4	Cooling Water Temp. High	Included	
M-10.10.5	Cooling Water Temp. Low	Optional	
M-10.10.6	Fuel Day Tank Level High	Included	
M-10.10.7	Fuel Day Tank Level Low	Included	
M-10.10.8	Battery Voltage High	Included	
M-10.10.9	Battery Voltage Low	Included	
M-10.10.10	Failure to Crank	Included	
M-10.10.11	Overcrank	Included	

NOTE: * These monitoring /control points shall also be provided at DG set Enclosure-mounted panel with viewing window

Name of Firm

Name & Signature of Representative

Designation

M-10.0 DIESEL ENGINE (Cont'd.....)

ITEM	DESCRIPTION	NPC REQUIREMENT	SUPPLIER'S DATA
M-10.10	HUMAN MACHINE INTERFACE CONTROL		
M-10.11.1	Manual Start/Stop *	Included	
M-10.11.2	Auto/Remote Start	Included	
M-10.11.3	Test Run Auto	Included	
M-10.11.4	Emergency Stop *	Included	
M-10.11.5	Alpha/Numeric Screen	Included	
M-10.11.6	Discrete Status Indicators	Included	
M-10.11.7	Fault Reset	Included	

NOTE: * These monitoring /control points shall also be provided at DG set Enclosure-mounted panel with viewing window

Name of Firm

Name & Signature of Representative

Designation

M-12.0 FUEL OIL STORAGE AND TRANSFER SYSTEM

ITEM	DESCRIPTION	NPC REQUIREMENT	SUPPLIER'S DATA
M-12.1	Fuel Oil Storage Tank		
M-12.1.1	Capacity (Nominal) , m ³	10	
M-12.1.2	Design Code	API 650 or Approved Equivalent	
M-12.1.3	Quantity, set	1	
M-12.1.4	Empty Weight, kg	By Contractor	
M-12.1.5	Operating Weight, kg	By Contractor	
M-12.1.6	Size (dia. X height), m x m	2.5 x 3	
M-12.1.7	Materials of Construction:		
	Plate, ASTM	A 36	
	Structurals, ASTM	A 36	
M-12.1.8	Shell Plate Thickness:		
	1 st Course to top course, mm	5 minimum	
M-12.1.9	Bottom Plate Thickness, mm	8 minimum	
M-12.1.10	Bottom Plate Slope, Mm/m	Per Specification or Drawing	
M-12.1.11	Roof Plate Thickness, mm	5 minimum	
M-12.1.12	Roof Plate Slope, Mm/m	Per Specification or Drawing	
M-12.1.13	Paint Specifications:		
	Shell Exterior	Per Specification	
	Shell Interior	Per Specification	
	Bottom Underside	Per Specification	
	Structurals	Per Specification	
M-12.1.14	Weld Examinations:		
	Shell, ASTM	Per Specification	
	Bottom Underside	Per Specification	
	Roof	Per Specification	
	Nozzles	Per Specification	
M-12.2	Fuel Oil Transfer/Unloading Pump		
A	Pump		
M-12.2.1	Manufacturer	By Contractor	
M-12.2.2	Place of Manufacture	By Contractor	
M-12.2.3	Quantity	1	
M-12.2.4	Type	Gear	
M-12.2.5	Capacity, m ³ /h	10	
M-12.2.6	Total Head, m	30	
M-12.2.7	Speed, rpm	By Contractor	

Name of Firm

Name & Signature of Representative

Designation

M-12.0 FUEL OIL STORAGE AND TRANSFER SYSTEM (Cont'd...)

ITEM	DESCRIPTION	NPC REQUIREMENT	SUPPLIER'S DATA
M-12.2.8	Efficiency, %	By Contractor	
	Power Required, kW	By Contractor	
	Material:		
	Casing	Cast Iron	
	Gear	Ductile Iron	
	Shaft	H. Gr. Carbon Steel	
	Weight kg	By Contractor	
B	Motor		
M-12.2.9	Manufacturer	By Contractor	
M-12.2.10	Place of Manufacture	By Contractor	
M-12.2.11	Type & Protection	NEMA Standards	
M-12.2.12	Insulation Class	Class F	
M-12.2.13	Rating:		
M-12.2.14	Voltage, V	230	
	Power Output, kW	By Contractor	
	Frequency, hz	60	
	Phase	Single	
M-12.2.15	Current at Rated Voltage:		
	Full Load, A	By Contractor	
	Locked Rotor, A	By Contractor	
M-12.2.16	Speed, rpm	By Contractor	
M-12.2.17	Weight, kg	By Contractor	

Name of Firm

Name & Signature of Representative

Designation

PART II – TECHNICAL DATA SHEETS**EW- ELECTRICAL WORKS****TABLE OF CONTENTS**

SECTION	DESCRIPTION	PAGE
DOCUMENTS TO BE SUBMITTED DURING BID OPENING		VI-TDS(EW)-1
E-1.0	AC Generator	VI-TDS(EW)-2
E-2.0	Generator Transformer	VI-TDS(EW)-3
DOCUMENTS TO BE SUBMITTED DURING POST QUALIFICATION but not limited to: (Reference for the Approval of Manufacturer's Brochures/Drawings)		VI-TDS(EW)-4
E-3.0	Generator Control and Protection Panel	VI-TDS(EW)-5
E-4.0	Station Service Transformer	VI-TDS(EW)-5
E-5.0	Power, Control and Instrumentation Cables	VI-TDS(EW)-5
E-6.0	Bus Conductor	VI-TDS(EW)-6
E-7.0	Grounding System	VI-TDS(EW)-7
E-8.0	Lightning Protection System	VI-TDS(EW)-7
E-9.0	Automatic Circuit Recloser	VI-TDS(EW)-8
E-10.0	Fuse Disconnect Switch with Lightning Arrester Combination	VI-TDS(EW)-8
E-11.0	Kilowatt-Hour Demand Meter	VI-TDS(EW)-9
E-12.0	Spare Parts and Tools	VI-TDS(EW)-10

PART II

TECHNICAL DATA SHEETS

EW – Electrical Works

Section E-1.0 – E-2.0

Documents to be Submitted during the Bid Opening

1. The following Technical Data Sheets shall be filled-out and to be submitted with the Bid Proposal.
2. Deviation from the requirements indicated in the Technical Data Sheets shall be ground for disqualification.
3. Full technical data of the equipment are indicated in the Technical Specifications (EW-15.3) which will be submitted during the implementation stage for review and approval.

Name of Firm

Name & Signature of Representative

Designation

E-1.0 AC GENERATOR

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
E-1.1	Manufacturer	By Supplier	
E-1.2	Place of Manufacture	By Supplier	
E-1.3	Generator Model	By Supplier	
E-1.4	Type	Rotating Field Synchronous AC Generator, PMG Type with AVR	
E-1.5	Minimum Rated Power Output at 0.8 Power Factor, kW	150	
E-1.6	Duty	Continuous	
E-1.7	Overload Capability	10% of rated power output	
E-1.8	Rated Voltage, V	480	
E-1.9	No. of Phase	3	
E-1.10	Frequency, Hz	60	
E-1.11	Winding Pitch	2/3	
E-1.12	Rated Speed	1800	
E-1.13	Insulation Class	Class H shall be used for both the armature and field windings	
E-1.14	Temperature Rise	Class F at rated load	
E-1.15	Stator Winding Temperature Detector	To be provided	
E-1.16	Space heater	To be provided	
E-1.17	Excitation System Type	Brushless, Separately Excited, Permanent Magnetic Generator (PMG)	
E-1.18	Automatic Voltage Regulator, % Voltage Regulation	$\pm 0.5\%$ in steady state with rapid response time	
E-1.19	Protection Class	IP 23	

Name of Firm

Name & Signature of Representative

Designation

E-2.0 GENERATOR TRANSFORMER

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
E-2.1	Manufacturer	By Supplier	
E-2.2	Place of Manufacture	By Supplier	
E-2.3	Transformer Model	By Supplier	
E-2.4	Minimum Rated Capacity, kVA	225	
E-2.5	No. of Phase	3	
E-2.6	Rated Voltage		
	a. Primary, kV	0.48	
	b. Secondary, kV	13.8	
E-2.7	Transformer Guaranteed Losses at Rated kVA, Voltage, Frequency and Temperature		
	a. No-Load Losses, Watts	By Supplier	
	b. Load Losses, Watts	By Supplier	
	c. Total Losses (a+b), Watts	By Supplier	
E-2.8	Vector Group	YNd11	
E-2.9	Sudden Pressure Relay	To be Provided	

Name of Firm

Name & Signature of Representative

Designation

PART II**TECHNICAL DATA SHEETS****EW – Electrical Works****Section E-3.0 – E-12.0**

**Documents to be Submitted during the Post Qualification
but not limited to:
(Reference for the Approval of Manufacturer's Brochures/Drawings)**

1. The following shall be filled-out and to be submitted during the post qualification.
2. Filled-out data by the Supplier shall only serve as reference for the review and approval of brochures/drawings during implementation stage.
3. Full technical data of the equipment are indicated in the Technical Specifications (EW-15.3) which will be submitted during the implementation stage for review and approval.
4. Non-submission of the documents shall be ground for disqualification.

Name of Firm

Name & Signature of Representative

Designation

E-3.0 GENERATOR CONTROL & PROTECTION PANEL

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
E-3.1	Manufacturer	By Supplier	
E-3.2	Generator Control Module		
	a. Manufacturer	By Supplier	
	b. Model	By Supplier	
E-3.3	Generator Circuit Breaker	Molded Case Circuit Breaker	
	a. Manufacturer	By Supplier	
	b. Model	By Supplier	
	c. Continuous Current Rating	Refer to Single Line Diagram	
	d. Type	Compact with Electronic Trip Unit and remote control functions	

E-4.0 STATION SERVICE TRANSFORMER

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
E-4.1	Manufacturer	By Supplier	
E-4.2	Transformer Model	By Supplier	
E-4.3	Minimum Rated Capacity, kVA	20	
E-4.4	No. of Phase	One (1)	
E-4.5	Rated Voltage		
	a. Primary, kV	7.97	
	b. Secondary, kV	0.24	

E-5.0 POWER, CONTROL & INSTRUMENTATION CABLE

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
15kV Power Cable			
E-5.1	Manufacturer	By Supplier	
E-5.2	Continuous current carrying capacity of conductor at 90°C Operating Temperature	Manufacturer's Data	

Name of Firm

Name & Signature of Representative

Designation

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
E-5.3	Conductor Cross-Section, mm ²	Refer to Single Line Diagram	
E-5.4	Conductor Material	Annealed Copper	
E-5.5	Insulation Material	Cross-linked polyethylene (XLPE)	
600V Power, Instrumentation and Control Cable			
E-5.6	Manufacturer	By Supplier	
E-5.7	Type		
	a. Power	THHN/THWN-2	
	b. Control & Instrumentation	Royal Cord	
E-5.8	Continuous current carrying capacity of conductor at 75°C Operating Temperature		
	a. THHN/THWN-2	Refer to Single Line Diagram	
	b. Royal Cord	By Supplier	
E-5.9	Conductor Material	Annealed Copper	

E-6.0 BUS CONDUCTOR

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
E-6.1	Manufacturer	By Supplier	
E-6.2	Type designation	Aluminum Conductor Steel Reinforced (ACSR)	
E-6.3	Conductor size	Refer to Single Line Diagram	
E-6.4	Ampacity, A	By Supplier	

Name of Firm

Name & Signature of Representative

Designation

E-7.0 GROUNDING SYSTEM

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
E-7.1	Grounding connection	Exothermic	
E-7.2	Permissible temperature rise of grid copper conductor, °C	300	
E-7.3	Grid conductor		
	a. Manufacturer	By Supplier	
	b. Minimum Size, mm ²	100	
	c. Material	tin-annealed copper stranded conductor (bare)	
E-7.4	Bonding Conductor		
	a. Manufacturer	By Supplier	
	b. Size, mm ²	100, 50 & 22	
	c. Material	tin-annealed copper stranded conductor with 1.2 kV PVC Insulation	
E-7.5	Copper Ground Rod		
	a. Manufacturer	By Supplier	
	b. Diameter, mm	≥ 19 mm	
	c. Length/section, m	≥ 3 m	

E-8.0 LIGHTNING PROTECTION SYSTEM

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
Lightning Protection			
E-8.1	Manufacturer	By Supplier	
Lightning Rod			
E-8.2	Material	Copper	
E-8.3	Length, mm	2000	
E-8.4	Minimum Diameter, mm	19	

Name of Firm

Name & Signature of Representative

Designation

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
Down Conductor			
E-8.5	Type	Insulated Copper Conductor	
E-8.6	Minimum Cross-Section Area	55 mm ²	
E-8.7	Insulation Material	PVC	

E-9.0 AUTOMATIC CIRCUIT RECLOSER

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
E-9.1	Manufacturer	By Supplier	
E-9.2	Place of Manufacture	By Supplier	
E-9.3	Type	Solid Dielectric Vacuum Interrupter	
E-9.4	Phase	3	
E-9.5	Rated Frequency, Hz	60	
E-9.6	Nominal Rated Voltage, kV	13.8	
E-9.7	Mainly Active Breaking Capacity	800 A	

E-10.0 FUSE DISCONNECT SWITCH WITH LIGHTNING ARRESTER COMBINATION

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
E-10.1	Manufacturer	By Supplier	
E-10.2	Rated voltage, kV	15	
E-10.3	Frequency, Hz	60	
E-10.4	BIL, kV	110	
E-10.5	Ampere Frame	100	
E-10.6	Interrupting Capacity, kA	10	
E-10.7	Fuse Link		
	a. Type	Universal button head design	

Name of Firm

Name & Signature of Representative

Designation

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
	b. Current Rating, A	Refer to Single Line Diagram	
E-10.8	Lightning Arrester		
	a. Type	Metal Oxide Varistor (MOV), gapless	

E-11.0 KILOWATT-HOUR DEMAND METER

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
240V Single Phase, Digital Kilowatt-Hour Demand Meter			
E-11.1	Manufacturer	By Supplier	
E-11.2	Accuracy Class	Class 0.5 or Better	
E-11.3	Wire	2	
E-11.4	Current Range	Class 200	
E-11.5	Frequency, Hz	60	
E-11.6	The Kilowatt-hour meter to be provided is certified and approved by ERC	Yes	
13.8kV Three Phase, Digital Kilowatt-Hour Demand Meter			
E-11.7	Manufacturer	By Supplier	
E-11.8	Accuracy Class	Class 0.2 or Better	
E-11.9	Wire	4	
E-11.10	Voltage, V	120 - 480	
E-11.11	Current Range	Class 20	
E-11.12	Frequency, Hz	60	
E-11.13	The Kilowatt-hour meter to be provided is certified and approved by ERC	Yes	
E-11.14	Metering Transformer		
	a. Insulation type	Full cast epoxy resin	
	b. Secondary rated current for all windings, A	5	

Name of Firm

Name & Signature of Representative

Designation

SECTION III – TECHNICAL SPECIFICATIONS

LuzP22Z1435Se

ITEM	DESCRIPTION	NPC REQUIREMENTS	SUPPLIER'S DATA
	c. Accuracy class	Class 0.2 or Better	
	d. BIL, kV	110	
E-11.15	Metering Voltage Transformer		
	a. Nominal voltage of VT, kV	13.2	
	b. Rated secondary voltage, V	120	
	c. Insulation type	Full cast epoxy resin	
	d. Accuracy class	Class 0.2 or Better	
	e. BIL, kV	110	

E-12.0 SPARE PARTS AND TOOLS

ITEM	DESCRIPTION ³	QTY. ¹	UNIT PRICE	TOTAL PRICE ²
E-12.1	Generator Circuit Breaker for Generator Control & Protection Panel of 150 kW D/G Set	1 Set		
E-12.2	GCPP Module/Controller with installed software for 150 kW D/G Set	1 Set		
E-12.3	Automatic Voltage Regulator (AVR) for 150 kW D/G Set	1 Set		
E-12.4	Rotating/Revolving Diodes for 150 kW D/G Set	1 Set		
E-12.5	Telescopic Hot Stick with Tip Lock Features, Material: Epoxy glass Minimum Length: 35 ft. No. of Sections: 8	1 set		
E-12.6	Lineman's Rubber Gloves Size: 14" Maximum Usage: 17,000 Volts	2 pairs		
E-12.7	Lineman's Belt Maximum Length: 42" Minimum Length: 34" D-to-D distance: 56 cm Center Hole: 38"	1 set		
E-12.8	Positioning Strap, Nylon Maximum Length: 2.0m	1 set		

Name of Firm

Name & Signature of Representative

Designation

TERMS OF REFERENCE

SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTOLO IS, BALUD, MASBATE

SECTION III – TECHNICAL SPECIFICATIONS

LuzP22Z1435Se

ITEM	DESCRIPTION ³	QTY. ¹	UNIT PRICE	TOTAL PRICE ²
	Minimum Length: 1.3m Adjustable Range: 0.7m			
E-12.9	Heavy Duty Hard Hat with strap & NPC (Passed Safety Standard)	3 pcs		

Note:

1. Minimum requirements but the Supplier may increase the specified quantity if found not sufficient. Additional spares consumed and/or required for any repairs/replacement during the warranty period shall be provided by the Supplier at no cost to NPC.
2. Indicated Price shall be used for reference in future purchase orders.
3. The above list is preliminary which is subject to changes to conform with the final design and model/brand of the proposed equipment (per manufacturer's standard).

Name of Firm

Name & Signature of Representative

Designation

SECTION IV

BID PRICE SCHEDULE (Schedule of Requirements)

TERMS OF REFERENCE

SUPPLY, DELIVERY, INSTALLATION, TEST, AND COMMISSIONING OF 2 X 150 KW
MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT &
BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREA IN JINTOTOLO IS.,
BALUD, MASBATE

SECTION IV - SCHEDULE OF REQUIREMENTS

LuzP22Z1435Se

SECTION IV - SCHEDULE OF REQUIREMENTS (BID PRICE SCHEDULE)

BPS.1 - SUMMARY

SUPPLY, DELIVERY, INSTALLATION, TEST, AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL
EQUIPMENT & BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREA IN JINTOTOLO IS., BALUD, MASBATE

ITEM NO.	PARTICULARS	TOTAL AMOUNT IN FIGURES		TOTAL PESO EQUIVALENT
		Foreign Currency	Phil. Peso	Phil. Peso
A.	Generating Set/s			
B.	Power Transformer/s			
C.	Other Mechanical Works			
D.	Other Electrical Works			
E.	Civil and Architectural Works			
F.	Spare Parts and Standard/Special Tools			
G.	Miscellaneous Works			
TOTAL AMOUNT				

Notes: Final delivery site of all equipment/materials shall be at the plant site

Name of Bidder: _____

Signature of Bidder: _____



SECTION IV - SCHEDULE OF REQUIREMENTS

SECTION IV - SCHEDULE OF REQUIREMENTS

(BID PRICE SCHEDULE)

BPS.2 - Breakdown of Prices

2 X 150 KW JINTOTOLO DIESEL POWER PLANT

Item No.	Description of Work or Materials	QTY.- UNIT	C O D E	UNIT PRICE FOR GOODS AND RELATED SERVICES TO BE SUPPLIED FROM ABROAD				UNIT PRICE FOR GOODS AND RELATED SERVICES TO BE SUPPLIED FROM WITHIN THE PHILIPPINES			TOTAL PRICE	
				Unit Price of Goods or Services Foreign Currency ()	Import Duties & other Levies Imposed by Phil. Govt. (Phil. Peso)	Value Added Tax and other Taxes Imposed by Phil. Govt. (Phil. Peso)	Local Transport from Port to Delivery Site (Phil. Peso)	Unit Price of Goods or Services (Phil. Peso)	Value Added Tax and other Taxes Imposed by Phil. Govt. (Phil. Peso)	Local Transport from Plant to Delivery Site (Phil. Peso)	Forex Currency (E x C)	Local Currency Portion (Phil. Peso) ((F+G+H) x C) or ((I+J+K) x C)
(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)	(I)	(J)	(K)	(L)	(M)
A.	GENERATING SET(S)											
A.1	150 kW Prime Power Output Modular Diesel Generating set, 1800 RPM, In-line multi-cylinder, 480 V, 3-phase, 60 hertz, equipped with turbocharger, air to air charge air cooler, electronic governor, direct fuel injection, sound attenuated and weatherproof enclosure and complete with associated auxiliary equipment for lubricating system, engine cooling system, intake air and exhaust gas system, fuel oil supply system, starting system, controls and protection devices, instruction manuals including installation works & alignment and other accessories as described in the technical specifications.	2 Sets										
SUB-TOTAL A				(Amount in Words)								
B.	POWER TRANSFORMER(S)											
B.1	225 kVA Generator Transformer, 480V/13.8kV, 3-phase, 60 Hz complete with the required accessories, protection relays, grounding materials and other appurtenances as described in the Technical Specifications, Technical Data Sheet and as shown on the Bid Drawings including installation works.	2 Sets										
SUB-TOTAL B				(Amount in Words)								
C.	OTHER MECHANICAL WORKS											
C.1.0	Fuel oil, lubricating oil, lubricants, coolant, chemicals and other consumables required during the initial filling, start-up, pre-test and pre-commissioning including fuel oil to be used during a re-test of performance test as described in Clause GW-9.0 of the technical specifications.	1 Lot										
C.2.0	Fuel Oil Storage Tank											
C.2.1	Diesel Fuel Oil Storage Tank, 10m ³ , 2.5m diameter x 3m height, complete with tank appurtenances, vertical ladder, railings, associated piping, level gauge, nozzles, anchor bolts and other accessories including erection/installation and tests as described in the Technical Specifications and/or Drawings	1 Lot										
C.2.2	Valves, fittings, supports, sounding tape and other accessories for interconnection of fuel transfer pump and waste oil discharge to the oil-water separator required excavation and backfilling works as described in the technical specifications and shown on the bid drawings: a. Gate Valve, 65mmØ, OS & Y, cast iron, flanged ends, class 150 - 3 sets b. Gate Valve, 50mmØ, bronze or stainless steel, rising stem, flanged or screwed ends, Class 150 - 1 set c. Butterfly Valve, 150mmØ, wafer type, cast iron body, stainless shaft steel and disc, Class 150 - 1 set d. Sounding Tape - 1 set	1 Lot										
C.3.0	Fuel Unloading/Transfer Pump											
C.3.1	Fuel Oil Transfer Pump, 10m ³ /hr, 30m head, 230V, 1-phase, 60 hz, gear type, horizontal, built-in adjustable relief valve, associated piping, complete with local control panel, with anchor bolts, concrete foundation and other appurtenances as required in the Technical Specifications	1 set										
C.3.2	Valves, fittings, supports, flow meter, strainer, pressure gauge and other accessories for interconnection of fuel unloading/transfer pump to/from FOST and to/from day tanks including required excavation and backfilling works as described in the technical specifications and shown on the bid drawings: a. Simplex strainer, 65mmØ, basket type, cast iron body, stainless steel screen element with magnet, flanged ends, 60 mesh - 2 sets b. Gate Valve, 65mmØ, OS & Y, cast iron, flanged ends, Class 150 - 6 sets c. Check Valve, 65mmØ, swing type, cast iron, flanged ends, Class 150, Class 150 - 2 sets d. Pressure Gauge, 100mmØ dial gauge, bourdon tube type, with dampener and isolation valve - 2 sets e. Flowmeter, 10m ³ /hr rated flow, turbine type, cast iron body, flanged ends, 125 psi, LCD display, 0.5% accuracy with internal battery that last at least 5 years, capable of monitoring total flow and instantaneous flow rate and equipped with pulse generator ready for future interconnections - 1 set	1 Lot										
C.3.3	Spare Parts for Fuel Transfer Pump for one (1) year operation per Manufacturer's recommendation and as specified in the Technical Specifications	1 Lot										

Notes: Final delivery site of all equipment/materials shall be at the plant site stated above.

If there is a discrepancy on the numbers/units/sets/quantities between or among the technical provision and Schedule of Requirements (SOR), SOR shall prevail.

* Bidders shall enter a code representing the Country of Origin of all imported equipment, materials and accessories.

** Cost of equipment, freight, insurance, etc. up to Phil. port of entry. Refer to ITB

*** Unit Price for Local Transportation, insurance and other local costs incidental to delivery of the goods from the Phil port of entry to final delivery site

Code Country of Origin

Name of Firm

Name and Signature of Authorized Representative

Designation

SECTION IV - SCHEDULE OF REQUIREMENTS

(BID PRICE SCHEDULE)

BPS.2 - Breakdown of Prices

2 X 150 KW JINTOTOLO DIESEL POWER PLANT

Item No.	Description of Work or Materials	QTY.- UNIT	C O D E	UNIT PRICE FOR GOODS AND RELATED SERVICES TO BE SUPPLIED FROM ABROAD				UNIT PRICE FOR GOODS AND RELATED SERVICES TO BE SUPPLIED FROM WITHIN THE PHILIPPINES			TOTAL PRICE	
				Unit Price of Goods or Services Foreign Currency ()	Import Duties & other Levies Imposed by Phil. Govt. (Phil. Peso)	Value Added Tax and other Taxes Imposed by Phil. Govt. (Phil. Peso)	Local Transport from Port to Delivery Site (Phil. Peso)	Unit Price of Goods or Services (Phil. Peso)	Value Added Tax and other Taxes Imposed by Phil. Govt. (Phil. Peso)	Local Transport from Plant to Delivery Site (Phil. Peso)	Forex Currency (E x C)	Local Currency Portion (Phil. Peso) ((F+G+H) x C) or ((I+J+K) x C)
(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)	(I)	(J)	(K)	(L)	(M)
C.4.0	Fuel Oil Transfer and Waste Oil-Water Piping System											
C.4.1	Day Tank, 900 liters capacity complete with manhole, inlet and outlet nozzle, nozzles for vent, overflow, drain and level gauge/switch complete with fittings connections and other accessories as required in the technical specifications.	2 Sets										
C.4.2	Pipe, fittings, supports, valves, flow meter, pressure gauge, strainers/filters, etc. and other accessories for interconnection of fuel transfer/unloading pump to/from FOST, to/from day tanks, and to/from DG sets, including Waste oil discharge to the oil-water separator from DG set area, complete with any required excavation and backfilling works as described in the technical specifications and shown on the bid drawings: a. Globe Valve, 32mmØ, OS & Y, bronze or stainless steel, rising stem, flanged or screwed ends, Class 150 - 2 sets b. Gate Valve, 20mmØ, OS & Y, bronze or stainless steel, rising stem, flanged or screwed ends, Class 150 - 2 sets c. Gate Valve, 15mmØ, OS & Y, bronze or stainless steel, rising stem, flanged or screwed ends, Class 150 - 2 sets d. Fuel Oil Pipe, 80 mm Ø, ASTM A53, Grade B, Sch 40, seamless, complete with pipe fittings and supports, gaskets, flanges, bolts and other accessories - 6m e. Fuel Oil Pipe, 65 mm Ø, ASTM A53, Grade B, Sch 40, seamless, complete with pipe fittings and supports, gaskets, flanges, bolts and other accessories - 18m f. Fuel Oil Pipe, 50 mm Ø, ASTM A53, Grade B, Sch 40, seamless, complete with pipe fittings and supports, gaskets, flanges, bolts and other accessories - 24m g. Fuel Oil Pipe, 32 mm Ø, ASTM A53, Grade B, Sch 40, seamless, complete with pipe fittings and supports, gaskets, flanges, bolts and other accessories - 6m h. Fuel Oil Pipe, 20 mm Ø, ASTM A53, Grade B, Sch 40, seamless, complete with pipe fittings and supports, gaskets, flanges, bolts and other accessories - 12m i. Fuel Oil Pipe, 15 mm Ø, ASTM A53, Grade B, Sch 40, seamless, complete with pipe fittings and supports, gaskets, flanges, bolts and other accessories - 6m j. Asphalt Jute, 6mm thick, for embedded fuel oil piping k. Drain Pipe, 160 mm O.D. (160mm DN), uPVC pipe, Sch. 80 or class 150, conforming to ASTM-1784, & associated fittings, supports & other accessories - 6m l. Drain Pipe, 110 mm O.D. (100mm DN), uPVC pipe, Sch. 80 or class 150, conforming to ASTM-1784, & associated fittings, supports & other accessories - 24m	1 lot										
C.5.0	Air-conditioning and Ventilation System											
C.5.1	Air-conditioning Unit for Containerized Control Room, Window Inverter type, 16,000 kJ/hr cooling capacity complete with controls (infrared remote) and other necessary accessories as described in the technical specifications.	1 Set										
C.5.2	Air-conditioning Unit for Bunkhouse, Window Inverter type, 8,500 kJ/hr cooling capacity complete with controls (infrared remote) and other necessary accessories as described in the technical specifications.	1 Set										
C.5.3	Wall Mounted Exhaust Fan for Containerized Control Room, 100 m3/hr cooling capacity complete with controls and other necessary accessories as described in the technical specifications.	2 Sets										
C.6.0	Fire Fighting System											
C.6.1	Portable Fire Extinguishers, HCFC or Halotron I, 7.1 kg (15 lbs min.), non-expiry, multi shots, wall hung type, certified/ approved by the certifying body specified in Section VI, Part I, MW-7.0, with bracket and mounting accessories	3 Sets										
C.6.2	Wheeled Type Fire Extinguisher (Foam-AFFF/F3) complete with self-contained cylinder mounted on frame with handle, floorstand and steel or rubberized wheels, 125 liters (33 gallons) capacity, associated valves, dial gauge indicator, nitrogen expellant tank for unit pressurization, 15 m long discharge hose of appropriate size fitted with couplings and foam nozzle assembly, shall be in certified/ approved by the certifying body specified in Section VI, Part I, MW-7.0	1 Set										

Notes: Final delivery site of all equipment/materials shall be at the plant site stated above

If there is a discrepancy on the number/unit/sets/quantities between or among the technical provision and Schedule of Requirements (SOR), SOR shall prevail.

* Bidders shall enter a code representing the Country of Origin of all imported equipment, materials and accessories

** Cost of equipment, freight, insurance, etc. up to Phil port of entry. Refer to ITB

*** Unit Price for Local Transportation, Insurance and other local costs incidental to delivery of the goods from the Phil port of entry to final delivery site

Code	Country of Origin

Name of Firm

Name and Signature of Authorized Representative

Designation

SECTION IV - SCHEDULE OF REQUIREMENTS

SECTION IV - SCHEDULE OF REQUIREMENTS

(BID PRICE SCHEDULE)

BPS.2 - Breakdown of Prices

2 X 150 KW JINTOTOLO DIESEL POWER PLANT

Item No.	Description of Work or Materials	QTY.- UNIT	UNIT PRICE FOR GOODS AND RELATED SERVICES TO BE SUPPLIED FROM ABROAD				UNIT PRICE FOR GOODS AND RELATED SERVICES TO BE SUPPLIED FROM WITHIN THE PHILIPPINES			TOTAL PRICE	
			Unit Price of Goods or Services Foreign Currency (US\$)	Import Duties & other Levies Imposed by Phil. Govt. (Phil. Peso)	Value Added Tax and other Taxes Imposed by Phil. Govt. (Phil. Peso)	Local Transport from Port to Delivery Site (Phil. Peso)	Unit Price of Goods or Services (Phil. Peso)	Value Added Tax and other Taxes Imposed by Phil. Govt. (Phil. Peso)	Local Transport from Plant to Delivery Site (Phil. Peso)	Forex Currency (E x C)	Local Currency Portion (Phil. Peso) ((F+G+H) x C) or ((I+J+K) x C)
(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)	(I)	(J)	(K)	(L)
C.7.0	Domestic Water System										
C.7.1	Well Drilling and Development System Well Drilling, Well Development, Pumping Test and Disinfection, complete with 50 mm Ø casing and 32mm suction pipe conforming to ASTM A53, Gr. B, Sch. 40 hot-dip galvanized & other accessories as described in the Technical Specifications	1 Lot									
C.7.2	Water Tank, 600 liters capacity, polyethylene, complete with nozzles, manhole, inlet and outlet nozzles, supports, overflow and drain nozzles with pipes, valves, pipe structural steel supports with anchor bolts on foundation and access ladder and other accessories as required in the technical specifications.	1 Set									
C.7.3	Hand pump Jermatic, 2 gpm min. flow, reciprocating type, cast iron body complete with foot valves, fittings, supports, concrete pad and other accessories as described in the technical specifications	1 Set									
C.7.4	Domestic water pipe, fittings, supports, valves and other accessories for interconnection of the supplied equipment including required excavation and backfilling works; test and disinfection as described in the technical specifications and shown on the bid drawings: a. Gate Valve, 25 mm Ø, cast bronze, screwed ends, rising stem, Class 150 (1 Set) b. Gate Valve, 20 mm Ø, cast bronze, screwed ends, rising stem, Class 150 (2 Sets) c. Gate Valve, 15 mm Ø, cast bronze, screwed ends, rising stem, Class 150 (2 Sets) d. Hose Bibb, 20 mm Ø, bronze body, screwed ends, Class 150 (3 Sets) e. Water Pipe, 32 mm O.D. (25 mm N.D.), uPVC pipe, sch 80 or Class 150, and its associated fittings, pipe supports and other accessories - 18m f. Water Pipe, 25 mm O.D. (20 mm N.D.), uPVC pipe, sch 80 or Class 150, and its associated fittings, pipe supports and other accessories - 32m g. Water Pipe, 20 mm O.D. (15 mm N.D.), uPVC pipe, sch 80 or Class 150, and its associated fittings, pipe supports and other accessories - 6m	1 Lot									
C.8	Smoke stack/pipe, insulation and associated structural steel supports (as applicable)	1 Lot									
	SUB-TOTAL C		(Amount in Words)								
D.	OTHER ELECTRICAL WORKS										
D.1	Generator Control and Protection Panel complete with the required metering, monitoring, control and protection devices, synchronizing, circuit breaker and other appurtenances as described in the Technical Specifications, Technical Data Sheet and as shown on the Bid Drawings including installation works in the Containerized Control Room.	2 Set(s)	PRICE OF THIS ITEM SHALL BE INCLUDED IN ITEMS A.1 ABOVE								
D.2	20 kVA Station Service Transformer, 7.97KV/240 V, 1-phase, 60 Hz complete with the required accessories and other appurtenances as described in the Technical Specifications, Technical Data Sheet and as shown on the Bid Drawings including installation works.	1 Set									
D.3	15kV Automatic Circuit Recloser complete with the required accessories and other appurtenances as described in the Technical Specifications, Technical Data Sheet and as shown on the Bid Drawings including installation works.	1 Set									
D.4	13.8kV Kilowatt-Hour Demand Meter complete with its instrument transformers and other accessories as described in the Technical Specifications, Technical Data Sheet and as shown on the Bid Drawings including installation works.	1 Lot									
D.5	240V Kilowatt-Hour Demand Meter complete with its accessories as described in the Technical Specifications, Technical Data Sheet and as shown on the Bid Drawings incl. installation works.	1 Lot									
D.6	15kV Fuse Disconnect Switch with Lightning Arrestor Combination complete with the required fuse link, brackets and accessories as described in the Technical specifications and Technical Data Sheets as shown on the Bid Drawings including installation works.	1 Lot									
D.7	Power, Control & Instrumentation Cables complete with the required accessories for cabling works to interface the supplied equipment to the 13.8kV bus as described in the Technical Specifications, Technical Data Sheet and as shown on the Bid Drawings including installation works.	1 Lot									
D.8	Electrical conduits and fittings required for cabling works as described in the Technical Specifications, Technical Data Sheets and as shown on the Bid Drawings including installation works.	1 Lot									

Notes: Final delivery site of all equipment/materials shall be at the plant site stated above.

If there is a discrepancy on the numbers/units/sets/quantities between or among the technical provision and Schedule of Requirements (SOR), SOR shall prevail.

• Bidders shall enter a code representing the Country of Origin of all imported equipment, materials and accessories.

** Cost of equipment, freight, insurance, etc. up to Phil. port of entry. Refer to ITB

*** Unit Price for Local Transportation, insurance and other local costs incidental to delivery of the goods from the Phil port of entry to final delivery site

Code	Country of Origin

SECTION IV - SCHEDULE OF REQUIREMENTS

SECTION IV - SCHEDULE OF REQUIREMENTS

(BID PRICE SCHEDULE)

BPS.2 - Breakdown of Prices

2 X 150 KW JINTOTULO DIESEL POWER PLANT

Item No.	Description of Work or Materials	QTY.- UNIT	C O D E	UNIT PRICE FOR GOODS AND RELATED SERVICES TO BE SUPPLIED FROM ABROAD				UNIT PRICE FOR GOODS AND RELATED SERVICES TO BE SUPPLIED FROM WITHIN THE PHILIPPINES			TOTAL PRICE	
				Unit Price of Goods or Services Foreign Currency () ^{***}	Import Duties & other Levies Imposed by Phil. Govt. (Phil. Peso)	Value Added Tax and other Taxes Imposed by Phil. Govt. (Phil. Peso)	Local Transport from Port to Delivery Site *** (Phil. Peso)	Unit Price of Goods or Services (Phil. Peso)	Value Added Tax and other Taxes Imposed by Phil. Govt. (Phil. Peso)	Local Transport from Plant to Delivery Site *** (Phil. Peso)	Forex Currency (E x C)	Local Currency Portion (Phil. Peso ((F+G+H) x C) or ((I+J+K) x C)
(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)	(I)	(J)	(K)	(L)	(M)
D.	OTHER ELECTRICAL WORKS											
D.9	Take-Off Structure complete with the required steel poles, cross arms, braces, bus conductor, line and materials/hardware, lightning protection, termination kit and other accessories as described in Technical Specifications, Technical Data Sheet and as shown on the Bid Drawings including installation works.	1 Lot										
D.10	Grounding System complete with the required grounding grid conductor, equipment bonding riser, exothermic welding materials, test pit, ground rods and other accessories as described in the Technical Specifications and Technical Data Sheets as shown on the Bid Drawings including installation works.	1 Lot										
D.11	Lighting and power system of the plant site complete with the required panelboard, lighting fixtures, switches, outlets, cables, conduits, boxes and other fittings as described in the Technical Specifications and as shown on the Bid Drawings including installation works.	1 Lot										
	SUB-TOTAL D			(Amount in Words)								
E.	CIVIL WORKS AND ARCHITECTURAL WORKS											
E.1	Site Development											
E.1.1	Earth Works											
a.	Clearing and Grubbing	1 lot										
b.	Grading Fill	480 cu.m										
c.	Gravel Surfacing (Genset/Switchyard Area)	22 cu.m										
E.1.2	Drainage System/Appurtenant Structures											
a.	Reinforced Concrete Drainage Pipe	120 l.m										
b.	uPVC Pipe	40 l.m										
c.	Drain Pit	2 sets										
d.	Septic Tank	2 sets										
e.	Surface Inlet Manhole	8 sets										
E.1.3	Roadway											
a.	Concrete Walkway & Concrete Ramp	9 cu.m										
E.1.4	Fence including gate											
a.	Perimeter Fence	160 l.m										
b.	Secusion Fence	34 l.m										
E.2	Design and Construct (including anchor bolts and other relevant accessories shown in the Bid Drawings)											
a.	Concrete foundation for 2 gensets including drain ditch and all other relevant items shown in the drawing	1 lot										
b.	Concrete foundation for 2 sets of transformer	1 lot										
E.3	Other Structures and Facilities											
a.	Pre-Fabricated Containerized House (3m x 6m)	2 sets										
b.	Hazardous Waste & Solid Waste Storage Facility (4m x 6.5m)	1 lot										
c.	Guard Post (1.65m x 1.65m)	1 lot										
d.	Water Tank Support Structure	1 lot										
e.	Day Tank Support Structure	1 lot										
f.	F.O.S.T. foundation, containment wall, drain pit, valve box and other relevant items shown in the bid drawings and indicated in the technical specifications	1 lot										
g.	Perimeter Lighting Foundation	9 pc										
h.	CHB Zocalo Wall for Genset Area	37 l.m										
i.	Oil Water Separator (1.9m x 2.5m)	1 set										
j.	Pumphouse (1.5m x 2m)	1 lot										
k.	Flagpole	1 set										
	SUB-TOTAL E			(Amount in Words)								

Notes: Final delivery site of all equipment/materials shall be at the plant site stated above.
 If there is a discrepancy on the number/units/sets/quantities between or among the technical provision and Schedule of Requirements (SOR), SOR shall prevail.
 * Bidders shall enter a code representing the Country of Origin of all imported equipment, materials and accessories.
 ** Cost of equipment, freight, insurance, etc. up to Phil. port of entry. Refer to ITB.
 *** Unit Price for Local Transportation, insurance and other local costs incidental to delivery of the goods from the Phil port of entry to final delivery site.

Name of Firm

Name and Signature of Authorized Representative

Designation

SECTION IV - SCHEDULE OF REQUIREMENTS

SECTION IV - SCHEDULE OF REQUIREMENTS

(BID PRICE SCHEDULE)

BPS.2 - Breakdown of Prices

2 X 150 KW JINTOTULO DIESEL POWER PLANT

Item No.	Description of Work or Materials	QTY.- UNIT	C D E	UNIT PRICE FOR GOODS AND RELATED SERVICES TO BE SUPPLIED FROM ABROAD				UNIT PRICE FOR GOODS AND RELATED SERVICES TO BE SUPPLIED FROM WITHIN THE PHILIPPINES			TOTAL PRICE	
				Unit Price of Goods or Services Foreign Currency () ¹	Import Duties & other Levies Imposed by Phil. Govt. (Phil. Peso)	Value Added Tax and other Taxes Imposed by Phil. Govt. (Phil. Peso)	Local Transport from Port to Delivery Site *** (Phil. Peso)	Unit Price of Goods or Services (Phil. Peso)	Value Added Tax and other Taxes Imposed by Phil. Govt. (Phil. Peso)	Local Transport from Plant to Delivery Site *** (Phil. Peso)	Forex Currency (E x C)	Local Currency Portion (Phil. Peso) ((F+G+H) x C) or ((I+J+K) x C)
(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)	(I)	(J)	(K)	(L)	(M)
F.	SPARE PARTS AND SPECIAL/STANDARD TOOL											
F.1	MECHANICAL											
F.1.1	Spare Parts per Unit of 150 kW Diesel Genset During the Warranty Period (M-4.1: Part II - Technical Data Sheets, Mechanical Works of the Technical Specification)											
a.	Air Filter Element (6 pcs/size)	2 lots										
b.	Lube Oil Filter Element (30 pcs/size)	2 lots										
c.	Fuel Filter Element (15 pcs/size)	2 lots										
d.	Water Filter Element, (6 pcs/size)	2 lots										
e.	Fan Belt (3 pcs/size)	2 lots										
f.	Alternator Belt (3 pcs/size)	2 lots										
g.	Coolant (4 Gallon)	2 lots										
h.	Expected spares to be consumed during the performance test	2 lots										
i.	Other spare parts recommended by Manufacturer	2 lots										
F.1.2	Spare Parts per Total Units of 150 kW Generating Sets Supplied and Delivered (M-4.2: Part II - Technical Data Sheets, Mechanical Works of the Technical Specification)											
a.	Fuel Injector Assembly	2 Pcs										
b.	Top Overhauling Kit	1 Set										
c.	Actuator	1 Set										
d.	Jackel Water Pump Repair Kit	1 Set										
e.	Lube Oil Pump Repair Kit	1 Set										
f.	Fan Adaptor & Accessories including Bearings	2 Sets										
g.	Rocker Gear Cover Gasket	12 Pcs										
h.	Thermostat	1 Set										
i.	Lub Oil Pump Switch	1 Set										
j.	Hot Water Temp. Switch	1 Set										
k.	Turbocharger Repair Kit	1 Set										
l.	Exhaust Manifold Bellow	1 Set										
m.	Magnetic Pick-up	1 Pcs										
n.	Other spare parts recommended by Manufacturer	1 Lot										
F.1.3	Manufacturer's Special/Standard Tools											
F.1.3.1	Standard/Special Tools per Total Units Gensets to be Supplied and Delivered (M-5.1: Part II - Technical Data Sheets, Mechanical Works of the Technical Specification)											
a.	Portable computer (Minimum of Intel i7 Processor, 16GB (1x16GB) DDR4 2666 MHZ, 256 GB PCIe NVMe SSD +1TB SATA 5400RPM 2.5" Inch, 13"-15.6" screen size & with the latest pre-installed windows operating system compatible with manufacturer's/for Supplier's software) needed in programming the genset control setting (complete with licensed CD-ROM drive dongles of genset control system) and electronic/digital governing system including other digital components that require exclusive programs from the Manufacturer and/or Supplier with free update throughout the operating life of the genset	1 Set										
b.	Puller, Cylinder Liner	1 Set										
c.	Puller, Generator Bearing	1 Set										
d.	Puller, Injector Sleeve	1 Set										
e.	Extractor, Valve Seat	1 Set										
f.	Extractor, Piston Ring	1 Set										
g.	Extractor, Valve Guide	1 Set										
h.	Extractor, Valve Spring	1 Set										
i.	Expander, Injector Sleeve	1 Set										
j.	Roamer, Injector Sleeve	1 Set										
k.	Collimator, Injector (Range 0-500 bars)	1 Set										
l.	Feeler Gauge	1 Set										
m.	Special tools for overhauling and re-assembly of turbocharger	1 Set										
n.	Cleaning nozzle for cleaning of turbocharger	1 Set										
o.	Special tools for maintenance and cleaning of radiators and fans	1 Set										
p.	Mechanical Torque Wrench with click type or dial type torque measurement indicators for cylinder head, main and guide bearing, connecting rod and all engine components utilizing bolt and nut as locking medium	1 set										
q.	Single and double open-end spanner	1 Set										

Notes: Final delivery site of all equipment/materials shall be at the plant site stated above

If there is a discrepancy on the number/units/sets/quantities between or among the technical provision and Schedule of Requirements (SOR), SOR shall prevail.

Bidders shall enter a code representing the Country of Origin of all imported equipment, materials and accessories

Cost of equipment, freight, insurance, etc. up to Phil. port of entry. Refer to ITB

Unit Price for Local Transportation, insurance and other local costs incidental to delivery of the goods from the Phil port of entry to final delivery site

Code	Country of Origin

Name of Firm

Name and Signature of Authorized Representative

Designation

SECTION IV - SCHEDULE OF REQUIREMENTS

SECTION IV - SCHEDULE OF REQUIREMENTS

(BID PRICE SCHEDULE)

BPS.2 - Breakdown of Prices

2 X 150 KW JINTOTOLLO DIESEL POWER PLANT

Item No.	Description of Work or Materials	QTY.- UNIT	C O D E	UNIT PRICE FOR GOODS AND RELATED SERVICES TO BE SUPPLIED FROM ABROAD				UNIT PRICE FOR GOODS AND RELATED SERVICES TO BE SUPPLIED FROM WITHIN THE PHILIPPINES			TOTAL PRICE	
				Unit Price of Goods or Services Foreign Currency () **	Import Duties & other Levies Imposed by Phil. Govt. (Phil. Peso)	Value Added Tax and other Taxes Imposed by Phil. Govt. (Phil. Peso)	Local Transport from Port to Delivery Site *** (Phil. Peso)	Unit Price of Goods or Services (Phil. Peso)	Value Added Tax and other Taxes Imposed by Phil. Govt. (Phil. Peso)	Local Transport from Plant to Delivery Site *** (Phil. Peso)	Forex Currency (E x C)	Local Currency Portion (Phil. Peso) ((F+G+H) x C) or ((I+J+K) x C)
(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)	(I)	(J)	(K)	(L)	(M)
F.1.3.1	Standard/Special Tools per Total Units Gensets to be Supplied and Delivered (M-5.1: Part II - Technical Data Sheets, Mechanical Works of the Technical Specification) Cont'd...											
r.	Injector timing gauge	1 Pc										
s.	Standard/special tools necessary for overhauling and re-assembly of engine which are not mentioned above	1 Set										
t.	Other standard tools recommended by the Manufacturer	1 Lot										
F.1.3.2	Miscellaneous Tool (M-5.2: Part II - Technical Data Sheets, Mechanical Works of the Technical Specification)											
a.	Hoist, hand chain, 2 tons capacity, 3 meters lift	1 Unit										
b.	Wrench, combination, 13 pcs/set	1 Set										
c.	Wrench, open, 8 pcs/set	1 Set										
d.	Wrench box, 7 pcs/set	1 Set										
e.	Wrench, socket, 17 pcs/set	1 Set										
f.	Wrench, adjustable, chrome vanadium steel, drop forged, fine polished, heavy duty, sizes: 8, 10 & 12"	1 Set										
g.	Wrench, pipe, forged steel, heavy duty, sizes: 12 & 14"	1 Set										
h.	Wrench, torque, 0-500 Nm	1 Pc										
i.	Plier, combination, sizes: 6, 7 & 8"	1 Set										
j.	Plier, long nose, sizes: 6 & 8"	1 Set										
k.	Screw driver, 6 pcs/set	1 Set										
l.	Vise, size 6" swivel type, pre drilled holes for mounting	1 Pc										
m.	Caliper, digimatic, measuring range: 0-150mm, accuracy: +/- 0.02mm	1 Pc										
n.	Micrometer, outside deviation within: +/- 0.01 mm, heavy duty	1 Pc										
o.	Drill, Electric, 13mm hammer drill, 220 V, 60 Hz, 710 W, 3.2a, reversible, with hammer, lock-on button and bit box	1 Pc										
p.	Bit, drill, 70 pcs/set, includes 3 position ratcheting hand drive, brad point bits-wood, twist drill bits - metal/wood/plastic/masonry	1 Set										
q.	Grinder, angle, heavy duty, 220 V, 60 Hz, 750 W, 1200 rpm, single phase, variable speed	1 Set										
r.	Tester, Multi, Digital	1 Pc										
s.	Meter, Clamp, Digital	1 Pc										
t.	Tester, Megger (0-1000)	1 Pc										
u.	Allen Wrench	1 Set										
v.	Hammer - ball & claw (2 pcs each type)	1 Set										
w.	Filter Wrench	1 Pc										
x.	Tongue & Groove Pliers (10")	1 Pc										
y.	Precision Screwdrivers (long type)	1 Set										
z.	Grease gun	1 Pc										
aa.	Locker Cabinet with 8 compartment with lock keys and ball rollers	1 Set										
bb.	Tool box, heavy duty, 535mm x 250mm x 239 mm (or as required to contain all the standard/special and miscellaneous Tools)	1 Set										
cc.	Other tools recommended by the Manufacturer	1 Lot										
F.1.3.3	Miscellaneous Equipment and Materials (MW-9.0)											
F.1.3.3a	Four Wheel Drum Truck (210 liter capacity)	1 pc.										
F.1.3.3b	Clock (10" diameter)	1 set										
F.1.3.3c	Steel Cabinet locker, 60 x 45 x 140 cm galvalum materials	1 set										
F.1.3.3d	Office Table and Chairs (Standard size table, 3 drawers with lock keys and 2 chairs with roller balls)	1 set										
F.1.3.3e	Ear muff, fluid filled high attenuation	10 sets										
F.1.3.3f	Lube Oil requirement (for the next lube oil change)	80 liters										
F.1.3.3g	Flash Light and head light with rechargeable AA battery, halogen bulb, LED light	1 set										
F.1.3.3h	Automatic Rechargeable Emergency Light	1 set										

Notes: Final delivery site of all equipment/materials shall be at the plant site stated above.

If there is a discrepancy on the numbers/units/sets/quantities between or among the technical provision and Schedule of Requirements (SOR), SOR shall prevail.

• Bidders shall enter a code representing the Country of Origin of all imported equipment, materials and accessories

** Cost of equipment, freight, insurance, etc. up to Phil. port of entry. Refer to ITB

*** Unit Price for Local Transportation, insurance and other local costs incidental to delivery of the goods from the Phil port of entry to final delivery site

Code	Country of Origin

Name of Firm

Name and Signature of Authorized Representative

Designation

SECTION IV - SCHEDULE OF REQUIREMENTS

SECTION IV - SCHEDULE OF REQUIREMENTS

(BID PRICE SCHEDULE)

BPS.2 - Breakdown of Prices

2 X 150 KW JINTOTULO DIESEL POWER PLANT

Item No.	Description of Work or Materials	QTY.- UNIT	C O D E	UNIT PRICE FOR GOODS AND RELATED SERVICES TO BE SUPPLIED FROM ABROAD				UNIT PRICE FOR GOODS AND RELATED SERVICES TO BE SUPPLIED FROM WITHIN THE PHILIPPINES			TOTAL PRICE	
				Unit Price of Goods or Services Foreign Currency () **	Import Duties & other Levies Imposed by Phil. Govt. (Phil. Peso)	Value Added Tax and other Taxes Imposed by Phil. Govt. (Phil. Peso)	Local Transport from Port to Delivery Site *** (Phil. Peso)	Unit Price of Goods or Services (Phil. Peso)	Value Added Tax and other Taxes Imposed by Phil. Govt. (Phil. Peso)	Local Transport from Plant to Delivery Site *** (Phil. Peso)	Foreign Currency (E x C)	Local Currency Portion (Phil. Peso) ((F+G+H) x C) or ((I+J+K) x C)
(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)	(I)	(J)	(K)	(L)	(M)
F.1.3.3	Miscellaneous Equipment and Materials (MW-9.0) (Cont'd...)											
F.1.3.3	Electricians First Aid Kit (Plastic case filled specifically to meet the needs of the electricians most common injuries – burns, eye irritations, cuts and insect bites) consists of the ff: a. Adhesive bandages, plastic 1 x 3 - 16 pcs b. Burn Ointment 1/8 oz - 6 pcs c. Cold Pack, Instant - 4 d. Eye wash Solution, Eye pads & Strips - 7 e. Tweezers - 4 f. Latex Gloves, Pair - 1 box g. PVP Iodine Wipes - 10 pcs h. Scissors, 4" blunt - 1 pc i. Sting Kill Swabs - 4 pcs j. Triangular Bandage - 4 pcs k. First Aid Guide - 1 pc	1 set										
F.1.3.3	Diesel Fuel including plastic drum	800 liters										
F.1.3.3	Hard Hat with NPC logo, white color	5 sets										
F.1.3.3	Plastic table and 4-chair (monoblock)	1 set										
F.1.4.1	SPARE PARTS (E-5.0 of Part II - Technical Data Sheet, Electrical Works of the Technical Specifications)											
F.1.4.1a	Generator Circuit Breaker for Generator Control and Protection Panel (GCPP)	1 Set										
F.1.4.1b	Telescopic Hot Stick with Tip Lock Features Material: Epoxyglass, Minimum Length: 35 ft., No. of Sections: 8	1 Set										
F.1.4.1c	Lineman's Rubber Gloves, Size: 14", Maximum Usage: 17,000 Volts	2 Pair										
F.1.4.1d	Lineman's Belt, Maximum Length: 42", Minimum Length: 34", D-to-D distance: 58 cm, Center Hole: 38"	1 Set										
F.1.4.1e	Positioning Strap, Nylon, Maximum Length: 2.0m, Minimum Length: 1.3m, Adjustable Range: 0.7m	1 Set										
F.1.4.1f	Heavy Duty Hard Hat with strap (Passed Safety Standard)	3 Pcs										
	SUB-TOTAL F											
G.	MISCELLANEOUS WORKS											
G.1	Job Site Cameras, complete with all the necessary accessories and peripherals, spare / tools, installation and testing for the proper operation and maintenance in accordance with the Specifications and Technical Data Sheets for the provision of the following: a) Construction Cameras (2 Sets), complete with the required accessories and peripherals; and, b) SDHC Memory Cards, complete with the required storage capacity and spares; and, c) Alkaline Batteries, complete with the required quantities and spares.	1 Lot										
G.2	Tagging and/or Labels for Equipment, Tanks, Valves, Piping, Instruments and its fixing accessories as described in the bid documents or shown on the drawings.	1 Lot										
G.3	Painting for tanks, fuel oil piping & equipment, water piping, waste oil piping, its associated valves, fittings, supports and other accessories including touch-up for factory painted equipment and accessories as described in the technical specifications or shown on the drawings.	1 Lot										
G.4	Conduct training at site of at least four (4) NPC personnel to be conducted by expert/s who are knowledgeable & trained by the genset manufacturer or his authorized distributor incl. equipment auxiliaries.	1 Lot										
G.5	Conduct Testing & Commissioning incl. test instruments & other services as described in the technical specifications.	1 Lot										
	SUB-TOTAL G											
	GRAND TOTAL											

Notes: Final delivery site of all equipment/materials shall be at the plant site stated above.
If there is a discrepancy on the numbers/units/sets/quantities between or among the technical provision and Schedule of Requirements (SOR), SOR shall prevail.

* Bidders shall enter a code representing the Country of Origin of all imported equipment, materials and accessories

** Cost of equipment, freight, insurance, etc. up to Phil. port of entry. Refer to ITB

*** Unit Price for Local Transportation, insurance and other local costs incidental to delivery of the goods from the Phil port of entry to final delivery site

Code	Country of Origin

SECTION V

BIDDING FORMS

SECTION V – BIDDING FORMS

TABLE OF CONTENTS

NPCSF-GOODS-01	- Checklist of Technical and Financial Envelope Requirements for Bidders
NPCSF-GOODS-02	- List of all Ongoing Government & Private Contracts Including Contracts Awarded but not yet Started
NPCSF-GOODS-03	- Statement of the bidder's Single Largest Completed Contract (SLCC) similar to the contract to be bid
NPCSF-GOODS-04	- Computation of Net Financial Contracting Capacity (NFCC)
NPCSF-GOODS-05	- Joint Venture Agreement
NPCSF-GOODS-06	- <i>NOT USED</i>
NPCSF-GOODS-07	- Omnibus Sworn Statement (Revised)
NPCSF-GOODS-08	- Bid Letter
Sample Form	- Bank Guarantee Form for Advance Payment
Sample Form	- Certification from DTI as Domestic Bidder

Standard Form No: NPCSF-GOODS-01

Checklist of Technical & Financial Envelope Requirements for Bidders**A. THE 1ST ENVELOPE (TECHNICAL COMPONENT) SHALL CONTAIN THE FOLLOWING:****1. ELIGIBILITY DOCUMENTS****a. (CLASS A)**

- PhilGEPs Certificate of Registration and Membership under Platinum Category (all pages) in accordance with Section 8.5.2 of the Revised IRR of RA. 9184;

Note: The failure by the prospective bidder to update its Certificate with the current and updated Class "A" eligibility documents shall result in the automatic suspension of the validity of its Certificate until such time that all of the expired Class "A" eligibility documents has been updated

- Statement of all its ongoing government and private contracts if any, whether similar or not similar in nature and complexity to the contract to be bid (NPCSF-GOODS-02)
- The Statement of the bidder's Single Largest Completed Contract (SLCC) similar to the contract to be bid, and whose value, adjusted to current prices using the Philippine Statistics Authority (PSA) consumer price index, must be at least 25% of the ABC (NPCSF-GOODS-03) complete with the following supporting documents:

1. Certificate of Acceptance; or Certificate of Completion; or Official Receipt (O.R); or Sales Invoice

(The Single Largest Completed Contract (SLCC) as declared by the bidder shall be verified and validated to ascertain such completed contract. Hence, bidders must ensure access to sites of such projects/equipment to NPC representatives for verification and validation purposes during post-qualification process.

It shall be a ground for disqualification, if verification and validation cannot be conducted for reasons attributable to the Bidder.)

- Duly signed computation of its Net Financial Contracting Capacity (NFCC) at least equal to the ABC (NPCSF-GOODS-04) or a Committed Line of Credit (CLC) at least equal to ten percent (10%) of the ABC, issued by a Universal or Commercial Bank; If the Bidder opted to submit a Committed Line of Credit (CLC), the bidder must submit a granted credit line valid/effective at the date of bidding.

b. (CLASS B)

- For Joint Venture (if applicable), any of the following:

- Valid Joint Venture Agreement (NPCSF-GOODS-05)

OR

- Notarized statements from all the potential joint venture partners stating that they will enter into and abide by the provisions of the JVA, if awarded the contract

- Certification from the relevant government office of their country stating that Filipinos are allowed to participate in their government procurement activities for the same item/product (For foreign bidders claiming eligibility by reason of their country's extension of reciprocal rights to Filipinos)

Standard Form No: NPCSF-GOODS-01

2. Technical Documents

- Duly signed, completely filled-out and notarized Omnibus Sworn statement (Revised) (NPCSF-GOODS-07), complete with the following attachments:
 - For Sole Proprietorship:
 - Special Power of Attorney
 - For Partnership/Corporation/Cooperative/Joint Venture:
 - Document showing proof of authorization (e.g., duly notarized Secretary's Certificate, Board/Partnership Resolution, or Special Power of Attorney, whichever is applicable)
- Drawings & Documents to be submitted with the Proposal as specified in Sections M-1.0, M-2.0, Annexes A.1 to A.3 for Mechanical Works and Sections E-1.0 and E-2.0 for Electrical Works, Section III – Part II Technical Data Sheets
- Complete eligibility documents of the proposed subcontractor, if any

B. THE 2ND ENVELOPE (FINANCIAL COMPONENT) SHALL CONTAIN THE FOLLOWING:

- Duly signed Bid Letter indicating the total bid amount in accordance with the prescribed form (NPCSF-GOODS-08)
- Duly signed and completely filled-out Schedule of Requirement (Section IV) indicating the unit and total prices per item and the total amount in the prescribed Price Schedule form.
- For Domestic Bidder claiming for domestic preference:
 - Letter address to the BAC claiming for preference
 - Certification from DTI as Domestic Bidder in accordance with the prescribed forms provided

CONDITIONS:

1. Each Bidder shall submit Two (2) copies of the first and second components of its Bid, marked Original and photocopy. Only the original copy will be read and considered for the bid. Any misplaced document outside of the Original copy will not be considered. The photocopy is ONLY FOR REFERENCE. NPC may request additional hard copies and/or electronic copies of the Bid. However, failure of the Bidders to comply with the said request shall not be a ground for disqualification..
2. A Bidder not submitting bid for reason that his cost estimate is higher than the ABC, is required to submit his letter of non-participation/regret supported by corresponding detailed estimates. Failure to submit the two (2) documents shall be understood as acts that tend to defeat the purpose of public bidding without valid reason as stated under Section 69.1.(i) of the revised IRR of R.A. 9184.

TERMS OF REFERENCE

SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT & BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREA IN JINTOTOLO IS., BALUD, MASBATE

SECTION V – BIDDING FORMS

LuzP22Z1435Se

Standard Form Number: NPCSF-GOODS-02

List of All Ongoing Government and Private Contracts Including Contract Awarded But Not Yet Started

Business Name : _____

Business Address : _____

Name of Contract/ Project Cost	a. Owner's Name b. Address c. Telephone Nos.	Nature of Work	Bidder's Role		a. Date Awarded b. Date Started c. Date of Completion or Contract Duration/ Date of Delivery	Value of Outstanding Works / Undelivered Portion
			Description	%		
Government						
Private						
Total Cost						

The bidder shall declare in this form all his on-going government and private contracts including contracts where the bidder (either as individual or as a Joint Venture) is a partner in a Joint Venture agreement other than his current joint venture where he is a partner. Non declaration will be a ground for disqualification of bid.

Note : This statement shall be supported with the following documents for all the contract(s) stated above which shall be submitted during Post-qualification:

1. Contract/Purchase Order and/or Notice of Award
2. Certification coming from the project owner/client that the performance is satisfactory as of the bidding date.

Submitted by : _____
(Printed Name & Signature)

Designation : _____

Date : _____

TERMS OF REFERENCE

SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT & BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREA IN JINTOTOLO IS., BALUD, MASBATE

SECTION V – BIDDING FORMS

LuzP22Z1435Se

Standard Form Number: NPCSF-GOODS-03

The Statement of the bidder's Single Largest Completed Contract (SLCC) similar to the contract to be bid

Business Name : _____
 Business Address : _____

Name of Contract	a. Owner's Name b. Address c. Telephone Nos.	Nature of Work	Contractor's Role		a. Amount at Award b. Amount at Completion c. Duration	a. Date Awarded b. Contract Effectivity c. Date Completed
			Description	%		

- Notes: 1. The bidder must state only one (1) Single Largest Completed Contract (SLCC) similar to the contract to be bid.
 2. Supporting documents such as any of the following: Certificate of Acceptance; or Certificate of Completion; or Official Receipt (O.R); or Sales Invoice for the contract stated above shall be submitted during Bid Opening.

Submitted by : _____
 (Printed Name & Signature)
 Designation : _____
 Date : _____

Standard Form Number: NPCSF-GOODS-04

NET FINANCIAL CONTRACTING CAPACITY (NFCC)

- A. Summary of the Supplier's/Distributor's/Manufacturer's assets and liabilities on the basis of the income tax return and audited financial statement for the immediately preceding calendar year are:

		Year 20__
1.	Total Assets	
2.	Current Assets	
3.	Total Liabilities	
4.	Current Liabilities	
5.	Net Worth (1-3)	
6.	Net Working Capital (2-4)	

- B. The Net Financial Contracting Capacity (NFCC) based on the above data is computed as follows:

NFCC = [(Current assets minus current liabilities) x 15] minus the value of all outstanding or uncompleted portions of the projects under ongoing contracts, including awarded contracts yet to be started coinciding with the contract for this Project.

NFCC = P _____

Herewith attached is certified true copy of the audited financial statement, stamped "RECEIVED" by the BIR or BIR authorized collecting agent for the immediately preceding calendar year.

Submitted by:

Name of Supplier / Distributor / Manufacturer

Signature of Authorized Representative

Date : _____

Standard Form Number: NPCSF-GOODS-05

JOINT VENTURE AGREEMENT**KNOW ALL MEN BY THESE PRESENTS:**

That this JOINT VENTURE AGREEMENT is entered into by and between:
_____, of legal age, *(civil status)* _____, authorized representative of
_____ and a resident of _____.

- and -

_____, of legal age, *(civil status)* _____, authorized representative of
_____ a resident of _____.

That both parties agree to join together their capital, manpower, equipment, and other resources and efforts to enable the Joint Venture to participate in the Bidding and Undertaking of the hereunder stated Contract of the **National Power Corporation**.

NAME OF PROJECT**CONTRACT AMOUNT**

That the capital contribution of each member firm:

NAME OF FIRM	CAPITAL CONTRIBUTION
1. _____	P _____
2. _____	P _____

That both parties agree to be jointly and severally liable for their participation in the Bidding and Undertaking of the said contract.

That both parties agree that _____ and/or _____ shall be the Official Representative/s of the Joint Venture, and are granted full power and authority to do, execute and perform any and all acts necessary and/or to represent the Joint Venture in the Bidding and Undertaking of the said contract, as fully and effectively and the Joint Venture may do and if personally present with full power of substitution and revocation.

That this Joint Venture Agreement shall remain in effect only for the above stated Contract until terminated by both parties.

Name & Signature of Authorized Representative

Official Designation

Name of Firm

Name & Signature of Authorized Representative

Official Designation

Name of Firm

Witnesses

1. _____

2. _____

[Jurat]

[Format shall be based on the latest Rules on Notarial Practice]

Standard Form No: NPCSF-GOODS-07

Omnibus Sworn Statement (Revised)**REPUBLIC OF THE PHILIPPINES)**
CITY/MUNICIPALITY OF _____) S.S.**AFFIDAVIT**

I, [Name of Affiant], of legal age, [Civil Status], [Nationality], and residing at [Address of Affiant], after having been duly sworn in accordance with law, do hereby depose and state that:

1. *[Select one, delete the other:]*

[If a sole proprietorship:] I am the sole proprietor or authorized representative of [Name of Bidder] with office address at [address of Bidder];

[If a partnership, corporation, cooperative, or joint venture:] I am the duly authorized and designated representative of [Name of Bidder] with office address at [address of Bidder];

2. *[Select one, delete the other:]*

[If a sole proprietorship:] As the owner and sole proprietor, or authorized representative of [Name of Bidder], I have full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for [Name of the Project] of the [Name of the Procuring Entity], as shown in the attached duly notarized Special Power of Attorney;

[If a partnership, corporation, cooperative, or joint venture:] I am granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for [Name of the Project] of the [Name of the Procuring Entity], as shown in the attached [state title of attached document showing proof of authorization (e.g., duly notarized Secretary's Certificate, Board/Partnership Resolution, or Special Power of Attorney, whichever is applicable)];

3. [Name of Bidder] is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government/foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board, by itself or by relation, membership, association, affiliation, or controlling interest with another blacklisted person or entity as defined and provided for in the Uniform Guidelines on Blacklisting;

4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;

5. [Name of Bidder] is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;

6. *[Select one, delete the rest:]*

[If a sole proprietorship:] The owner or sole proprietor is not related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;

[If a partnership or cooperative:] None of the officers and members of *[Name of Bidder]* is related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;

[If a corporation or joint venture:] None of the officers, directors, and controlling stockholders of *[Name of Bidder]* is related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;

7. *[Name of Bidder]* complies with existing labor laws and standards; and
8. *[Name of Bidder]* is aware of and has undertaken the responsibilities as a Bidder in compliance with the Philippine Bidding Documents, which includes:
 - a. Carefully examining all of the Bidding Documents;
 - b. Acknowledging all conditions, local or otherwise, affecting the implementation of the Contract;
 - c. Making an estimate of the facilities available and needed for the contract to be bid, if any; and
 - d. Inquiring or securing Supplemental/Bid Bulletin(s) issued for the *[Name of the Project]*.
9. *[Name of Bidder]* did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.
10. In case advance payment was made or given, failure to perform or deliver any of the obligations and undertakings in the contract shall be sufficient grounds to constitute criminal liability for Swindling (Estafa) or the commission of fraud with unfaithfulness or abuse of confidence through misappropriating or converting any payment received by a person or entity under an obligation involving the duty to deliver certain goods or services, to the prejudice of the public and the government of the Philippines pursuant to Article 315 of Act No. 3815 s. 1930, as amended, or the Revised Penal Code.

IN WITNESS WHEREOF, I have hereunto set my hand this ____ day of ____, 20__ at _____, Philippines.

[Insert NAME OF BIDDER OR ITS AUTHORIZED REPRESENTATIVE]

[Insert signatory's legal capacity]
Affiant

[Jurat]

[Format shall be based on the latest Rules on Notarial Practice]

Standard Form No: NPCSF-GOODS-08

BID LETTER

Date: _____

To: **THE PRESIDENT**
National Power Corporation
BIR Road cor. Quezon Ave.
Diliman, Quezon City

Gentlemen:

Having examined the Bidding Documents including Bid Bulletin Numbers *[insert numbers]*, the receipt of which is hereby duly acknowledged, we, the undersigned, offer to perform **SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT & BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREA IN JINTOTOLO IS., BALUD, MASBATE (LuzP22Z1435Se)** in conformity with the said Bidding Documents for the sum of *[total Bid amount in words and figures]* or such other sums as may be ascertained in accordance with the Schedule of Prices attached herewith and made part of this Bid.

We undertake, if our Bid is accepted, to supply and deliver the goods and perform other services, if required within the contract duration and in accordance with the scope of the contract specified in the Schedule of Requirements and Technical Specifications.

If our Bid is accepted, we undertake to provide a performance security in the form, amounts, and within the times specified in the Bidding Documents.

We agree to abide by this Bid for the Bid Validity Period specified in Bid Documents and it shall remain binding upon us and may be accepted at any time before the expiration of that period.

Until a formal Contract is prepared and executed, this Bid, together with your written acceptance thereof and your Notice of Award, shall be binding upon us.

We understand that you are not bound to accept the Lowest Calculated Bid or any Bid you may receive.

We certify/confirm that we comply with the eligibility requirements pursuant to the Bidding Documents.

We likewise certify/confirm that the undersigned, *[for sole proprietorships, insert: as the owner and sole proprietor or authorized representative of [Name of Bidder]* has the full power and authority to participate, submit the bid, and to sign and execute the ensuing contract, on the latter's behalf for the *[Name of Project]* of the National Power Corporation *[for partnerships, corporations, cooperatives, or joint ventures, insert: is granted full power and authority by the [Name of Bidder]* to participate, submit the bid, and to sign and execute the ensuing contract on the latter's behalf for *[Name of Project]* of the National Power Corporation.

We acknowledge that failure to sign each and every page of this Bid Letter, including the attached Schedule of Requirements (Bid Price Schedule), shall be a ground for the rejection of our bid.

*[name and signature of authorized signatory]*_____
[in the capacity of]

Duly authorized to sign Bid for and on behalf of _____
[name of bidder]

Bank Guarantee Form for Advance Payment

To: **THE PRESIDENT**
National Power Corporation
BIR Road cor. Quezon Ave.
Diliman, Quezon City

[name of Contract]

Gentlemen and/or Ladies:

In accordance with the Advance Payment Provision, of the General Conditions of Contract, [name and address of Supplier] (hereinafter called the "Supplier") shall deposit with the PROCURING ENTITY a bank guarantee to guarantee its proper and faithful performance under the said Clause of the Contract in an amount of [amount of guarantee in figures and words].

We, the [name of the universal/commercial bank], as instructed by the Supplier, agree unconditionally and irrevocably to guarantee as primary obligator and not as surety merely, the payment to the PROCURING ENTITY on its first demand without whatsoever right of objection on our part and without its first claim to the Supplier, in the amount not exceeding [amount of guarantee in figures and words].

We further agree that no change or addition to or other modification of the terms of the Contract to be performed thereunder or of any of the Contract documents which may be made between the PROCURING ENTITY and the Supplier, shall in any way release us from any liability under this guarantee, and we hereby waive notice of any such change, addition, or modification.

This guarantee shall remain valid and in full effect from the date the advance payment is received by the Supplier under the Contract and until the Goods are accepted by the PROCURING ENTITY.

Yours truly,

Signature and seal of the Guarantors

[name of bank or financial institution]

[address]

[date]

CERTIFICATION AS A DOMESTIC BIDDER

This is to certify that based on the records of this office, (Name of Bidder) is
duly registered with the DTI on _____.

This further certifies that the articles forming part of the product of (Name of Bidder)
which are/is (Specify) _____ are substantially composed of
articles, materials, or supplies grown, produced or manufactured in the Philippines. (Please
encircle the applicable description/s).

This certification is issued upon the request of (Name of Person/Entity) in
connection with his intention to participate in the bidding for the (Name of Project)
of the National Power Corporation (NPC).

Given this ___ day of _____ 20__ at _____, Philippines

Name

Position

Department of Trade & Industry

SECTION VI

BID DRAWINGS

TERMS OF REFERENCE

SUPPLY, DELIVERY, INSTALLATION, TEST, AND
COMMISSIONING OF 2 X 150 KW MODULAR DIESEL
GENERATING SETS, ASSOCIATED ELECTRICAL
EQUIPMENT & BALANCE OF PLANT FOR THE
ELECTRIFICATION OF NEW AREA IN JINTOTOLO IS.,
BALUD, MASBATE

LuzP22Z1435Se

BID DRAWINGS

ARCHITECTURAL DRAWINGS




SECTION VI - BID DRAWINGS**AW - ARCHITECTURAL DRAWINGS**


DRAWING NO.	TITLE
JinDPP-BDA-17.001	PREFABRICATED CONTAINER HOUSE (Control Room)
JinDPP-BDA-17.002	PREFABRICATED CONTAINER HOUSE (Bunkhouse & Storage Room)
JinDPP-BDA-17.003	GUARD POST (Plan, Elevations & Section)
JinDPP-BDA-17.004	HAZARDOUS WASTE & SOLID WASTE STORAGE AREA (Plan)
JinDPP-BDA-17.005	HAZARDOUS WASTE & SOLID WASTE STORAGE AREA (Elevations)
JinDPP-BDA-17.006	PUMPHOUSE (Plan, Section & Details)

50MM POLYSTERENE INSULATION
WITH DOUBLE-SIDED 0.45MM
PRE-PAINTED GALVANIZED IRON
SHEET.

MAGNESIUM BOARD WITH
LINOLEUM FINISH

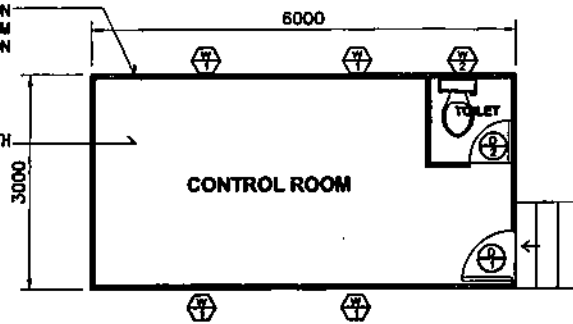

FLOOR PLAN
SCALE 1:75

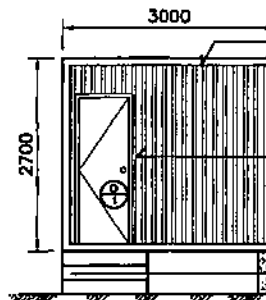


FRONT ELEVATION
SCALE 1:75


GLASSWOOL INSULATION WITH PRE-PAINTED
GI SHEET ROOF AND INTERIOR CEILING

50MM POLYSTERENE INSULATION WITH
DOUBLE-SIDED 0.45MM PRE-PAINTED GALVANIZED
IRON SHEET.

CONCRETE PEDESTAL

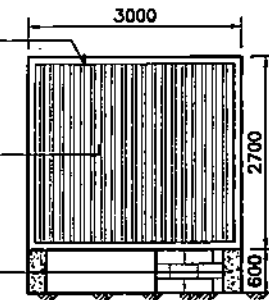

REAR ELEVATION
SCALE 1:75

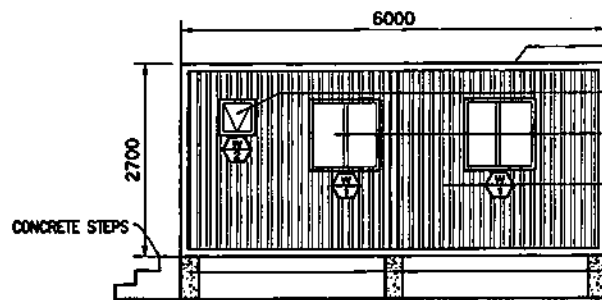

LEFT SIDE ELEVATION
SCALE 1:75


GLASSWOOL INSULATION WITH PRE-PAINTED GI SHEET
ROOF AND INTERIOR CEILING

ALUMINUM FRAME AWNING WINDOW

ALUMINUM FRAME SLIDING WINDOWS

50MM POLYSTERENE INSULATION WITH DOUBLE-SIDED 0.45MM
PRE-PAINTED GALVANIZED IRON SHEET.

CONCRETE PEDESTAL

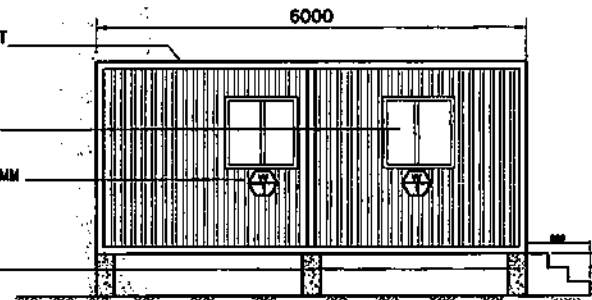


RIGHT SIDE ELEVATION
SCALE 1:75


NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.
2. WORK THIS DRAWING WITH RELATED CIVIL, MECHANICAL AND ELECTRICAL DRAWINGS.

TAP TO SEPTIC TANK 3"Ø CO3"

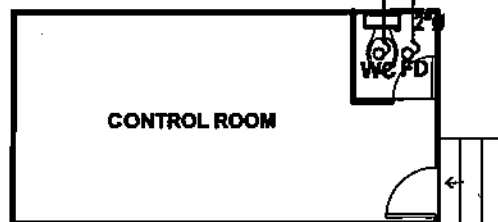

PLUMBING LAYOUT
SCALE 1:75

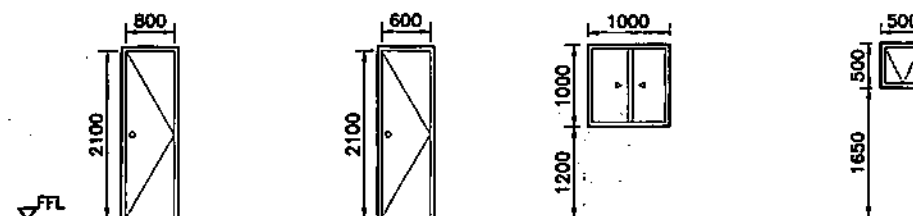

D1

D2

W1

W2

FLUSH TYPE STEEL DOOR : FLUSH TYPE PVC DOOR


**SCHEDULE OF DOORS
AND WINDOWS**

SCALE 1:75


: GLASS AND ALUM. SLIDING WINDOW : GLASS AND ALUM. AWNING WINDOW
: 6 MM THICK CLEAR GLASS : 6 MM THICK CLEAR GLASS
: ALUMINUM FRAME : ALUMINUM FRAME

OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTOLDO R. LOCATION: BRGY. JINTOTOLDO ISLAND, BALLED MARBATE			
TITLE: PREFABRICATED CONTAINER HOUSE (CONTROL ROOM)			
DESIGNED	BY	CHKD	DATE
DRAWN	BY	CHKD	DATE
REVIEWED	BY	CHKD	DATE
CHECKED	BY	CHKD	DATE
ELEC.	BY	CHKD	DATE
MECH.	BY	CHKD	DATE
SUBMITTER:		R.R. R. VILLANUEVA PROJECT MANAGER	
RECOMMENDED:		A.C. ISIPITU PROJECT MANAGER	
APPROVED:		G.B. MAGPOC, JR. Manager, EOD	
DWG. NO. JInDPP-BDA-17.001		SPEC. NO. LutzP22Z1435S	
SCALE: AS SHOWN		BID DRAWING	
REV. 0			

50MM POLYSTERENE INSULATION
WITH DOUBLE-SIDED 0.45MM
PRE-PAINTED GALVANIZED IRON
SHEET.

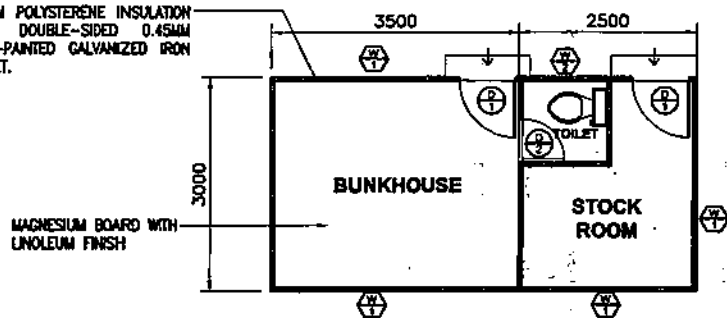

FLOOR PLAN
SCALE 1:75




LEFT SIDE ELEVATION
SCALE 1:75

GLASSWOOL INSULATION WITH PRE-PAINTED
GI SHEET ROOF AND INTERIOR CEILING


ALUMINUM FRAME SLIDING WINDOWS

50MM POLYSTERENE INSULATION WITH
DOUBLE-SIDED 0.45MM PRE-PAINTED GALVANIZED
IRON SHEET.

CONCRETE STEP
CONCRETE PEDESTAL



RIGHT SIDE ELEVATION
SCALE 1:75

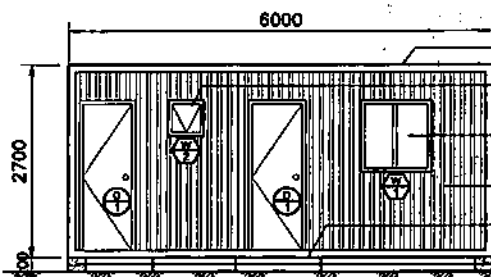

FRONT ELEVATION
SCALE 1:75


GLASSWOOL INSULATION WITH PRE-PAINTED GI SHEET
ROOF AND INTERIOR CEILING

ALUMINUM FRAME AWNING WINDOW

ALUMINUM FRAME SLIDING WINDOWS

50MM POLYSTERENE INSULATION WITH DOUBLE-SIDED 0.45MM
PRE-PAINTED GALVANIZED IRON SHEET.


CONCRETE STEP

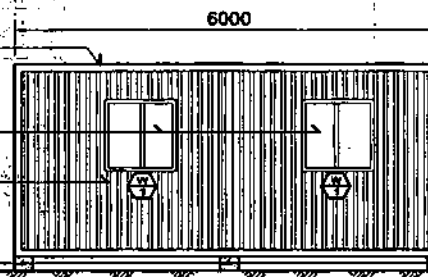


REAR ELEVATION
SCALE 1:75

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.
2. WORK THIS DRAWING WITH RELATED CIVIL, MECHANICAL AND ELECTRICAL DRAWINGS.

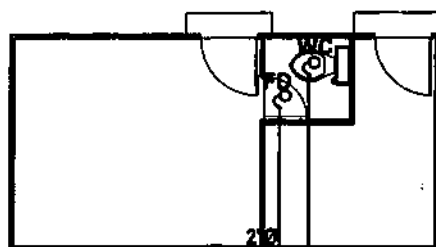

PLUMBING LAYOUT
SCALE 1:75

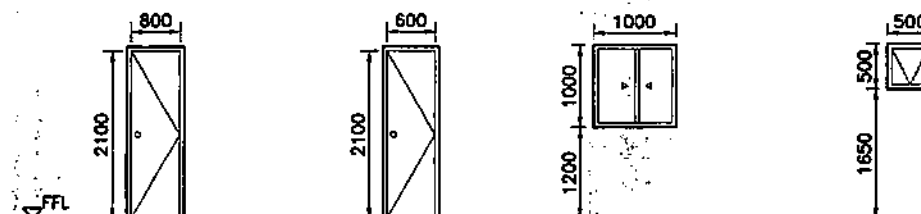


**SCHEDULE OF DOORS
AND WINDOWS**


SCALE 1:75

FLUSH TYPE STEEL DOOR : FLUSH TYPE PVC DOOR
: GLASS AND ALUM. SLIDING WINDOW
: 6 MM THICK CLEAR GLASS
: ALUMINUM FRAME
: GLASS AND ALUM. AWNING WINDOW
: 6 MM THICK CLEAR GLASS
: ALUMINUM FRAME


OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 3 X 125 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTULO RL, BALID, MARBATE			
LOCATION: BRDY, JINTOTULO ISLAND, BALID MARBATE			
TITLE: PREFABRICATED CONTAINER HOUSE (BUNKHOUSE AND STORAGE ROOM)			
DESIGNED	BY	CHKD	DATE
DRAWN	BY	CHKD	DATE
REVIEWED	PRINCIPAL ENGR. IN CHARGE		RECOMMENDED
CHECKED			APPROVED
ELEC.			
MECH.			
DWG. NO. JInDPP-SDA-17.002		SPEC. NO. LuzP22214355e	
SCALE: AS SHOWN		BID DRAWING	
REV.		REV. 0	

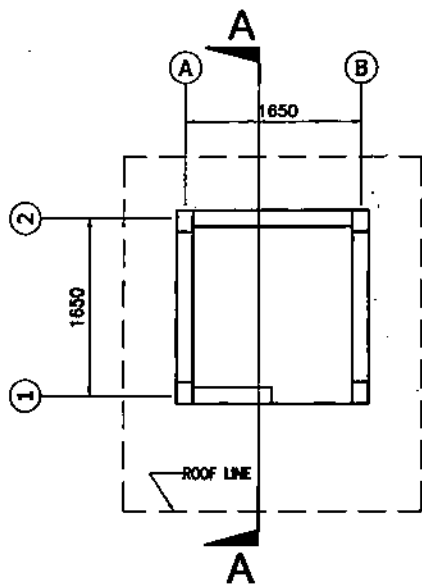


FLOOR PLAN
SCALE 1:50

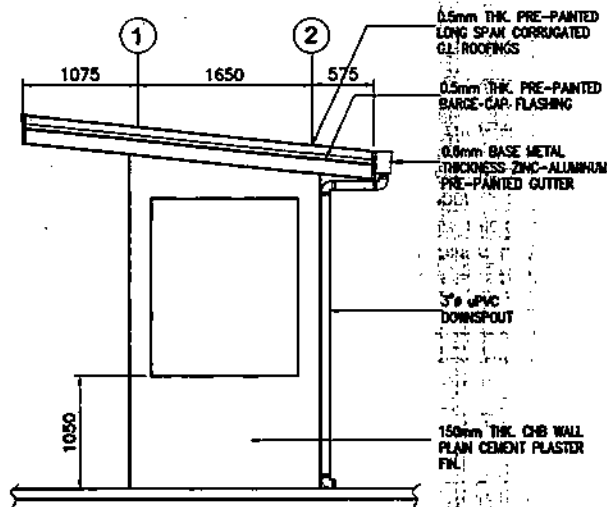


RIGHT SIDE ELEVATION
SCALE 1:50

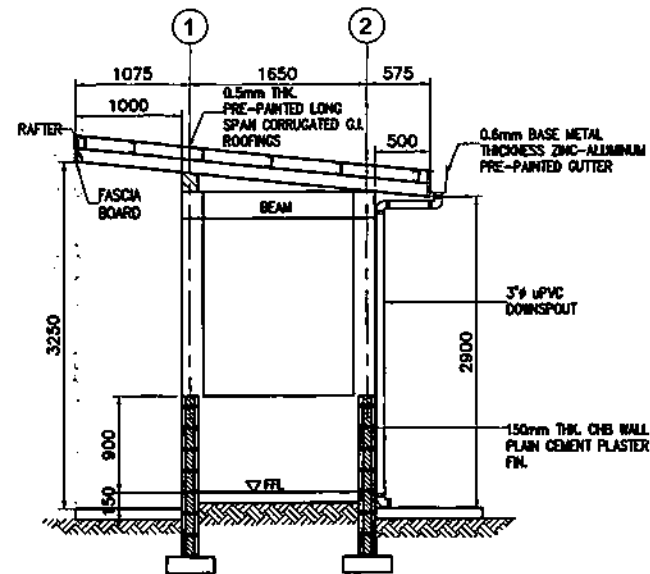

SECTION A-A
SCALE 1:50

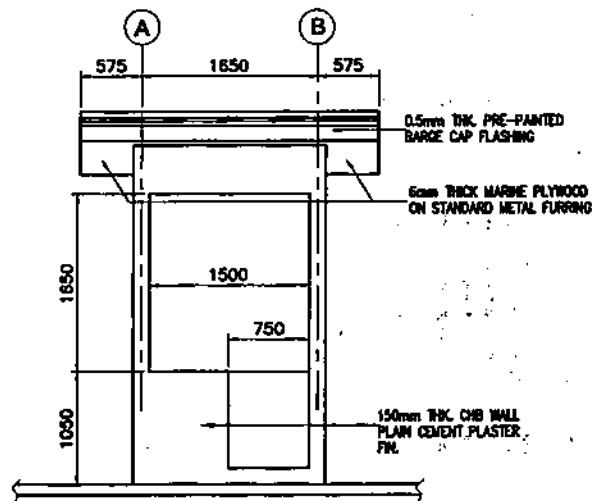


FRONT ELEVATION
SCALE 1:50

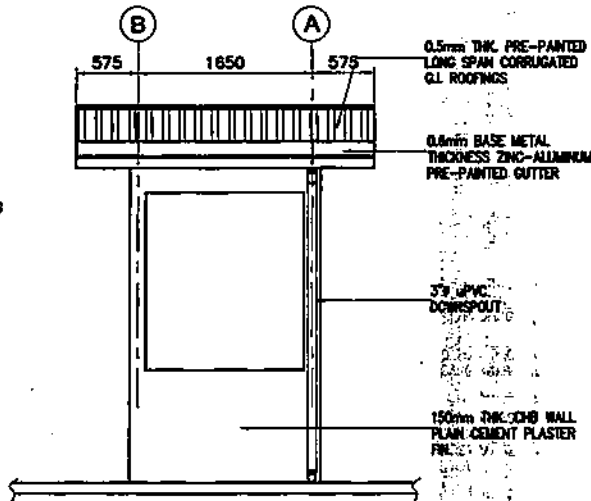


REAR ELEVATION
SCALE 1:50


NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.
2. WORK THIS DRAWING WITH CIVIL DRAWINGS.

OWNER:				NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 100 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN ANTITOLDO IS., BALABO, MARABATE					
LOCATION: BRISTY, ANTITOLDO ISLAND, BALABO MARABATE					
TITLE: GUARD POST (PLAN, ELEVATIONS & SECTION)					
DESIGNED	BY	CHKD	DATE	SUBMITTED	<i>R.R. VILLANUEVA</i> Project Engineer & BOO
DRAWN				RECOMMENDED	<i>A. DESPINTU</i> Manager, E&E
REVIEWED	PRINCIPAL ENGR./ARCHT.			APPROVED	<i>G.B. MAGPOC, JR.</i> Manager, E&E
CHECKED					
ELEC					
MECH					
DWG. NO. JInDPP-BDA-17.003			SPEC. NO. L12P22Z1435S9		
SCALE: AS SHOWN			BID DRAWING		
REV. DATE NATURE OF REVISION			BY CHKD. RECD. APPD.		
			REV. 0		

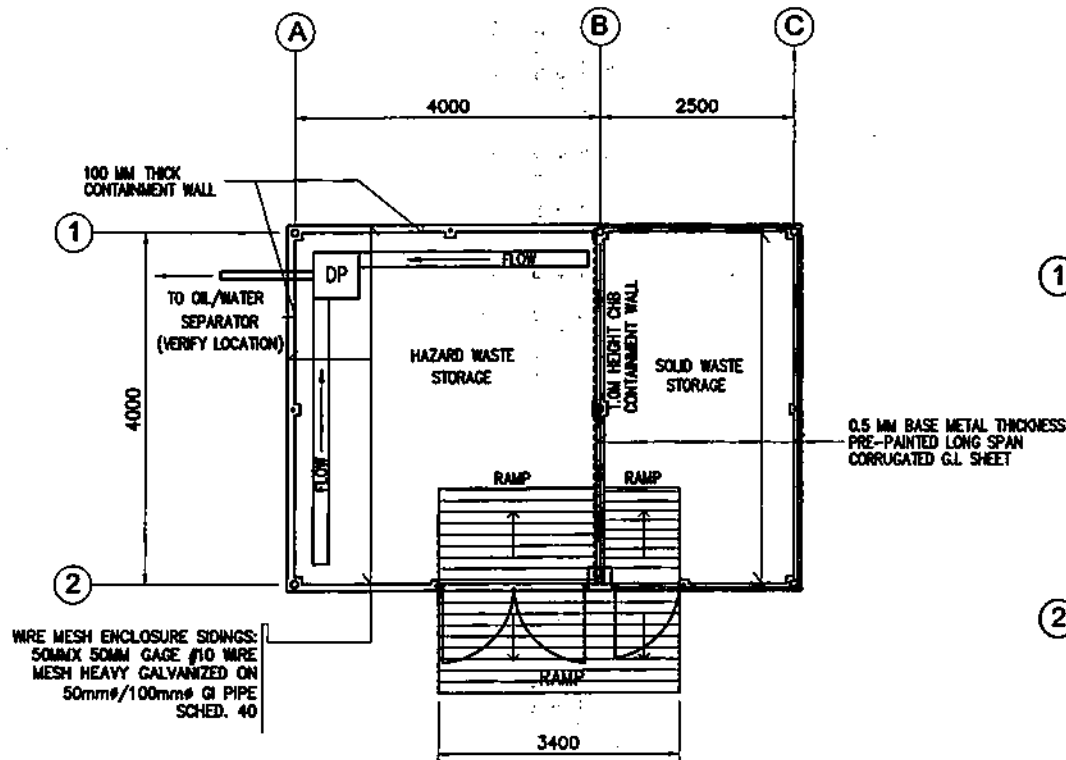

FLOOR PLAN
SCALE 1:75

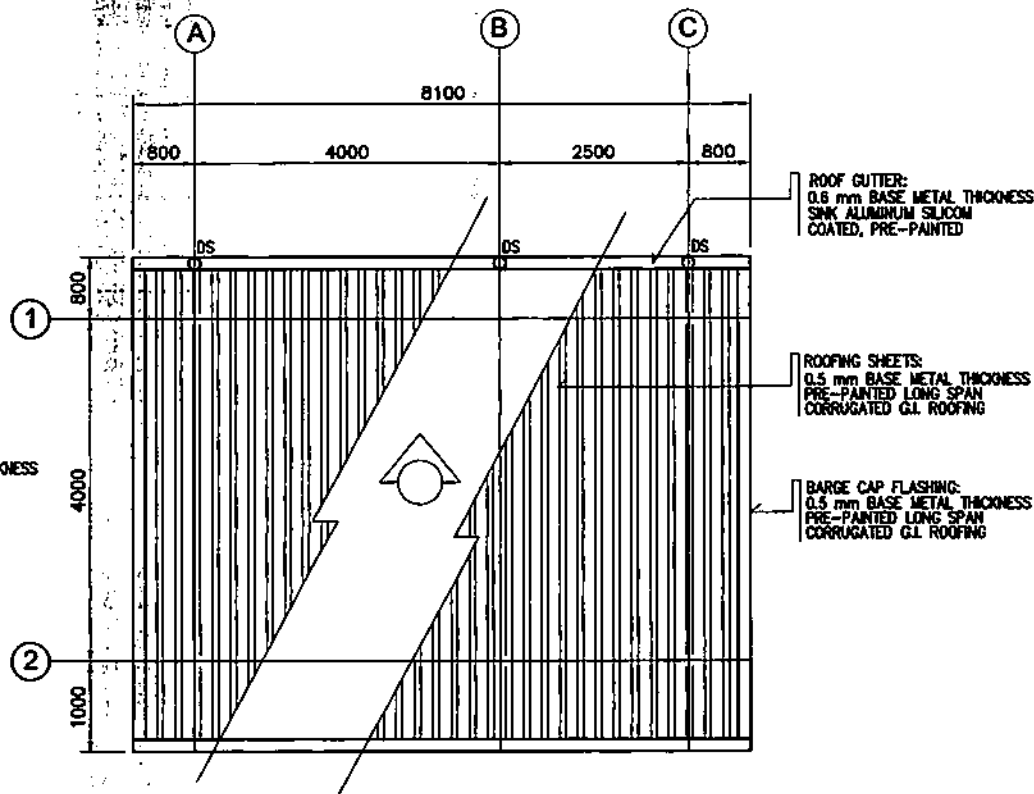


ROOF PLAN
SCALE 1:75

NOTES:


1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.
2. WORK THIS DRAWING WITH RELATED CIVIL, MECHANICAL AND ELECTRICAL DRAWINGS.

OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 125 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN ANTITOLLO IS., BALABAN, MARBATE			
LOCATION: BRISTY, ANTITOLLO ISLAND, BALABAN MARBATE			
TITLE: HAZARDOUS WASTE & SOLID WASTE STORAGE AREA (PLAN)			
DESIGNED	BY	CHKD	DATE
DRAWN			
REVIEWED	PRINCIPAL ENGR. / ARCHT.		RECOMMENDED:
CHECKED BY			
ELEC.			
MECH.			
SUBMITTED:		R.R.R. VILLANUEVA Project Engineer & CEAD	
RECOMMENDED:		A. ESPINOSA Manager, CEAD	
APPROVED:		G.B. MAGPOC, JR. Manager, CEAD	
DWG. NO. JinDPP-BDA-17.004		SPEC. NO. LuzP2221435S	
SCALE: AS SHOWN		BID DRAWING	
REV. 0			

REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPL.

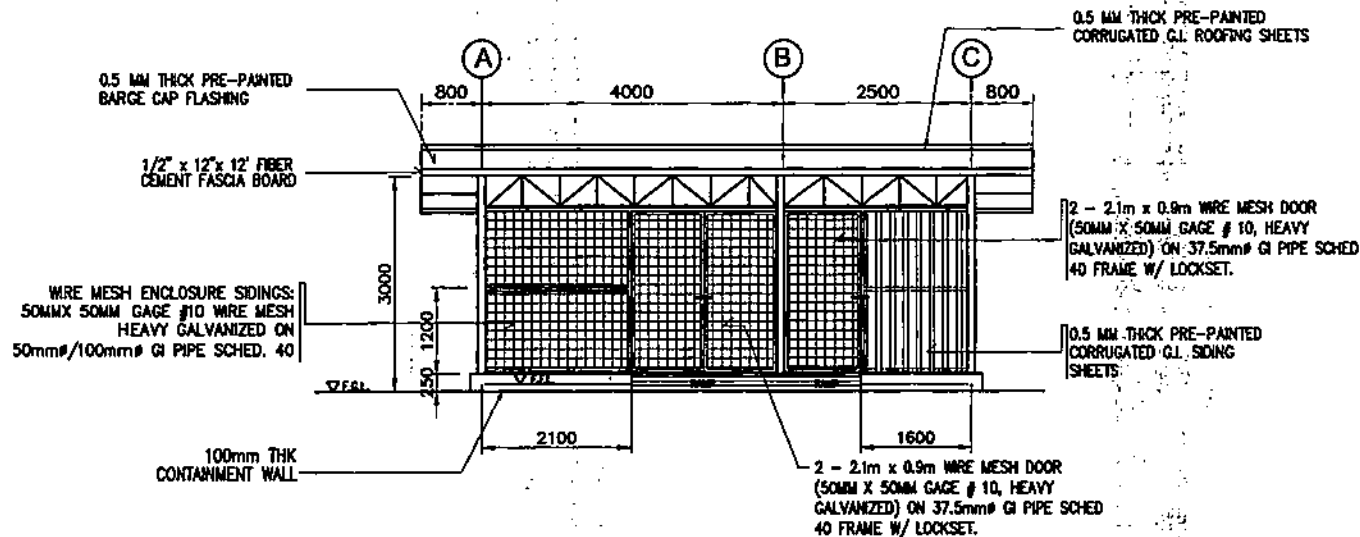


FRONT ELEVATION
SCALE 1:75

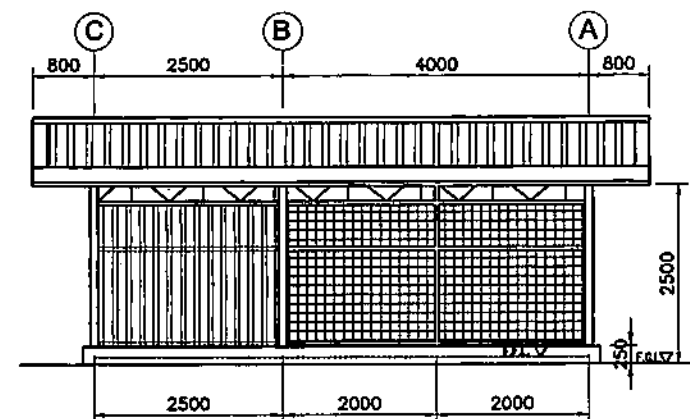


REAR ELEVATION
SCALE 1:75

NOTES:


1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.
2. WORK THIS DRAWING WITH RELATED CIVIL, MECHANICAL AND ELECTRICAL DRAWINGS.

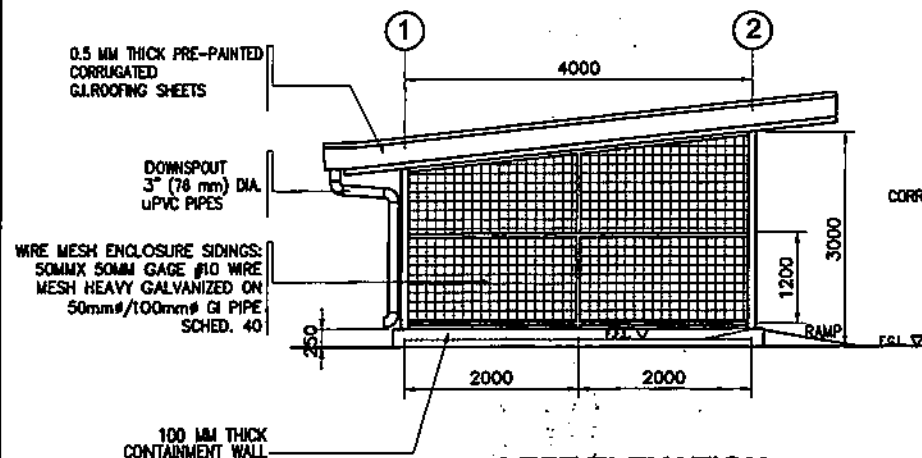

LEFT ELEVATION
SCALE 1:75

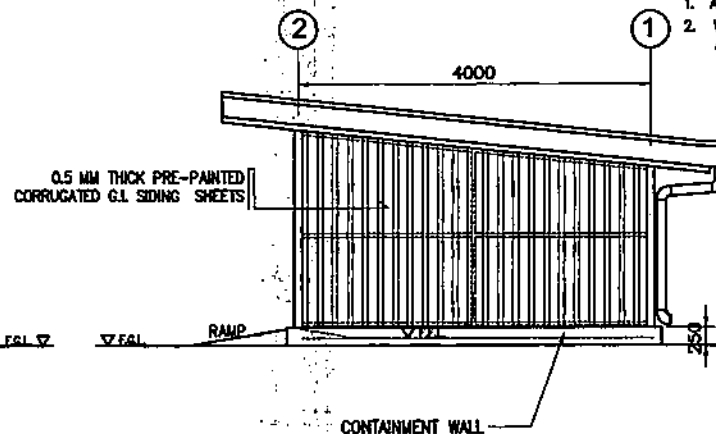





RIGHT ELEVATION
SCALE 1:75


OWNER:		 NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF HIGH AREAS IN JINTOTOLDO IS., BALAB, MARABATE			
LOCATION: BRGY. JINTOTOLDO ISLAND, BALAB, MARABATE			
TITLE: HAZARDOUS WASTE & SOLID WASTE STORAGE AREA (ELEVATIONS)			
DESIGNED	BY	CHKD	DATE
DRAWN	2		
REVIEWED	PRINCIPAL ENGR./ARCHT.		
CHECKED			
ELEC.			
MECH.			
SUBMITTED:		R.R.R. VILLANUEVA Principal Architect / ENGR.	
RECOMMENDED:		A. ESPINOSA Manager, O&D	
APPROVED:		G.B. MAGPOC, JR. Manager, O&D	
DWG. NO. JInDPP-BDA-17.005		SPEC. NO. LuzP22Z1435Se	
SCALE AS SHOWN		BID DRAWING	
REV. 0			

REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPO.

NOTES:

1. WORK THIS DRAWING WITH MECHANICAL DRAWINGS.

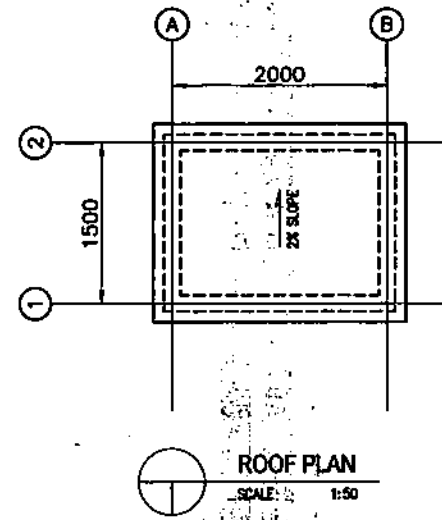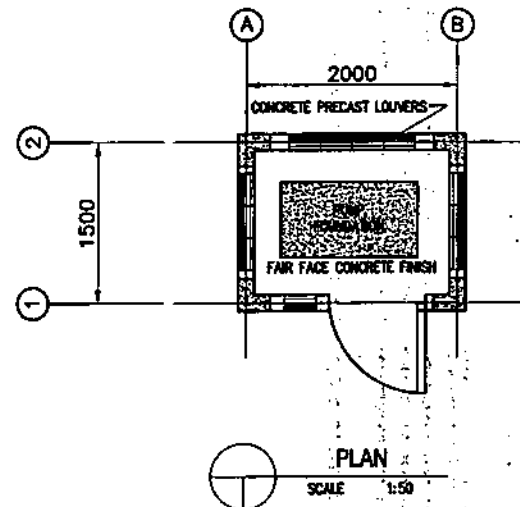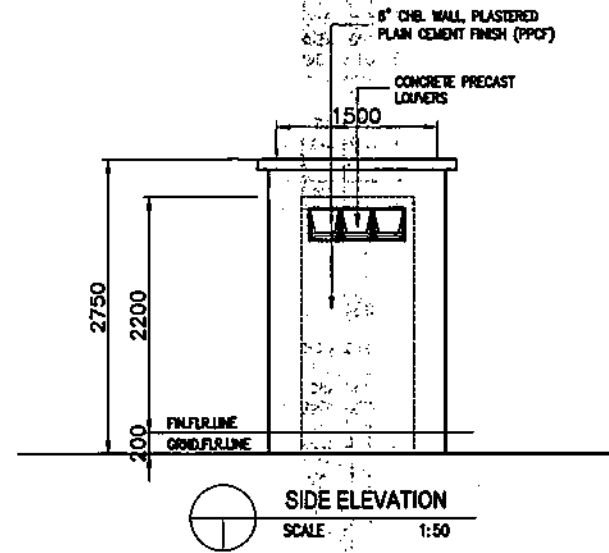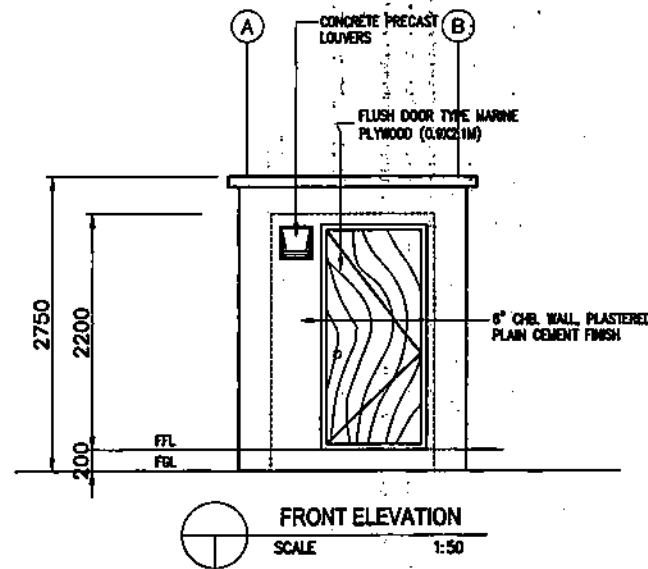

OWNER:		 NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 3 X 110 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTULO IS, BALABO, MARBATE			
LOCATION: BRST, JINTOTULO ISLAND, BALABO MARBATE			
TITLE: PUMP HOUSE (PLAN, SECTION & DETAILS)			
DESIGNED	BY	CHKD	DATE
DRAWN			
REVIEWED	PROJECT ENGINEER / ARCHT.		RECOMMENDED: A. C. ESPRITU Manager, CEAD
CHECKED			APPROVED: G. B. MAGPOC, JR. Manager, DED
ELEC.			
MECH.			
DWG. NO. JinDPP-BDA-17.006		SPEC. NO. LuzPZZ214358e	
SCALE AS SHOWN		BID DRAWING	
REV. 0			

REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPD.

TERMS OF REFERENCE

SUPPLY, DELIVERY, INSTALLATION, TEST, AND
COMMISSIONING OF 2 X 150 KW MODULAR DIESEL
GENERATING SETS, ASSOCIATED ELECTRICAL
EQUIPMENT & BALANCE OF PLANT FOR THE
ELECTRIFICATION OF NEW AREA IN JINTOTOLO IS.,
BALUD, MASBATE

LuzP22Z1435Se

BID DRAWINGS

CIVIL DRAWINGS



SECTION VI - BID DRAWINGS**CW - CIVIL DRAWINGS**

DRAWING NO.	TITLE
JinDPP-BDC-17.001	JINTOTOLO DPP (Site Development Plan)
JinDPP-BDC-17.002	JINTOTOLO DPP (Drainage Plan)
JinDPP-BDC-17.003	PREFABRICATED CONTAINER HOUSE (Foundation, Footing, Steps, Walk & Pedestal Plan & Details)
JinDPP-BDC-17.004	GUARD POST (Foundation Plan, Roof Framing Plan & Details)
JinDPP-BDC-17.005	HAZARDOUS WASTE & SOLID WASTE STORAGE AREA (Foundation & Roof Framing Plans)
JinDPP-BDC-17.006	HAZARDOUS WASTE & SOLID WASTE STORAGE AREA (Framing Elevations)
JinDPP-BDC-17.007	HAZARDOUS WASTE & SOLID WASTE STORAGE AREA (Footing & Containment Wall Details)
JinDPP-BDC-17.008	TYPICAL ENTRANCE GATE & PERIMETER FENCE (Elevation, Section & Details)
JinDPP-BDC-17.009	TYPICAL GENSET & TRANSFORMER PAD (Plan, Section & Details)
JinDPP-BDC-17.010	TYPICAL WATER TANK & DAY TANK SUPPORT (Plan, Section & Details)
JinDPP-BDC-17.011	SEPTIC TANK, CATCH BASIN & OPEN CANAL (Section & Details)
JinDPP-BDC-17.012	DRAINAGE SYSTEM (Details of Surface Inlet Manhole, SIM)


TERMS OF REFERENCE

SUPPLY, DELIVERY, INSTALLATION, TEST, AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT & BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREA IN JINTOTOLO IS., BALUD, MASBATE

SECTION VI – BID DRAWINGS

LuzP22Z1435Se

JinDPP-BDC-17.013	OIL-WATER SEPARATOR
JinDPP-BDC-17.014	FLAG POLE & LIGHTING POLE FOUNDATION (Plan, Section & Details)
JinDPP-BDC-17.015	DIRECT BURIAL STEEL POLE (Section & Details)
JinDPP-BDC-17.016	SECLUSION FENCE & PEDESTRIAN GATE (Plan, Section & Details)
JinDPP-BDC-17.017	FOST FOUNDATION & CONTAINMENT WALL (Plan & Section)
JinDPP-BDC-17.018	FOST FOUNDATION & CONTAINMENT WALL (Reinforcements & Details)
JinDPP-BDC-17.019	FOST DRAIN PIT & VALVE BOX (Plan, Section & Details)
JinDPP-BDC-17.020	PUMPHOUSE (Foundation Plan & Column Details)
JinDPP-BDC-17.021	PUMPHOUSE (Roof Beam/Slab Section & Details)

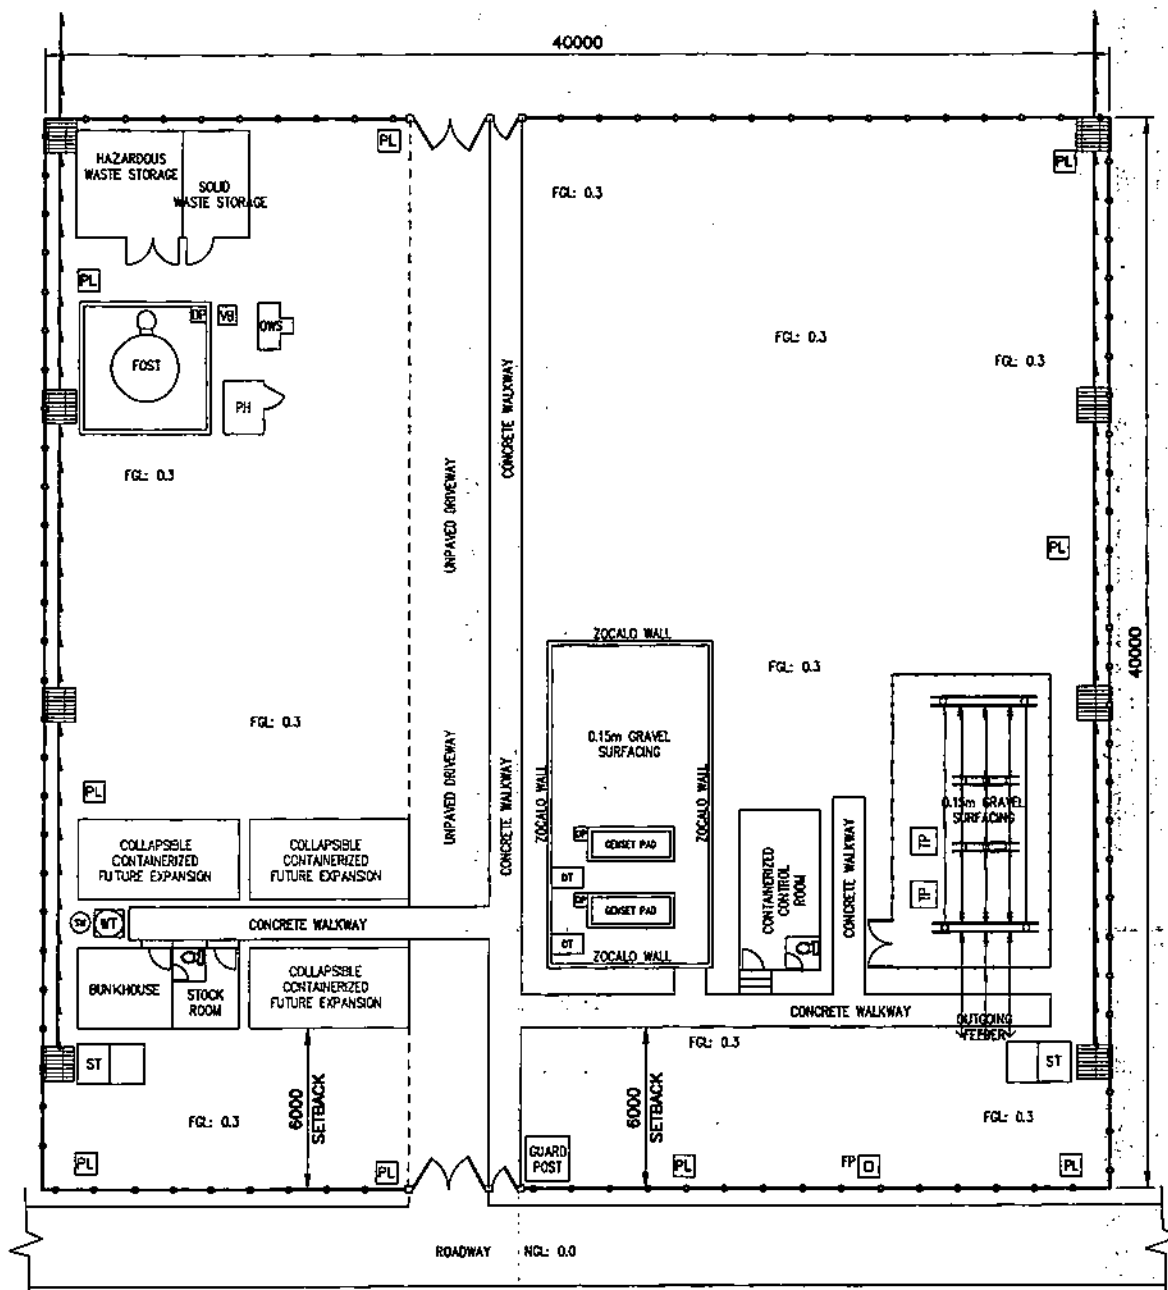


SITE DEVELOPMENT PLAN

SCALE 1:200

MASBATE

SITE
(JINTOTOLO ISLAND)

LOCATION PLAN
NOT TO SCALE

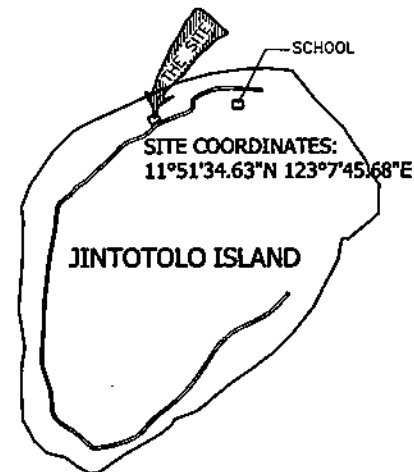

VICINITY PLAN
NOT TO SCALE

LEGEND:

- FP - FLAG POLE
- WT - WATER TANK
- SW - SHALLOW WELL
- DT - DAY TANK
- DP - DRAIN PIT
- ST - SEPTIC TANK
- TP - TRANSFORMER PAD
- OWS - OIL-WATER SEPARATOR
- PL - PERIMETER LIGHTING
- VB - VALVE BOX
- PH - PUMP HOUSE
- FOST - FUEL OIL STORAGE TANK
- SI - SURFACE INLET MANHOLE


— 600mm Ø RCP PIPE




NOTES:

1. THIS DRAWING IS FOR BIDDING PURPOSES ONLY.
2. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.


OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 180 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTOLO IS. BALUD, MASBATE.			
LOCATION: BRGY. JINTOTOLO ISLAND, BALUD MASBATE			
TITLE: JINTOTOLO DPP (SITE DEVELOPMENT PLAN)			
DESIGNED	BY	CHKD	DATE
DRAWN			
REVIEWED	PRINCIPAL ENGR. / ARCHT.		
CIVIL/ARCHT			
ELEC.			
MECH.			
SUBMITTED:		H. L. MENDOZA Principal Engineer - C&D	
RECOMMENDED:		A. C. ESPINOSA Chief Engineer - C&D	
APPROVED:		G. B. MAGPOC, JR. Manager, C&D	
DWG. NO. JindPP-BDC-17.001		SPECS. NO. LuzP22Z14359	
SCALE: AS SHOWN		BID DRAWING	
REV.		DATE	
NATURE OF REVISION		BY	
		CHKD	
		RECD	
		APPD	
		REV. 0	

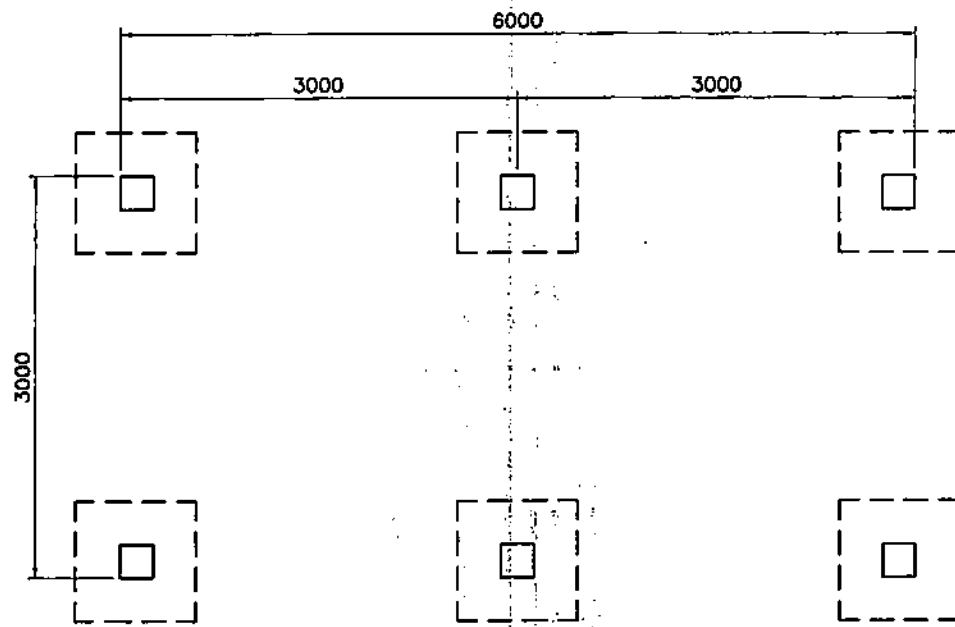

FOUNDATION PLAN
SCALE 1:40

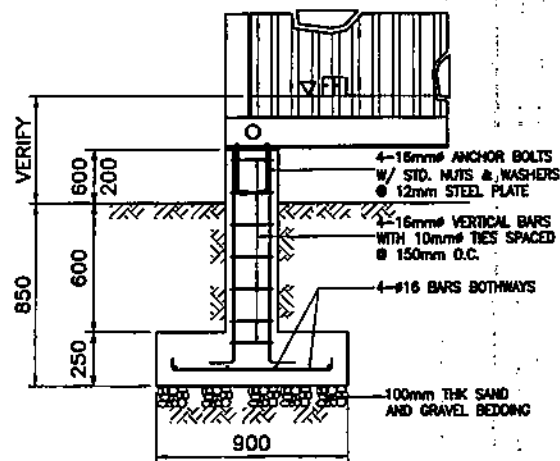


SECTION

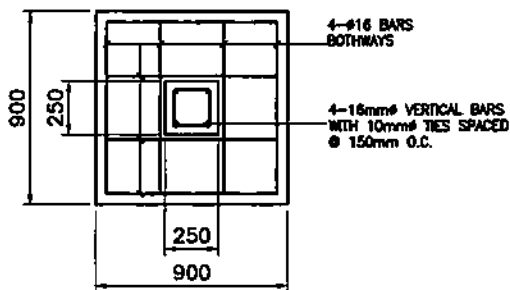


PLAN

DETAILS OF PEDESTAL FOOTING
SCALE 1:20

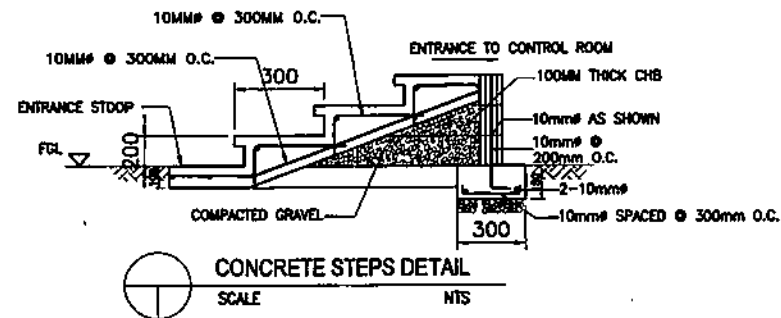


CONCRETE STEPS DETAIL
SCALE NTS

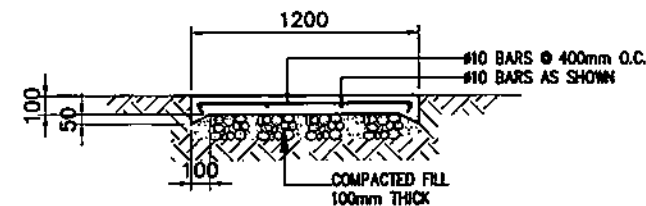








CONCRETE WALKWAY DETAIL
SCALE NTS

NOTES:


1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. FOOTING DESIGN BASED ON ALLOWABLE SOIL PRESSURE OF 3,000 psf (144 KPa) AND TO BE VERIFY BASED ON ACTUAL SOIL CONDITION.
3. UNLESS OTHERWISE INDICATED IN THE PLANS OR NOTED IN THE SPECIFICATIONS, THE MINIMUM 28 DAY CYLINDER COMPRESSIVE STRENGTH OF CONCRETE SHALL BE 20.7MPa.
4. UNLESS OTHERWISE INDICATED SPECIFIED IN THE PLANS, THE MINIMUM YIELD STRENGTH OF REINFORCEMENT TO BE USED SHALL BE GRADE 40.
4. ALL ASPECTS OF CONSTRUCTION AND DETAILING OF REINFORCEMENTS SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE ACI-318 CODE.

OWNER:		 NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 1M JON MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW ANAS IN JINTOTULO II, LOCATION: BRGY. JINTOTULO II, BULID HARBOR			
TITLE: PREFABRICATED CONTAINER HOUSE (FOUNDATION, FOOTING, STEPS, WALK AND PEDESTAL PLAN AND DETAILS)			
DESIGNED	BY	CHKD	DATE
DRAWN	BY	CHKD	DATE
REVIEWED	BY	CHKD	DATE
CHECKED	BY	CHKD	DATE
ELC.	BY	CHKD	DATE
MECH.	BY	CHKD	DATE
SUBMITTED:		H. L. MENDOZA Project Engineer, ESD	
RECOMMENDED:		A. C. B. SPURITU Manager, ESD	
APPROVED:		G. B. MAGPOC, JR. Manager, ESD	
DWG. NO. JInDPP-BDC-17.003		SPEC. NO. LuzP2221435S	
SCALE: AS SHOWN		BID DRAWING	
REV. 0		REV. 0	


REV.	DATE	NATURE OF REVISION	BY	CHKD	RECD	APPR.

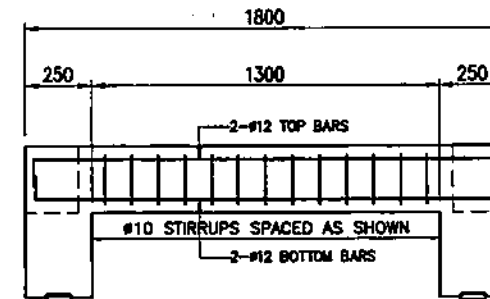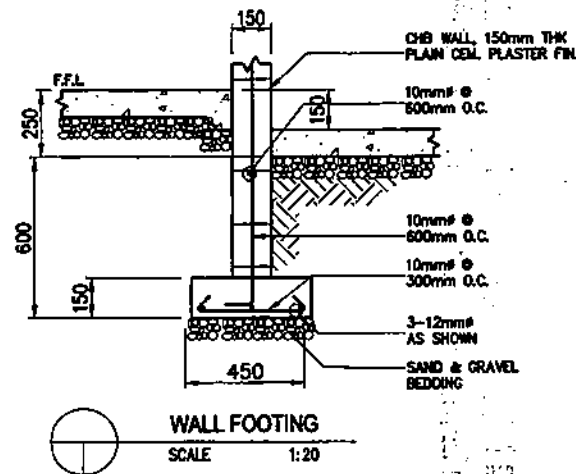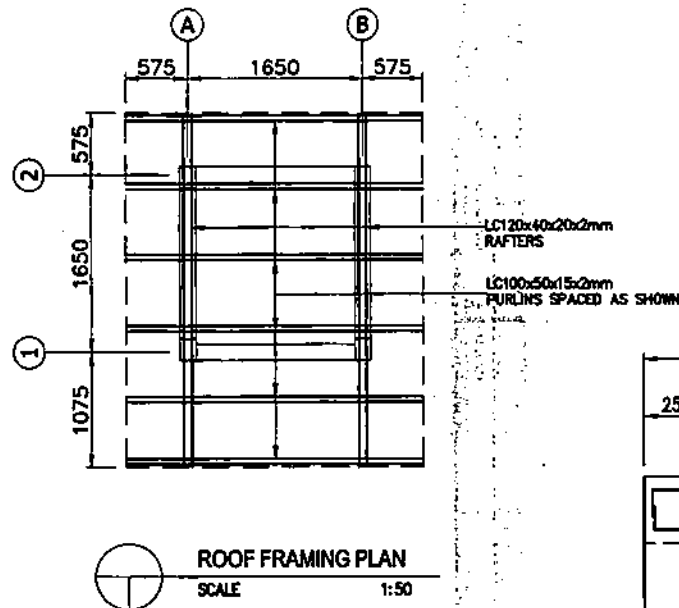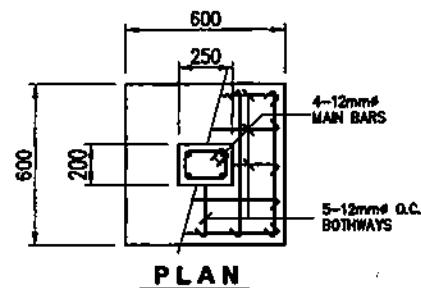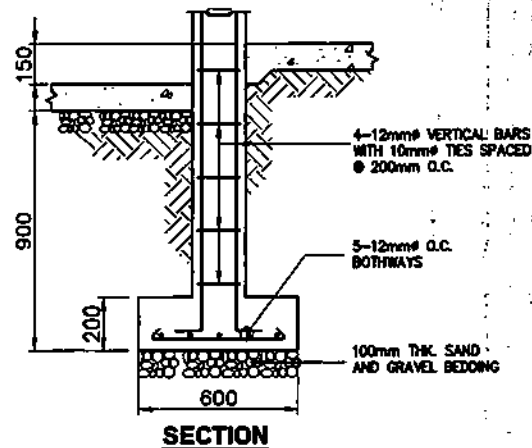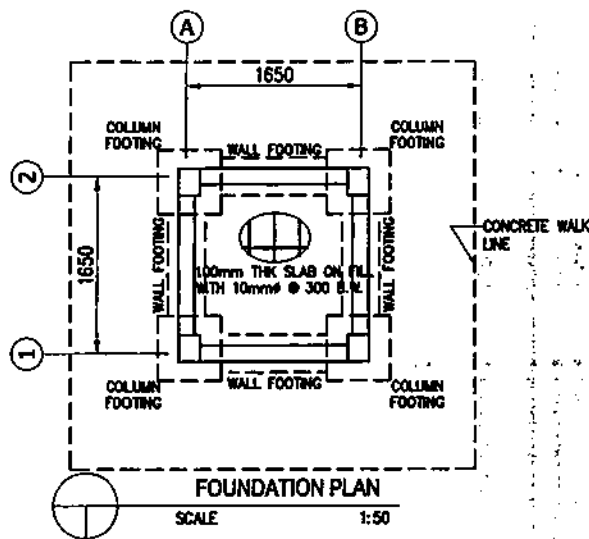

OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 3 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JANTOLOLO, BALSAP, MARBATE			
LOCATION: BSWT, JANTOLOLO ISLAND, BALSAP MARBATE			
TITLE:		GUARD POST (FOUNDATION PLAN, ROOF FRAMING PLAN AND DETAILS)	
DESIGNED	BY	CHKD	DATE
DRAWN	BY	CHKD	DATE
REVIEWED	BY	CHKD	DATE
CIVIL/ARCHT	BY	CHKD	DATE
ELEC	BY	CHKD	DATE
MECH	BY	CHKD	DATE
SUBMITTED:		H. L. MENDOZA Principal Engineer, ESD	
RECOMMENDED:		A. C. ESPINOSA Principal Engineer, ESD	
APPROVED:		G. B. MAGPOC, JR. Manager, ESD	
DWG. NO. JInDPP-BDC-17.004		SPEC. NO. LuzP22Z1435S	
SCALE: AS SHOWN		BID DRAWING	
REV. 0		REV. 0	

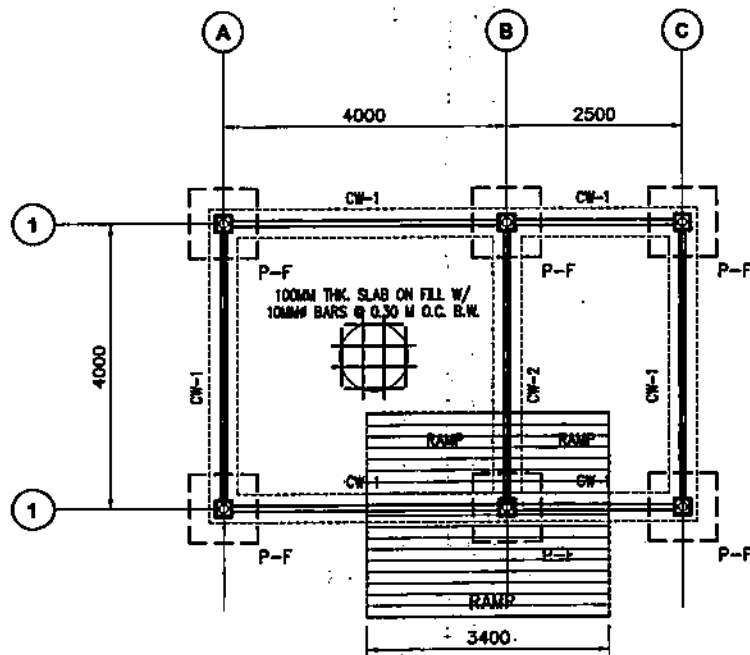

FOUNDATION PLAN
SCALE 1:75

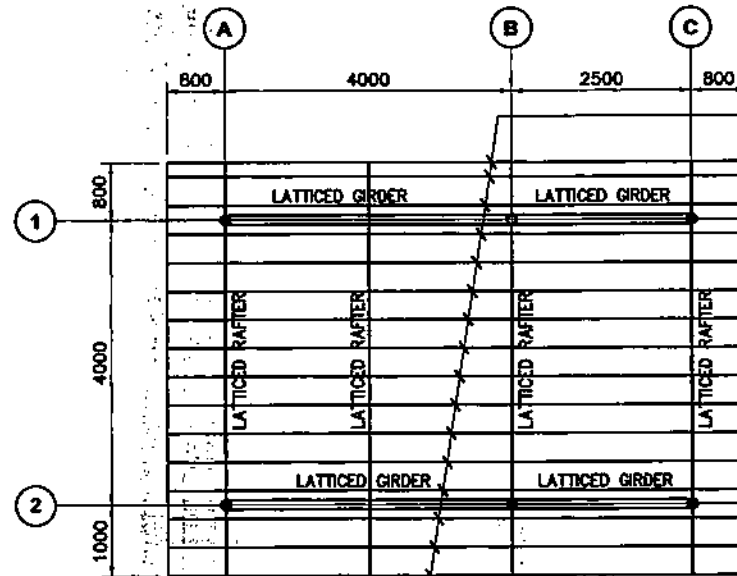


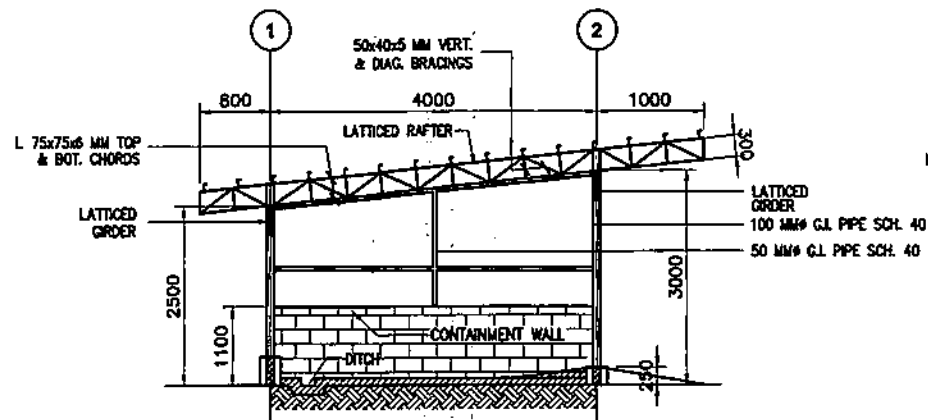
ROOF FRAMING PLAN
SCALE 1:75

LC-100x50x15x2 MM PURLINS
@ 0.50 M O.C. CONNECTED
BY L 75x75x3 MM CLEATS


NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.
2. WORK THIS DRAWING WITH RELATED ARCHITECTURAL, MECHANICAL AND ELECTRICAL DRAWINGS.


OWNER:				NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JANTOLOLO IS.					
LOCATION: BABY JANTOLOLO ISLAND, SALUD MARBATE					
TITLE: HAZARDOUS WASTE & SOLID WASTE STORAGE AREA (FOUNDATION & ROOF FRAMING PLANS)					
DESIGNED	BY	CHKD	DATE	SUBMITTED	H. L. MENDOZA
DRAWN				RECOMMENDED	A. C. ESPRITU
REVIEWED	PRINCIPAL ENGR./INCHT.			APPROVED	G. B. MAGPOC, JR.
CHURNCHT					Manager, E&C
ELEC.					
MECH.					
DWG. NO. JinDPP-BDC-17.005		SPEC. NO. LitzP22Z1435S			
SCALE AS SHOWN		BID DRAWING		REV. 0	



ELEVATION @ GRID B
SCALE 1:75

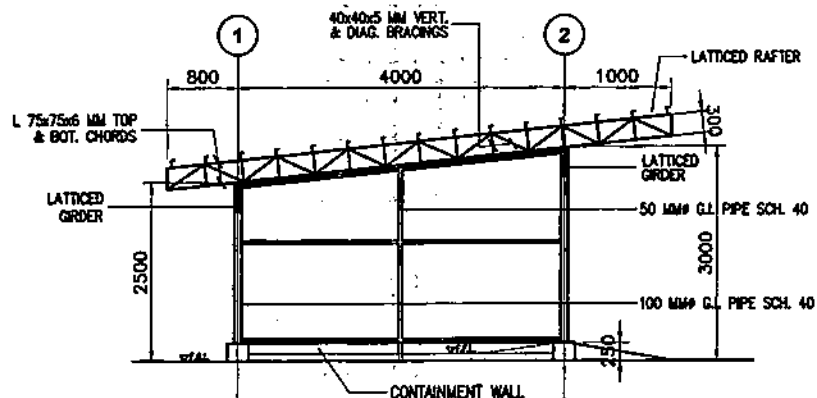


LEFT SIDE ELEVATION
SCALE 1:75

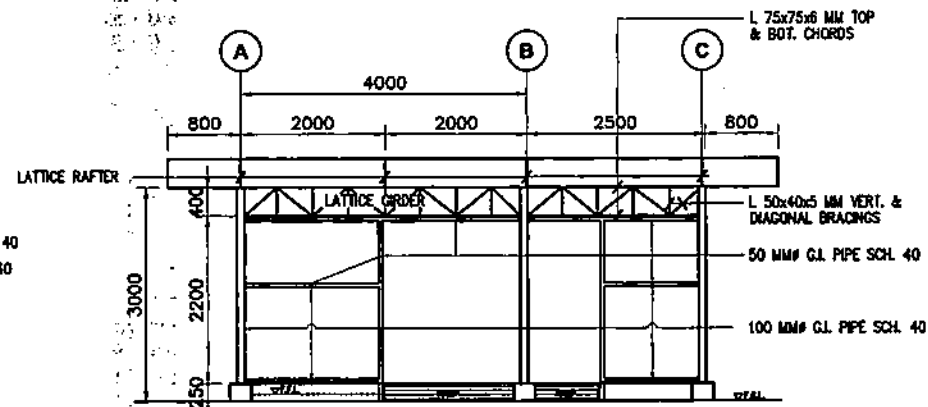


**FRONT ELEVATION
(SHOWING STEEL FRAMES)**
SCALE 1:75

NOTES:


1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.
2. WORK THIS DRAWING WITH RELATED ARCHITECTURAL AND ELECTRICAL DRAWINGS.

OWNER:				NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW BROOKAN DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JANTOLO IS. LOCATION: BRDT, JANTOLO ISLAND, BALID MARBATE					
TITLE: HAZARDOUS WASTE & SOLID WASTE STORAGE AREA (FRAMING ELEVATIONS)					
DESIGNED	BY	CHKD	DATE	SUBMITTED	<i>H. L. MENDOZA</i> Principal Engineer A, E&M
DRAWN				RECOMMENDED	<i>A. C. ESPRITU</i> Engineer A, E&M
REVIEWED	PRINCIPAL ENGR./ARCHT.			APPROVED	<i>G. B. MAGPOC, JR.</i> Manager, E&M
CIVIL/ARCHT					
ELEC.					
MECH.					
DWG. NO. JInDPP-BDC-17.006		SPECS. NO. LuzP2221435S9			
SCALE: AS SHOWN		BID DRAWING			REV. 0

REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPR.




PEDESTAL PLAN

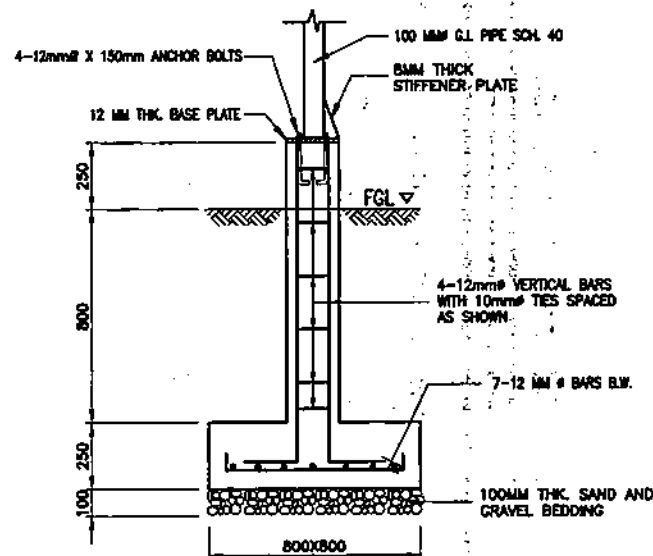


PEDESTAL-FOOTING (P-F)

NTS

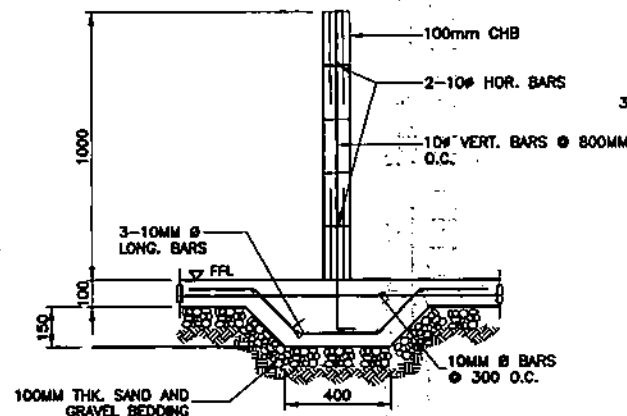


CONTAINMENT WALL (CW-2)

NTS

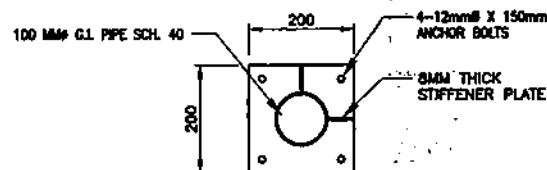

TYPICAL BASE PLATES DETAILS

NTS

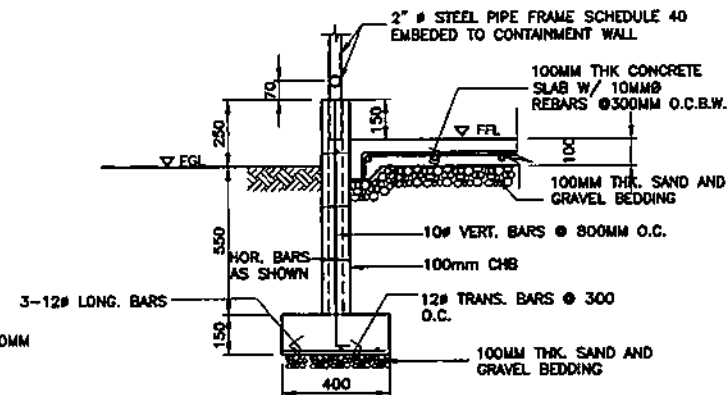


CONTAINMENT WALL (CW-1)


NTS

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. MINIMUM COMPRESSIVE STRENGTH OF CONCRETE SHALL BE $f_c = 28.7 \text{ MPa}$ AT 28 DAYS PERIOD.
3. REINFORCING BARS SHALL CONFORM TO THE LATEST PHILIPPINE REINFORCING BARS SHALL CONFORM TO THE LATEST PHILIPPINE.
4. ALL ASPECTS OF CONSTRUCTION AND DETAILING OF REINFORCEMENTS SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE ACI CODE.
5. ALL STRUCTURAL STEEL SHALL CONFORM TO SPECIFICATIONS FOR A36 STEEL WHILE ALL ANCHOR BOLTS TO A307 SPECIFICATIONS.
6. ALL CONNECTIONS SHALL BE WELDED IN ACCORDANCE WITH THE AMERICAN WELDING SOCIETY.
7. WORK THIS DRAWING WITH ARCHITECTURAL DRAWINGS.


OWNER:		 NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X (IN 10V) MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN SINTOLOLO IN.			
LOCATION: BAYT, SINTOLOLO ISLAND, BALID MARBATE			
TITLE: HAZARDOUS WASTE & SOLID WASTE STORAGE AREA (FOOTING & CONTAINMENT WALL DETAILS)			
DESIGNED	BY	CHKD	DATE
DRWN			
REVIEWED	PRINCIPAL ENGR. / MCHT.		
CHECKED BY			
ELEC.			
MECH.			
SUBMITTED:		H. I. MENDOZA Principal Engineer	
RECOMMENDED:		A. C. ESPRITU Principal Engineer	
APPROVED:		G. B. MAGPOC, JR. Manager, E&C	
DWG. NO. JInDPP-BDC-17.007		SPEC. NO. LUP2221435S	
SCALE: AS SHOWN		BID DRAWING	
REV. 0			

REV.	DATE	NATURE OF REVISION	BY	CHKD.	REC'D.	APPR.

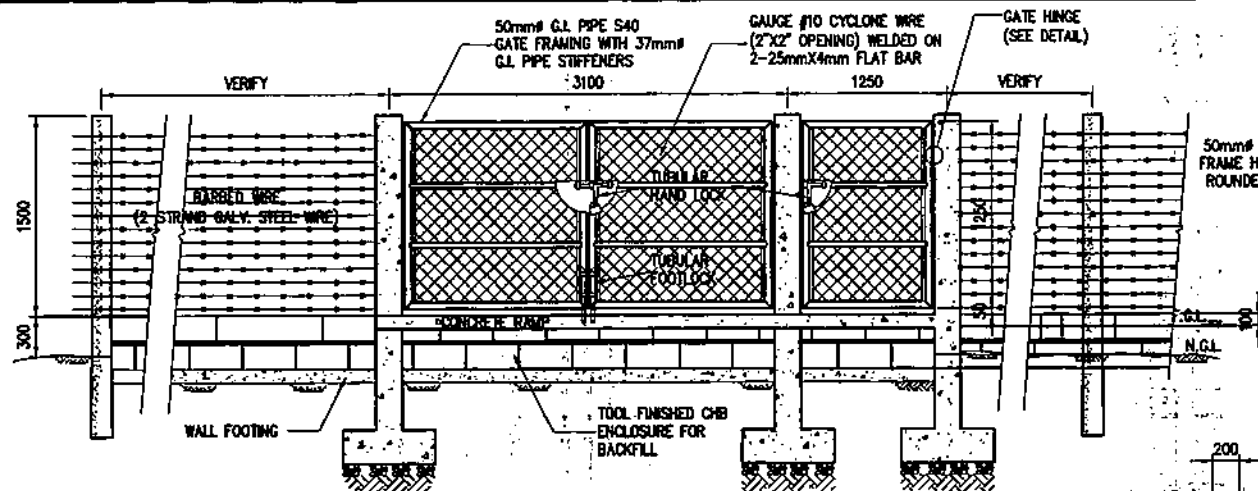


ENTRANCE GATE ELEVATION

SCALE 1:50

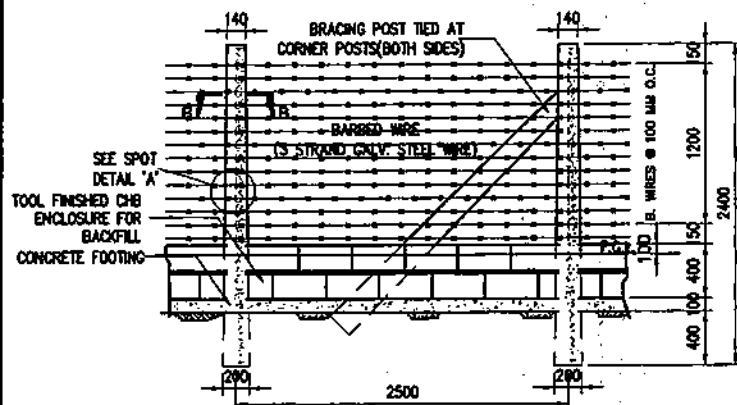


BARBED WIRE FENCE DETAILS


SCALE 1:40




DETAIL 'A'



SECTION B-B

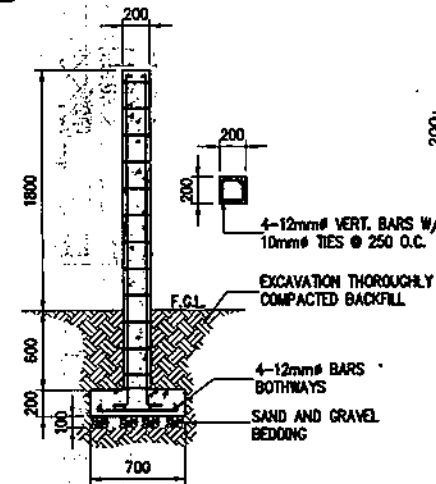

SECTION

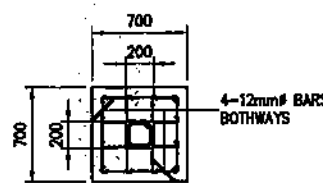


PLAN



DET. OF GATE POST


SCALE 1:40

GATE HINGE



WALL FOOTING DET.

SCALE 1:20

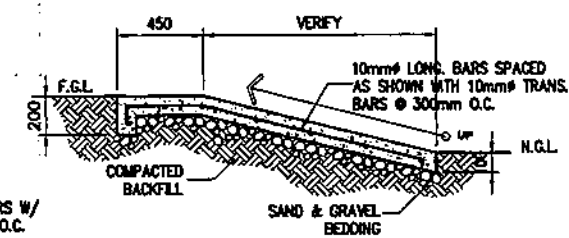


CONCRETE RAMP DET.

SCALE NTS


NOTES:

- ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.
- UNLESS OTHERWISE INDICATED IN THE PLANS OR NOTED IN THE SPECIFICATIONS, THE MINIMUM 28 DAY CYLINDER COMPRESSIVE STRENGTH OF CONCRETE SHALL BE 20.70MPA.
- REINFORCING BARS SHALL CONFORM TO THE LATEST REQUIREMENTS OF PNS FOR DSB GR. 275.
- ALL ASPECTS OF CONSTRUCTION AND DETAILING OF REINFORCEMENTS SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE ACI-318 CODE.


OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 3 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN ANTITOLLO, BALAB, MABATE.			
LOCATION: BRDY, ANTITOLLO ISLAND, BALAB MABATE			
TITLE: TYPICAL ENTRANCE GATE & PERIMETER FENCE (ELEVATION, SECTION & DETAILS)			
DESIGNED	BY	CHKD	DATE
DRAWN	2		
REVIEWED	PRINCIPAL ENGR. (ARCHT.)		
CIVIL/ARCHT			
ELEC.			
MECH.			
SUBMITTED:		H. L. MENDOZA Project Engineer in Charge	
RECOMMENDED:		A.C. ESPRITU Manager, CDD	
APPROVED:		G. B. MAGPOC, JR. Manager, CDD	
DWG. NO. JInDPP-BDC-17.008		SPEC. NO. LuzP22Z1435Se	
SCALE: AS SHOWN		BID DRAWING	
REV.		REV. 0	

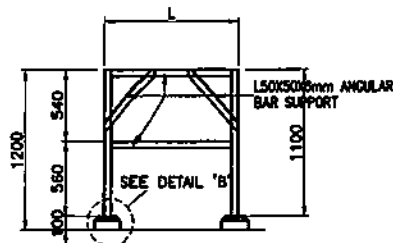


ELEVATION

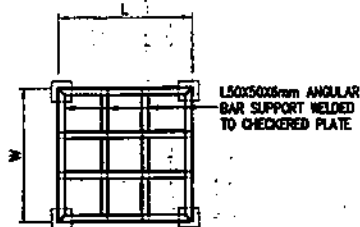


FRAMING PLAN

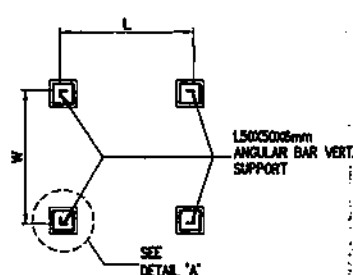

PLAN

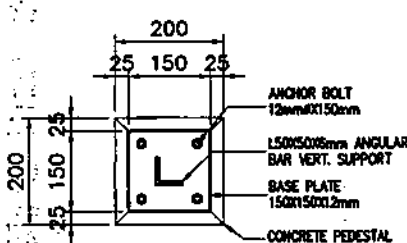


DETAIL 'A'

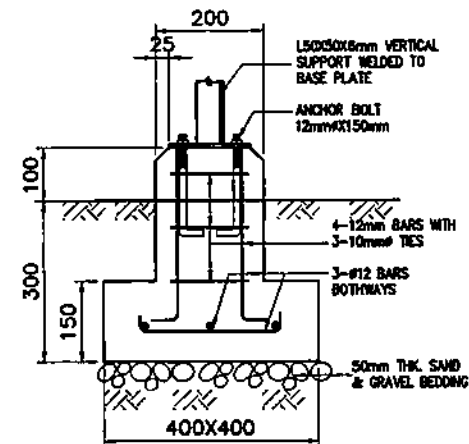


DETAIL 'B'


WATER TANK SUPPORT
SCALE 1:40




SIDE ELEVATION

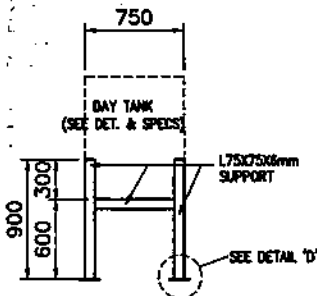


FRONT ELEVATION

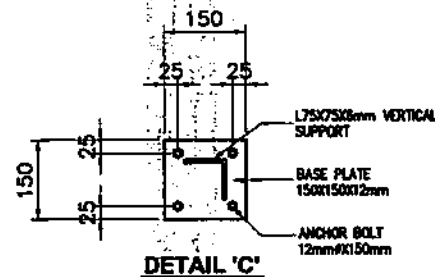


DETAIL 'C'

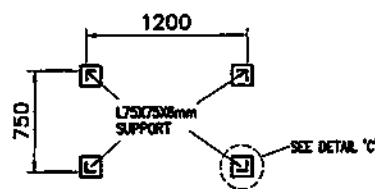

PLAN

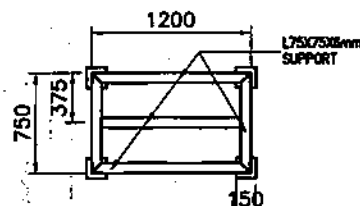

FRAMING PLAN

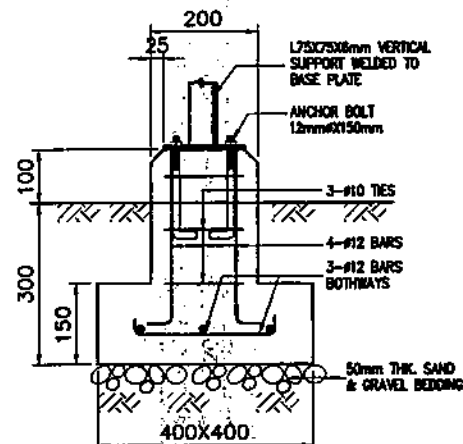


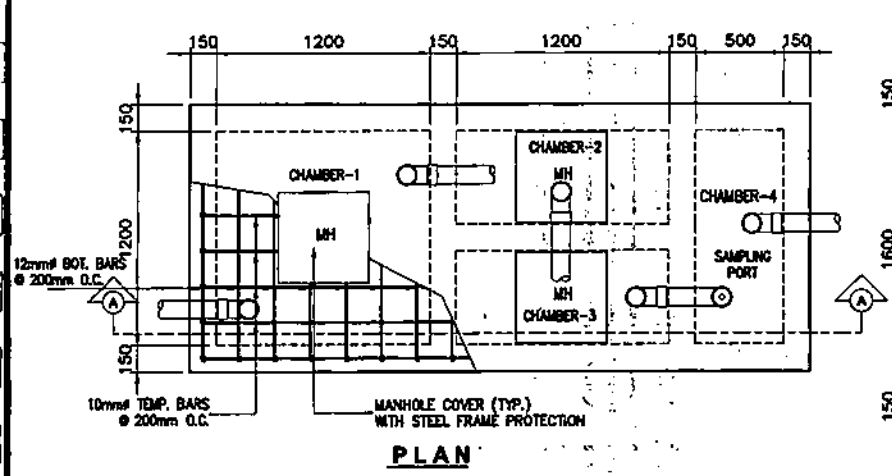
DETAIL 'D'

DAY TANK SUPPORT
SCALE 1:40


NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETER UNLESS OTHERWISE INDICATED.
2. USE STRUCTURAL GRADE STEEL SHAPES, BARS AND PLATES CONFORMING TO ASTM A36.
3. ALL WELDING WORKS SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE AMERICAN WELDING SOCIETY.
4. ALL STRUCTURAL STEEL SHALL BE FABRICATED AND ERECTED IN ACCORDANCE WITH THE AISC SPECIFICATIONS AND CODE OF STANDARD PRACTICE.
5. WORK THIS WITH MECHANICAL DRAWINGS.
6. FINAL DIMENSION OF WATER TANK SUPPORT WILL VARY IN THE WATER TANK TO BE SUPPLIED.


OWNER:		 NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 180 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN ANTITOLLO IN BALIS, MARABATE			
LOCATION: BRBY, ANTITOLLO ISLAND, BALIS MARABATE			
TITLE: TYPICAL WATER TANK AND DAY TANK SUPPORT (PLAN, SECTION AND DETAILS)			
DESIGNED	BY	CHKD	DATE
DRAWN	BY	CHKD	DATE
REVIEWED	PRINCIPAL ENGR. / ARCHT.	RECOMMENDED	
CHKD/ARCHT		APPROVED	
ELEC.			
MECH.			
DWG. NO. JlnDPP-BDC-17.010		SPEC. NO. LuzP2221435S	
SCALE: AS SHOWN		BID DRAWING	
REV. DATE		NATURE OF REVISION	
BY		CHKD. RECD. APD.	




PLAN

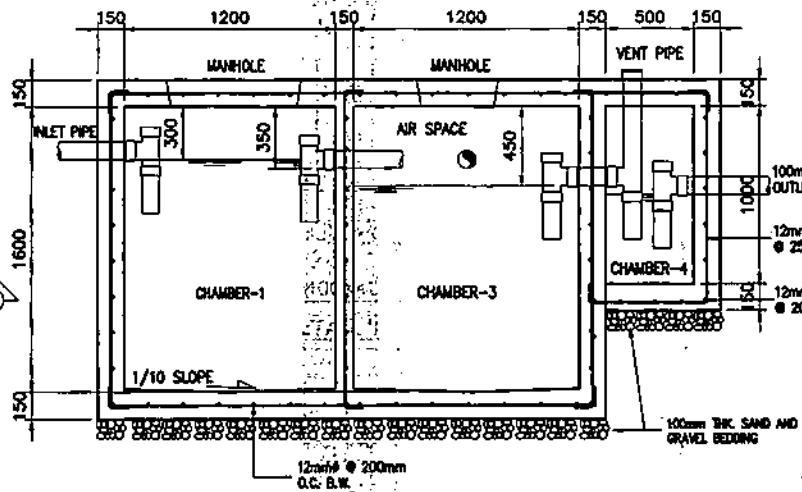


SECTION 'A'

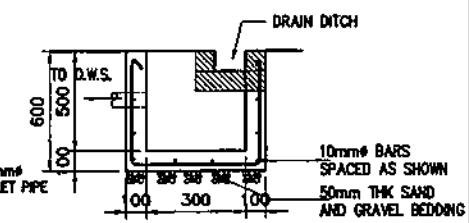


SECTION

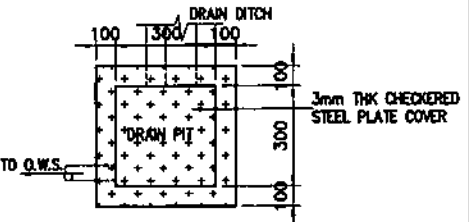


PLAN

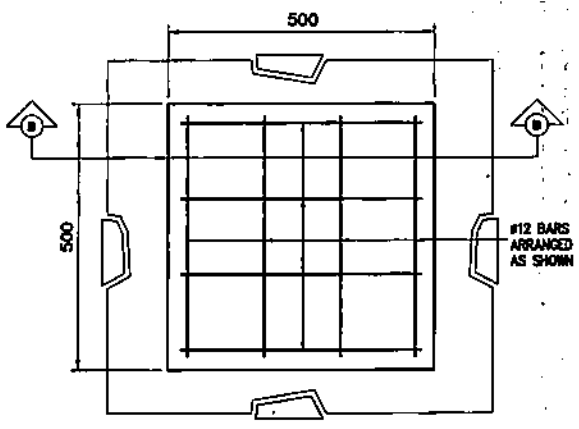

PLAN

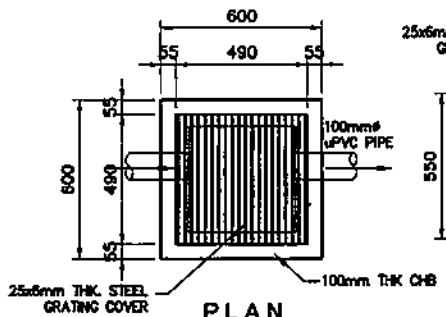


PLAN

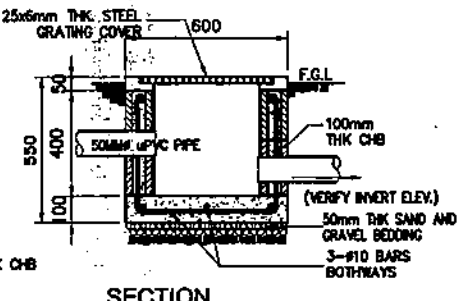


SECTION


DETAIL OF CATCH BASIN (CB)
SCALE 1:20

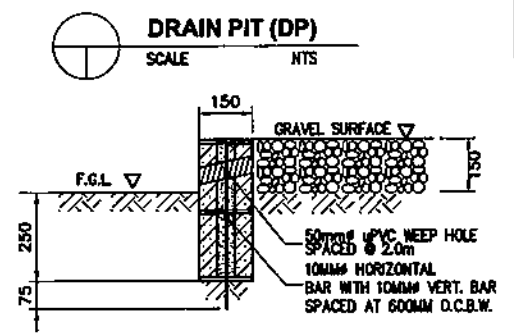

CHB ZOCALO WALL
SCALE NTS

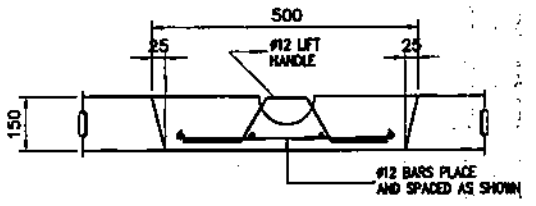

SECTION B-B

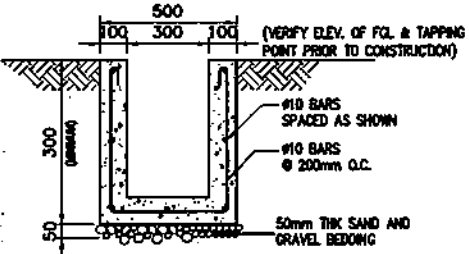


DETAIL OF OPEN RC CANAL
SCALE 1:20

MANHOLE COVER
SCALE 1:10


NOTES:

- ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED IN THE DRAWING.
- USE 20.70MPa CONCRETE FOR ALL DRAINAGE APPURTENANT STRUCTURES UNLESS OTHERWISE INDICATED.
- REINFORCING STEEL BARS SHALL CONFORM TO THE REQUIREMENTS OF THE PNS FOR DEFORMED STEEL BARS GRADE 275.
- POLYVINYL CHLORIDE (PVC) PIPE SHALL BE UNPLASTICIZED CONFORMING TO ISO4435 OR EQUIVALENT.


OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2.2 MW MODULAR DIESEL GENERATING SETS ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JANTOLO IS, BALAB, MARBATE			
LOCATION: BUDY, JANTOLO ISLAND, BALAB MARBATE			
TITLE: SEPTIC TANK, CATCH BASIN & OPEN CANAL (SECTION AND DETAILS)			
DESIGNED	BY	CHKD	DATE
DRAWN	BY	CHKD	DATE
REVIEWED	BY	CHKD	DATE
CIVIL/ARCHT	BY	CHKD	DATE
ELEC	BY	CHKD	DATE
MECH	BY	CHKD	DATE
SUBMITTED:		H. L. MENDOZA Principal Engineer & CSO	
RECOMMENDED:		A. G. B. RITTO Manager, CEAD	
APPROVED:		G. B. MAGPOG, JR. Manager, DSD	
DWG. NO. JinDPP-BDC-17.011		SPECR. NO. LuzP22Z1435S	
SCALE AS SHOWN		BID DRAWING	
REV.		REV. 0	

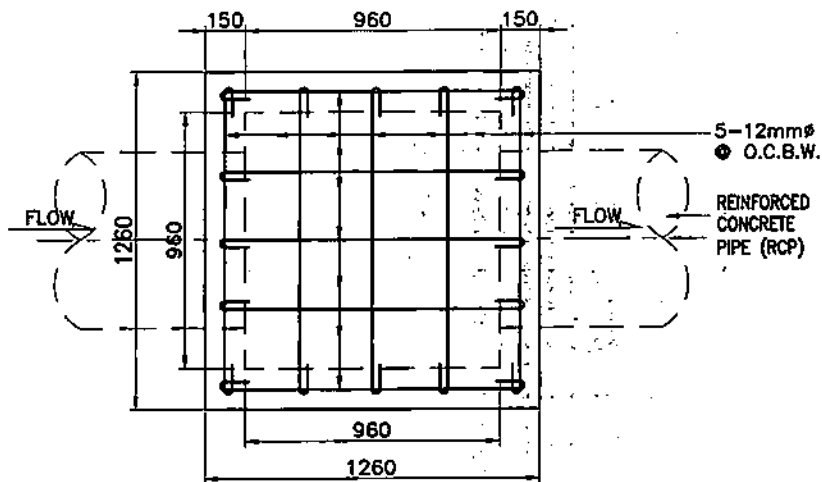


BOTTOM SLAB PLAN

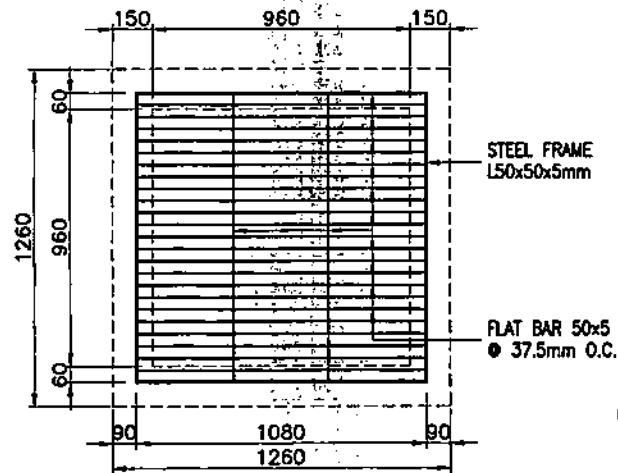

PLAN

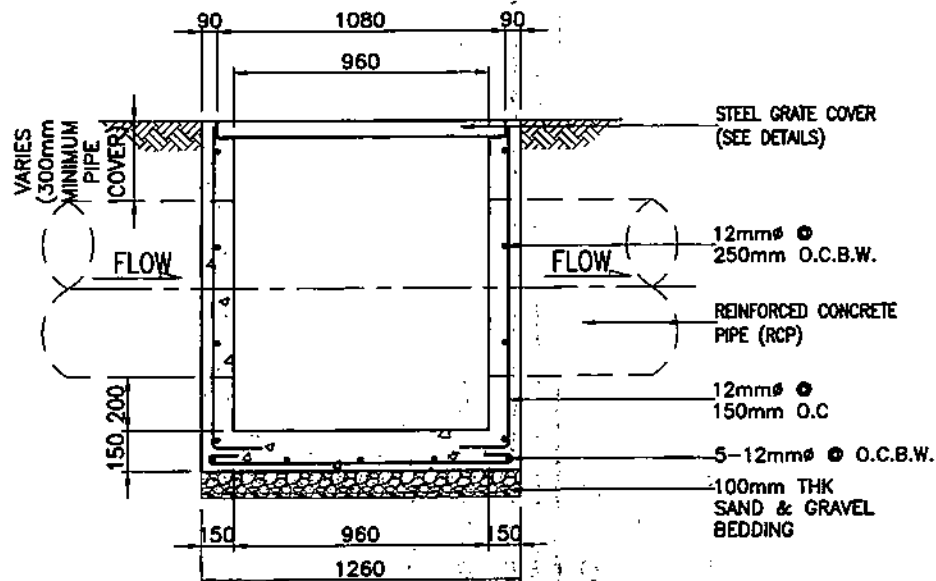


TYPICAL SECTION

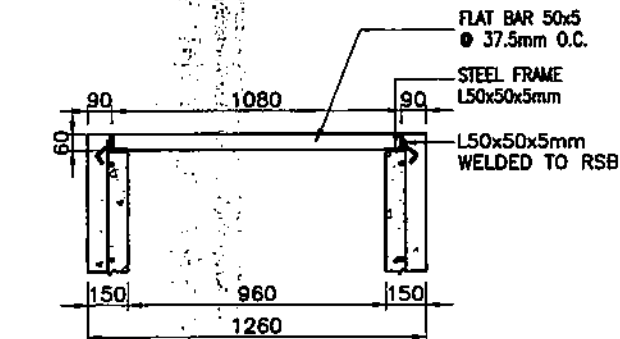

SECTION







DETAILS OF STEEL GRATE COVER
SCALE 1:20

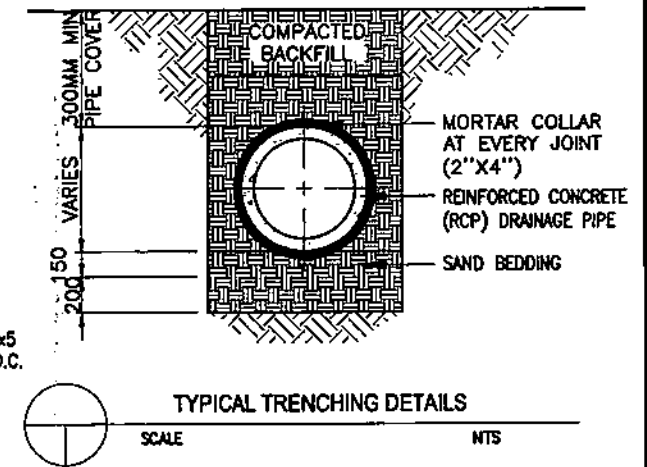

TYPICAL TRENCHING DETAILS

TYPICAL DETAILS OF SURFACE INLET MANHOLE (SIM)
SCALE 1:20


OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATORS WITH ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTULO RL, BALUD, MARBATE			
LOCATION: DIST. JINTOTULO INLAND, BALUD MARBATE			
TITLE: DRAINAGE SYSTEM (DETAILS OF SURFACE INLET MANHOLE, SIM)			
DESIGNED	BY	CHKD	DATE
DRAWN			
REVIEWED	PRINCIPAL ENGR./ARCHT.		
CIVIL/ARCHT			
ELEC.			
MECH.			
SUBMITTED:		H. L. MENDOZA Planning Engineer / E&D	
RECOMMENDED:		A. C. ESPERITU Manager, E&D	
APPROVED:		G. B. MAGPOC, JR. Manager, E&D	
DWG. NO. JinDPP-BDC-17.012		SPEC. NO. LuzP22Z1435S	
SCALE: AS SHOWN		BID DRAWING	
REV. 5		REV. 5	

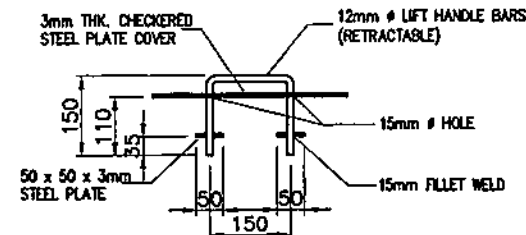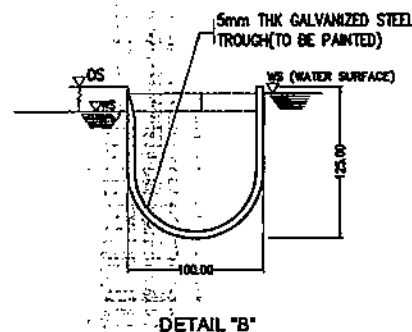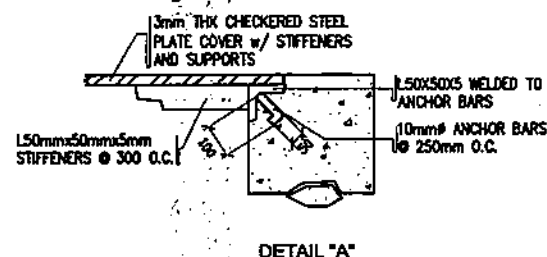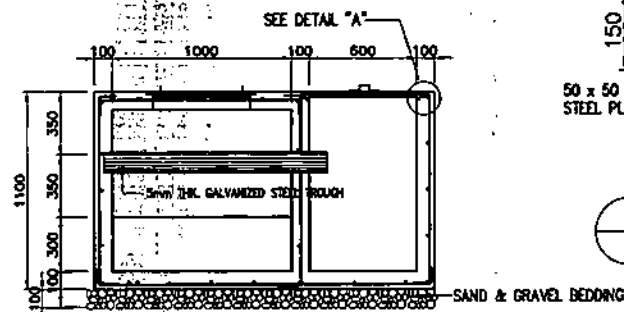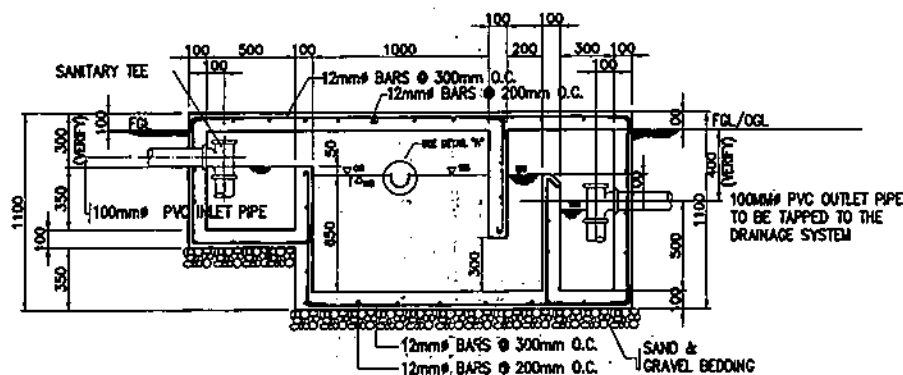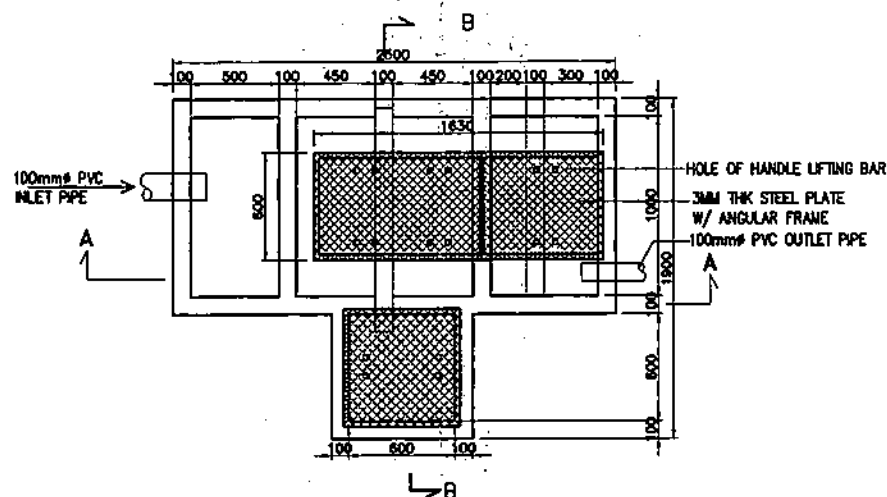


NOTES:

1. ALL DIMENSIONS AND ELEVATIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.
2. MINIMUM COMPRESSIVE STRENGTH OF CONCRETE SHALL BE $f_c = 20.70 \text{ MPa}$ AT 28 DAY PERIOD.
3. ALL REINFORCING STEEL BARS SHALL CONFORM TO THE LATEST REQUIREMENTS OF PNS FOR DEFORMED STEEL BARS, GRADE 275.
4. ALL ASPECTS OF CONSTRUCTION AND DETAILING OF REINFORCEMENTS SHALL BE IN ACCORDANCE WITH THE LATEST PROVISIONS OF ACI-318 CODE.
5. BEFORE THE START OF THE CONSTRUCTION, VERIFY THE DRAINAGE STRUCTURES & ELEVATIONS CONNECTED TO THE OIL-WATER SEPARATOR.
6. AFTER THE COMPLETION OF THE CONSTRUCTION, THE OIL-WATER SEPARATOR MUST BE FILLED WITH WATER UP TO THE BOTTOM RIM OF THE STEEL TROUGH.


OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 x 150 KW MODULAR DIESEL GENERATING SETS ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN INTOTULO IS, BALUB, MARBATE			
LOCATION: SUBST. INTOTULO ISLAND, BALUB MARBATE			
TITLE: OIL-WATER SEPARATOR			
DESIGNED	BY	CHKD	DATE
DRAWN			
REVIEWED	PRINCIPAL ENGR./ARCHT.	RECOMMENDED	
CIVIL/ARCHT		APPROVED	
ELEC.			
MECH.			
DWG. NO. JInDPP-BDC-17.013		SPEC. NO. LuzP22Z1435S0	
SCALE AS SHOWN		BID DRAWING	
REV. DATE		NATURE OF REVISION	
BY		CHKD. RECD. APPL.	

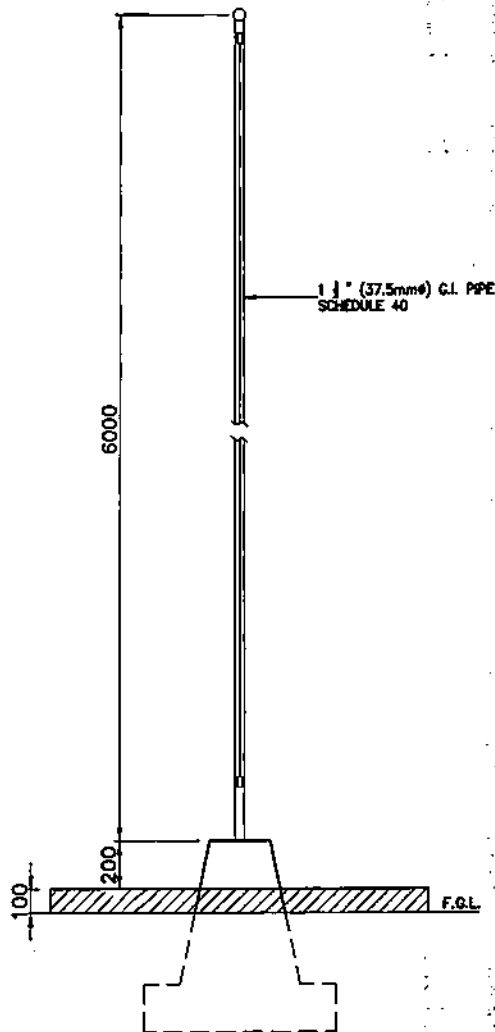

FLAG POLE ELEVATION
SCALE 1:15

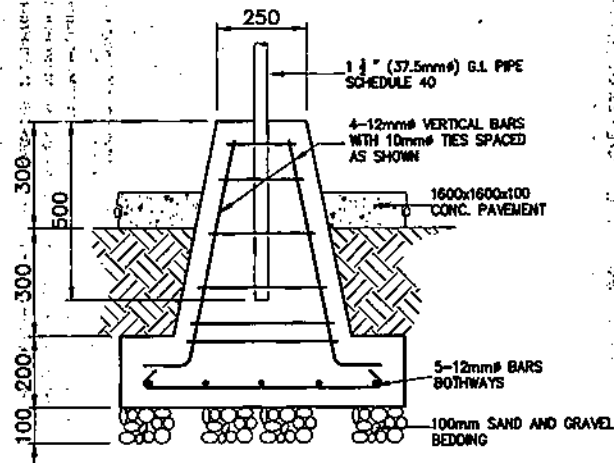


SECTION

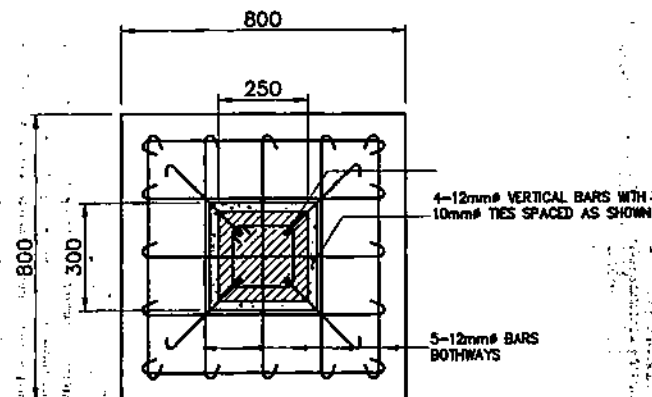

PLAN

FLAG POLE FOUNDATION
SCALE 1:15

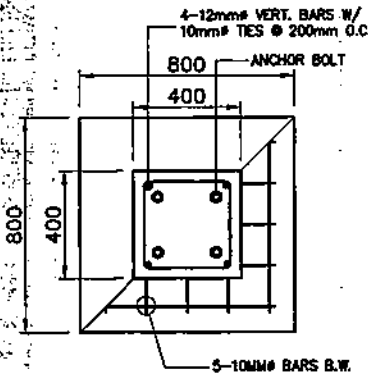

PLAN



PERIMETER LIGHTING POLE FOUNDATION

SCALE

1:20


NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED IN THE DRAWING.
2. USE 20.70MPa CONCRETE FOR ALL APPURTENANT STRUCTURES UNLESS OTHERWISE INDICATED.
3. REINFORCING STEEL BARS SHALL CONFORM TO THE REQUIREMENTS OF THE PNS FOR DEFORMED STEEL BARS GRADE 275.



OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTULO II, BALID, MARBATE			
LOCATION: BRST, JINTOTULO ISLAND, BALID MARBATE			
TITLE: FLAG POLE & LIGHTING POLE FOUNDATION (PLAN, SECTIONS & DETAILS)			
DESIGNED	BY	CHKD	DATE
DRAWN	BY	CHKD	DATE
REVIEWED	PRINCIPAL ENGR./ARCHT.	RECOMMENDED	
CHECKED		APPROVED	
ELEC.			
MECH.			
DWG. NO. JinDPP-BDC-17.014		SPEC. NO. LuzP2221435S	
SCALE: AS SHOWN		BID DRAWING	
REV. 0			

REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPD.

(REFER TO STEEL POLE DESCRIPTION)


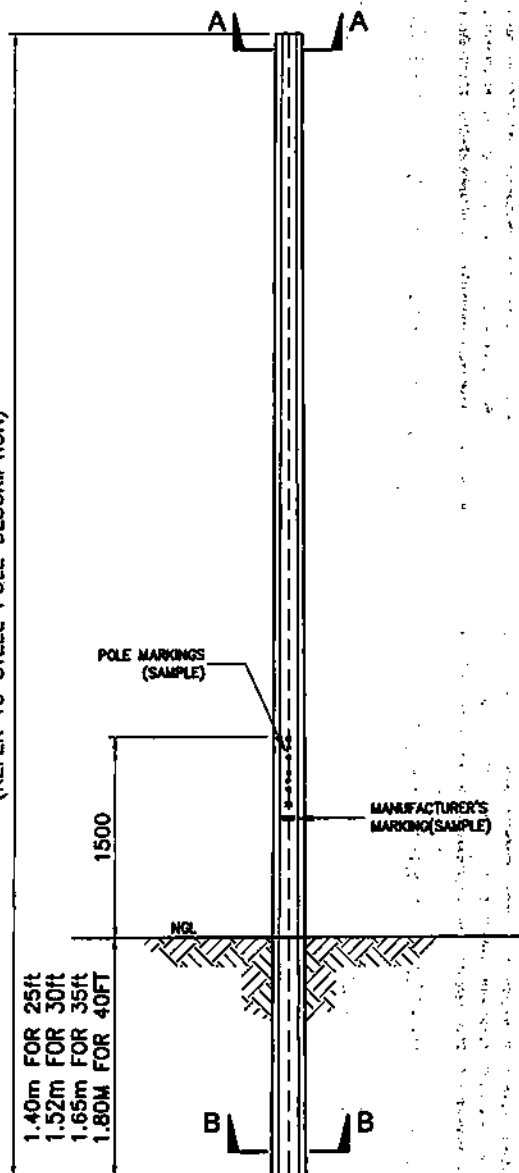


ELEVATION OF STEEL POLE
SCALE 1:40

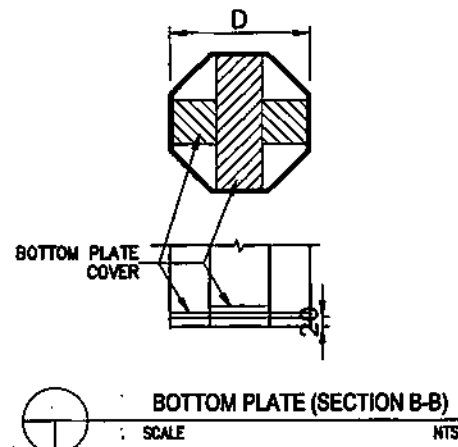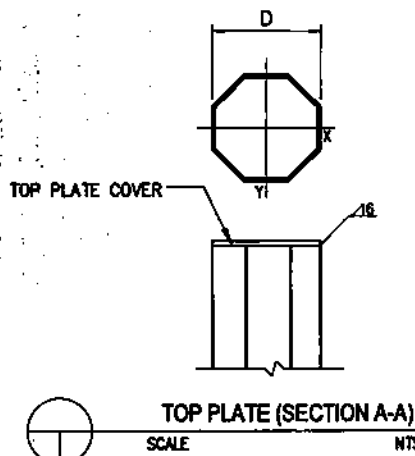

SHAFT INFORMATION


DESCRIPTION \ LENGTH	25 ft.	30 ft.	35 ft.	40 ft.
TIP DIAMETER	150mm	200mm	200mm	200mm
BUTT DIAMETER	240mm	260mm	300mm	320mm
THICKNESS	4mm	4mm	4mm	4mm

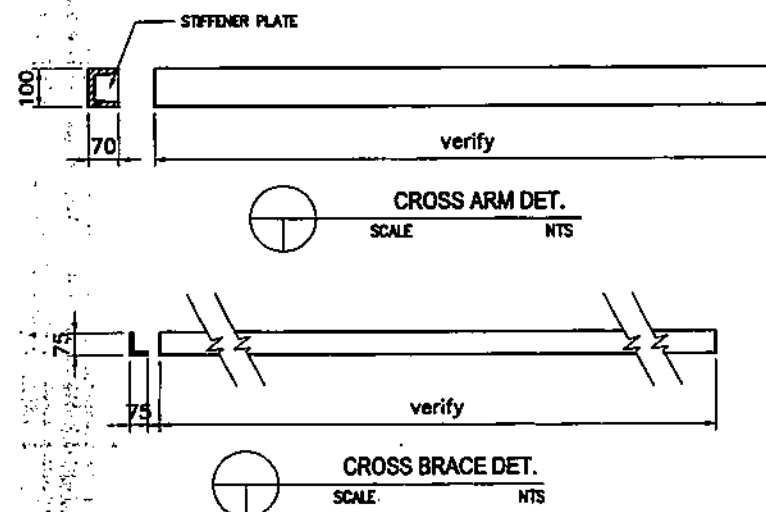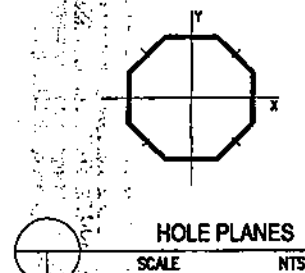


NOTES:

- ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
- DRILL HOLES ON CENTERLINE OF POLE FACES.
- HOLE LOCATION AND DIAMETER SHALL BE REFERRED TO ELECTRICAL DRAWINGS FOR DIFFERENT TYPES OF POLE.
- POLES SHALL BE OCTAGONAL (8 SIDES) AND THE DIAMETERS ARE MEASURED ON THE OUTSIDE AND ACROSS THE FLAT SURFACES.
- THE MATERIAL FOR POLE SHALL BE 345MPa (50ksi) MINIMUM YIELD STRENGTH OF ROLLED STEEL PLATE.
- ALL POLES ARE HOT DIP GALVANIZED IN ACCORDING WITH ASTM A123M WITH MINIMUM COATING THICKNESS OF 85 MICRONS.
- TIP AND BUTT OF POLES SHALL BE COVERED WITH PLATE SIMILAR TO SHAFT BODY THICKNESS.
- CROSSARMS SHALL BE 6MM THICK BENDED CHANNEL SECTION PROVIDED WITH 6MM THICK STIFFENER PLATE WELDED AT 300MM ON CENTERS.
- CROSS BRACES SHALL BE 6MM THICK ANGULAR SECTION. LENGTHS AND HOLE LOCATIONS SHALL BE REFERRED TO ELECTRICAL DRAWINGS.


OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 110 KV MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTULO RD.			
LOCATION: BRGY. JINTOTULO ISLAND, BALKIS MARBATE			
TITLE:		DIRECT BURIAL STEEL POLE (SECTION & DETAILS)	
DESIGNED	BY	CHD	DATE
DRAWN	BY	CHD	DATE
REVIEWED	BY	CHD	DATE
CHECKED	BY	CHD	DATE
ELEC.	BY	CHD	DATE
MECH.	BY	CHD	DATE
SUBMITTED:		H. L. BENDOZA PROJECT ENGINEER	
RECOMMENDED:		A. C. BENDITO PROJECT ENGINEER	
APPROVED:		G. B. MAGPOC, JR. MANAGER	
DWG. NO. JInDPP-BDC-17.015		SPECS. NO. LuzP22Z1435S4	
REV. DATE		NATURE OF REVISION	
BY		CHD	
RECD.		APVD.	
SCALE: AS SHOWN		BID DRAWING	
REV. 0			

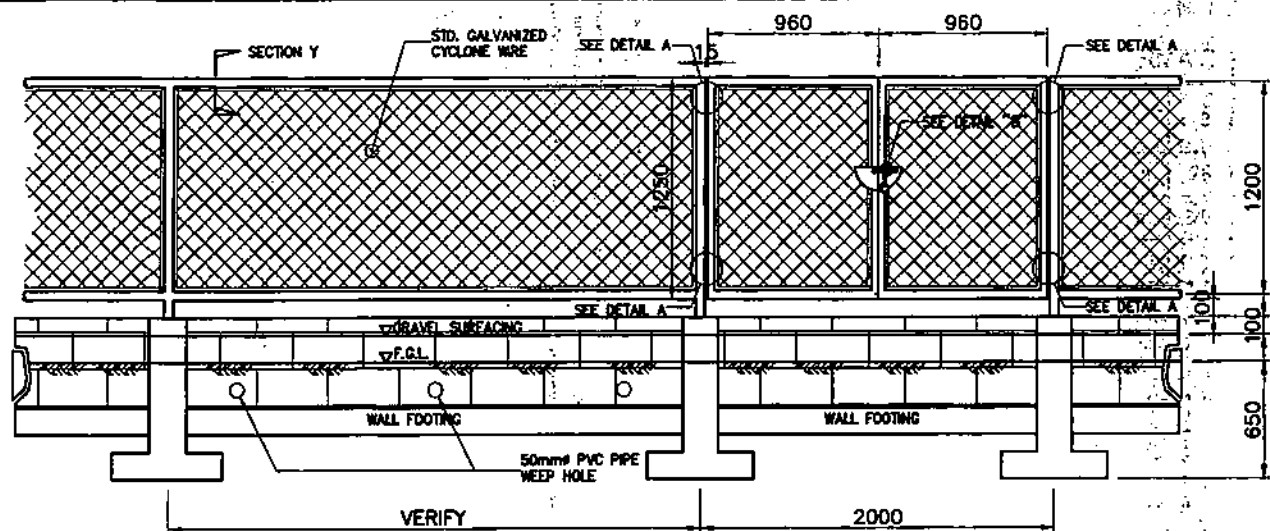


SECTION Y
SCALE 1:30

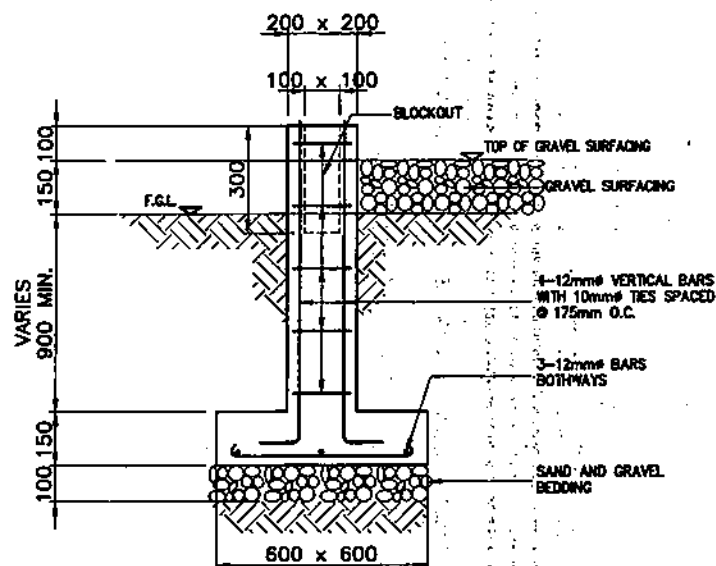


PEDESTAL FOOTING
SCALE 1:15

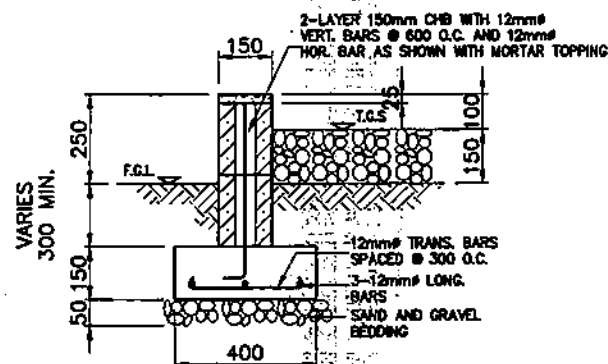


WALL FOOTING
SCALE 1:15

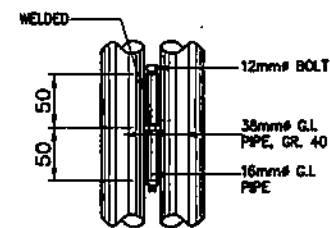

DETAIL 'A'

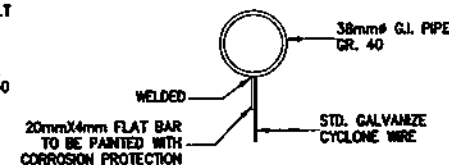

SECTION Y

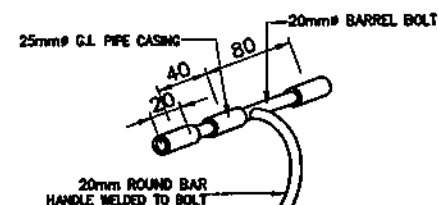


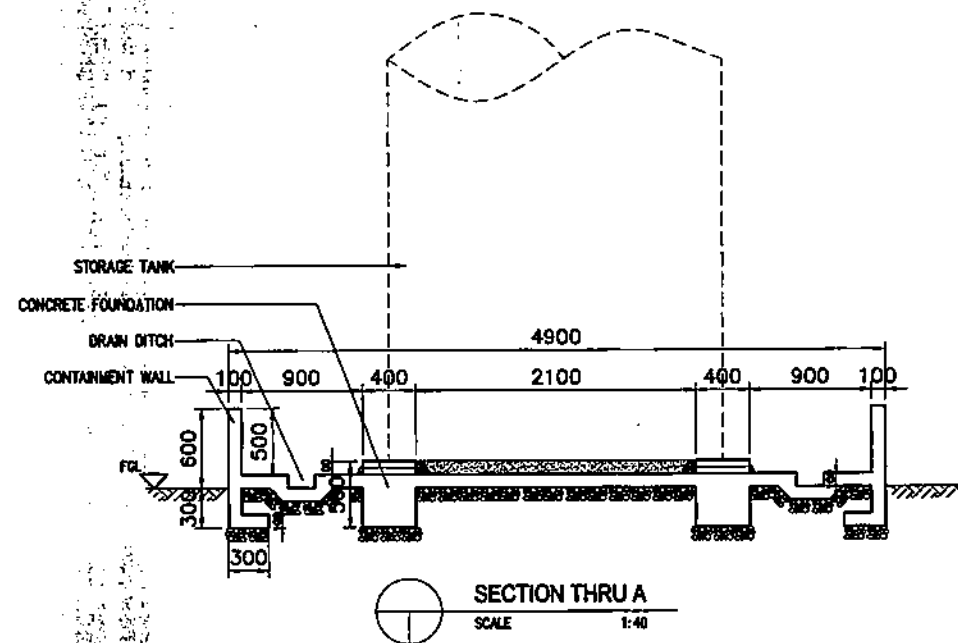
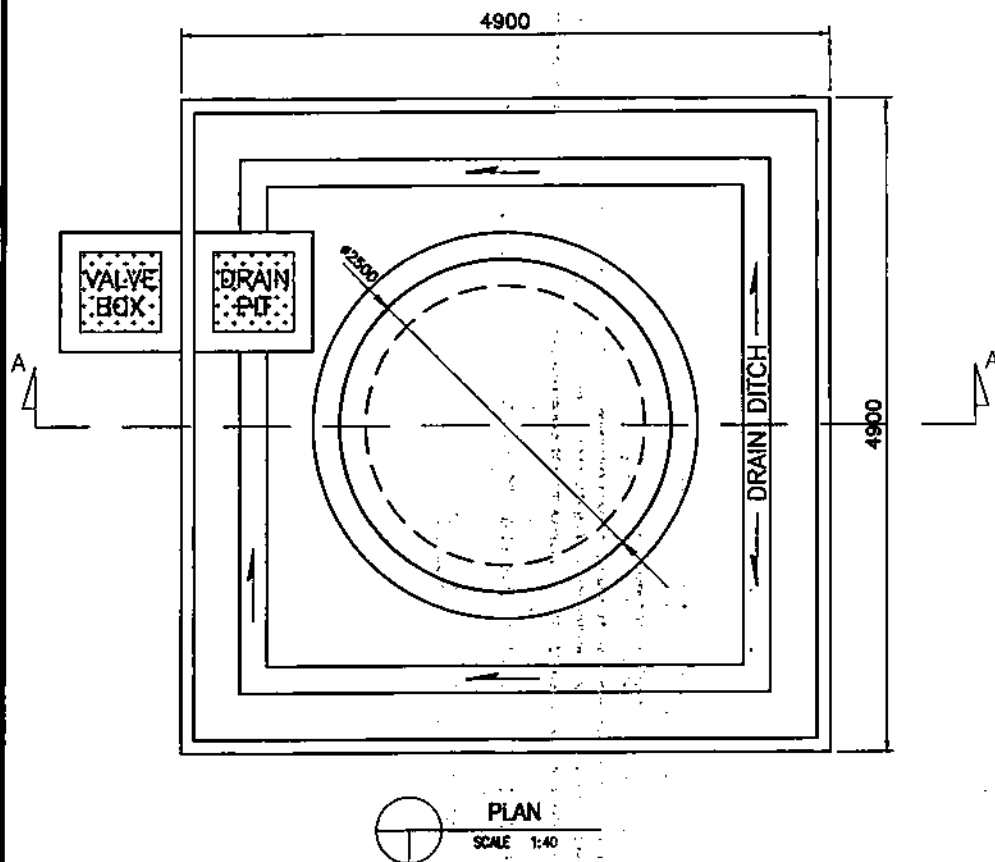
6mm THK SLOTTED STEEL PLATE
HASP W/ 10mm ROUND BAR LOOP

DETAIL 'B'

NOTES:


1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.
2. PLAN/LAYOUT OF SECLUSION FENCE TO BE CONSTRUCTED ARE INDICATED IN ELECTRICAL DRAWING.
3. WORK THIS WITH ELECTRICAL DRAWINGS.

OWNER:				NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 138 KVP MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JANTOTULO IS, BALUD, MARBATE					
LOCATION: BRST, JANTOTULO ISLAND, BALUD MARBATE					
TITLE: SECLUSION FENCE & PEDESTRIAN GATE (PLAN, SECTION & DETAILS)					
DESIGNED	BY	CHD	DATE	SUBMITTED	H. L. MENDOZA Principal Engineer
DRAWN	BY	CHD	DATE	RECOMMENDED	A. C. ESPRITU Engineer
REVIEWED	BY	CHD	DATE	APPROVED	G. B. MAGPOC, JR. Manager, DDO
CHECKED	BY	CHD	DATE		
ELEC.	BY	CHD	DATE		
MECH.	BY	CHD	DATE		
DWG. NO. JlnDPP-BDC-17.016			SPEC. NO. LuzP22214359		
REV. DATE			NATURE OF REVISION		
BY			CHD		
RECD.			APPL.		
SCALE: AS SHOWN			BID DRAWING		
REV. 0					




NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.
2. CONCRETE POURING SHALL BE MONOLITHIC.
3. WORK THIS WITH MECHANICAL DRAWINGS.

OWNER:		 NATIONAL POWER CORPORATION AGHAM ROAD, DALIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 125 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JANTOLOLO IS. LOCATION: BRIST, JANTOLOLO ISLAND, BALABO MARIANA			
TITLE: FOST FOUNDATION & CONTAINMENT WALL (PLAN & SECTION)			
DESIGNED	BY	CHKD	DATE
DRAWN			
REVIEWED	PRINCIPAL ENGR. / ARCHT.	RECOMMENDED:	H. L. MENDOZA Principal Engineer / ELEC.
CIVIL/ARCHT		APPROVED:	A. C. ESPINOSA Engr. / ELEC.
ELEC.			G. B. MAGPOC, JR. Manager, EEC
MECH.			
DWG. NO. JInDPP-BDC-17.017		SPEC. NO. LuzP22Z14359	
SCALE: AS SHOWN		BID DRAWING	
REV. 0			

REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPL.



DRAIN & BLOCKOUT PLAN

SCALE


1:40



BLOCKOUT DETAILS

SCALE


NTS

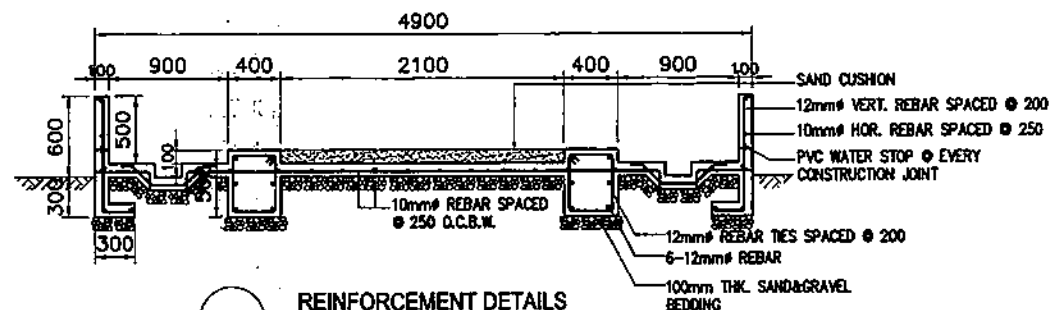

REINFORCEMENT DETAILS

SCALE

1:40

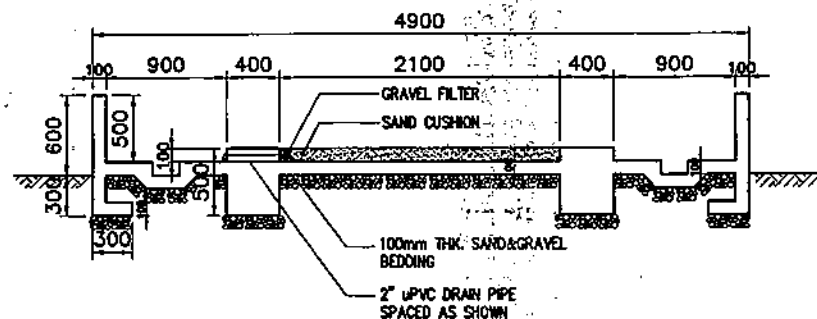


DRAIN SECTION


SCALE

1:40


- NOTES:**

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.
2. CONCRETE POURING SHALL BE MONOLITHIC.
3. WORK THIS WITH MECHANICAL DRAWINGS.


OWNER:		 NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 110 KV MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN ANTITOLO IN BALID, MARABATE			
LOCATION: BRST, ANTITOLO ISLAND, BALID MARABATE			
TITLE: FOST FOUNDATION & CONTAINMENT WALL (REINFORCEMENTS & DETAILS)			
DESIGNED	BY	CHKD	DATE
DRAWN			
REVIEWED	PERSONAL ENGR. / ARCHT.		
CHECKED			
ELEC.			
MECH.			
SUBMITTER:		H. L. MENDOZA Planning Engineer / PCAB	
RECOMMENDED:		A. C. ESPINOSA Electrical Engt PCAB	
APPROVED:		G. S. MAGPOC, JR. Manager, DDD	
DWG. NO. JlnDPP-BDC-17.018		SPECS. NO. L12P22Z1435S4	

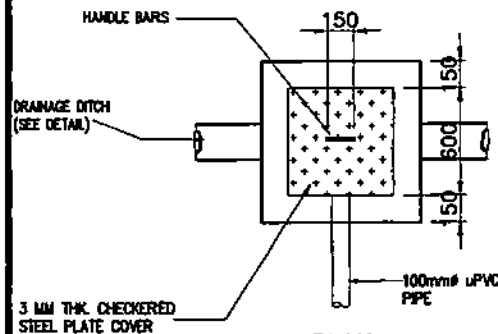



PLAN

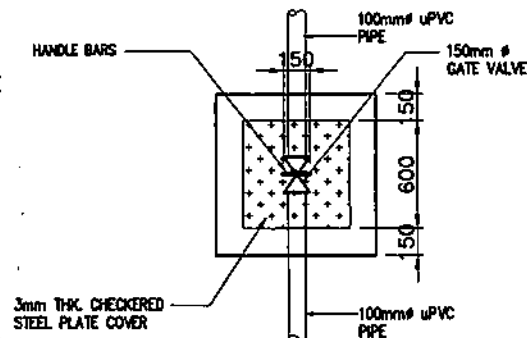


PLAN

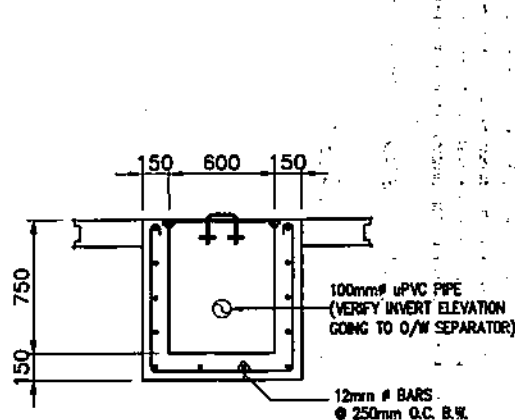

SECTION

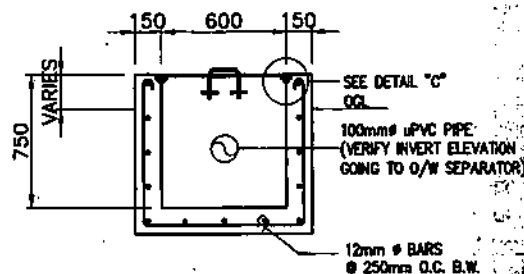



SECTION

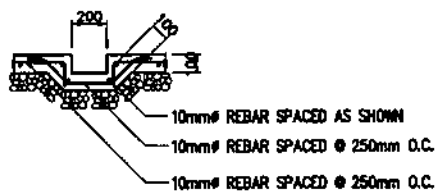

NOTES:





1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.
2. MINIMUM COMPRESSIVE STRENGTH OF CONCRETE IS $f_c = 20.70 \text{ MPa}$.
3. REINFORCING STEEL BARS SHALL CONFORM TO THE REQUIREMENTS OF THE PHILIPPINE NATIONAL STANDARD (LATEST EDITION) FOR DEFORMED BARS GRADE 275.
4. WORK THIS DRAWING WITH MECHANICAL DRAWINGS.

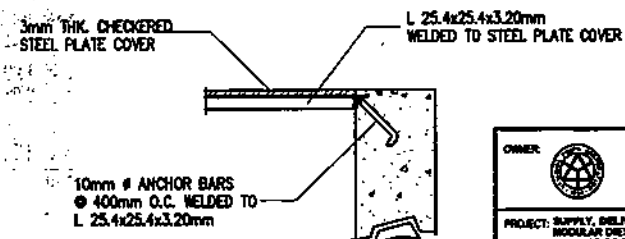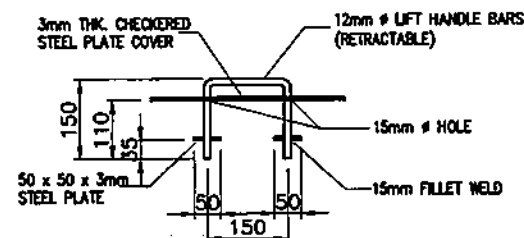

DETAIL - C

OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 3 X 118 KW MODULAR DIESEL GENERATORS WITH ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTULO TA, BALABO, MARBATE			
LOCATION: BRGT. JINTOTULO ISLAND, BALABO MARBATE			
TITLE:		FAST DRAIN PIT & VALVE BOX (PLAN, SECTION & DETAILS)	
DESIGNED	BY	CHKD	DATE
DRAWN	BY	CHKD	DATE
REVIEWED	BY	CHKD	DATE
CHECKED	BY	CHKD	DATE
ELEC.	BY	CHKD	DATE
MECH.	BY	CHKD	DATE
SUBMITTED:		H. L. MENDOZA Project Engineer / CEO	
RECOMMENDED:		A. C. ESPRITU Project Engineer / CEO	
APPROVED:		G. B. MAGPOC, JR. Manager, EEO	
DWG. NO. JINPPP-BDC-17.019		SPECS. NO. LuzP22Z1435S	
SCALE: AS SHOWN		BID DRAWING	
REV. 0			


REV.	DATE	NATURE OF REVISION	BY	CHKD.	REC'D.	APP'D.

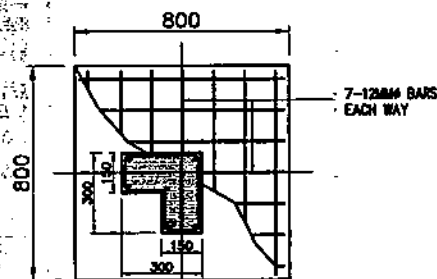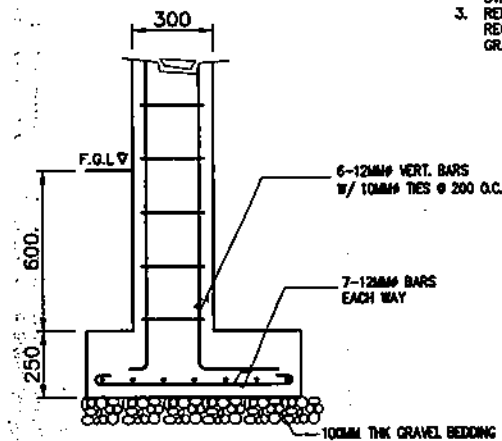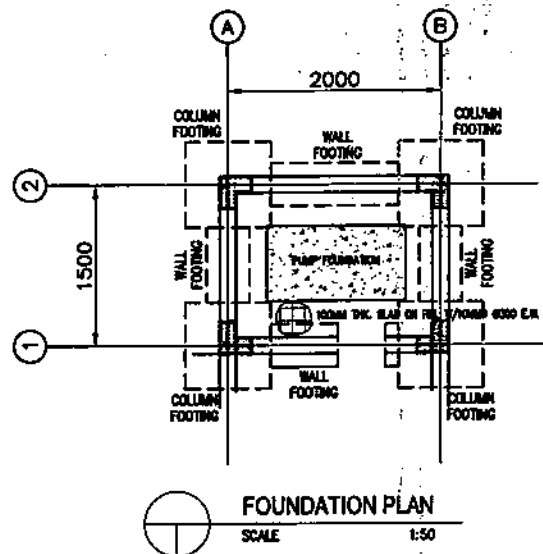


PLAN



1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED IN THE DRAWING.
2. USE 20.70MPa CONCRETE FOR ALL APPURTENANT STRUCTURES UNLESS OTHERWISE INDICATED.
3. REINFORCING STEEL BARS SHALL CONFORM TO THE REQUIREMENTS OF THE PNS FOR DEFORMED STEEL BARS GRADE 275.


OWNER:		 NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 136 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREA IN INTOTOLDO IS. BALUD, MARBATE			
LOCATION: BWSY, INTOTOLDO ISLAND, BALUD MARBATE			
TITLE:		PUMPHOUSE (FOUNDATION PLAN & COLUMN DETAILS)	
DESIGNED	BY	CHKD	DATE
DRAWN	<i>[Signature]</i>		
REVIEWED	PRINCIPAL ENGR. (ARCHT.)		
CHALNCHT			
ELEC.			
MECH.			
SUBMITTED:		<i>[Signature]</i> H. L. MENDOZA Project Engineer, CEAD	
RECOMMENDED:		<i>[Signature]</i> A. C. ESPRITU Engineer, CEAD	
APPROVED:		<i>[Signature]</i> G. B. MAGPOC, JR. Manager, EOD	
DWS. NO. JinDPP-BDC-17-020		SPECS. NO. LuzP22214355	
SCALE: AS SHOWN		BID DRAWING REV. 0	

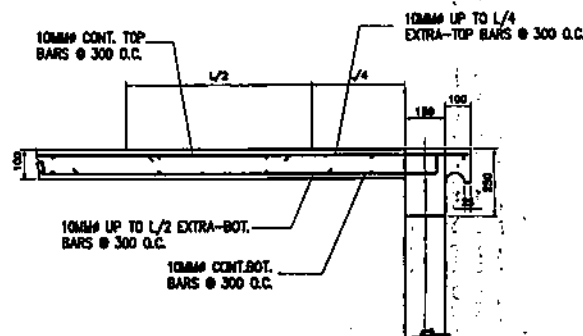

ROOF SLAB REINFORCEMENT

SCALE


NTS

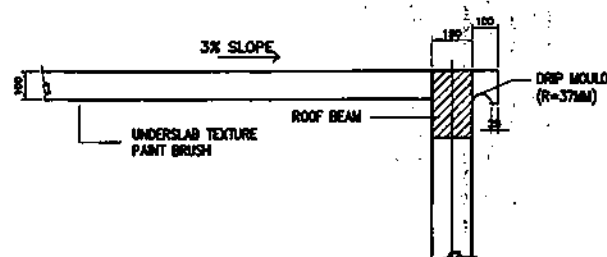

ROOF SLAB DETAIL

SCALE


NTS

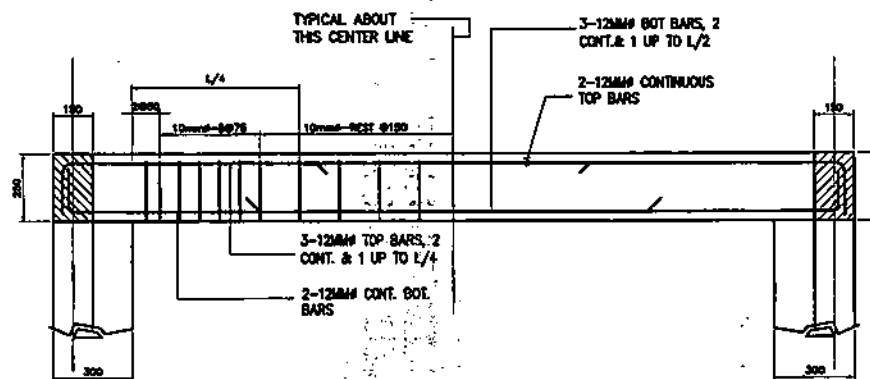


BEAM DETAIL

SCALE

NTS



SECTION AT MIDSPAN



SECTION AT SUPPORT



BEAM SECTION

SCALE

NTS

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED IN THE DRAWING.
2. USE 20.70MPa CONCRETE FOR ALL APPURTENANT STRUCTURES UNLESS OTHERWISE INDICATED.
3. REINFORCING STEEL BARS SHALL CONFORM TO THE REQUIREMENTS OF THE PNS FOR DEFORMED STEEL BARS GRADE 275.

OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JANTOLOLO IS.			
LOCATION: BRGY. JANTOLOLO ISLAND, BALUD MARBATE			
TITLE: PUMPHOUSE (ROOF BEAM/SLAB SECTION & DETAILS)			
DESIGNED	BY	CHKD	DATE
DRAWN			
REVIEWED	PRINCIPAL ENGR. / ARCHT.		SUBMITTER: H. L. MENDOZA Principal Engineer, CEA
CIVIL/ARCHT			RECOMMENDED: A. C. ESPRITU Manager, CEA
ELEC.			APPROVED: G. B. MAGPOC, JR. Manager, CEA
MECH.			
DWG. NO. JinDPP-BDC-17.021		SPEC. NO. LuzP22Z1435Sg	
SCALE: AS SHOWN		BID DRAWING	
REV. 0		REV. 0	

REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPD.

TERMS OF REFERENCE

**SUPPLY, DELIVERY, INSTALLATION, TEST, AND
COMMISSIONING OF 2 X 150 KW MODULAR DIESEL
GENERATING SETS, ASSOCIATED ELECTRICAL
EQUIPMENT & BALANCE OF PLANT FOR THE
ELECTRIFICATION OF NEW AREA IN JINTOLO IS.,
BALUD, MASBATE**

LuzP22Z1435Se


BID DRAWINGS

MECHANICAL DRAWINGS




SECTION VI - BID DRAWINGS**MW - MECHANICAL DRAWINGS**


DRAWING NO.	TITLE
JinDPP-BDM-17.001	PLANT LAYOUT
JinDPP -BDM-17.002	EQUIPMENT AND PIPING LAYOUT
JinDPP -BDM-17.003	DOMESTIC WATER P & I DIAGRAM
JinDPP -BDM-17.004	TYPICAL SHALLOW WELL DETAILS
JinDPP -BDM-17.005	900 LITER DAY TANK
JinDPP -BDM-17.006	FUEL OIL FILLING SYSTEM (P & I DIAGRAM)
JinDPP -BDM-17.007	TANK STAIR AND RAILING DETAILS (10 KL FUEL OIL STORAGE TANK)
JinDPP -BDM-17.008	LEVEL GAUGE INDICATOR DETAILS (10 KL FUEL OIL STORAGE TANK)
JinDPP -BDM-17.009	ROOF AND SHELL MANHOLE DETAILS (10 KL FUEL OIL STORAGE TANK)
JinDPP -BDM-17.010	NOZZLE ARRANGEMENT AND OTHER DETAILS (10 KL FUEL OIL STORAGE TANK)
JinDPP -BDM-17.011	PLAN AND SECTION (10 KL FUEL OIL STORAGE TANK)
JinDPP -BDM-17.012	PLATE ARRANGEMENT AND DETAILS (10 KL FUEL OIL STORAGE TANK)
JinDPP -BDM-17.013	HOLDING DOWN BOLT DETAILS (10 KL FUEL OIL STORAGE TANK)
JinDPP -BDM-17.014	NOZZLE DETAILS (10 KL FUEL OIL STORAGE TANK)
JinDPP -BDM-17.015	TANK NOZZLE AND PIPINGS (10 KL FUEL OIL STORAGE TANK)
JinDPP -BDM-17.016	RAFTER DETAILS (10 KL FUEL OIL STORAGE TANK)

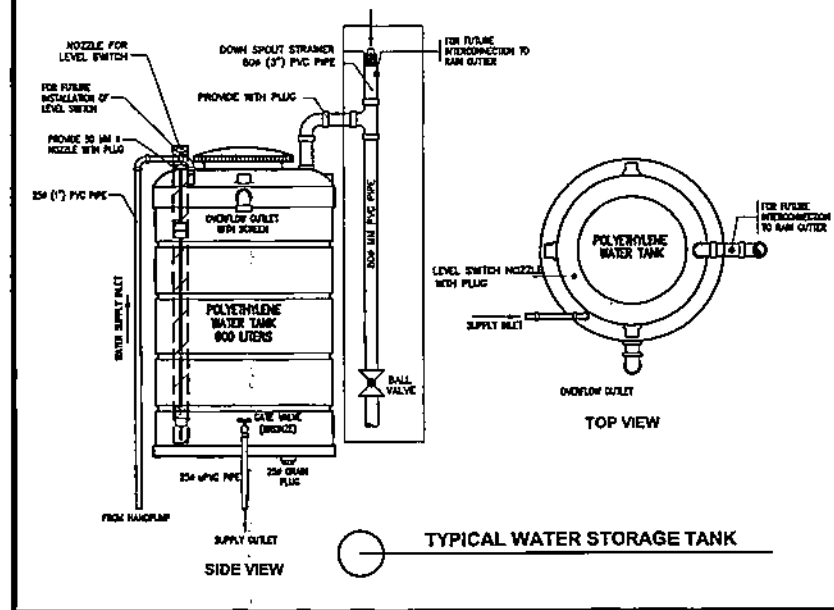


1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. ALL PIPING, PIPE FITTINGS AND SUPPORTS, VALVES AND OTHER ACCESSORIES REQUIRED SHALL BE SUPPLIED, INSTALLED AND TESTED BY THE CONTRACTOR INCLUDING THE REQUIRED GUARANTEE AND WARRANTY.
3. DOMESTIC WATER PIPING AND FITTINGS SHALL BE OF UNPLASTICIZED POLYETHYLENE (HDPE) SCHEDULE 80 OR CLASS 150 CONFORMING TO ASTM D-1784 OR APPROVED EQUIVALENT (EXCEPT OTHERWISE SHOWN).
4. WATER SYSTEM PIPE SHALL GENERALLY BE INSTALLED UNDERGROUND NO LESS THAN 300MM DPTH.
5. ALL 1/2" IDPE PIPE DIMENSIONS SHOWN ARE IN NOMINAL DIAMETER (DN) WITH THE FOLLOWING EQUIVALENCES:
- | | |
|---------------|--------------------------------|
| 80MM (3") | = 90MM OUTSIDE DIAMETER (O.D.) |
| 40MM (1 1/2") | = 50MM OUTSIDE DIAMETER (O.D.) |
| 32MM (1 1/4") | = 40MM O.D. |
| 25MM (1") | = 32MM O.D. |
| 20MM (3/4") | = 26MM O.D. |
| 15MM (1/2") | = 20MM O.D. |
6. THIS DRAWING IS FOR BIDDING PURPOSES ONLY.

LEGEND	
—	MAIN DOMESTIC PIPELINE
	GATE VALVE (NORMALLY OPEN)
	GATE VALVE (NORMALLY CLOSE)
	BALL VALVE
	CHECK VALVE
	REDUCER
	HOSE BIB
	BLIND FLANGE

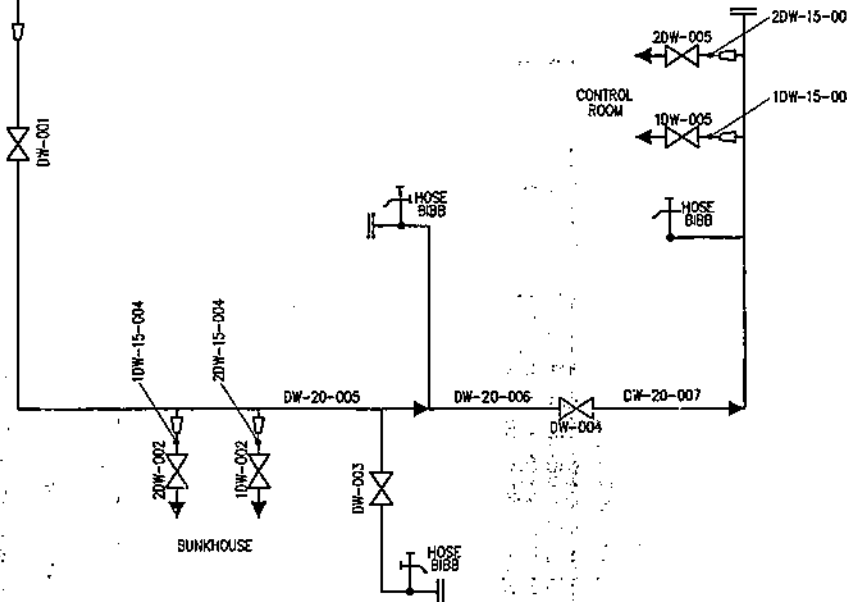




OWNER:	 NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY																							
PROJECT:	SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 134 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTULO IS. BALUD, MARABATE																							
LOCATION:	SITIO JINTOTULO ISLAND, BALUD MARABATE																							
TITLE:	DOMESTIC WATER P&I DIAGRAM																							
<table border="1"> <tr> <td>BY</td> <td>CHKD</td> <td>DATE</td> </tr> <tr> <td>DESIGNED</td> <td>JRC</td> <td></td> </tr> <tr> <td>DRAWN</td> <td>JRC</td> <td></td> </tr> <tr> <td>REVIEWED</td> <td>PRINCIPAL ENGR. / AGENT.</td> <td></td> </tr> <tr> <td>CAL./ARCHT</td> <td></td> <td></td> </tr> <tr> <td>ELEC.</td> <td></td> <td></td> </tr> <tr> <td>MECH.</td> <td></td> <td></td> </tr> </table>	BY	CHKD	DATE	DESIGNED	JRC		DRAWN	JRC		REVIEWED	PRINCIPAL ENGR. / AGENT.		CAL./ARCHT			ELEC.			MECH.			SUBMITTED: <u>N. G. ESPAROS</u> Principal Engineer - MECH. RECOMMENDED: <u>J. A. FELIX JR.</u> Manager, MECH. APPROVED: <u>G. B. MAGPOC, JR.</u> Manager, DDO		
BY	CHKD	DATE																						
DESIGNED	JRC																							
DRAWN	JRC																							
REVIEWED	PRINCIPAL ENGR. / AGENT.																							
CAL./ARCHT																								
ELEC.																								
MECH.																								
DWG. NO. JinDPP-BDM-17.903		SPECS. NO. LuzP22Z143559																						

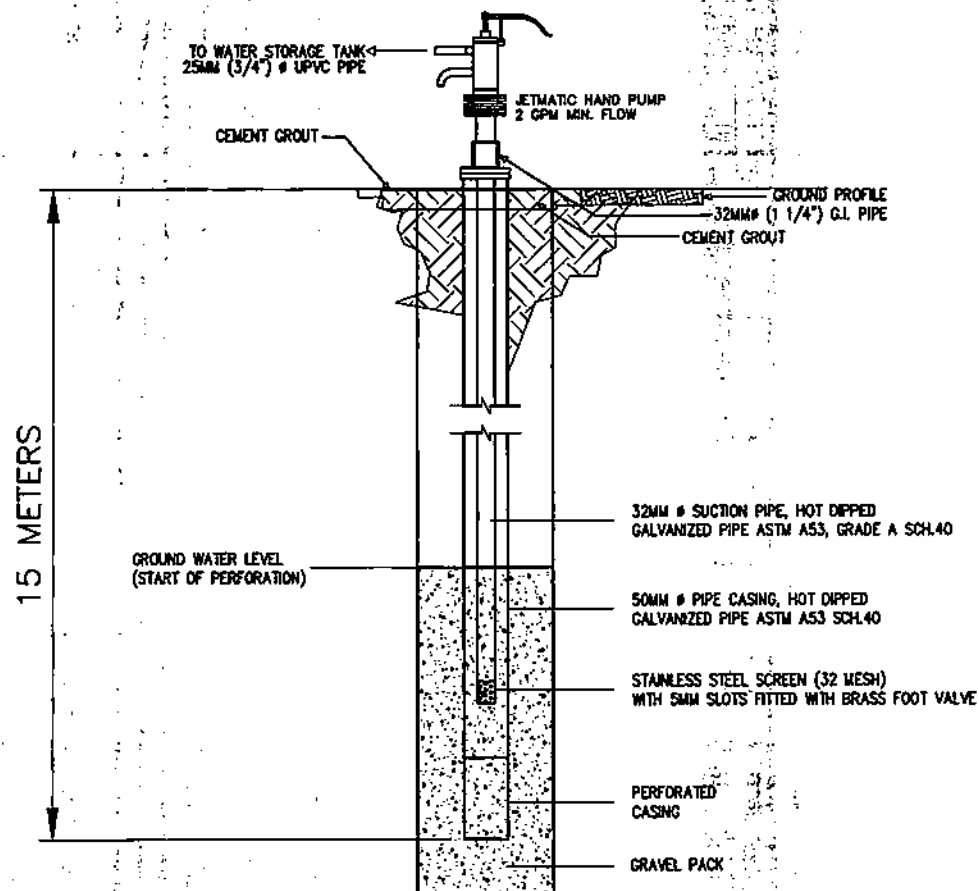				DWG. NO. JIN DPP-BDM-17.003		SPECS. NO. LUZP22214359	
REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPR.	SCALES NTS BID DRAWING REV. 0



NOTES:



1. THIS DRAWING IS FOR BIDDING PURPOSES ONLY.
2. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
3. EQUIPMENT TO BE FURNISHED SHALL BE DESIGNED & CONSTRUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF THE SPECIFICATIONS & SHALL FIT INTO THE SPACE AVAILABLE WITH PROPER REGARD TO ACCESSIBILITY, PASSAGEWAY, HANDLING AND STRUCTURE LIMITATIONS.
4. ALL WORKS SHALL BE DONE IN ACCORDANCE WITH THE REQUIREMENTS OF THE TECHNICAL SPECIFICATIONS.
5. PIPING, VALVES, FITTINGS AND OTHER ACCESSORIES SHALL BE PROVIDED TO CONFORM WITH THE REQUIREMENTS OF THE TECHNICAL SPECIFICATIONS.
6. THIS DRAWING SHOWS A TYPICAL INSTALLATION OF A WELL. THE SUPPLIER SHALL PROVIDE FINAL DESIGN AND DETAILS FOR NPC REVIEW AND APPROVAL.


OWNER:				NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN ANTITOLLO IS					
LOCATION: BRGY. ANTITOLLO ISLAND, BALUD MARIKATA					
TITLE: TYPICAL SHALLOW WELL DETAILS					
DESIGNED	BY	CHKD	DATE	SUBMITTED:	
DRAWN		JTC		PROPOSED BY:	N.G. ESPAYOS
REVIEWED	PRINCIPAL ENG'G / ARCHT.			RECOMMENDED:	J.A. PAREJA, JR.
CIVIL/ARCHT				MANAGER:	
ELEC.				APPROVED:	G.B. MAGPOC, JR.
MECH.				MANAGER, ISO	
Dwg. No. JinDPP-BDM-17.004				Specs. No. LuzP222143CSe	
REV.	DATE	NATURE OF REVISION	BY	CHKD.	REC'D.
			APPD.	SCALE: NTS	BID DRAWING
					REV. 0



3. THIS DRAWING IS FOR BIDDING PURPOSES ONLY.
4. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED;
5. ELEVATION OF DAY TANK SHALL NOT BE LESS THAN THOSE INDICATED ON RELEVANT CIVIL DRAWINGS, BUT MAY BE ADJUSTED/INCREASED TO CONFORM WITH THE ENGINE REQUIREMENTS PER MANUFACTURERS RECOMMENDATIONS.
6. THE TANK SHALL BE SHOP-FABRICATED, RECTANGULAR MADE OF ASTM A 36 OR APPROVED EQUAL WITH MINIMUM THICKNESS OF 5 MM, WITH INTERIOR AND EXTERIOR COATING TO CONFORM WITH THE MANUFACTURER SPECIFICATIONS.
7. EACH DIESEL GENERATING SET SHALL BE PROVIDED WITH FUEL DAY TANK; AND
8. LEVEL SWITCH FOR HIGH AND LOW LEVEL ALARMS SHALL BE PROVIDED AND BE MONITORED AT THE GENERATOR CONTROL & PROTECTION PANEL, LOCATED AT THE CONTROL ROOM.



LEGEND	
—	MAIN LINE
	GATE VALVE (NORMALLY OPEN)
	STRAINER

OWNER:  **NATIONAL POWER CORPORATION**
AGHANG ROAD, DILIMAN QUEZON CITY

PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW
 MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND
 BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN ANTITULO N
 BALSU, MARABATE


LOCATION: BRGY. JINTOTULO ISLAND, BALSU MARABATE

TITLE: **900L FUEL OIL DAY TANK**

	BY	CHECKED	DATE	
DESIGNED	DA	JTC		SUBMITTED: <u><i>[Signature]</i></u> N. G. EBRAYOS PROJECT ENGINEER A, MEU
DRAWN	DA	JTC		
REVIEWED	PRINCIPAL ENGINEER / ARCHT.			RECOMMENDED: <u><i>[Signature]</i></u> J. A. TAPED JR. MANAGER, MEU
CHECK/ARCHT.				APPROVED: <u><i>[Signature]</i></u> G. S. MAGPONG JR. MANAGER, DDO
ELEC.				
MECH.				


DOC. NO. **JinDPP-BDM-17.005** SPECS. NO. **LuzP22Z1433Se**

						DIB. NO. J1nDPP-BDM-17.005		SPCS. NO. LuzP2221433S	
REV.	DATE	NATURE OF REVISION		BY	CHKD.	RECD.	APPD.	SCALE: NTS	BID DRAWING
									REV. 0

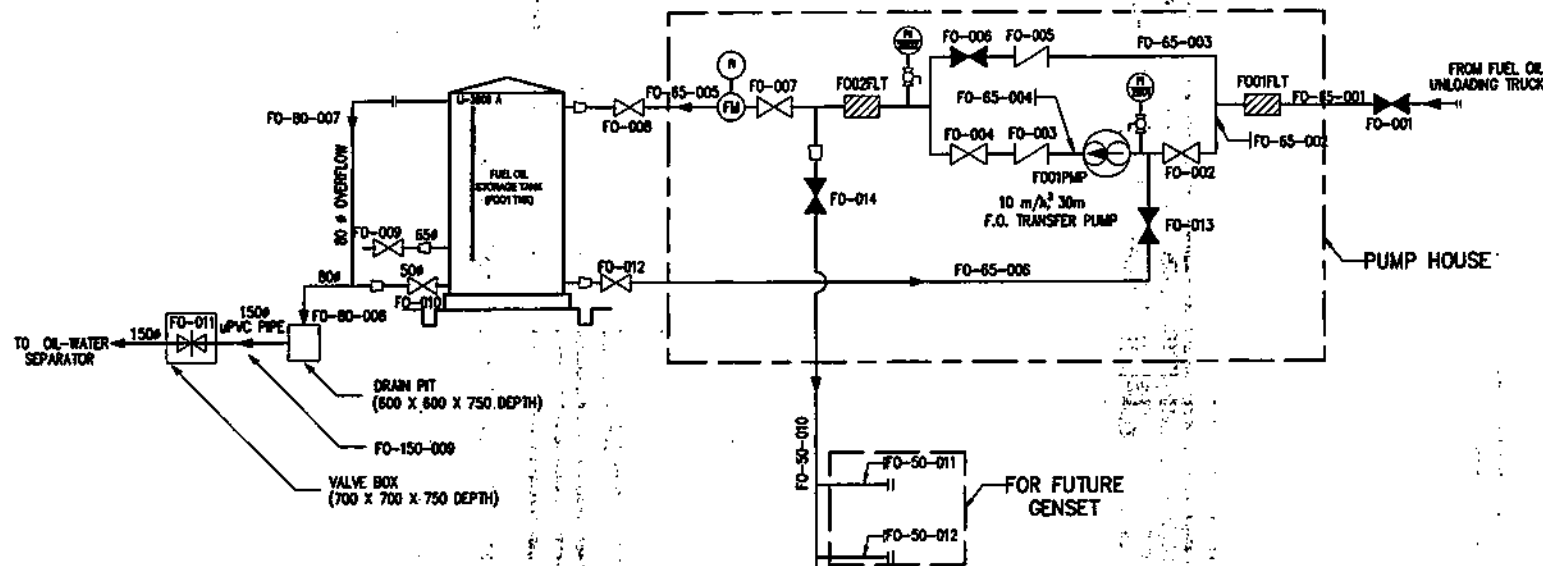

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. ALL PIPING, PIPE SUPPORTS AND FITTINGS, VALVES AND ACCESSORIES SHALL BE SUPPLIED, INSTALLED AND TESTED BY THE CONTRACTOR. PIPES ARE GENERALLY INSTALLED ABOVE GROUND EXCEPT FROM PUMPHOUSE TO POWERHOUSE (UNLESS OTHERWISE SHOWN ON THE DRAWING) WHICH SHALL BE INSTALLED UNDERGROUND. (NOT LESS THAN 300 MM UNDERGROUND)
3. FUEL OIL PIPES SHALL CONFORM TO ASTM A53 GR. B, SEAMLESS AND SCHEDULE 40. MATERIALS FOR VALVES 65MM# AND ABOVE SHALL BE CAST IRON AND CAST BRONZE FOR 50 MM # AND BELOW.
4. REFER TO CIVIL DRAWINGS FOR THE DETAILED DRAWINGS OF TANK FOUNDATION/BUND WALL, DRAIN PIT AND VALVE BOX.
5. VALVE INSIDE DRAIN VALVE BOX SHALL BE PROPERLY SUPPORTED.
6. DRAIN PIPE FROM DRAIN PIT UP TO THE EXISTING DRAINAGE SYSTEM SHALL BE MADE OF uPVC, SCHEDULE 80 OR CLASS 150 CONFORMING TO ASTM D-1784 OR APPROVED EQUIVALENT.
7. F.O. STEEL PIPES WHICH ARE BURIED UNDERGROUND SHALL BE APPLIED WITH 6 MM THICKNESS OF ASPHALT JUTE OR APPROVED EQUIVALENT. PRIOR TO APPLICATION OF ASPHALT JUTE, EXTERNAL SURFACES SHALL BE PRIMED WITH 2 COATS OF COAL TAR EPOXY POLYAMIDE OF 170 MICRONS PFT EACH COAT.
8. THE CONTRACTOR SHALL SUPPLY FLEXIBLE HOSE NOT LESS THAN 50 MM# AND 3 METERS LONG FITTED WITH STEEL PIPE NOT LESS THAN 50 MM # FOR HANDLING FUEL OIL FROM A 210 L DRUM AND FLANGE CONNECTION AT F. O. TRANSFER PUMP SUCTION. THE FLEXIBLE HOSE SHALL BE MADE OF SYNTHETIC RUBBER TUBE, REINFORCED WITH SPIRAL-PLYED SYNTHETIC FABRIC WITH WIRE HELIX.

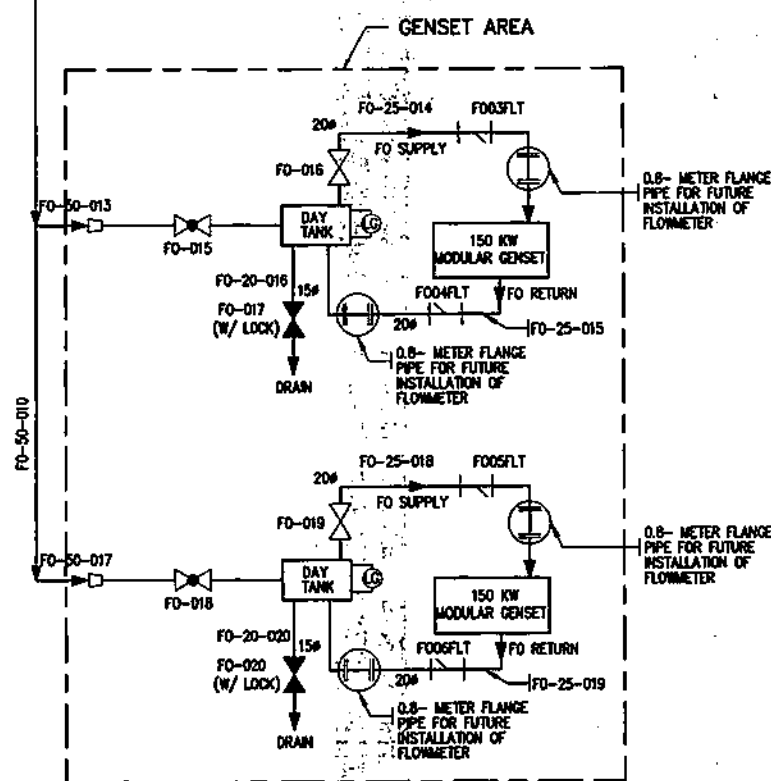


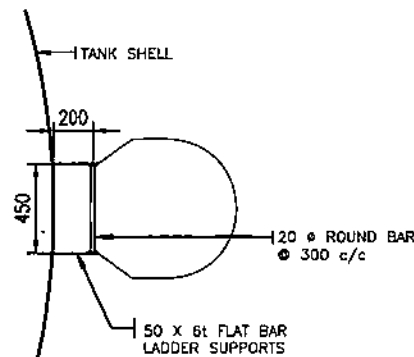
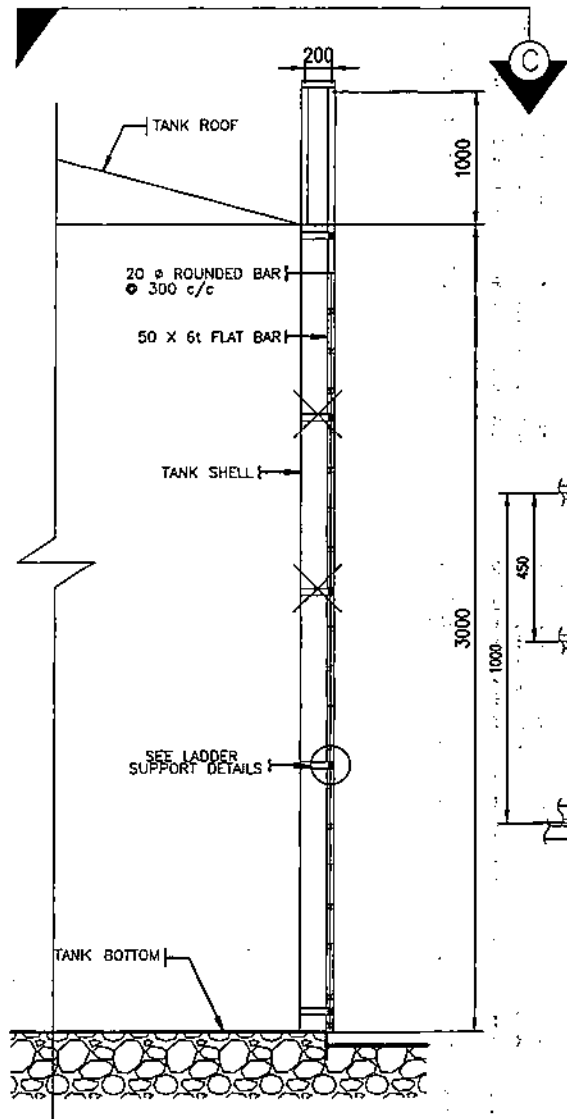
LEGEND :

- ✕ - BUTTERFLY VALVE
- ⊗ - GLOBE VALVE
- ⊠ - GATE VALVE W/MANHOLE
- ⊞ - GATE VALVE
- ⊞ - GATE VALVE (NORMALLY CLOSED)
- ⌌ - CHECK VALVE
- ⌌ - FUEL FILTER
- - REDUCER
- ⊙ - PRESSURE GAUGE
- FI - FLOW INDICATOR
- FM - FLOW METER
- FH - FLEXIBLE HOSE
- ⊕ - LEVEL GAUGE (GLASS TYPE)
- ⌌ - Y-STRAINER
- ⌌ - COCK
- ⌌ - BLIND FLANGE OR END PLUG


PIPE DESIGNATION LEGEND:

- XX - 00 - 000
 NOMINAL PIPE SIZE (DIAMETER)
 SEQUENCE NO.


OWNER: 		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR GENSET, GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOLOLO IS, BALABO, MARBATE			
LOCATION: BRGY. JINTOLOLO ISLAND, BALABO MARBATE			
TITLE: FUEL OIL STORAGE AND TRANSFER SYSTEM (P & I DIAGRAM)			
DESIGNED	BY: JTC	CHKD	DATE
DRAWN	JTC	SUBMITTED:	
REVIEWED	PRINCIPAL ENGR. / ARCHT.	RECOMMENDED:	
CNL/ARCHT		APPROVED:	
ELEC.			
MECH.			
ORL NO. JINOPP-BDM-17.006		SPECS. NO. LUZP2221435S	
REV. DATE		NATURE OF REVISION	
BY		CHKD. RECD. APPD.	
SCALE: NTS		BID DRAWING	
		REV 0	




SECTION C

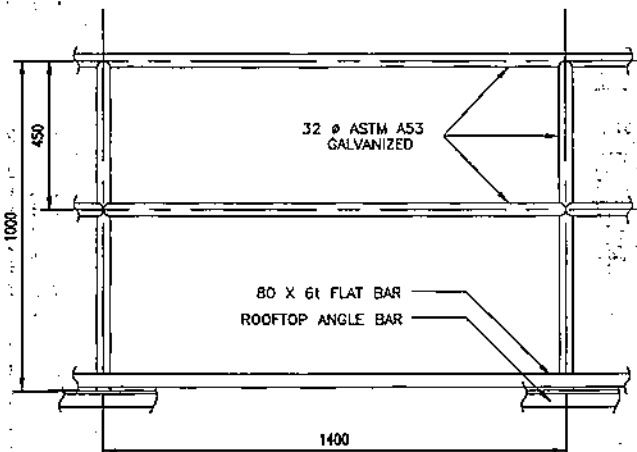

TYPICAL ROOF HANDRAIL

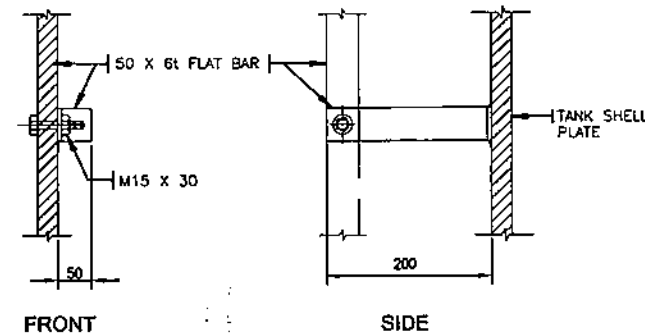


LADDER SUPPORT DETAILS

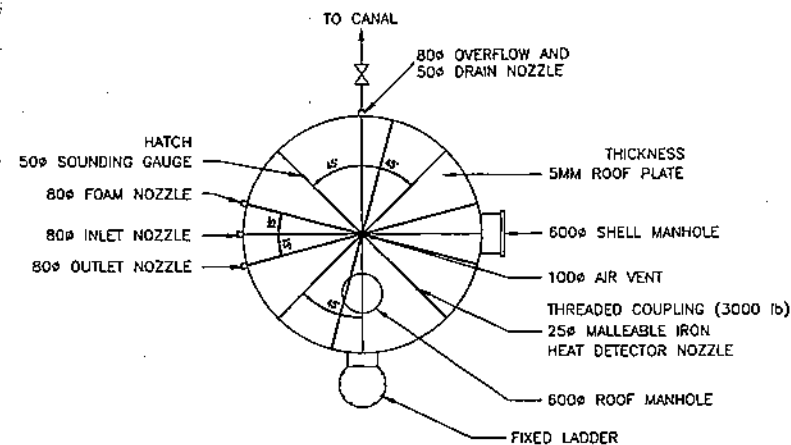

NOTES:


1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. THE FUEL OIL STORAGE TANK SHALL BE CONSTRUCTED TO CONFORM WITH THE LATEST EDITION OF API 650 AND THE MINIMUM REQUIREMENTS SHOWN ON THIS DRAWING OR AS SPECIFIED IN THE TECHNICAL SPECIFICATIONS.
3. DETAILED DRAWINGS SHALL BE SUBMITTED BY THE SUPPLIER/CONTRACTOR FOR NPC REVIEW/APPROVAL.
4. ALL WELDING WORKS SHALL CONFORM TO THE REQUIREMENTS OF THE SPECIFICATION AND API 650.
5. NOZZLE FOR TANK SHALL BE INSTALLED BASED ON TANK ORIENTATION SHOWN ON PLANT'S LAYOUT.

OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOLOLO, BALIG, MASARATE			
LOCATION: BAYO, JINTOLOLO ISLAND, BALIG, MASARATE			
TITLE: 10 CU. M. FUEL OIL STORAGE TANK TANK STAIR AND RAILING DETAILS			
DESIGNED	BY	CHKD	DATE
DRAWN	JTC		
REVIEWED	PRINCIPAL ENGINEER	RECOMMENDED	
OVERSIGHT			
ELC.		APPROVED	
DATE			
DWG. NO. JirDPP-SDM-17-007		SPEC. NO. LUP-P2221435S6	
REV. DATE		NATURE OF REVISION	
ST		CHD	
REQD		APPD	
SCALE		NTS	
BID DRAWING		REV. 0	

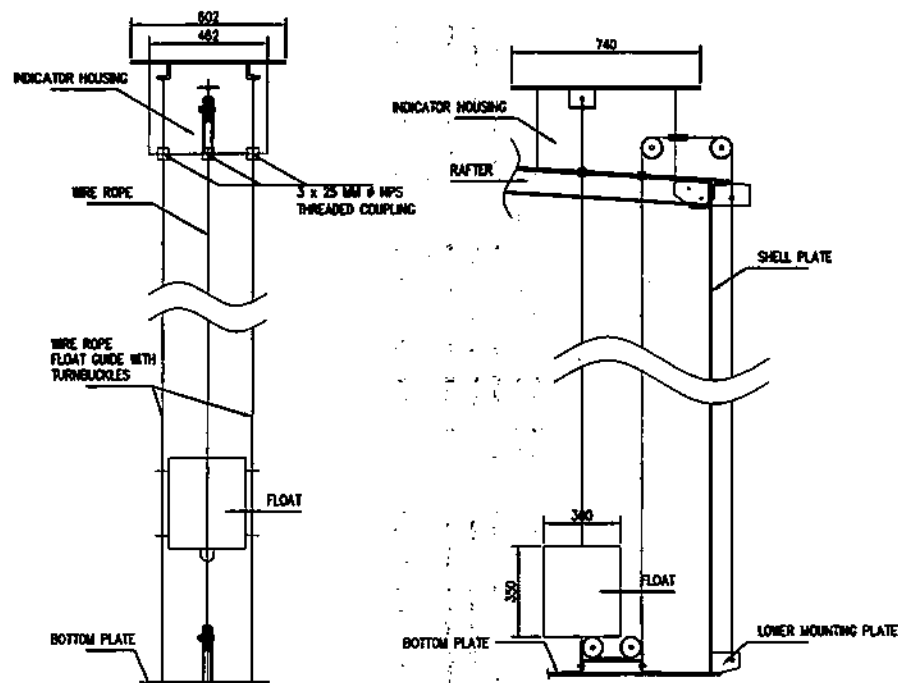


FRONT VIEW


SECTIONAL VIEW

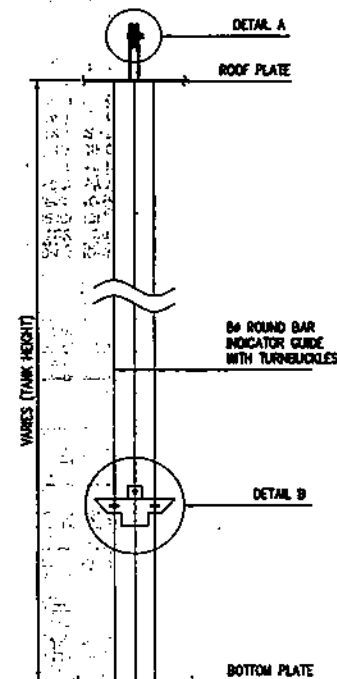


EXTERNAL VIEW

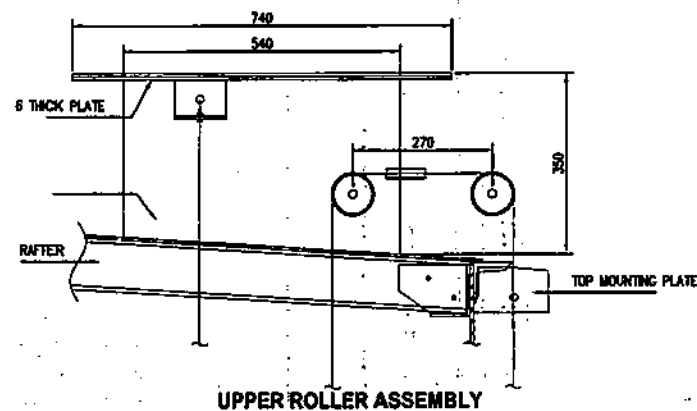


UPPER ROLLER ASSEMBLY

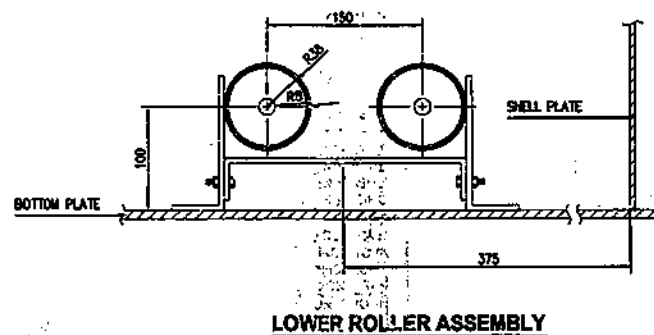

LOWER ROLLER ASSEMBLY




DETAIL A
SCALE: 1:50

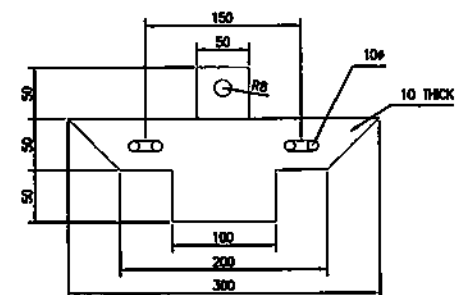


DETAIL B


NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. THE FUEL OIL STORAGE TANK SHALL BE CONSTRUCTED TO CONFORM WITH THE LATEST EDITION OF API 650 AND THE MINIMUM REQUIREMENTS SHOWN ON THIS DRAWING OR AS SPECIFIED IN THE TECHNICAL SPECIFICATIONS.
3. DETAILED DRAWINGS, IF NECESSARY SHALL BE SUBMITTED BY THE CONTRACTOR FOR NPC REVIEW/APPROVAL.
4. ALL WELDING WORKS SHALL CONFORM TO THE REQUIREMENTS OF THE SPECIFICATION AND API 650.
5. CALIBRATION SCALES SHALL BE PAINTED ON THE TANK AND SHALL BE LARGE ENOUGH SO IT CAN EASILY BE VISIBLE FROM THE CONTROL ROOM / POWERHOUSE.
6. SIZE AND DIMENSIONS OF FLOAT AND BOARD TANK GAUGE ASSEMBLY MAY BE MODIFIED IN COORDINATION WITH THE DEVICE SUPPLIER.


OWNER:				NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 100 KVA MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTULO IN BALID, MARBATE					
LOCATION: BRGY. JINTOTULO INLAND, BALID MARBATE					
TITLE: LEVEL GAUGE INDICATOR DETAILS (10KL FUEL OIL STORAGE TANK)					
DESIGNED	BY	CHKD	DATE	SUBMITTED	
	JTC				N. G. EMBAYOS
DRAWN	JTC			RECOMMENDED	J. A. RAPEL, JR.
REVIEWED	PRINCIPAL ENGR. (MCHT.)			APPROVED	G. BLASOPOL, JR.
CALCULATED					
ENGINEER					
MECH.					
DWG. NO. JinDPP-BDM-17.008			SPEC. NO. LuzP22Z1435S6		
SCALE: AS SHOWN			BID DRAWING		
REV.	DATE	NATURE OF REVISION	BY	CHKD.	REC'D.

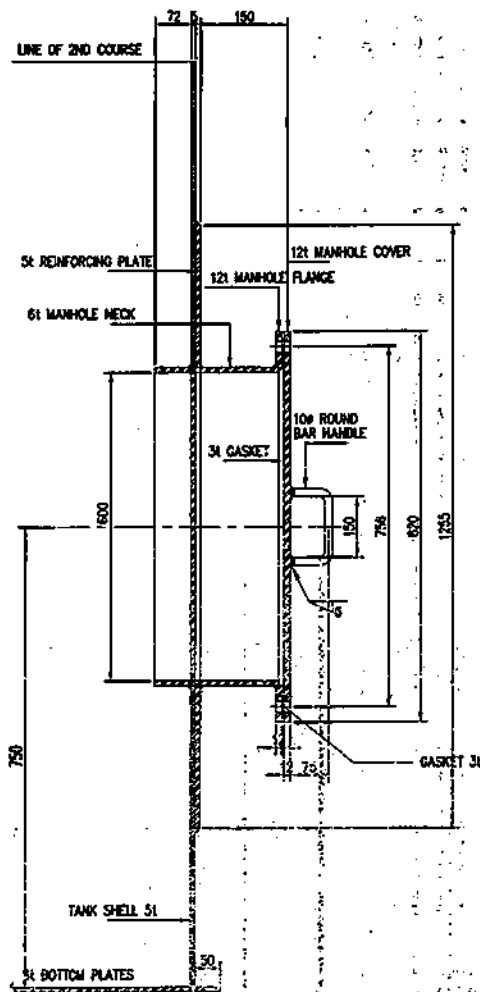


SHELL MANHOLE SECTION

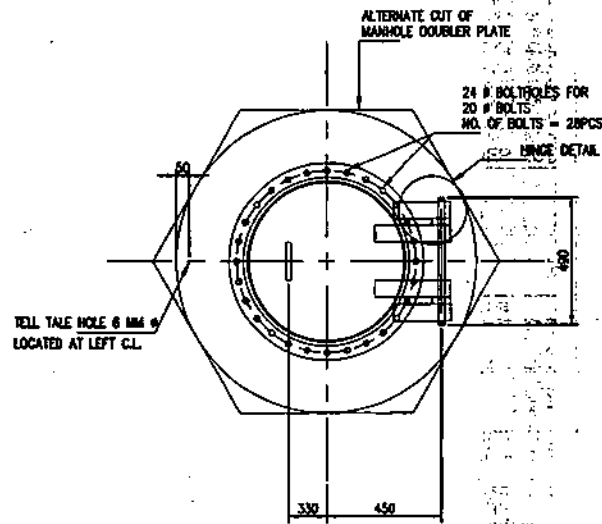


SHELL MANHOLE PLAN



HINGE DETAIL




DETAIL A

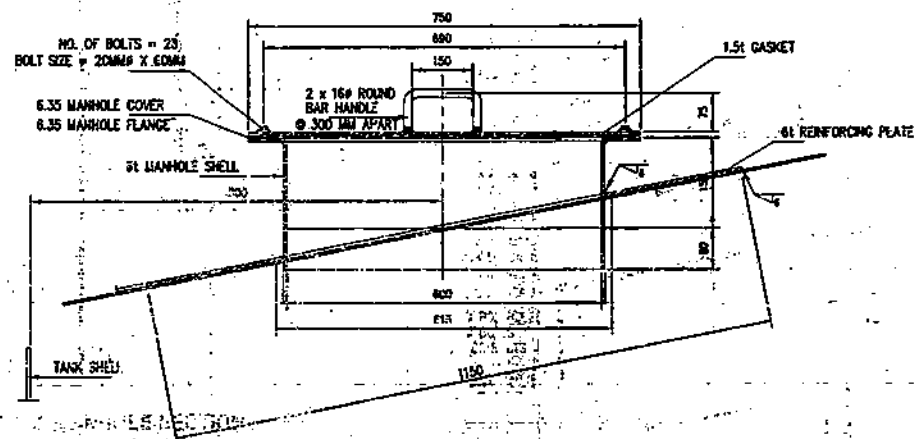


ROOF MANHOLE SECTION


NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. THE FUEL OIL STORAGE TANK SHALL BE CONSTRUCTED TO CONFORM WITH THE LATEST EDITION OF API 650 AND THE MINIMUM REQUIREMENTS SHOWN ON THIS DRAWING OR AS SPECIFIED IN THE TECHNICAL SPECIFICATIONS.
3. DETAILED DRAWINGS, IF NECESSARY SHALL BE SUBMITTED BY THE CONTRACTOR FOR NPC REVIEW/APPROVAL.
4. THE CONTRACTOR MAY PROPOSE DIFFERENT MANHOLE HINGE DETAIL SUBJECT TO NPC'S APPROVAL.
5. ALL WELDING WORKS SHALL CONFORM TO THE REQUIREMENTS OF THE SPECIFICATION AND API 650.


OWNER:		 NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 MW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTOLDO B. SALUD, MARBATE			
LOCATION: BRGY. JINTOTOLDO DELANO, SALUD MARBATE			
TITLE: ROOF AND SHELL MANHOLE DETAILS (10 KL FUEL OIL STORAGE TANK)			
DESIGNED:	BY	CHKD	DATE
DRAWN:			
REVIEWED:	PRINCIPAL ENGR. (ARCHT.)	RECOMMENDED:	
CIVIL/ARCHT:			
ELEC:			
MECH:	JTC	APPROVED:	
DWG. NO. JinDPP-BDM-17.009		SPEC. NO. LuzP22Z1435Se	
SCALE AS SHOWN		BID DRAWING	

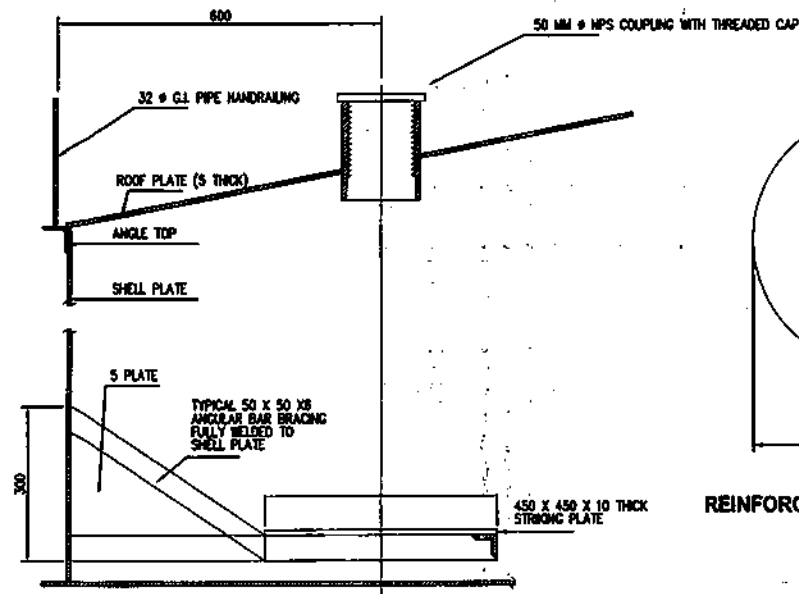

GAUGE HATCH NOZZLE AND STRIKING PLATE

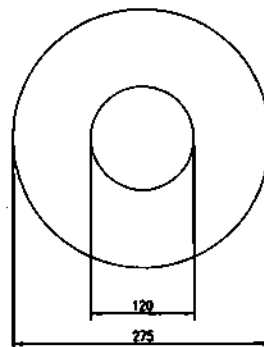


REINFORCING PLATE FOR 100 Ø VENT NOZZLE

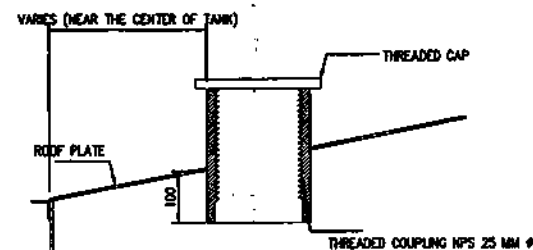

HEAT DETECTOR NOZZLE

NOTES:


1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. THE FUEL OIL STORAGE TANK SHALL BE DESIGNED AND CONSTRUCTED TO CONFORM WITH THE REQUIREMENTS OF THE LATEST EDITION OF API 650 AND THE MINIMUM REQUIREMENTS SHOWN ON THIS DRAWING OR AS SPECIFIED IN THE TECHNICAL SPECIFICATIONS.
3. DETAILED DRAWINGS AS REQUIRED SHALL BE SUBMITTED BY THE CONTRACTOR FOR NPC REVIEW/APPROVAL.
4. NOZZLES FOR HEAT DETECTOR AND FOAM NOZZLE SHALL BE SUPPLIED WITH THREADED CAP AND BLIND FLANGE, RESPECTIVELY.
5. ALL WELDING WORKS SHALL CONFORM TO THE REQUIREMENTS OF THE SPECIFICATION AND API 650.

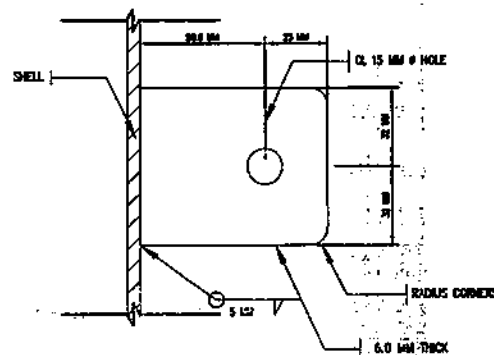

GROUNDING LUG

NOTES FOR GROUNDING LUGS

1. LUG MATERIAL SHALL BE AUSTENITIC STAINLESS STEEL WHEN ATTACHED TO CARBON OR LOW ALLOY STEEL PARTS.
2. TWO SETS INCLUDING 3 M LENGTH, 20 MM # COPPER GROUNDING ROD ARE REQUIRED FOR EACH TANK.

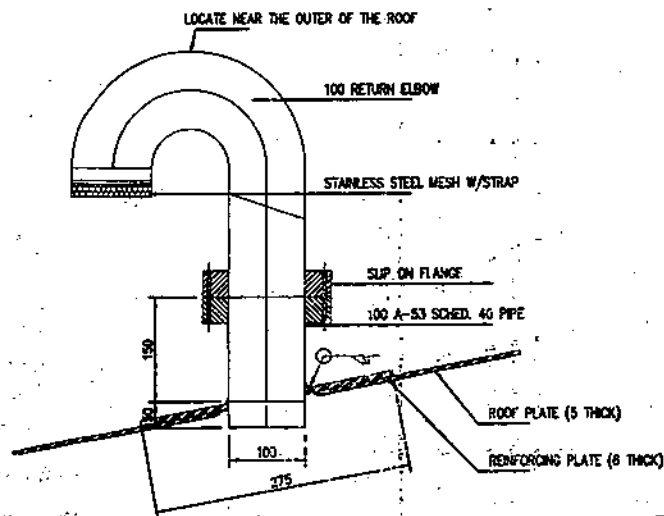


ROOF OPEN VENTY

(MAYBE INSTALLED AT CENTER OF ROOF)


OWNER		NATIONAL POWER CORPORATION AGHAM ROAD, DILMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 100 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN ANTOLLO IS. BALULU, MARBATE			
LOCATION: BRGY. ANTOLLO ISLAND, BALULU MARBATE			
TITLE: NOZZLE ARRANGEMENT AND OTHER DETAILS (10 KL FUEL OIL STORAGE TANK)			
DESIGNED BY	CHKD	DATE	SUBMITTED
DRAWN			BY: J. A. TAPAL JR.
REVIEWED	PRINCIPAL ENGR. / ARCHT.		RECOMMENDED
CYCLING/IT			
ELC.			APPROVED
MECH.	JTC		C. B. LACROZ, JR.
DWG. NO. JIN DPP-BDM-47.C10		SPEC. NO. L12P2221435Se	
SCALE: AS SHOWN		BID DRAWING	

REV.	DATE	DESCRIPTION	BY	CHKD.	RECD.	APP.

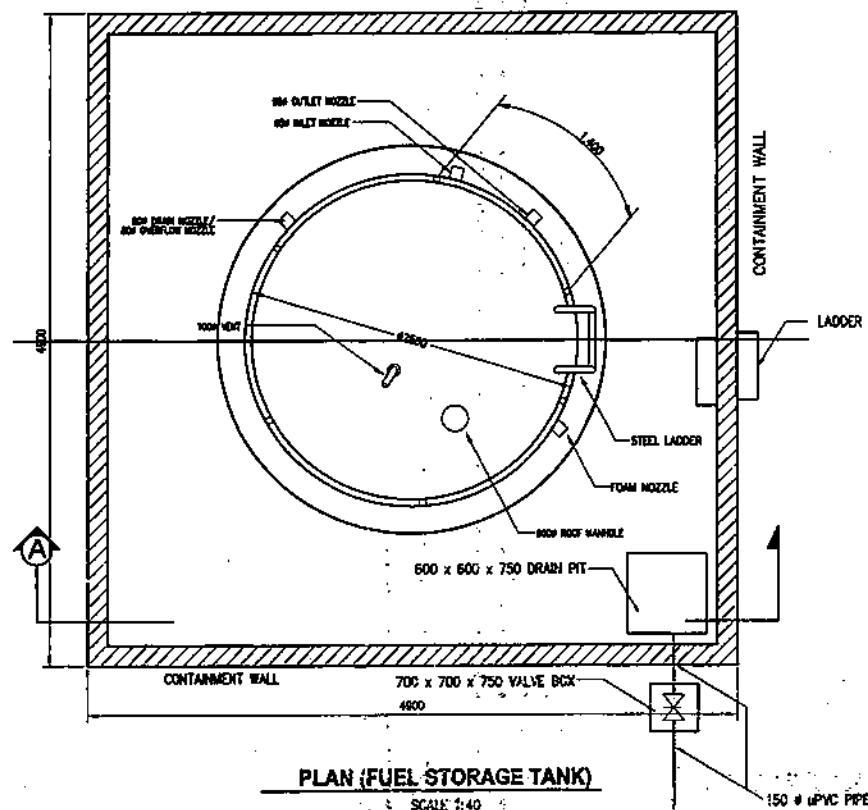


NOTES:


1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. REFER TO CIVIL DRAWINGS FOR THE DETAILS OF TANK FOUNDATION, CONTAINMENT WALL, DRAIN PIT/DITCH AND CONTAINMENT ACCESS LADDER.
3. REFER TO DRAWINGS FOR Pkg47-BDM-17.005 TO Pkg47-BDM-17.014 FOR DETAILS OF TANK APPURTENANCES.

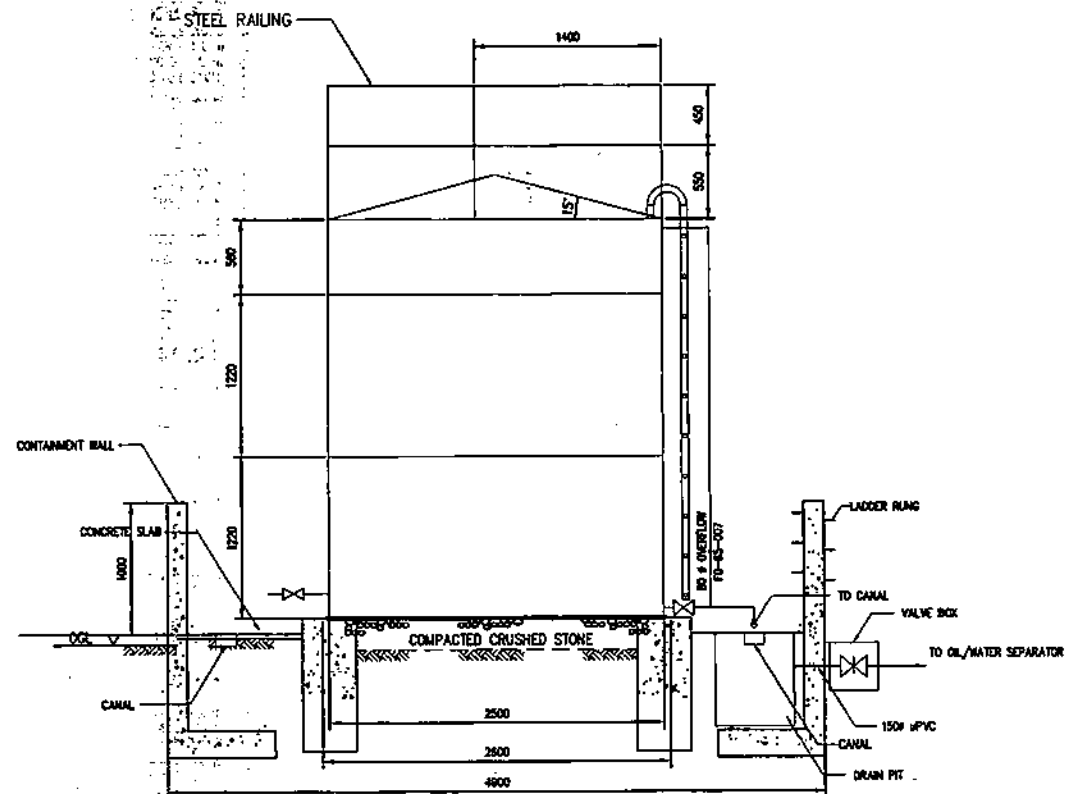


OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTULO IS. BALUD, MARBATE.			
LOCATION: BRGY. JINTOTULO ISLAND, BALUD, MARBATE			
TITLE:			
PLAN AND SECTION (10 KL FUEL OIL STORAGE TANK)			
DESIGNED	BY	CHKD	DATE
DRAWN			
REVISED	PRINCIPAL ENGR./ARCHT.	RECOMMENDED	
CONTRACT			
DEC.			
MECH.	JTC		
DWG. NO. JindPP-BDM-17.011		SPEC. NO. LuzP22Z1435Su	
SCALE AS SHOWN		BID DRAWING REV. 0	

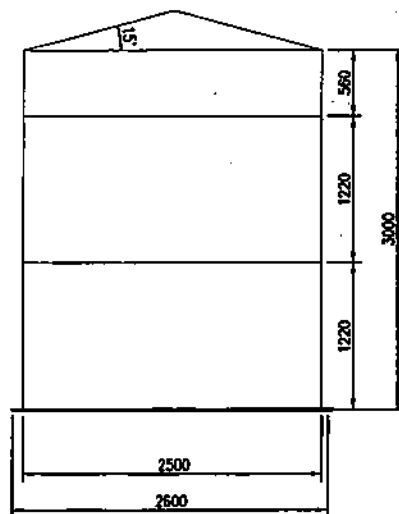


SIDE ELEVATION

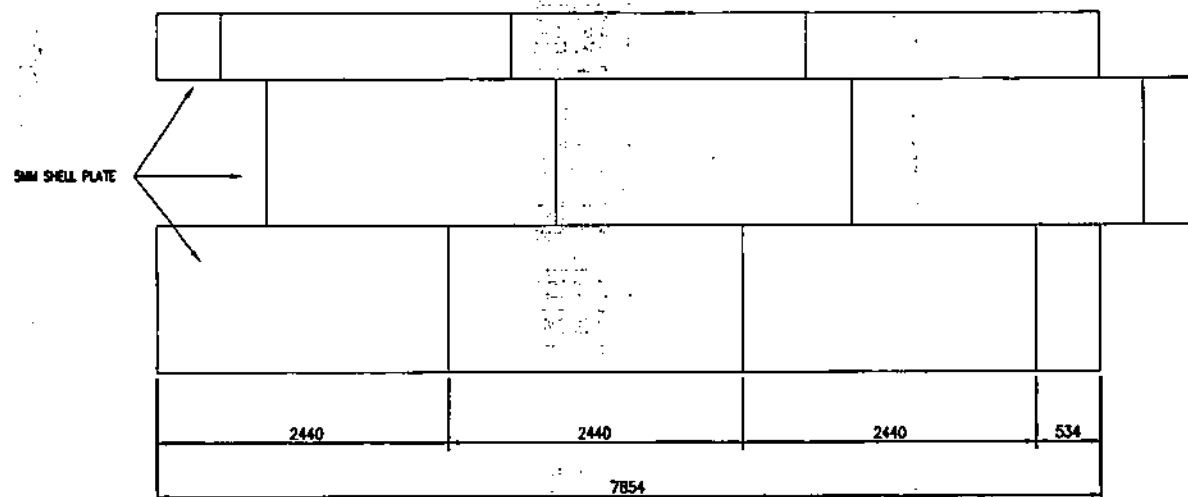

SHELL PLATE ARRANGEMENT

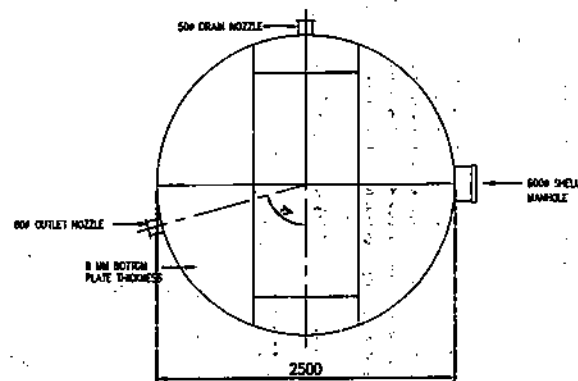


BOTTOM PLATE ARRANGEMENT

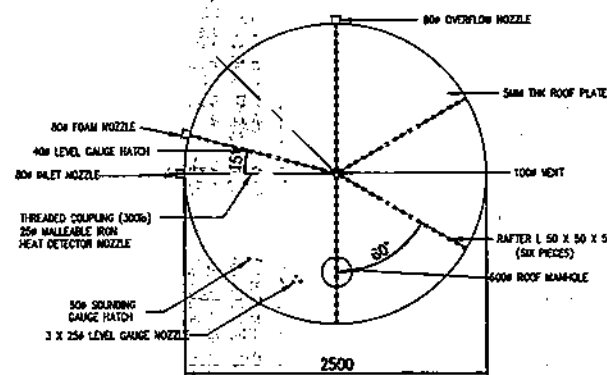


ROOF PLATE ARRANGEMENT

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. THE FUEL OIL STORAGE TANK SHALL BE DESIGNED AND CONSTRUCTED TO CONFORM WITH THE REQUIREMENTS OF THE LATEST EDITION OF API 650 AND THE MINIMUM REQUIREMENTS SHOWN ON THIS DRAWING OR AS SPECIFIED IN THE TECHNICAL SPECIFICATIONS.
3. DETAILED DRAWINGS AS REQUIRED SHALL BE SUBMITTED BY THE CONTRACTOR FOR NPC REVIEW/APPROVAL.
4. NOZZLES FOR HEAT DETECTOR AND FOAM NOZZLE SHALL BE SUPPLIED WITH THREADED CAP AND BLIND FLANGE, RESPECTIVELY.
5. ALL WELDING WORKS SHALL CONFORM TO THE REQUIREMENTS OF THE SPECIFICATION AND API 650.
6. TANK NOZZLES, CAGED LADDER SHALL BE INSTALLED BASED ON TANK ORIENTATION.


OWNER:		 NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 100 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN ANTITOLLO RD, BALUG, MARBATE			
LOCATION: BRGY. ANTITOLLO INLAND, BALUG MARBATE			
TITLE: PLATE ARRANGEMENT AND DETAILS (10KL FUEL OIL STORAGE TANK)			
DESIGNED	BY	CHKD	DATE
DRAWN			
REVIEWED	PRINCIPAL ENGR. / ARCHT.	RECOMMENDED	
CHECKED		APPROVED	
ELC.			
MECH.			
DWG. NO. JindPP-BDM-17.012		REVISION LUPP22Z1435Se	
SCALE: NTS		BID DRAWING	

REV.	DATE	DESCRIPTION	BY	CHKD.	RECD.	APPR.

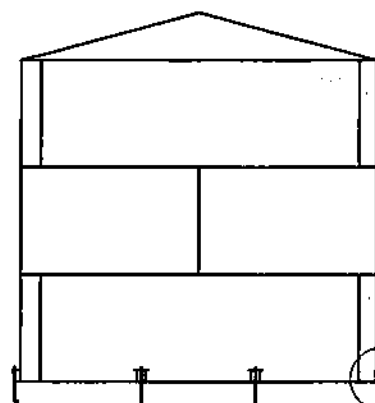


SIDE ELEVATION

HOLDING DOWN BOLTS
SEE DETAIL A

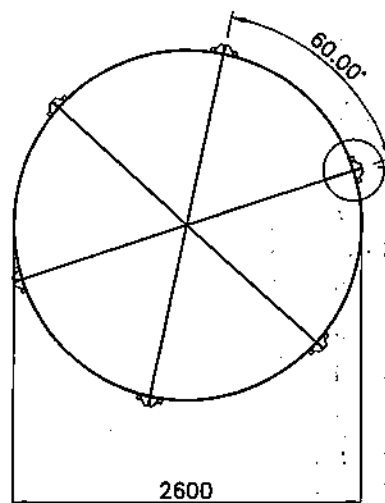


ANCHOR BOLTS DETAILS

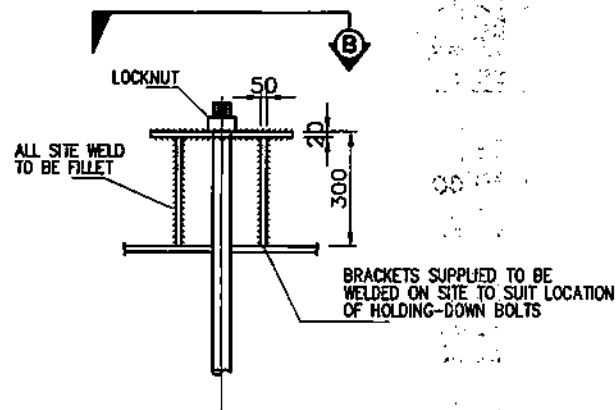

VIEW A


HOLDING DOWN BOLTS DETAILS

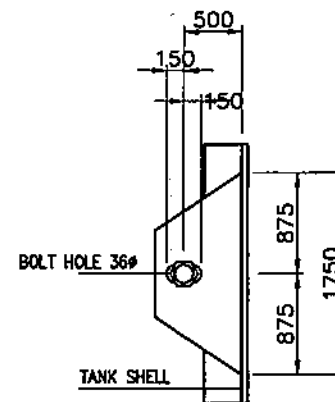

VIEW B

NOTES:








1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. THE FUEL OIL STORAGE TANK SHALL BE CONSTRUCTED TO CONFORM WITH THE LATEST EDITION OF API 650 AND THE MINIMUM REQUIREMENTS SHOWN ON THIS DRAWING OR AS SPECIFIED IN THE TECHNICAL SPECIFICATIONS.
3. DETAILED DRAWINGS, IF NECESSARY SHALL BE SUBMITTED BY THE CONTRACTOR FOR HPC REVIEW/APPROVAL.
4. ALL WELDING WORKS SHALL CONFORM TO THE REQUIREMENTS OF THE SPECIFICATION AND API 650.
5. REFER TO RELEVANT CIVIL DRAWINGS FOR DETAILS OF FOUNDATION DRAWINGS.

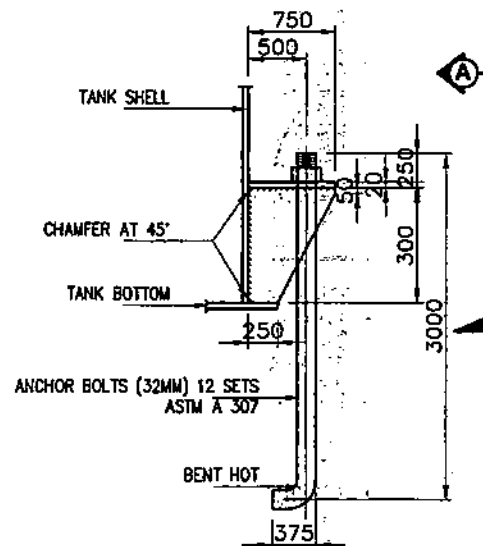

DETAIL A



OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KVA MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOLOLO R. BALANG, BARASATE			
LOCATION: BRGY. JINTOLOLO WILAND, BALANG BARASATE			
TITLE: 10 CU. M. FUEL OIL STORAGE TANK HOLDING DOWN BOLT DETAILS			
DESIGNED	BY	CHKD	DATE
DRAWN	JTC	JTC	
REVIEWED	PRINCIPAL ENGR. / ARCHT.		RECOMMENDED
CIVIL/ARCHT			
ELEC			
MECH			
APPROVED:		G. B. MAGPOC, JR. MECH. ENG.	
DWG. NO. J1nDPP-BDM-17.013		SPEC. NO. LUZP2221435Sg	
SCALE: NYB		SID DRAWING	
REV. 0		REV. 0	

REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPD.

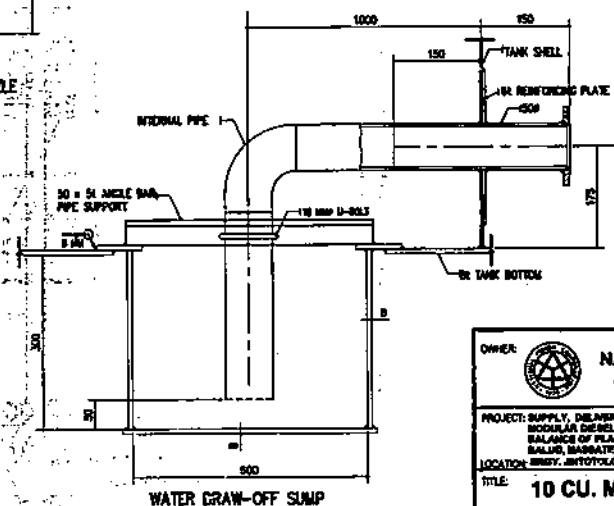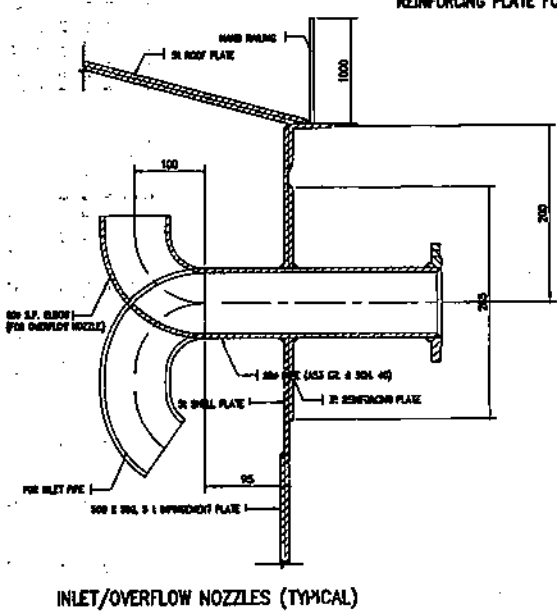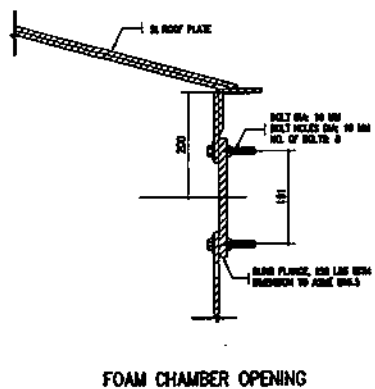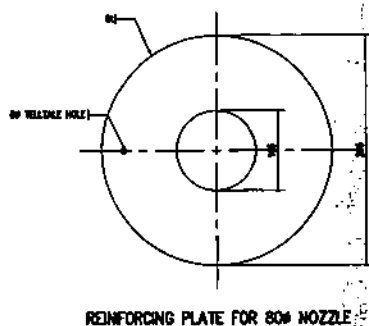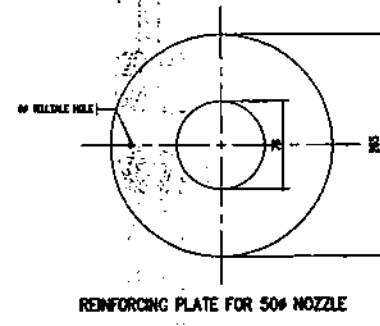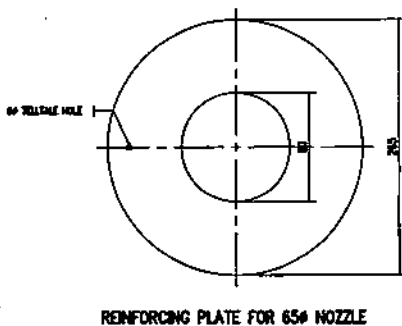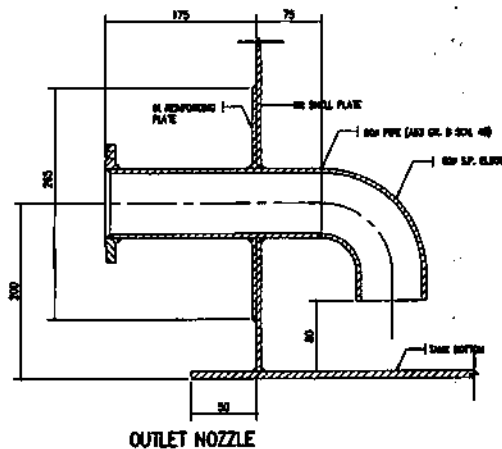


- NOTES:**
1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
 2. THE FUEL OIL STORAGE TANK SHALL BE CONSTRUCTED TO CONFORM WITH THE LATEST EDITION OF API 650 AND THE MINIMUM REQUIREMENTS SHOWN ON THIS DRAWING OR AS SPECIFIED IN THE TECHNICAL SPECIFICATIONS.
 3. DETAILED DRAWINGS, IF NECESSARY SHALL BE SUBMITTED BY THE CONTRACTOR FOR NPC REVIEW/APPROVAL.
 4. ALL WELDING WORKS SHALL CONFORM TO THE REQUIREMENTS OF THE SPECIFICATION AND API 650.
 5. INLET AND OVERFLOW NOZZLES SHALL BE SEPARATELY LOCATED DEPENDING ON THE ORIENTATION OF THE TANK SHOWN ON RESPECTIVE PLANT'S LAYOUT.
 6. THE ERECTION PROCEDURE FOR DRAW OFF NOZZLE SHALL INCLUDE THE FOLLOWING STEP PER API 650:
 - A. A HOLE SHALL BE CUT IN THE BOTTOM PLATE OR A SUMP SHALL BE PLACED IN THE FOUNDATION BEFORE BOTTOM PLACEMENT;
 - B. A NEAT EXCAVATION SHALL BE MADE TO CONFORM TO THE SHAPE OF THE DRAWOFF SUMP, THE SUMP SHALL BE PUT IN PLACE, AND THE FOUNDATION SHALL BE COMPACTED AROUND THE SUMP AFTER PLACEMENT; AND
 - C. THE SUMP SHALL BE WELDED TO THE BOTTOM.

OWNER		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 1M 10% MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN ANTITOLLO IS. BALUB, MAGSATE			
LOCATION: BRGY. ANTITOLLO ISLAND, BALUB MAGSATE			
TITLE: 10 CU. M. FUEL OIL STORAGE TANK NOZZLE DETAILS			
DESIGNED	BY	CHKD	DATE
DRAWN	JTC		
REVIEWED	PRINCIPAL ENGR./ARCHT.	RECOMMENDED	
ONWARD BY			
ELEC.		APPROVED	
MECH.			
DWG. NO. JinDPP-BDM-17.014		SPEC. NO. LuzP2221435S	
SCALE AS SHOWN		3/10 DRAWING	
REV.	DATE	NAME OF PERSON	BY

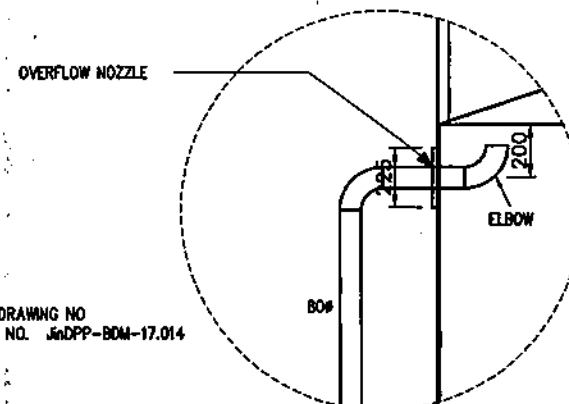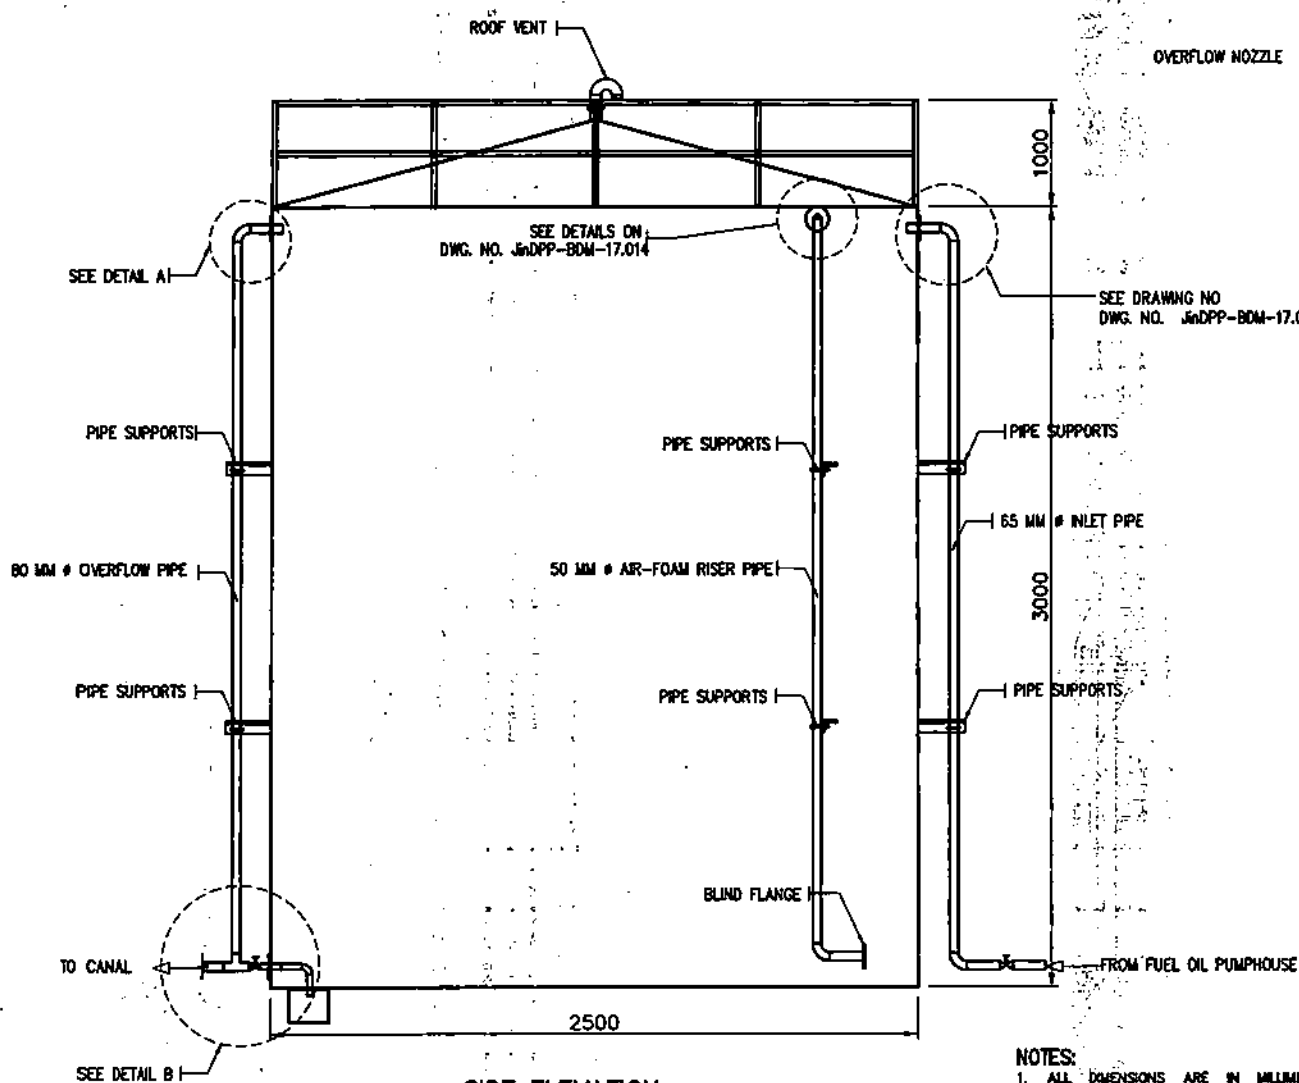

DETAIL A

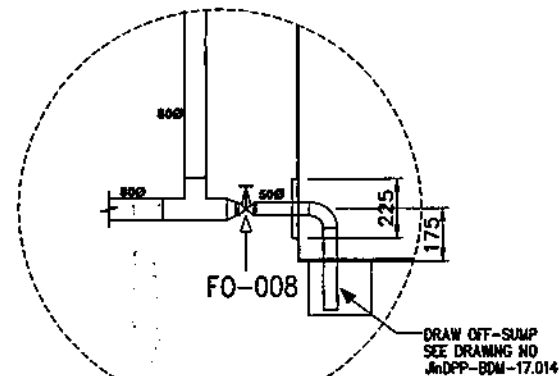


DETAIL B

SIDE ELEVATION



NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. THE FUEL OIL STORAGE TANK SHALL BE CONSTRUCTED TO CONFORM WITH THE LATEST EDITION OF API 650 AND THE MINIMUM REQUIREMENTS SHOWN ON THIS DRAWING OR AS SPECIFIED IN THE TECHNICAL SPECIFICATIONS.
3. DETAILED DRAWINGS, IF NECESSARY SHALL BE SUBMITTED BY THE CONTRACTOR FOR NPC REVIEW/APPROVAL.
4. ALL WELDING WORKS SHALL CONFORM TO THE REQUIREMENTS OF THE SPECIFICATION AND API 650.
5. PIPE SHALL CONFORM TO ASTM A. 53 GR. B, SCHEDULE 40 AND SEAMLESS PIPE


OWNER:				NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN, QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN ANTITOLD IS., BALABU, MARABAT.					
LOCATION: BIRY, ANTITOLD ISLAND, BALABU MARABAT.					
TITLE: 10 CU. M. FUEL OIL STORAGE TANK TANK NOZZLE AND PIPINGS					
DESIGNED	BY	CHKD	DATE	SUBMITTED	
DRAWN		JTC			
REVIEWED	PRINCIPAL ENGR. / ARCHT.			RECOMMENDED	
CHALUNCKY					
ELEC.				APPROVED	
MECH.					
DWG. NO. JmDPP-BDM-17.015			SHEET NO. LUP2221435Sg		
SCALE: NTS			BID DRAWING		
REV. DATE			NATURE OF REVISION		
BY			CHKD. RECD. APPD.		

BID DRAWING


REV. C

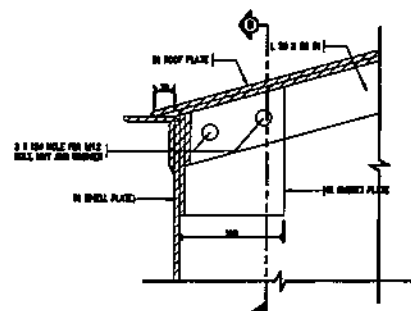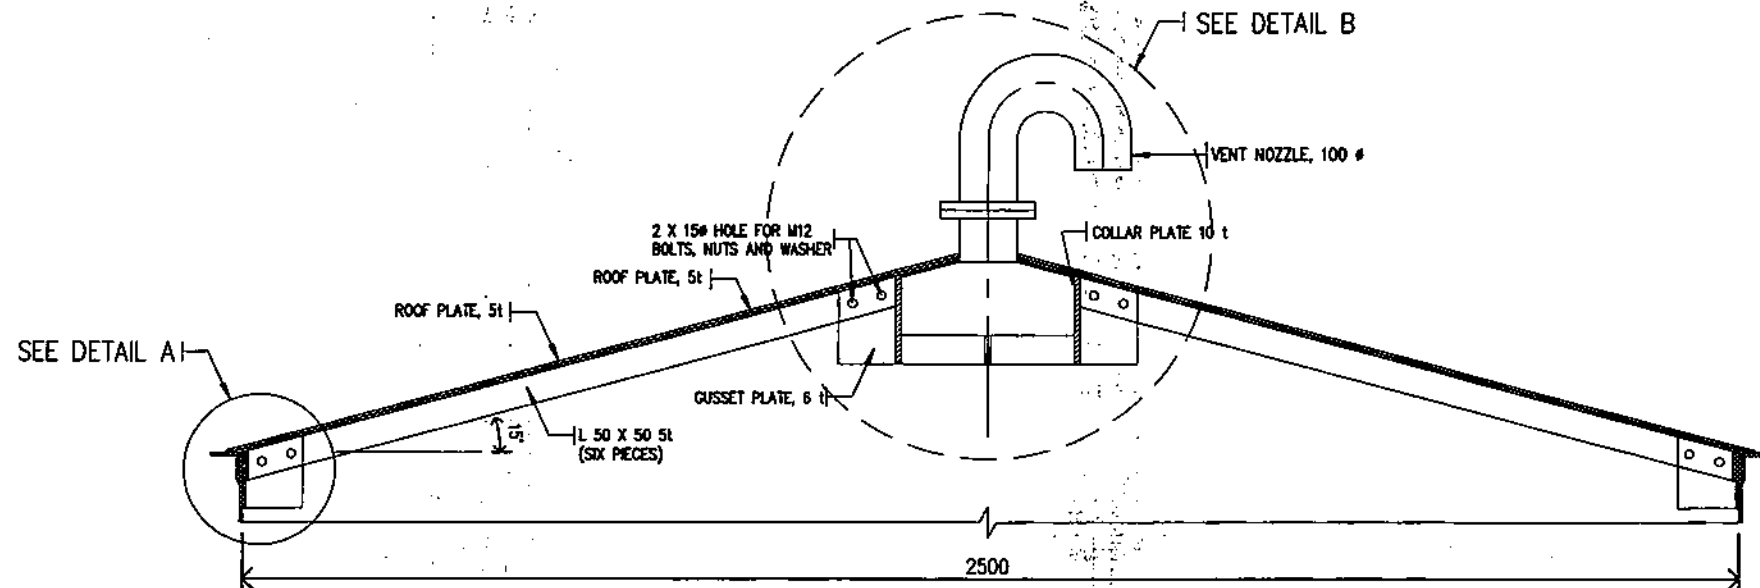

DETAIL A

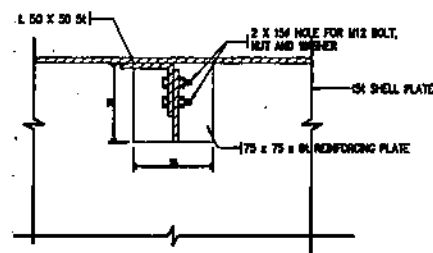

SECTION B

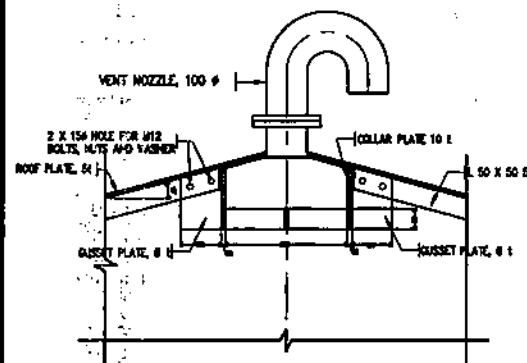

DETAIL B

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. THE FUEL OIL STORAGE TANK SHALL BE CONSTRUCTED TO CONFORM WITH THE LATEST EDITION OF API 650 AND THE MINIMUM REQUIREMENTS SHOWN ON THIS DRAWING OR AS SPECIFIED IN THE TECHNICAL SPECIFICATIONS.
3. DETAILED DRAWINGS, IF NECESSARY SHALL BE SUBMITTED BY THE CONTRACTOR FOR NPC REVIEW/APPROVAL.
4. ALL WELDING WORKS SHALL CONFORM TO THE REQUIREMENTS OF THE SPECIFICATION AND API 650.

OWNER:



NATIONAL POWER CORPORATION
AGHAM ROAD, DILIMAN, QUEZON CITY

PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN ANTITOLD II, BALABO, SAMPAGUANA

LOCATION: BRGY. ANTITOLD II, BALABO, SAMPAGUANA

TITLE:

10 CU. M. FUEL OIL STORAGE TANK
RAFTER DETAILS

DESIGNED	BY	CHKD	DATE
	JTC		
DRAWN		JTC	
REVIEWED	PRINCIPAL ENGR./ARCHT.		
CHECKED			
ELEC.			
MECH.			

SUBMITTED: **N. G. MAGPANG**
RECOMMENDED: **J. A. MAGPANG**
APPROVED: **G. M. MAGPANG, JR.**
Manager, DDO

DWG. NO. JinDPP-BDM-17.016

SPEC. NO. LuzP2221435S

REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPL.

SCALE: AS SHOWN

BID DRAWING

REV. 0

TERMS OF REFERENCE

SUPPLY, DELIVERY, INSTALLATION, TEST, AND
COMMISSIONING OF 2 X 150 KW MODULAR DIESEL
GENERATING SETS, ASSOCIATED ELECTRICAL
EQUIPMENT & BALANCE OF PLANT FOR THE
ELECTRIFICATION OF NEW AREA IN JINTOTOLO IS.,
BALUD, MASBATE


LuzP22Z1435Se

BID DRAWINGS

ELECTRICAL DRAWINGS

SECTION VI - BID DRAWINGS**EW - ELECTRICAL DRAWINGS**

DRAWING NO.	TITLE
JinDPP-BDE-17.001	SINGLE LINE DIAGRAM
JinDPP-BDE-17.002	EQUIPMENT LAYOUT
JinDPP-BDE-17.003	DETAILS OF TAKE-OFF STRUCTURE 1/2
JinDPP-BDE-17.004	DETAILS OF TAKE-OFF STRUCTURE 2/2
JinDPP-BDE-17.005	CONDUIT PLAN LAYOUT
JinDPP-BDE-17.006	GROUNDING SYSTEM
JinDPP-BDE-17.007	LIGHTING & POWER LAYOUT AND DETAILS OF LIGHTING FIXTURES
JinDPP-BDE-17.008	LIGHTING & POWER LAYOUT, SCHEDULE OF LOADS AND RISER DIAGRAM (BUNKHOUSE)
JinDPP-BDE-17.009	SCHEMATIC AND PANEL FOR PUMP MOTOR
JinDPP-BDE-17.010	PERIMETER LIGHTING LAYOUT
JinDPP-BDE-17.011	LIGHTING CONTROL SYSTEM
JinDPP-BDE-17.012	SCHEDULE OF LOAD & RISER DIAGRAM
JinDPP-BDE-17.013	SYSTEM CONFIGURATION
JinDPP-BDE-17.014	GENERATOR CONTROL & PROTECTION PANEL (GCPP) OUTLINE DRAWING
JinDPP-BDE-17.015	GROUNDING SYSTEM CONNECTION DETAILS
JinDPP-BDE-17.016	STEEL POLE GROUNDING CONNECTION DETAILS
JinDPP-BDE-17.017	DETAILS OF TRANSFORMER TERMINATION
JinDPP-BDE-17.018	LIGHTNING PROTECTION SYSTEM
JinDPP-BDE-17.019	DETAILS OF CONTROL HOUSE & CABLE ENTRY
JinDPP-BDE-17.020	ALTERNATOR SPACE HEATER CONTROL CIRCUIT
JinDPP-BDE-17.021	GENERAL NOTES

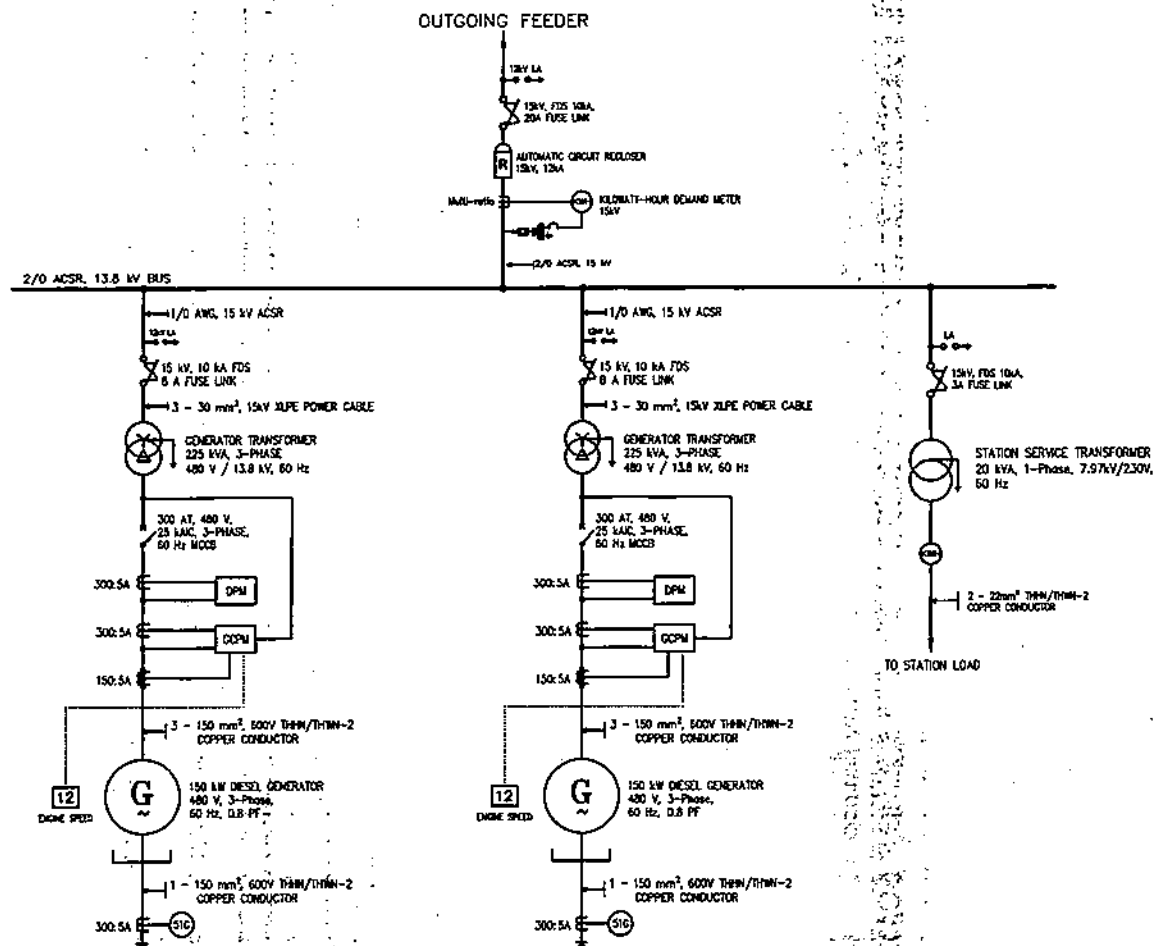

NOTES:

1. THE SUPPLIER SHALL PROVIDE PROTECTION MODULE EQUIPPED WITH THE ENGINE-GENERATOR PROTECTION AS SHOWN.
2. TRIP AND FAULT ALARM/SIGNAL FROM THE GENERATOR TRANSFORMER SHALL BE INCLUDED IN THE ENGINE-GENERATOR ALARM SYSTEM.
3. BURDENS AND RATINGS INCLUDING CIRCUIT PROTECTIONS OF INSTRUMENT TRANSFORMER SHALL BE DETERMINED BY THE SUPPLIER.
4. ALL THE EQUIPMENT TO BE SUPPLIED SHALL BE TESTED AND PROVEN PASSED IN ACCORDANCE TO THE REQUIREMENTS OF SECTION VI - TECHNICAL SPECIFICATIONS.

LEGENDS AND SYMBOLS:

- FDS - FUSE DISCONNECT SWITCH
 LA - LIGHTNING ARRESTER
 ACSR - ALUMINUM CONDUCTOR STEEL REINFORCED
 CLF - CURRENT LIMITING FUSE
 MCCB - MOLDED CASE CIRCUIT BREAKER
 MR - MULTI-RATIO
 CT - CURRENT TRANSFORMER
 CBCT - CORE BALANCE CURRENT TRANSFORMER
 ⬇ - EARTH / GROUND CONNECTION



GENERATOR CONTROL & PROTECTION MODULE (GCPM)

- B1 - UNDER/OVER FREQUENCY RELAY
 59 - OVERVOLTAGE RELAY
 50/51 - PHASE OVERCURRENT RELAY
 50N/51N - RESIDUAL OVERCURRENT RELAY
 51G - GROUND OVERCURRENT RELAY
 51V - VOLTAGE RESTRAINED OVERCURRENT RELAY
 49 - ROTOR TEMPERATURE SENSOR
 46 - NEGATIVE SEQUENCE CURRENT RELAY
 32 - DIRECTIONAL POWER RELAY
 27 - UNDERVOLTAGE RELAY
 12 - OVERSPEED RELAY
 AUTOMATIC & MANUAL SYNCHRONIZING FUNCTION
 AUTOMATIC & MANUAL LOAD SHARING FUNCTION

DIGITAL MULTI-POWER METER (DPM)

- W - WATT
 VA - VOLT-AMPERE
 VAR - VOLT-AMPERE, REACTIVE
 Wh - WATT-HOUR
 VAh - VA-HOUR
 VARh - VAR-HOUR
 Hz - FREQUENCY
 PF - POWER FACTOR
 PHASE ANGLE (VOLTAGE & CURRENT)
 LINE TO LINE VOLTAGES
 LINE TO NEUTRAL VOLTAGES
 LINE TO LINE CURRENTS
 LINE TO NEUTRAL CURRENTS

NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JIYOTOLGO IS, BALUG, MABATE	
LOCATION: BRGY. JIYOTOLGO ISLAND, BALUG MABATE	
TITLE: SINGLE LINE DIAGRAM	
DESIGNED: <i>[Signature]</i> DRAWN: <i>[Signature]</i> REVIEWED: <i>[Signature]</i> CHG/ARCHT: <i>[Signature]</i> ELEC: <i>[Signature]</i> MECH: <i>[Signature]</i>	SUBMITTED: <i>[Signature]</i> RECOMMENDED: <i>[Signature]</i> APPROVED: <i>[Signature]</i> Manager, E&E
DMC NO. JInDPP-BDE-17.001	SPECS. NO. LUEP22Z1435Se
SCALE: N.T.S.	
REFERENCE DRAWING	
REV. 0	

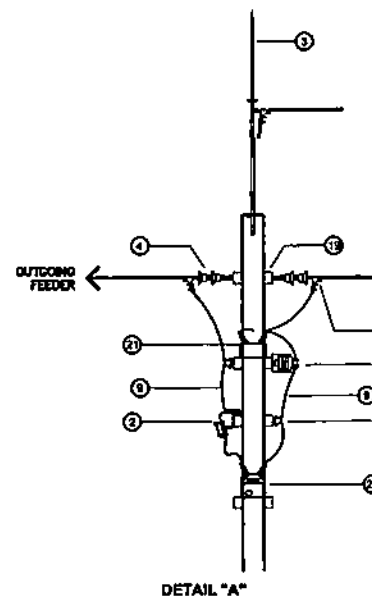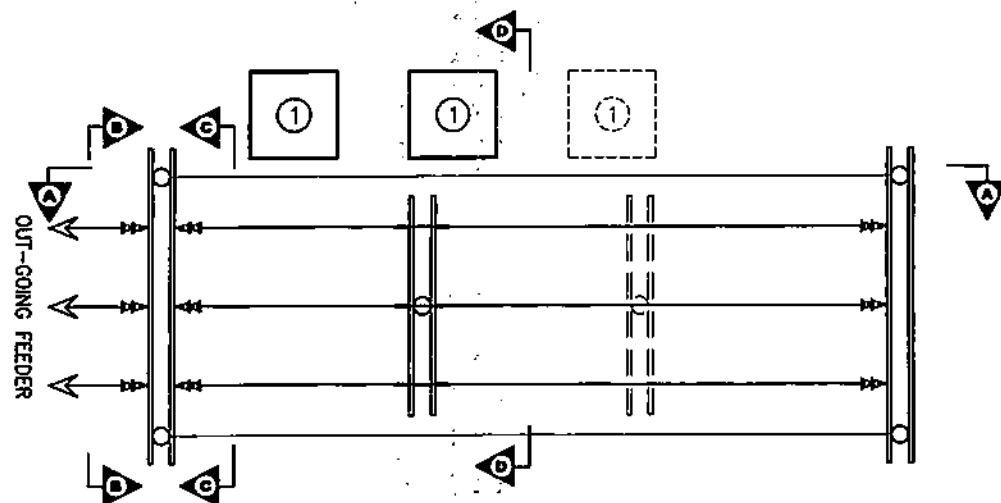


DETAIL "A"

LEGEND:


- ① - GENERATOR TRANSFORMER
- ② - FUSE DISCONNECT SWITCH WITH LA COMBINATION
- ③ - LIGHTNING ROD W/ DOWN CONDUCTOR
- ④ - TENSION INSULATOR
- ⑤ - SEALANT
- ⑥ - T-CONNECTOR
- ⑦ - CONDUIT SUPPORT
- ⑧ - 25 FT. STEEL POLE
- ⑨ - 2/0 AWG ACSR
- ⑩ - 3/8" HIGH STRENGTH GRADE STEEL GALVANIZED OVERHEAD GROUND WIRE
- ⑪ - GROUND CLAMP
- ⑫ - BILLING METER
- ⑬ - CONDUIT
- ⑭ - POWER CABLE, 15KV XLPE
- ⑮ - TERMINATION KIT
- ⑯ - STATION SERVICE TRANSFORMER
- ⑰ - DEAD-END CLAMP
- ⑱ - PIN TYPE INSULATOR
- ⑲ - STEEL CROSSARM
- ⑳ - CURRENT TRANSFORMER
- ㉑ - POTENTIAL TRANSFORMER
- ㉒ - AUTOMATIC CIRCUIT RECLOSER
- ㉓ - 30 FT. STEEL POLE
- ㉔ - RECLOSER CONTROLLER
- ㉕ - 1/0 AWG ACSR
- ㉖ - OVERHEAD GROUND WIRE BAYONET

NOTES:


1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. ALL EQUIPMENT IN HIDDEN [] LINES ARE FOR FUTURE INSTALLATION.
3. THE SUPPLIER SHALL DETERMINE THE LENGTH OF THE OHGW BAYONET WHICH SHOULD PROVIDE 45' PROTECTION TO ALL EQUIPMENT INCLUDING THE BUS FEEDERS AGAINST LIGHTNING SURGES.

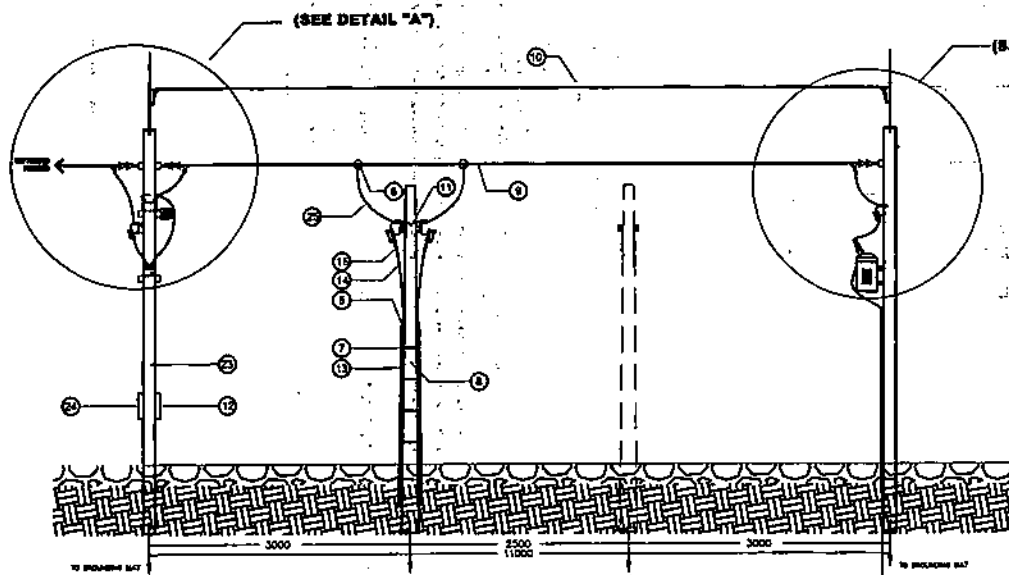

SECTION A-A

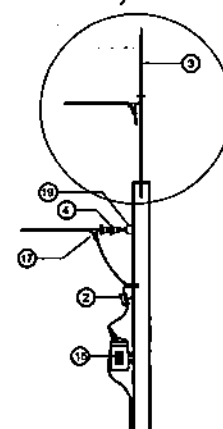

DETAIL "B"

OWNER: 		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTOLDO IS, BALID, SAMPALAN			
LOCATION: BRGY. JINTOTOLDO ISLAND, BALID MARIATE			
TITLE: DETAILS OF TAKE-OFF STRUCTURE (1/2)			
DESIGNED	BY	CHKD	DATE
CRASH			
REVIEWED	PRINCIPAL ENGR. / ARCHT.	RECOMMENDED	R. P. VERAR
CIVIL/ARCHT			
ELEC			
MEDL			
Dwg. No. JlnDPP-8DE-17.003		SPECS. No. LuzP22Z1435S	
SCALE: N.T.S.		REFERENCE DRAWING	
REV. 0			


REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPD.

LEGEND:


- ① - GENERATOR TRANSFORMER
- ② - FUSE DISCONNECT SWITCH WITH LA COMBINATION
- ③ - LIGHTNING ROD W/ DOWN CONDUCTOR
- ④ - TENSION INSULATOR
- ⑤ - SEALANT
- ⑥ - T-CONNECTOR
- ⑦ - CONDUIT SUPPORT
- ⑧ - 25 FT. STEEL POLE
- ⑨ - 2/0 AWG ACSR
- ⑩ - 3/8" HIGH STRENGTH GRADE STEEL GALVANIZED OVERHEAD GROUND WIRE
- ⑪ - GROUND CLAMP
- ⑫ - BILLING METER
- ⑬ - CONDUIT
- ⑭ - POWER CABLE, 15KV XLPE
- ⑮ - TERMINATION KIT
- ⑯ - STATION SERVICE TRANSFORMER
- ⑰ - DEAD-END CLAMP
- ⑱ - PIN TYPE INSULATOR
- ⑲ - STEEL CROSSARM
- ⑳ - CURRENT TRANSFORMER
- ㉑ - POTENTIAL TRANSFORMER
- ㉒ - AUTOMATIC CIRCUIT RECLOSER
- ㉓ - 30 FT. STEEL POLE
- ㉔ - RECLOSER CONTROLLER
- ㉕ - 1/0 AWG ACSR
- ㉖ - OVERHEAD GROUND WIRE BAYONET

NOTES:


1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. THE SUPPLIER SHALL DETERMINE THE LENGTH OF THE OHGW BAYONET SO AS TO PROVIDE 45° PROTECTION TO ALL EQUIPMENT INCLUDING THE BUS FEEDERS AGAINST LIGHTNING SURGES.

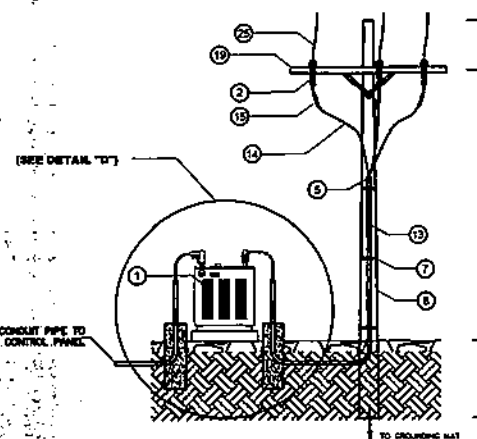


SECTION D-D

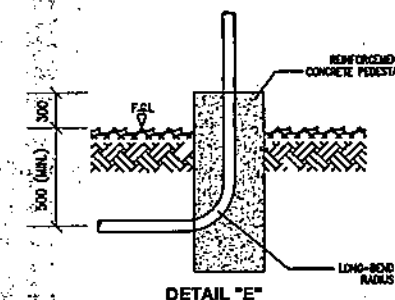

DETAIL 'E'

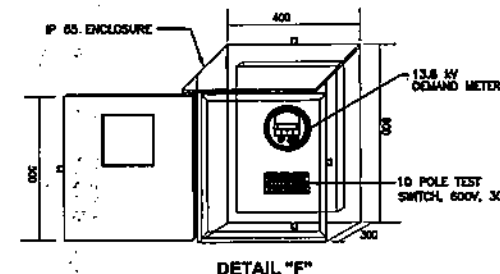


DETAIL 'F'

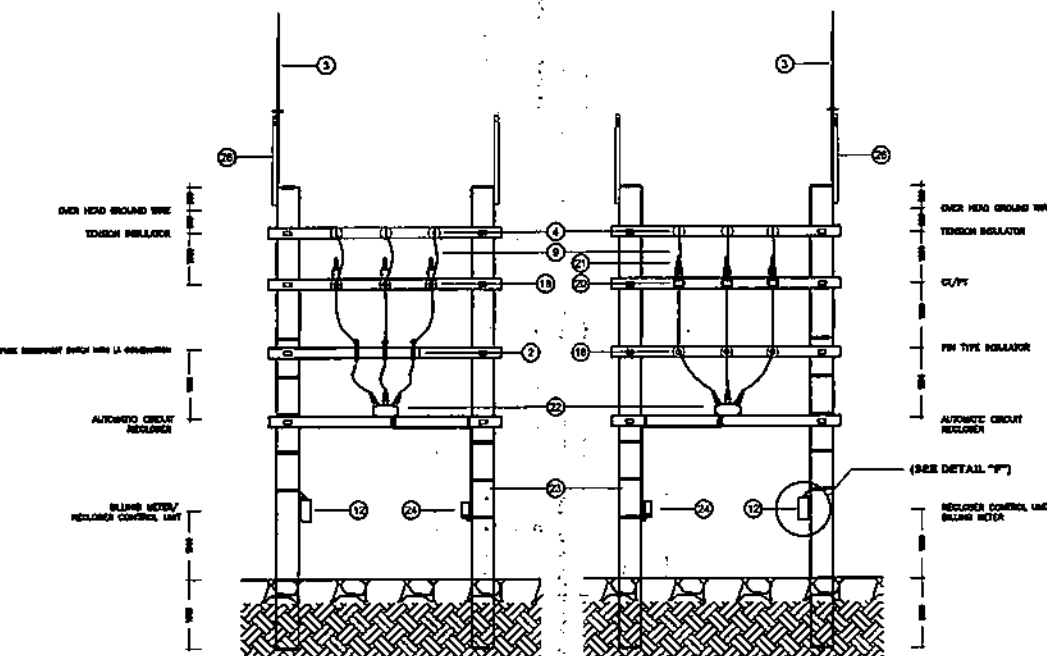


SECTION B-B

SECTION C-C

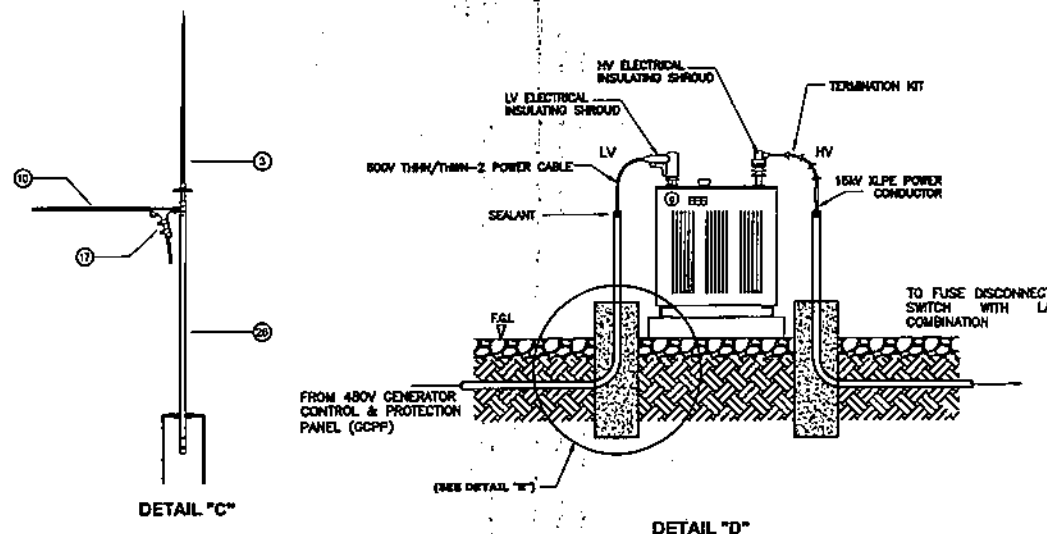


DETAIL 'C'

DETAIL 'D'

OWNER: 		NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 118 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN ANTITOLDO IS., SALLU, MABABATE			
LOCATION: BRGY. ANTITOLDO ISLAND, SALLU MABABATE			
TITLE: DETAILS OF TAKE-OFF STRUCTURE (2/2)			
DESIGNED	BY	CHKD	DATE
DRAWN			
REVIEWED	PRINCIPAL ENG'G	ARCHT.	
CHK/ARCHT			
ELEC.			
MECH.			
SUBMITTED: R. P. VERAR		RECOMMENDED: C. Z. C. LUGOD, JR.	
APPROVED: G. B. MAGPOC, JR.		Manager, E&C	
Dwg. No. JInDPP-BDE-17.004		Specs. No. LuzP22Z1435S	
SCALE: N.T.S.		REFERENCE DRAWING	
REV. DATE		NATURE OF REVISION	
BY		CHKD. RECD. APPD.	

REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPD.

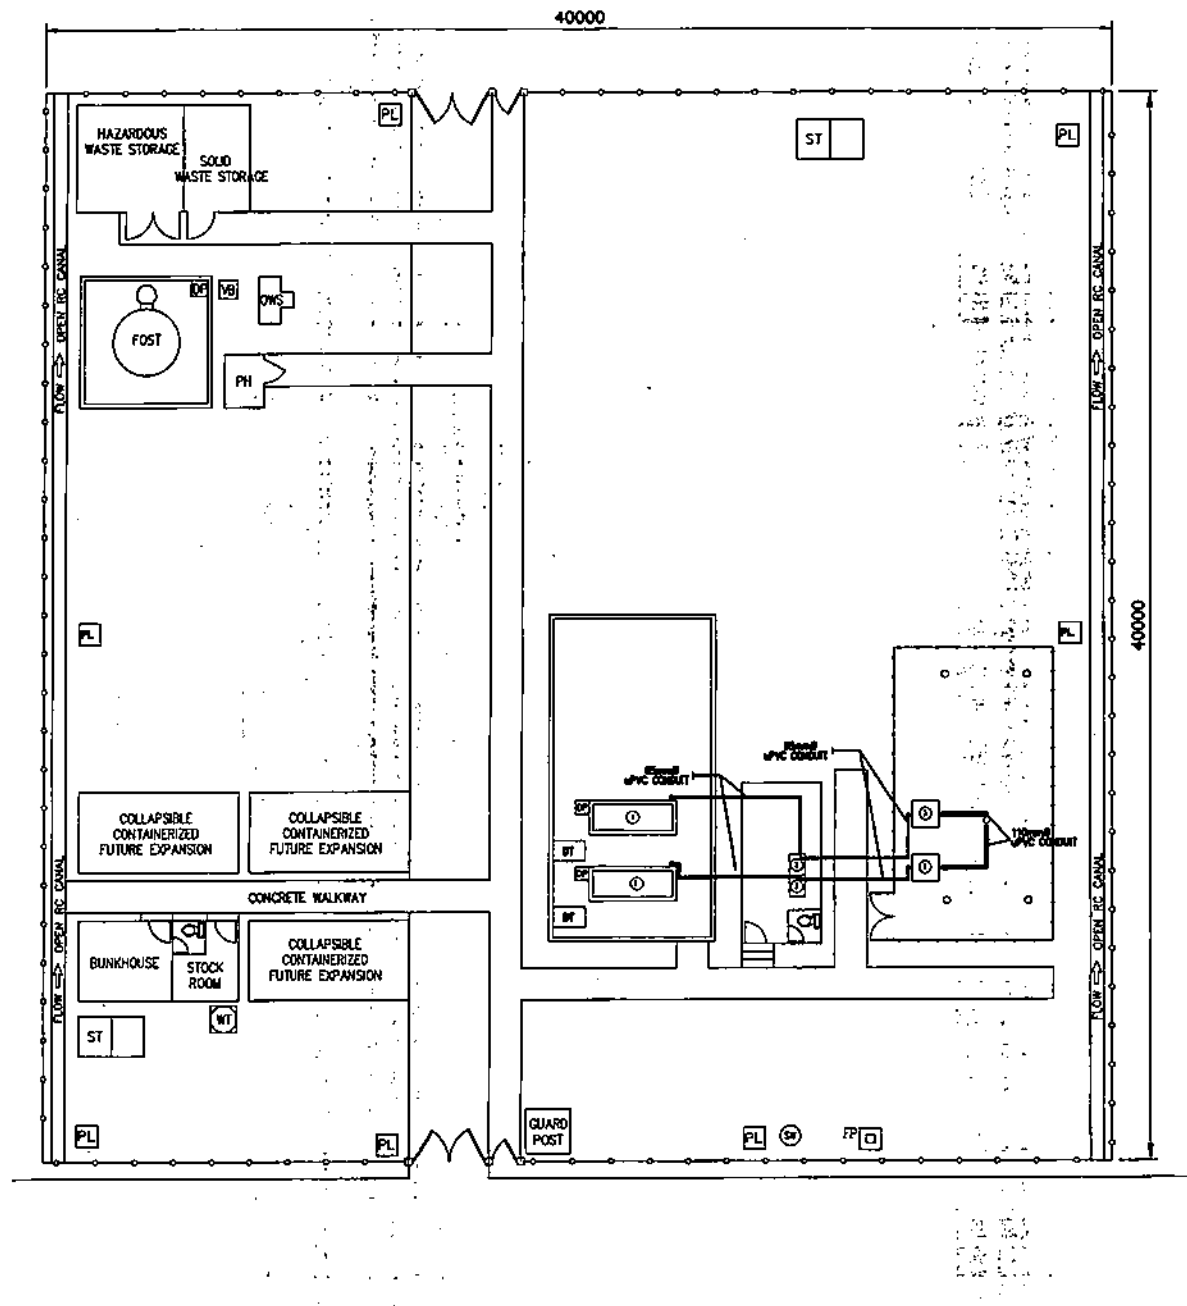


NOTES:

- THIS DRAWING IS FOR BIDDING PURPOSES ONLY. THE SUPPLIER SHALL DETERMINE THE ACTUAL ROUTE OF CONDUIT RUN AND SHALL SUBMIT THE LAYOUT FOR APPROVAL OF NPC.
- CONDUIT (uPVC) SIZES ARE AS FOLLOWS:
 - 600V THHN/THWN-2 POWER CABLES - 55mm² uPVC
 - CONTROL & INSTRUMENTATION CABLES - 20mm² uPVC
 - 15kV XLPE POWER CABLES - 110mm² uPVC
- THIS DRAWING SHALL BE WORKED WITH CIVIL AND MECHANICAL DRAWINGS.


LEGEND:

- ① - DIESEL GENERATOR
- ② - GENERATOR CONTROL & PROTECTION PANEL (GCPP)
- ③ - GENERATOR TRANSFORMER
- WT - DAY TANK

OWNER:		NATIONAL POWER CORPORATION AGHAM ROAD, DILMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTOLDO IS, BALLO, SAGBATE			
LOCATION: BRGY. JINTOTOLDO ISLAND, BALLO SAGBATE			
TITLE: CONDUIT PLAN LAYOUT			
DESIGNED	BY	CHKD	DATE
DRWN			
REVIEWED	PRINCIPAL DES'N / ARCHT.	RECOMMENDED	C. Z. C. LUGOD, JR. Manager, EED
CHK/ARCHT		APPROVED	G. B. MAGPOC, JR. Manager, EED
ELEC.			
MECH.			
DRG. NO. JinDPP-BDE-17.005		SPECS. NO. L12P22Z1435S	
REV.		DATE	
NATURE OF REVISION		BY	
CHKD		RECD	
APPD.		SCALE: N.T.S.	
REFERENCE DRAWING		REV. 0	

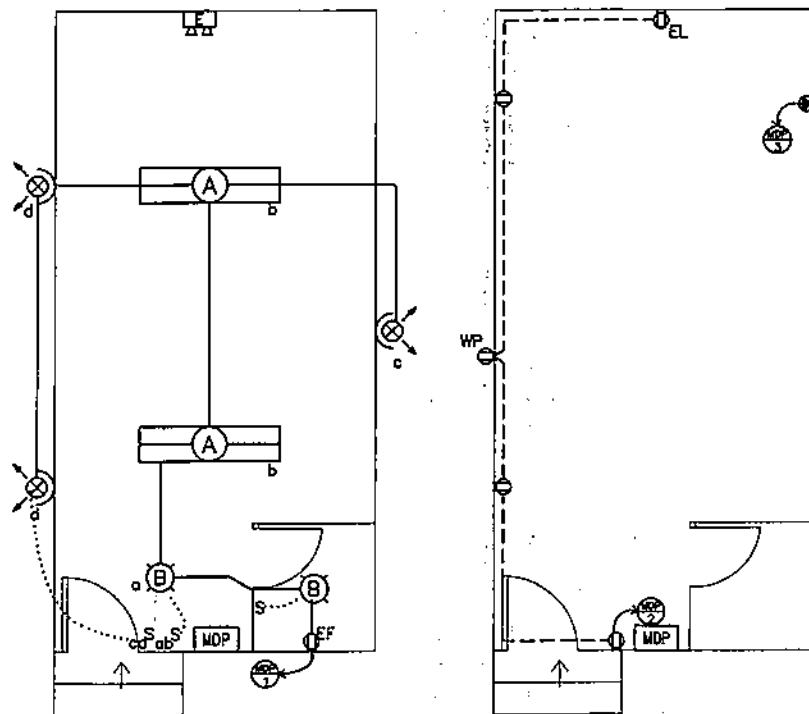

CONTROL ROOM LIGHTING & POWER LAYOUT

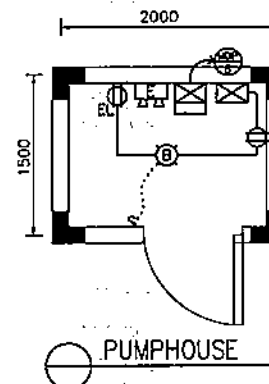

NOTES:

1. ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE LATEST PROVISIONS OF THE PHILIPPINE ELECTRICAL CODE, LOCAL ORDINANCES AND REGULATIONS.
2. CONDUIT RUNS ARE INDICATIVE ONLY. THE ACTUAL LOCATION SHALL BE DETERMINED IN THE FIELD.
3. ALL WIRES SHALL BE TYPE THHN/THWN-2 600V INSULATION, 90°C OPERATING TEMP., STRANDED COPPER CONDUCTOR.
4. CONDUIT SHALL BE UPVC, SCH40.
5. ALL DIMENSIONS ARE IN MILLIMETER UNLESS OTHERWISE SPECIFIED.
6. THIS DRAWING SHALL BE WORKED WITH CIVIL AND MECHANICAL BID DRAWINGS.



LEGEND:

- FIXTURE TYPE A
- FIXTURE TYPE B
- FIXTURE TYPE C
- FIXTURE TYPE E
- SINGLE POLE SWITCH
- DUPLEX SWITCH
(SUBSCRIPT DENOTES LAMP BEING CONTROLLED)
- WEATHERPROOF DUPLEX SWITCH
(SUBSCRIPT DENOTES LAMP BEING CONTROLLED)
- 200VA DUPLEX CONVENIENCE OUTLET
- 200VA DUPLEX CONVENIENCE OUTLET (WEATHER PROOF)
- EMERGENCY LIGHT OUTLET
- EXHAUST FAN OUTLET
- ENCLOSED CIRCUIT BREAKER W/ BUILT-IN UNIVERSAL CONVENIENCE OUTLET FOR ACU
- CIRCUIT RUNNING ON CEILING
- CIRCUIT RUNNING UNDERGROUND/WALL
- CONTROL CIRCUIT
- CIRCUIT HOMERUN
- MAIN DISTRIBUTION PANELBOARD
- 50AF/15AT 2P, MCB IN NEMA 1 ENCLOSURE
- PUMP MOTOR LOCAL CONTROL AND PROTECTION PANEL


A	B	C	D	E	F
IP20 FLUSH MOUNTED TYPE LIGHTING FIXTURE, WITH MIRROR FINISH ALUMINUM REFLECTOR, 2 x 16 WATTS COOL WHITE 190H OUTPUT LED LAMP TUBE LUMINAIRES.	IP20 3 x 8 WATTS COOL WHITE CLASSIC GLOBE SHAPE FROSTED FINISH, E27 BASE, COMPACT LED LAMP.	IP65 RATING 50 WATTS LED FLOOD LIGHT, FORGED WITH HIGH QUALITY ALUMINUM ALLOY WITH CLEAR TEMPERED GLASS AND BUILT-IN COOLING FINS.	30 WATTS LED PERIMETER LIGHTING LUMINAIRE WITH ALUMINUM HOUSING COMPLETE WITH ADAPTOR TO ENABLE LEVEL ADJUSTMENT ON LAMP POST	PORTABLE EMERGENCY LIGHTING FIXTURE, 2 x 2 WATTS LED WARM WHITE WITH BUILT-IN SEALED LEAD ACID BATTERY - CHARGING TIME < 20 HRS; USAGE TIME < 4 HRS	IP20 ROUND CEILING LUMINAIRE, SURFACE MOUNTED, 300mm DIAMETER, WHITE STEEL BASE, WHITE OPAL GLASS DIFFUSER AND COMPLETE WITH 2 x 16 WATTS, E27 BASE, FROSTED FINISH COMPACT LED LAMP.

NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREA IN ANTITOLLO IS, BALID, MAGSATE	
LOCATION: BRGY. ANTITOLLO ISLAND, BALID MAGSATE	
TITLE: LIGHTING & POWER LAYOUT AND DETAILS OF LIGHTING FIXTURES	
DESIGNED: _____ DRAWN: _____ REVIEWED: _____ CIVIL/ARCHT: _____ ELEC: _____ MECH: _____	BY: _____ CHKD: _____ DATE: _____ SUBMITTED: _____ RECOMMENDED: _____ APPROVED: _____ G. B. MAGPOC, JR. Manager, E&E
DWG. NO. JlnDPP-BDE-17.007 SPEC. NO. LuzP22Z1435Se	
SCALE: N.T.S. REFERENCE DRAWING REV. 0	

REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPR.



RISER DIAGRAM

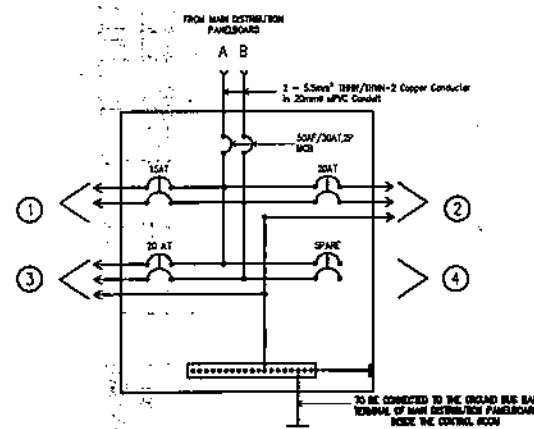

○ RISER DIAGRAM
LIGHTING AND POWER PANELBOARD

SCHEDULE OF LOADS							
CIR. NO.	DESCRIPTION	VA	V	A	SIZES		
					BREAKER	WIRE	CONDUIT
5	3 - 1 X 1W COMPACT LND LAMP, TYPE B	167.50	230	0.73	300V / 35A	2 - 3.5mm ² TRM/WH-2	Minimum 4"VC BLACK
	1 - 2 X 1W BOUND CROWN LAMINATE, TYPE F						
	1 - 300 W. COMPACT FLS. OUTLET						
2	2 - 300VA COMPENSATE OUTLET	630	328	1.65	300V / 30A	2 - 3.5mm ² TRM/WH-2 1 - 3.5mm ² TRM/WH-3	Minimum 4"VC BLACK
	2 - 2 X 2W EMERGENCY LIGHT OUTLET						
3	1 - 6.0 HP AIR COMPRESSOR UNIT	1725.00	328	1.52	300V / 35A	2 - 3.5mm ² TRM/WH-2 1 - 3.5mm ² TRM/WH-3	Minimum 4"VC BLACK
4	SPARE	0.00	230	0.00	300V / 30A		
	TOTAL	6025.50	320	17.42			

PROVIDE: 50 AF / 30 AT, 2P MCB WITH BRANCH CIRCUIT OF:
3 - 50AF/20AT, 2P, MCS
1 - 50AF/15AT, 2P, MCS

PROVIDE: 2 - 5.5mm² THHN/THWN-2 &
1 - 5.5mm² THHN/THWN-2 Copper Conductor










○ SCHEDULE OF LOADS


○ LIGHTING AND POWER PANELBOARD

- NOTES:

1. ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE LATEST PROVISIONS OF THE PHILIPPINE ELECTRICAL CODE, LOCAL ORDINANCES AND REGULATIONS.
2. CONDUIT RUNS ARE INDICATIVE ONLY. THE ACTUAL LOCATION SHALL BE DETERMINED IN THE FIELD.
3. ALL WIRES SHALL BE TYPE THHN/THWN-2 600V INSULATION, 90°C OPERATING TEMP., STRANDED COPPER CONDUCTOR.
4. CONDUIT SHALL BE uPVC, SCH.40.
5. ALL DIMENSIONS ARE IN MILLIMETER UNLESS OTHERWISE SPECIFIED.
6. THIS DRAWING SHALL BE WORKED WITH CIVIL AND MECHANICAL BID DRAWINGS.


LEGEND:

-  - FIXTURE TYPE B
-  - FIXTURE TYPE F
-  - FIXTURE TYPE C
-  - FIXTURE TYPE E
- S - SINGLE POLE SWITCH
- S_{ob} - DUPLEX SWITCH
(SUBSCRIPT DENOTES LAMP BEING CONTROLLED)
-  - 200VA DUPLEX CONVENIENCE OUTLET
-  - 200VA DUPLEX CONVENIENCE OUTLET (WEATHER PROOF)
-  - EMERGENCY LIGHT OUTLET
-  - EXHAUST FAN OUTLET
-  - ENCLOSED CIRCUIT BREAKER W/ BUILT-IN UNIVERSAL CONVENIENCE OUTLET FOR ACU
- _____ - CIRCUIT RUNNING ON CEILING
- - CIRCUIT RUNNING UNDERGROUND/WALL
- - CONTROL CIRCUIT
- - CIRCUIT HOMERUN
- [PP] - LIGHTING AND POWER PANELBOARD


OWNER:		NATIONAL POWER CORPORATION	
		AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT:	SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTOLG IS., BAILIS, MAGSATE		
LOCATION:	BAGY, JINTOTOLG ISLAND, BAILIS MAGSATE		
TITLE:	LIGHTING & POWER LAYOUT, SCHEDULE OF LOADS AND RISER DIAGRAM (BUNKHOUSE)		
DESIGNED BY	CHKD	DATE	SUBMITTED: <i>[Signature]</i> R. P. VERAR Principal Engineer, A-1330 RECOMMENDED: C. Z. C. LUGOD, JR. Manager, E-1330 APPROVED: G. B. MAGPOC, JR. Manager, 100
DRAWN			
REVIEWED	PRINCIPAL ENGR. / ARCHT.		
CHG./ARCHT			
ELEC.			
MECH.			
DWG. NO. JInDPP-BDE-17.008		SPECS. NO. LuzP22Z1435S	

NOTES:


1. PUMP MOTOR CONTROL, PROTECTION AND/OR MONITORING PANELS SHALL BE COLORED RAL 7032 AND ITS STEEL SHEET THICKNESS SHALL BE AT LEAST 2.0 MILLIMETERS.
2. THE CONTRACTOR SHALL DESIGN THE CABLE ENTRY FOR ALL THE POWER, CONTROL AND INSTRUMENTATION TO BE USE.
3. REMOTE CONTROL PANEL (RCP) SHALL BE LOCATED AT THE CONTROL ROOM TO BE COORDINATED WITH THE PLANT HEAD/PERSONNEL.
4. THE CONTRACTOR SHALL PROVIDE THE BROCHURES/CATALOGUES OF THE PUMP MOTOR CONTROL AND MONITORING PANELS INCLUDING COMPONENTS FOR METERING, PROTECTION, CONTROL AND MONITORING PURPOSES FOR APPROVAL OF NPC.

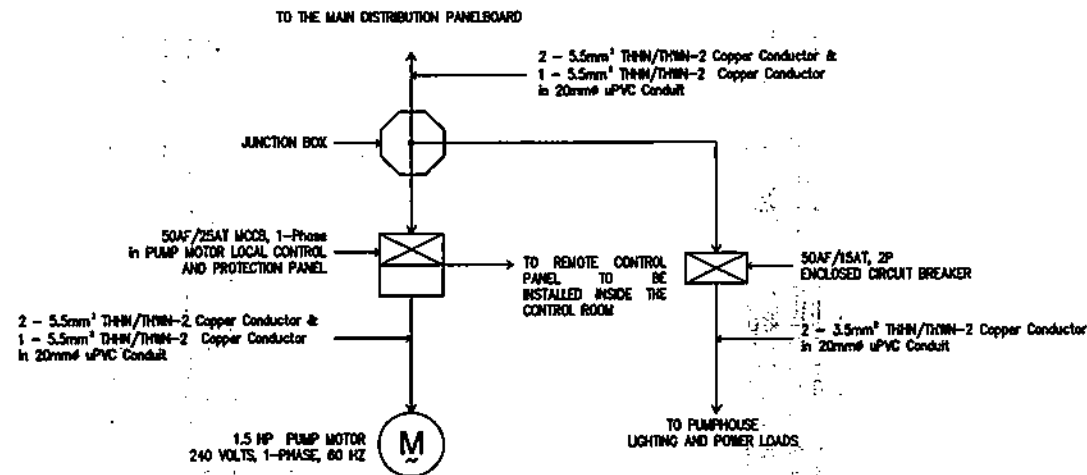



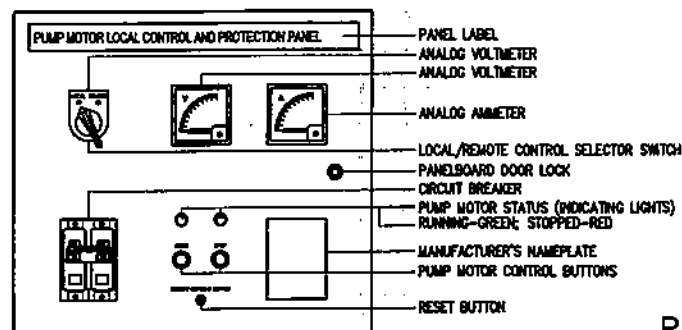

SINGLE LINE DIAGRAM
(FUEL OIL PUMP)

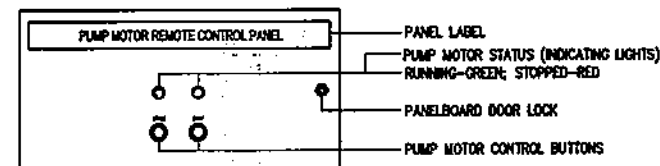


PUMP MOTOR LOCAL CONTROL
AND PROTECTION PANEL (LCPP)




PUMP MOTOR
REMOTE CONTROL PANEL (RCP)

OWNER:  NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JIKOTOTOLO IS, BALID, MARIKINA	
LOCATION: BRGY. JIKOTOTOLO ISLAND, BALID MARIKINA	
TITLE: SCHEMATIC AND PANEL FOR PUMP MOTOR	
DESIGNED	BY CHD DATE
DRAWN	SUBMITTED:  E.P. VERANO Electrical Engineer-III
REVIEWED	PRINCIPAL ENGR. / ARCHT. RECOMMENDED:  C. Z. C. LUGOD, JR. Manager, E&E
CHKD/INCHD	APPROVED:  G.B. MAGPOC, JR. Manager, E&E
FILED	
WCHD	
DWG. NO. JinDPP-BDE-17.009 SPECS. NO. LuzP22Z1435Se	
SCALE: N.T.S. REFERENCE DRAWING REV. 0	

REV.	DATE	NATURE OF REVISION	BY	CHD.	RECD.	APPD.

OWNER:		 AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT:		SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 3 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTOLID, BALID, MASBATE	
LOCATION:		BRGY. JINTOTOLID ISLAND, BALID MASBATE	
TITLE:		PERIMETER LIGHTING LAYOUT	
DESIGNED	BY	CHKD	DATE
DRAWN			
REVIEWED	PRINCIPAL ENGR. / ARCHT.		
CML/ARCHT			
ELEC.			
MEDL.			
SUBMITTED:		R. P. VERAR <i>[Signature]</i> Manager, EPCO	
RECOMMENDED:		C. Z. C. LUGOD, JR. <i>[Signature]</i> Manager, EPCO	
APPROVED:		G. B. MAGPOC, JR. <i>[Signature]</i> Manager, EPCO	
DWG. NO. JlnDPP-BDE-17.010		SPECS. NO. LuzP22Z14355e	
SCALE: N.T.S.		REFERENCE DRAWING REV. 0	


FROM LIGHTING AND POWER PANEL
BRANCH CIRCUIT

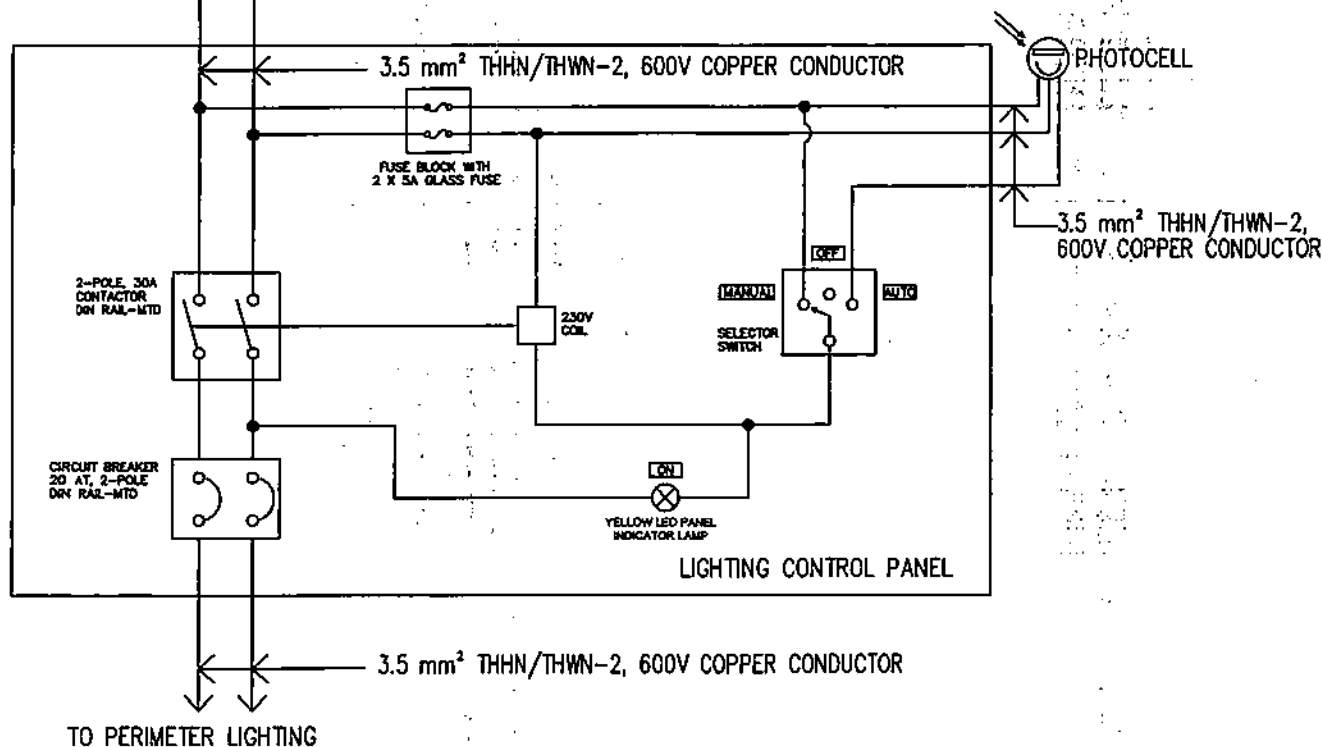







LIGHTING CONTROL SYSTEM WIRING DIAGRAM

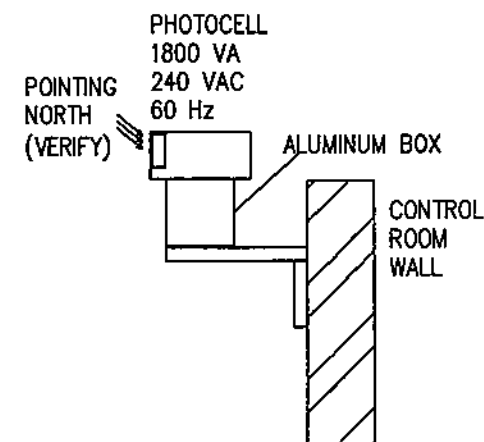NOTE(S):

1. THE LIGHTING CONTROL PANEL BOX SHALL BE WALL MOUNTED AND DUST TIGHT WITH DIMENSIONS OF 300 mm (W) X 300mm (L) X 150mm (D).
2. THE LIGHTING CONTROL PANEL BOX SHALL BE INSTALLED INSIDE THE CONTROL ROOM.
3. PHOTOCELL SHALL BE MOUNTED IN A 4 in. x 2 in. ALUMINUM BOX WITH WEATHERPROOF ENCLOSURE WHERE THE PHOTOCELL IS POINTING NORTH.
4. PHOTOCELL SHALL BE MOUNTED IN CONTROL ROOM WALL THAT IS POINTING NORTH, EXPOSED TO FULL DAYLIGHT AND NOT SHADOWED OR DIRECTLY EXPOSED TO ANY NIGHT-TIME ILLUMINATION.
5. ALL WIRES SHALL BE TYPE THHN/THWN-2, 600V COPPER CONDUCTOR.
6. ALL WORKS SHALL CONFORM WITH THE LATEST PROVISION OF THE PHILIPPINE ELECTRICAL CODE.



PHOTOCELL INSTALLATION DETAILS

OWNER:  NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 100 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTOLGO IS, BALABO, BALSABATE	
LOCATION: BRGY. JINTOTOLGO ISLAND, BALABO MARIKINA	
TITLE: LIGHTING CONTROL SYSTEM	
DESIGNED: 	SUBMITTED: 
DRAWN: 	RECOMMENDED BY: 
REVIEWED: PRINCIPAL ENGR. / ARCHT.	APPROVED: 
CHECK/RIGHT	
ELEC.	
MECH.	
Dwg. No. JInDPP-BDE-17.011	
Specs. No. LuzPZZ214355e	
REFERENCE DRAWING	
REV. 0	

REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPD.

SCALE: N.T.S.


SCHEDULE OF LOADS							
CKT NO.	DESCRIPTION	VA	V	SIZES			
				A	BREAKER	WIRE	CONDUIT
1	2 - 2 X 10W LED LAMP TUBE, TYPE A	400	230	1.74	50AF / 15AT	2 - 3.5mm ² THHN/THWN-2	20mmx20mm uPVC TRUNGING
	2 - 1 X 9W COMPACT LED LAMP, TYPE B						
	3 - 50W LED FLOOD LIGHT, TYPE C						
	1 - 100VA EXHAUST FAN OUTLET						
2	3 - 200VA CONVENIENCE OUTLET	900	230	3.91	50AF / 20AT	2 - 3.5mm ² THHN/THWN-2 1 - 5.5mm ² THHN/THWN-2	20mmx20mm uPVC TRUNGING
	1 - 200VA WEATHERPROOF CONVENIENCE OUTLET						
	1 - 100VA EMERGENCY LIGHT OUTLET						
3	1 - 2.0 HP AIR CONDITIONER UNIT	2790	230	12.00	50AF / 30AT	2 - 5.5mm ² THHN/THWN-2 1 - 5.5mm ² THHN/THWN-2	20mmx20mm uPVC TRUNGING
4	LIGHTING AND POWER PANEL (BUNKHOUSE)	4007.10	230	17.42	50AF / 30AT	2 - 5.5mm ² THHN/THWN-2 1 - 5.5mm ² THHN/THWN-2	20mmx20mm uPVC TRUNGING (20mmx8 uPVC CONDUIT UPON EXIT OF CONTROL ROOM)
5	7 - 1 X 30W LED PERIMETER LIGHTING, TYPE D	282	230	1.14	50AF / 15AT	2 - 3.5mm ² THHN/THWN-2 1 - 3.5mm ² THHN/THWN-2	20mmx20mm uPVC TRUNGING (20mmx8 uPVC CONDUIT UPON EXIT OF CONTROL ROOM)
6	PUMPHOUSE LOADS	2518.25	230	10.94	50AF / 25AT	2 - 5.5mm ² THHN/THWN-2 1 - 5.5mm ² THHN/THWN-2	20mmx20mm uPVC TRUNGING (20mmx8 uPVC CONDUIT UPON EXIT OF CONTROL ROOM)
7	GENERATOR SPACE HEATER FOR UNIT NO. 1	200	230	0.87	50AF / 20AT	2 - 3.5mm ² THHN/THWN-2 1 - 3.5mm ² THHN/THWN-2	20mmx20mm uPVC TRUNGING (20mmx8 uPVC CONDUIT UPON EXIT OF CONTROL ROOM)
8	GENERATOR SPACE HEATER FOR UNIT NO. 2	200	230	0.87	50AF / 20AT	2 - 3.5mm ² THHN/THWN-2 1 - 3.5mm ² THHN/THWN-2	20mmx20mm uPVC TRUNGING (20mmx8 uPVC CONDUIT UPON EXIT OF CONTROL ROOM)
9	SPACE	1500	230	6.52	50AF / 20AT		
10	SPACE						
	TOTAL	12745.35	230	55.41			

PROVIDE: 100 AF / 70 AT, 2P MCB WITH BRANCH CIRCUIT OF:
 2 - 50AF/30AT, 2P, MCB
 1 - 50AF/25AT, 2P, MCB
 4 - 50AF/20AT, 2P, MCB
 2 - 50AF/15AT, 2P, MCB






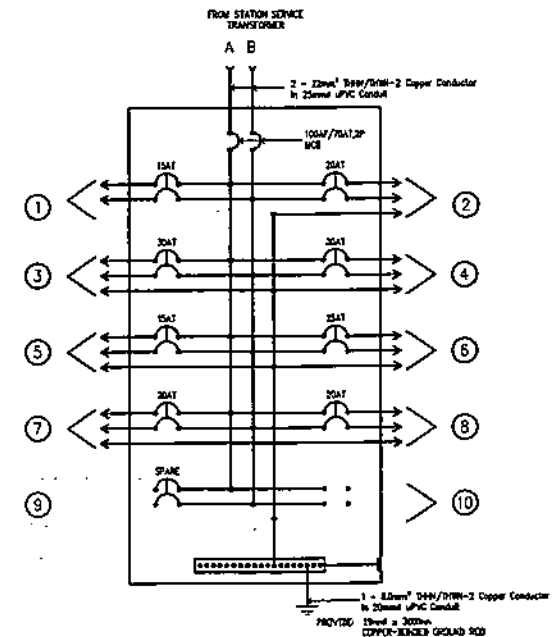


PROVIDE: 2 - 22mm² THHN/THWN-2 &
 1 - 8.0mm² THHN/THWN-2 Copper Conductor

SCHEDULE OF LOADS
 MAIN DISTRIBUTION PANELBOARD (MDP)


RISER DIAGRAM



RISER DIAGRAM
 MDP

OWNER:  NATIONAL POWER CORPORATION AGHAM ROAD, DILMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 100 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTULO IS, BALUD, MASBATE	
LOCATION: BRGY. JINTOTULO ISLAND, BALUD MASBATE	
TITLE: SCHEDULE OF LOADS & RISER DIAGRAM (MAIN DISTRIBUTION PANELBOARD)	
DESIGNED BY:  R.P. VERAR	SUBMITTED: 
DRAWN BY: 	RECOMMENDED BY:  Z.C. LUGOD, JR. Manager, E&E
CHEK/ARCHT: 	APPROVED:  G.B. MAGPOC, JR. Manager, E&E
ELEC: 	
MECH:	
DWG. NO. JInDPP-BDE-17.012 SPECS. NO. LuzP2221435S	
SCALE: N.T.S. REFERENCE DRAWING REV. 0	

REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPD.

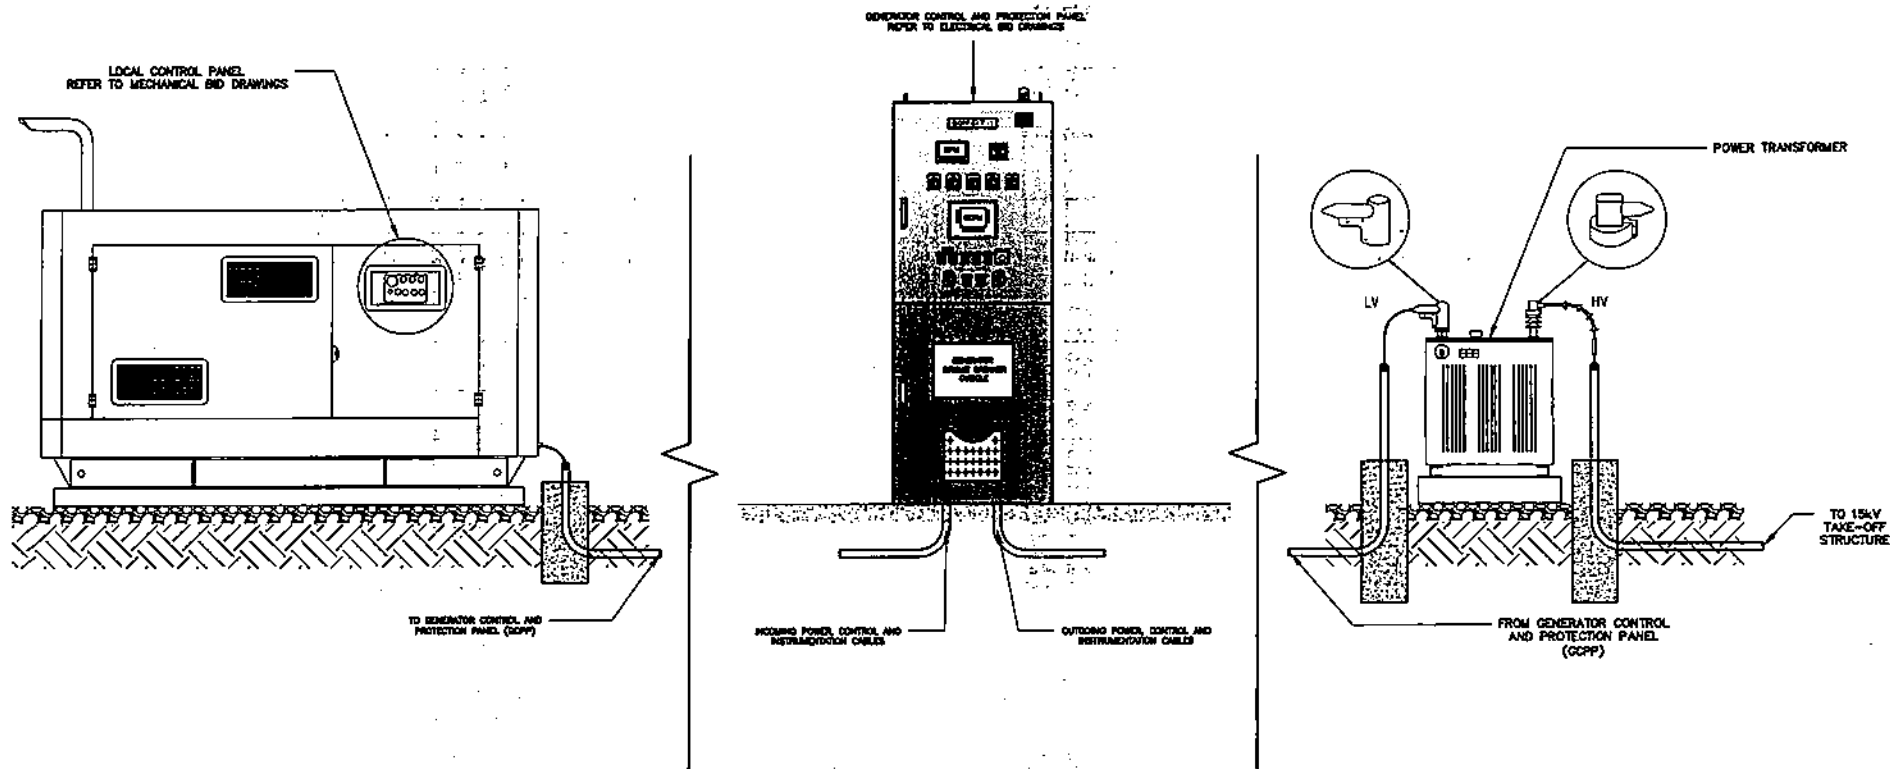

NOTES:

- THIS DRAWING IS INTENDED FOR BIDDING PURPOSES ONLY. THE LOCATION AND LAYOUT OF ALL THE EQUIPMENT TO BE SUPPLIED SHALL BE REFERRED TO THE CIVIL, MECHANICAL AND ELECTRICAL BID DRAWINGS.
- ALL THE DETAILS OF THE FOLLOWING EQUIPMENT SHALL BE IN ACCORDANCE WITH ALL THE TECHNICAL SPECIFICATIONS INDICATED IN THIS DOCUMENT. NON-COMPLIANCE TO THE REQUIREMENTS SHALL BE GROUNDS FOR DISQUALIFICATION.

LEGEND:

- LCP - LOCAL CONTROL AND PROTECTION PANEL
GCPP - GENERATOR CONTROL AND PROTECTION PANEL
DPM - DIGITAL POWER METER

NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 3 X 150 MW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTULO IS, SALSU, MARBATE	
LOCATION: BRGY. JINTOTULO ISLAND, SALSU MARBATE	
TITLE: SYSTEM CONFIGURATION	
DESIGNED: DRAWN: REVIEWED: CIVIL/ARCHT: ELEC: MECH:	BY: CHKD: DATE: SUBMITTED: RECOMMENDED: APPROVED:
DRG. NO. JInDPP-BDE-17.013	
SPECS. NO. LuzP22Z1435S	
SCALE: N.T.S.	
REFERENCE DRAWING	
REV. 0	

DETAIL - A

DETAIL - B

DETAIL - C

DETAIL - D


DETAIL - E

DETAIL - F

DETAIL - G





DETAIL - H

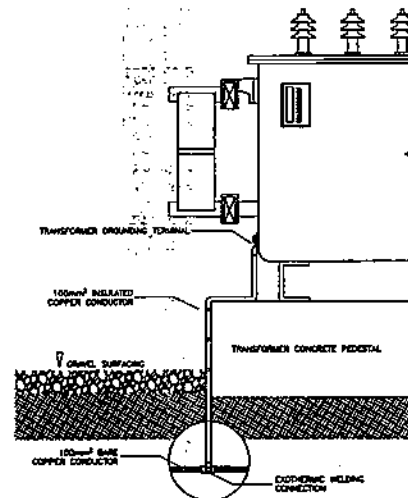DETAIL - I



EQUIPMENT GROUNDING CONNECTION





1. ALL DIMENSIONS INDICATED ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. INSTALLATION OF NEW GROUNDING SYSTEM SHALL BE WORKED WITH EQUIPMENT GROUNDING CONNECTION-1 AND DETAILS OF EXOTHERMIC WELDING CONNECTION.
3. GROUNDING CONDUCTOR SHALL BE EMBEDDED AT LEAST 0.60M.
4. ALL EQUIPMENT GROUNDING SHALL BE CONNECTED TO THE EXISTING GROUNDING MAT.
3. THE SUPPLIER SHALL PROVIDE TWO (2) TERMINALS FOR EQUIPMENT BODY GROUNDING OF ALL MAJOR EQUIPMENT (i.e. DIESEL GENERATOR, GENERATOR CONTROL AND PROTECTION PANEL, GENERATOR TRANSFORMER) AND SHALL BE CONNECTED TO THE EXISTING/NEW GROUNDING MAT USING 100MM² INSULATED COPPER CONDUCTOR AND EXOTHERMIC WELDING PROCESS.
4. CT/PT, AUTOMATIC CIRCUIT RECLOSER, STEEL POLES AND FENCE, EARTHING SHALL BE PROPERLY GROUNDING WITH 50MM² INSULATED COPPER CONDUCTOR.
5. CABLE TRAYS SHALL BE PROPERLY GROUNDING WITH 22MM² INSULATED COPPER CONDUCTOR.
6. IF THERE IS NO EXISTING GROUNDING MAT OR INSTALLATION OF NEW GROUNDING SYSTEM ON THE PLANT SITE, THE SUPPLIER SHALL USE GROUNDING RODS FOR ALL EQUIPMENT GROUNDING AS SHOWN ON EQUIPMENT GROUNDING CONNECTION-2.

OWNER:	 NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY																														
PROJECT:	SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTULO IS, BULLO, MARBATE																														
LOCATION:	BRCY, JINTOTULO ISLAND, BULLO MARBATE																														
TITLE:	GROUNDING SYSTEM CONNECTION DETAILS																														
<table border="1"> <thead> <tr> <th></th> <th>BY</th> <th>CHKD</th> <th>DATE</th> </tr> </thead> <tbody> <tr> <td>DESIGNED</td> <td></td> <td></td> <td></td> </tr> <tr> <td>DRAWN</td> <td></td> <td></td> <td></td> </tr> <tr> <td>REVIEWED</td> <td>PRINCIPAL ENGR. /</td> <td>ARCHT.</td> <td></td> </tr> <tr> <td>CNL/ARCHT.</td> <td></td> <td></td> <td></td> </tr> <tr> <td>ELEC.</td> <td></td> <td></td> <td></td> </tr> <tr> <td>MECH.</td> <td></td> <td></td> <td></td> </tr> </tbody> </table>			BY	CHKD	DATE	DESIGNED				DRAWN				REVIEWED	PRINCIPAL ENGR. /	ARCHT.		CNL/ARCHT.				ELEC.				MECH.				SUBMITTED:  R.P. VERAN Manager, ESD RECOMMENDED:  C. Z. C. LUGOD, JR. Manager, ESD APPROVED:  G. E. MAGPOC, JR. Manager, ESD	
	BY	CHKD	DATE																												
DESIGNED																															
DRAWN																															
REVIEWED	PRINCIPAL ENGR. /	ARCHT.																													
CNL/ARCHT.																															
ELEC.																															
MECH.																															
DWG. NO. JInDPP-BDE-17.015		SPECS. NO. LuzP22214358e																													

				DWG. NO. J1nDPP-BDE-17.015		SPECS. NO. L1uzP22Z1435S8	
REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPD.	SCALE: N.T.S. REFERENCE DRAWING REV. 0


NOTES:

1. ALL DIMENSIONS AS SHOWN ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.

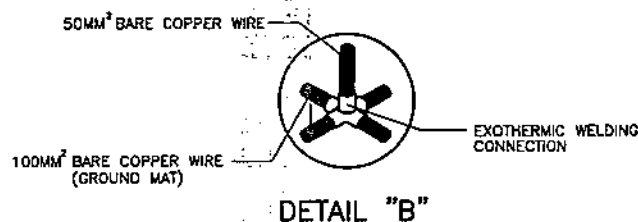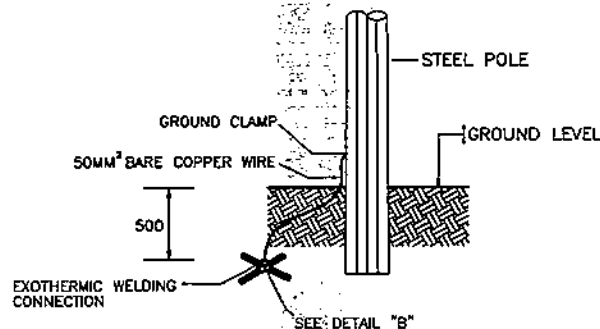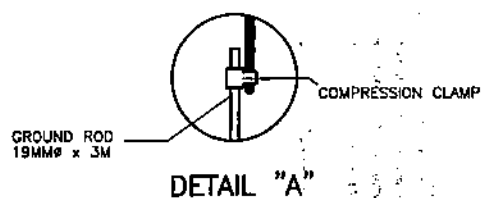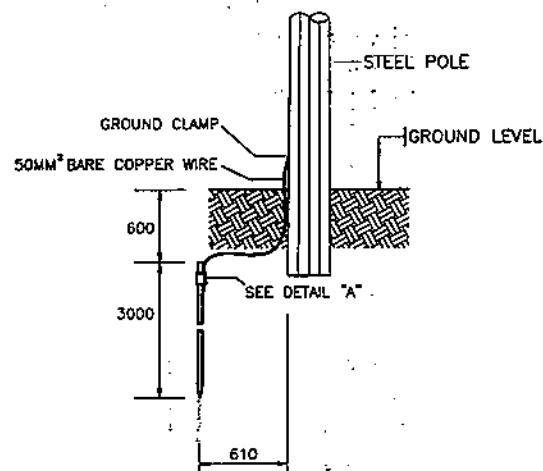


NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KVA MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREA IN JINTOTULO IS. BALUD, SAMPATE	
LOCATION: BRGY. JINTOTULO ISLAND, BALUD SAMPATE	
TITLE: STEEL POLE GROUNDING CONNECTION DETAILS	
DESIGNED: DRAWN: REVISION: CHL/NOTY: ELEC: MECH:	BY: CHD: DATE: SUBMITTED: RECOMMENDED: APPROVED:
Dwg. No. JinDPP-BDE-17.016 Specs. No. LuzP2221435S	
SCALE: N.T.S. REFERENCE DRAWING REV. 0	

REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPD.

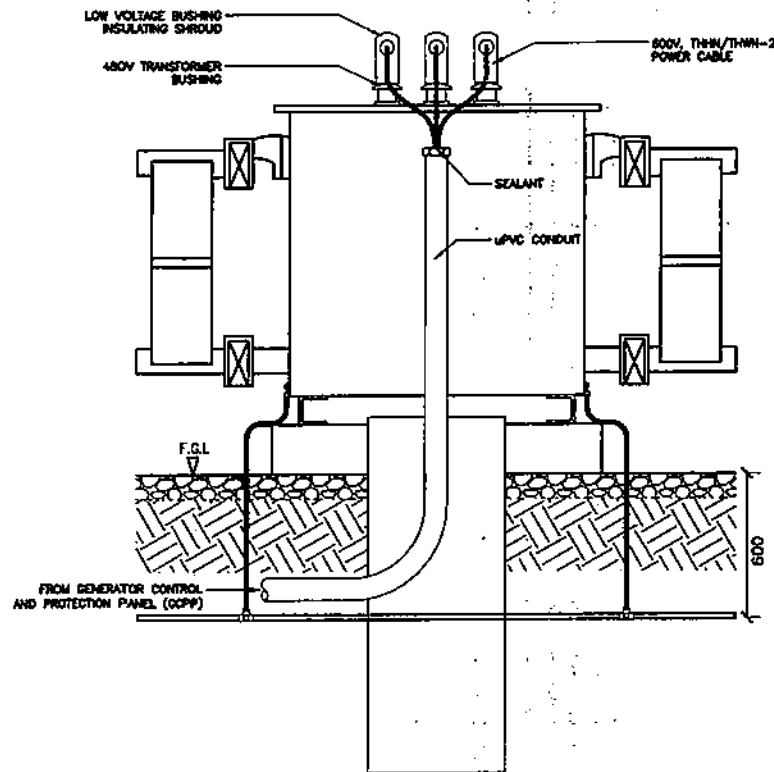


TRANSFORMER LOW VOLTAGE SIDE
CABLE TERMINATION



SCALE

NTS

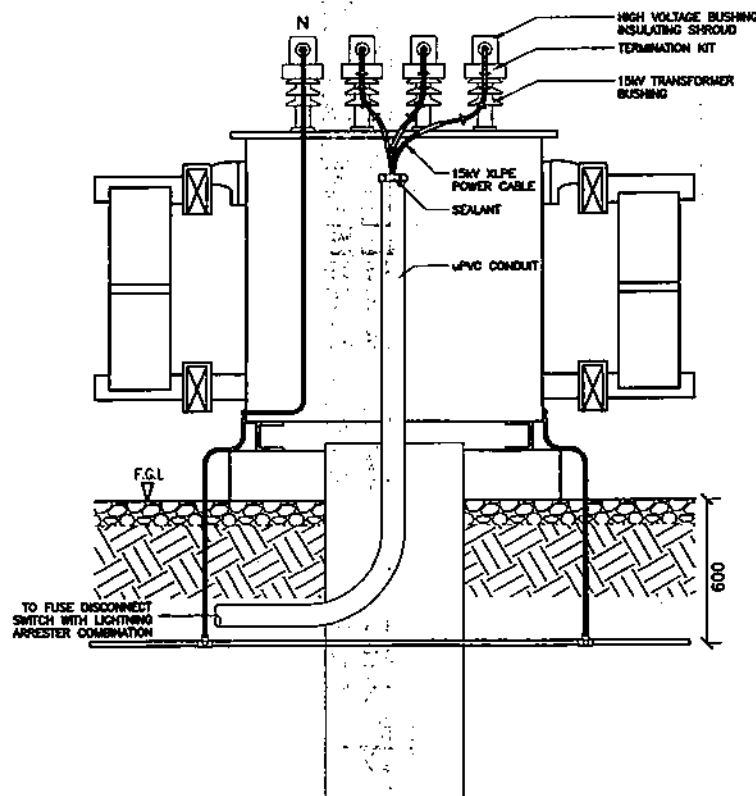

TRANSFORMER HIGH VOLTAGE SIDE
CABLE TERMINATION



SCALE


NTS

NOTES:

1. THE NUMBER OF POWER CABLES PER PHASE FOR THE LOW VOLTAGE (LV) SIDE IS FOR BIDDING PURPOSES ONLY. THE SUPPLIER SHALL VERIFY WHAT IS INDICATED IN THE SINGLE LINE DIAGRAM AND SHALL PROVIDE PROPER CABLE TERMINATION.
2. THE SUPPLIER SHALL PROVIDE TERMINATION KIT FOR THE HIGH VOLTAGE (HV) POWER CABLES AND SHALL DESIGN PROPER TERMINATION FOR THE NEUTRAL CABLE.
3. THE LV AND HV TERMINATIONS SHALL BE PROVIDED WITH SUITABLE INSULATING SHROUD. THE INSULATING SHROUD SHALL BE MANUFACTURED THROUGH DIP MOULDING PROCESS AND SHALL BE MADE FROM FLEXIBLE POLYVINYL CHLORIDE (PVC) MATERIAL, SUITABLE FOR LOW VOLTAGE TO HIGH VOLTAGE APPLICATIONS.
4. THE INSULATING SHROUD SHALL BE FLAME RETARDANT, CONFORMING WITH THE UL 94 STANDARDS AND SHALL BE TYPE TESTED FOR ELECTRIC STRENGTH IN ACCORDANCE WITH IEC 60243-1 OR APPROVED EQUIVALENT STANDARDS.

NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 3 X 15K RM MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTULO II, SALUGU, MARBATA	
LOCATION: BRGY. JINTOTULO II, SALUGU, MARBATA	
TITLE: <p>DETAILS OF TRANSFORMER TERMINATION</p>	
DESIGNED DRAWN REVISION CHL/ARCHT ELEC MECH	BY CHKD DATE SUBMITTED: <i>[Signature]</i> RECOMMENDED: <i>[Signature]</i> APPROVED: <i>[Signature]</i> G. B. MAGPOC, JR. Manager, E&C
DRG. NO. JINOPP-BDE-17.017 SPEC. NO. LuzP2221435S	
SCALE: N.T.S. REFERENCE DRAWING REV. 0	


REV.	DATE	NATURE OF REVISION	BY	CHKD.	RECD.	APPD.

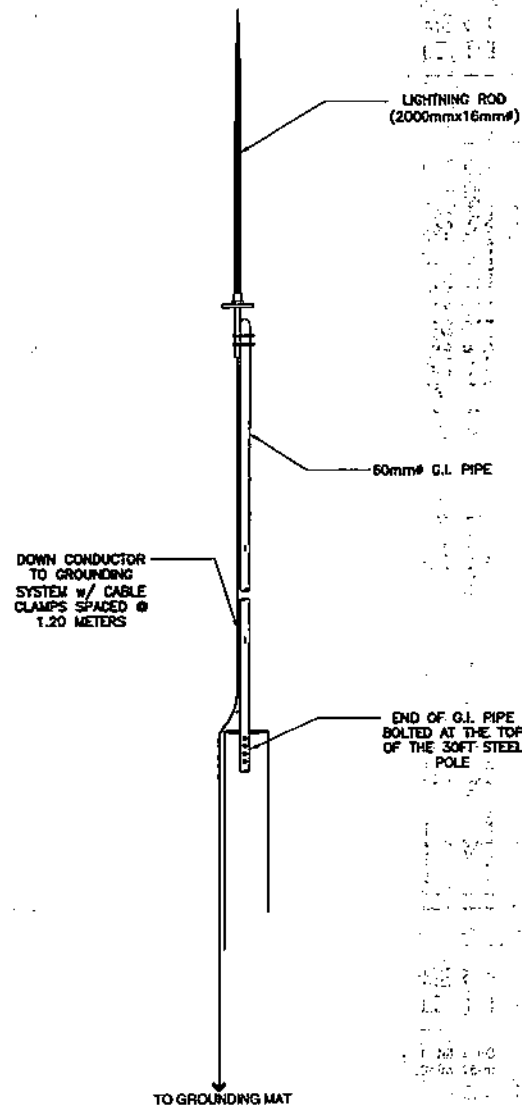


LIGHTNING PROTECTION SYSTEM


NOTES:


1. THE LIGHTNING PROTECTION SYSTEM SHALL BE INSTALLED APPROXIMATELY AS SHOWN ON THE DRAWING.
2. THE DOWN CONDUCTOR SHALL BE CONNECTED TO THE GROUNDING MAT.
3. THE SUPPLIER SHALL SUBMIT SPECIFICATION, FABRICATION AND INSTALLATION DRAWING FOR APPROVAL OF NPC.
4. THE G.I. PIPE SHALL HAVE AN INTERNAL DIAMETER OF 60mm AND SHALL HAVE A MINIMUM LENGTH OF 3.0 M

OWNER:				NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 KVA MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTULO IS, BULU, MARBATE					
LOCATION: BRST, JINTOTULO ISLAND, BULU MARBATE					
TITLE: LIGHTNING PROTECTION SYSTEM					
DESIGNED	BY	CHKD	DATE	SUBMITTED:	<i>[Signature]</i> R. P. VERON Project Engineer A, EED
DRAWN				RECOMMENDED:	<i>[Signature]</i> C. S. LUGBO, JR. Manager, EED
REVIEWED	PRINCIPAL ENGR. / ARCHT.			APPROVED:	<i>[Signature]</i> G. S. MAGPOC, JR. Manager, EED
CNL/ARCHT					
ELEC					
MECH					
Dwg. No. JInOPP-BDE-17.018				Specs. No. LuzP22Z1435Se	
REV.		DATE	NATURE OF REVISION	BY	CHKD. RECD. APPD.
SCALE: N.T.S.				REFERENCE DRAWING	
				REV. 0	

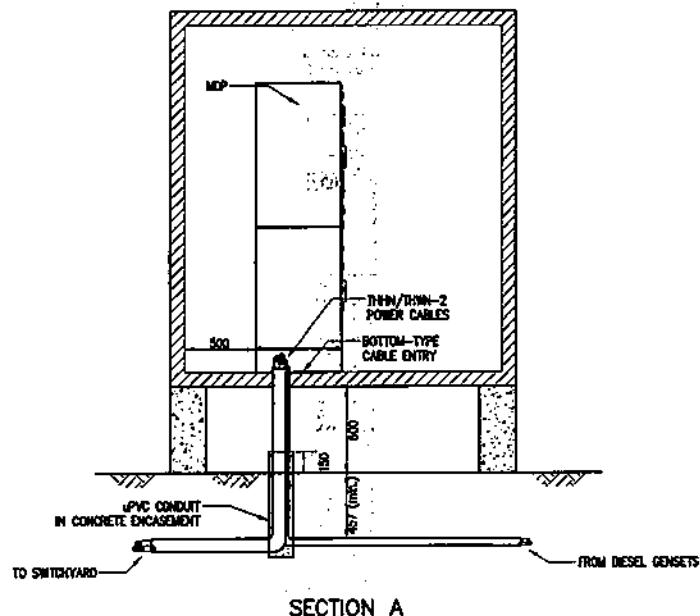


GCPP — GENERATOR CONTROL AND PROTECTION PANEL

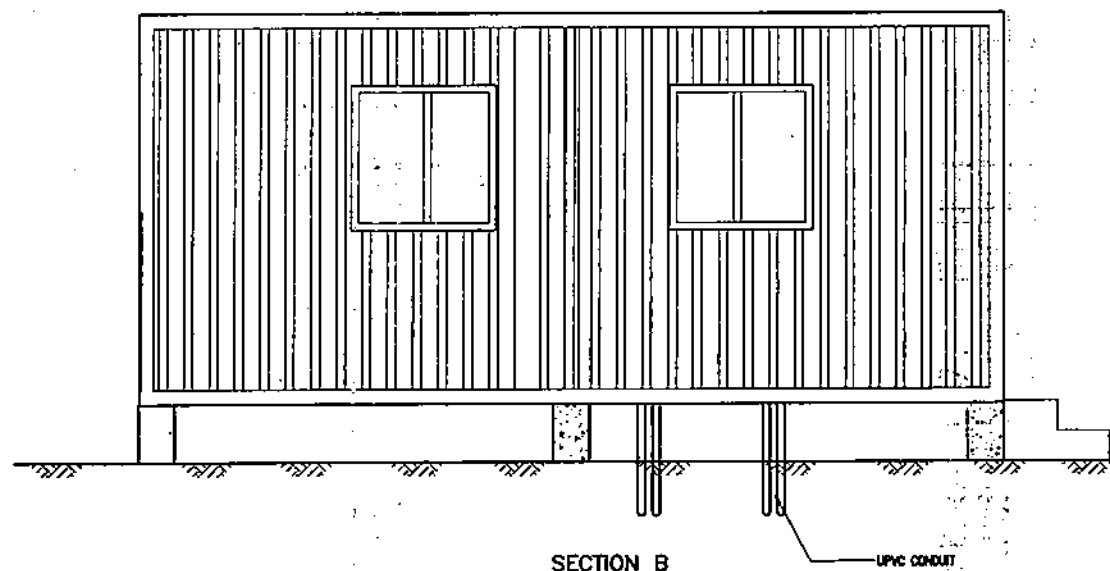

OWNER:		 NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 150 FOR MODULAR DESIGN OPERATING UNIT, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRICIFICATION OF NEW AREAS IN JINTOTOLLO IN, BALUD, MASBATE			
LOCATION:		BRIST. JINTOTOLLO ISLAND, BALUD MASBATE	
TITLE:		DETAILS OF CONTROL HOUSE & CABLE ENTRY	
DESIGNED	BY	CHKD	DATE
DRAWN			
APPROVED	PRINCIPAL ENGR. / ARCHT.		RECOMMENDED: C. C. LUGO, JR. Manager, 11/30/00
CHEK/ARCHT			APPROVED: G. B. MAGPOC, JR. Manager, 1/00
ELEC.			
MECH.			
DWD. NO. JInDPP-BDE-17.019		SPECS. NO. LuzP22Z14356	

1. THE CONTROL FOR AUTOMATIC OPERATION OF SPACE HEATER AS SHOWN IS TENTATIVE AND FOR BIDDING PURPOSES ONLY. ALTERNATIVE SCHEME MAY BE SUGGESTED/RECOMMENDED BY THE SUPPLIER WITH THE SAME AUTOMATIC OPERATION FOR ON AND OFF SCHEME SUBJECT TO NPC REVIEW AND APPROVAL



OWNER:		 NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 2 X 100 MW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN ANTITOLLO IS, SALLU, MABABATE			
LOCATION: BRGY. ANTITOLLO ISLAND, SALLU MABABATE			
TITLE: ALTERNATOR SPACE HEATER CONTROL CIRCUIT			
DESIGNED	BY	CHECKED	DATE
DRAWN			
ENGINEERED	PRINCIPAL DESIG. / ARCHT.		
CALC./ARCHT.			
ELEC.			
MECH.			
SUBMITTED:		R. P. VERAR <i>[Signature]</i> Manager, E&E	
RECOMMENDED:		G. C. LUGOD, JR. <i>[Signature]</i> Manager, E&E	
APPROVED:		G. B. MAGPOC, JR. <i>[Signature]</i> Manager, E&E	
DWG. NO. JIN-DPP-BDE-17.020		SPECDS. NO. LUZP22Z14358	

GENERAL NOTES:

1. THE GENERATOR BEARINGS SHALL BE DESIGNED TO ALLOW MINIMAL STRESS INDUCED IN THE SHAFT. GENERATORS RATED 500KW AND BELOW SHALL HAVE A SINGLE OR DOUBLE BEARING DESIGN.
2. SPACE HEATER SHALL BE INSTALLED ON THE ALTERNATOR FRAME TO MAINTAIN TEMPERATURE OF THE ALTERNATOR ABOVE THE DEW POINT WHILE NOT IN USE. POWER SUPPLY SHALL BE 120/240VAC SINGLE PHASE AND SHALL BE SOURCED FROM THE PLANT AVAILABLE POWER SUPPLY. AUTOMATIC CONTROL AND INDICATING LIGHTS FOR SPACE HEATER SHALL BE INTEGRATED IN THE GENERATOR CONTROL AND PROTECTION PANEL (GCPP). IT SHALL BE FURNISHED COMPLETE WITH ALL NECESSARY RELAYS AND CONTACTORS FOR AUTOMATIC OPERATION.

THE SPACE HEATER SHALL AUTOMATICALLY TURN-ON AT PREDETERMINED TIME DELAY WHEN THE GENERATOR IS SHUTDOWN TO AVOID UNNECESSARY OPERATION WHEN THE ALTERNATOR IS STILL HOT. LIKEWISE, A RELAY SHALL BE PROVIDED AS MEANS TO AUTOMATICALLY TURN-OFF THE SPACE HEATER OPERATION WHEN THE GENERATOR STARTS RUNNING.

A MANUALLY 2-POLE OPERATED CIRCUIT BREAKER SHALL BE PROVIDED TO OPEN AND CLOSE BOTH SIDES OF THE CIRCUIT FOR MAINTENANCE PURPOSE.

3. TEMPERATURE DETECTORS SHALL BE PROVIDED IN THE STATOR SLOTS AND AT THE END OF THE VENTILATING DUCTS ARRANGED TO RECEIVE HEAT FROM THE HOTTEST SPOT OF THE WINDINGS WITH APPROPRIATE CONTACTS FOR MONITORING, ALARM, DETECTION AND PROTECTION OF THE WINDINGS PROVIDED AT THE GCPP. AT CERTAIN PRE-SET TEMPERATURE (ALARM SETTING), THE TEMPERATURE DETECTOR WILL TRIGGER AN ALARM SO THAT AN ADJUSTMENT OR ACTION BEFORE ANY INSULATION DAMAGE OCCURS MAY BE DONE. THE CIRCUIT BREAKER FOR THE ALTERNATOR WILL AUTOMATICALLY TRIP IN THE EVENT THAT THE TEMPERATURE DETECTORS MEASURE THE WINDING TEMPERATURE TO BE ABOVE THE (SHUTDOWN SETTING) VALUE.

4. ALL WORKS TO BE DONE AND EQUIPMENT TO BE SUPPLIED SHALL BE IN COMPLIANT TO THE LATEST PROVISIONS OF THE FOLLOWING STANDARDS:


- a. ANSI/IEEE - AMERICAN NATIONAL STANDARDS INSTITUTE AND/OR INSTITUTE OF ELECTRICAL & ELECTRONIC ENGINEERS
- b. NEMA - NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
- MG - STANDARD FOR MOTORS AND GENERATORS
- WC-5 - THERMOPLASTIC-INSULATED WIRE AND CABLE FOR THE TRANSMISSION AND DISTRIBUTION OF ELECTRICAL ENERGY
- AB 1 - MOLDED CASE CIRCUIT BREAKER
- ICS2 - INDUSTRIAL CONTROLS AND SYSTEMS: CONTROLLERS, CONTACTORS AND OVERLOAD RELAYS RATED 600 VOLTS
- ICS - GENERAL STANDARDS FOR INDUSTRIAL CONTROL AND SYSTEMS
- MG-1 - MOTORS AND GENERATORS
- MG-2 - SAFETY STANDARD FOR CONSTRUCTION & GUIDE FOR SELECTION, INSTALLATION AND USE OF ELECTRIC MOTORS AND GENERATORS
- c. UL - UNDERWRITERS LABORATORIES, INC. (ALL PARTS APPLY)
- 44 - RUBBER-INSULATED WIRES AND CABLES
- 83 - THERMOPLASTIC INSULATED WIRES AND CABLES
- 508A - INDUSTRIAL CONTROL EQUIPMENT
- 1063 - MACHINE TOOL WIRE (MTW) FOR STRANDED CONDUCTOR ONLY

- d. IEC - INTERNATIONAL ELECTRO-TECHNICAL COMMISSION
- 60255 - ELECTRICAL RELAYS
- 60044 - INSTRUMENT TRANSFORMER
- 60071 - INSULATION COORDINATION
- 60076 - POWER TRANSFORMERS, PARTS 1-2
- 60060 - HIGH VOLTAGE TEST TECHNIQUE
- 61439 - LOW VOLTAGE SWITCHGEAR AND CONTROLGEAR ASSEMBLIES
- 60502 - POWER CABLES WITH EXTRUDED INSULATION AND THEIR ACCESSORIES FOR RATED VOLTAGES PARTS 1 & 2
- e. NFPA - NATIONAL FIRE PROTECTION ASSOCIATION
- 272 - STANDARD METHOD OF TEST FOR FIRE AND SMOKE CHARACTERISTICS OF WIRES AND CABLES
- f. ASTM - AMERICAN SOCIETY FOR TESTING AND MATERIALS
- g. ISO - INTERNATIONAL STANDARDS ORGANIZATION
- 9001 - QUALITY SYSTEM MODEL FOR QUALITY ASSURANCE IN DESIGN/DEVELOPMENT, MANUFACTURE AND TESTING
- 9002 - QUALITY SYSTEM MODEL FOR QUALITY ASSURANCE IN PRODUCTION, INSTALLATION & SERVICING
- h. PEC - PHILIPPINE ELECTRICAL CODE

5. THE SUPPLIER'S EQUIPMENT TO BE SUPPLIED SHALL BE SUBJECT TO ALL TESTS AND INSPECTION TO ENSURE THE SATISFACTORY PERFORMANCE OF ALL THE EQUIPMENT. ALL THE TESTS AND INSPECTION SHALL BE DONE WITH NO ADDITIONAL COST TO NPC AND SHALL BE COMPLIANT TO THE REQUIREMENTS OF THIS TENDER.

- a. EW-4.14 - INSPECTION AND TESTING FOR AC GENERATORS
- b. EW-5.8 - TESTS TO BE PERFORMED FOR POWER TRANSFORMERS
- c. EW-10.0 - FACTORY ASSEMBLY AND TESTS

6. NON-COMPLIANCE TO THE REQUIREMENTS STATED IN THIS TENDER SHALL BE GROUNDS FOR DISQUALIFICATION.

OWNER:				NATIONAL POWER CORPORATION AGHAM ROAD, DILIMAN QUEZON CITY	
PROJECT: SUPPLY, DELIVERY, INSTALLATION, TEST AND COMMISSIONING OF 3 X 150 KW MODULAR DIESEL GENERATING SETS, ASSOCIATED ELECTRICAL EQUIPMENT AND BALANCE OF PLANT FOR THE ELECTRIFICATION OF NEW AREAS IN JINTOTULO IS, SALSOD, MARIKINA					
LOCATION: BRGY. JINTOTULO ISLAND, SALSOD MARIKINA					
TITLE: GENERAL NOTES					
DESIGNED	BY	CHKD	DATE	SUBMITTED:	<i>[Signature]</i> R.P. VERAR
DRAWN				RECOMMENDED:	<i>[Signature]</i> L. C. LUGOD, JR.
REVIEWED	PRINCIPAL ENGR. / ARCHT.			APPROVED:	<i>[Signature]</i> O. S. MAGPOC, JR.
CHKD/ARCHT					
ELEC.					
MECH.					
Dwg. No. JmDPP-BDE-17.021				SPECS. No. LuzP22214355a	
REV. DATE		NATURE OF REVISION		BY CHKD. RECD. APPD.	
				SCALE: N.T.S.	
				REFERENCE DRAWING	
				REV. 0	